

APPENDIX A – CATALOGUE MATERIAL DATA SHEETS

CATALOGUE INDEX

Introduction	A.i
1.0 Window Wall	A1.i
2.0 Conventional Curtain Wall	A2.i
3.0 Unitized Curtain Wall	A3.i
4.0 High Performance Curtain Wall	A4.i
5.0 Steel Frame Construction	A5.i
6.0 Concrete Construction	A6.i
7.0 Wood Frame Construction	A7.i
8.0 Doors and Balconies	A8.i
9.0 Roofs	A9.i

Introduction

Introduction

Appendix A contains the catalogue of material data information sheets for all the details available for this guide. The purpose is to provide this information such that designers will be able to easily reference their project details to a modeled detail within the catalogue or to be able to make estimations based on the information provided. The catalogue is divided into 9 sections, based on construction type:

Catalogue Index	
1.	Window Wall
2.	Conventional Curtain Wall
3.	Unitized Curtain Wall
4.	High Performance Curtain Wall
5.	Steel Framed Walls
6.	Mass Walls
7.	Wood Frame Construction
8.	Balconies and Doors
9.	Roofs

Within each section contains a variety of clear field and interface details. The catalogue contains details modeled by Morrison Hershfield Ltd for this guide, along with previous modeling, including ASHRAE 1365-RP and other proprietary systems.

Each material data sheet is meant to be standalone and contains all the information needed for that particular detail. For instance, Detail 5.2.5 is a balcony slab detail for a steel stud assembly. That data sheet contains the material information for both the slab detail, and the clear field steel stud assembly above and below it. The clear field steel stud assembly material data sheet 5.1.7 is not additionally required to analyze the slab detail.

It should be noted that, as they are standalone, there are not necessarily a matching clear field data sheet for every detail. Additionally, some assemblies shown in the data sheets contain more than one interface detail, so while they are arranged by major detail type (slab, then parapet etc), there may be other interface details contained within it. The thermal results information in each results data sheet in Appendix B is given for all interface details contained within a single assembly detail.

Air Films and Contact Resistances

In thermal modeling, beyond the assembly material properties, assemblies are also affected by air films and contact resistances. From ASHRAE 1365-RP, the modeling was extensively calibrated with air films and contact resistances and is shown below in Tables A.1 and A.2. More information on assumptions and other modeling parameters can be found in Section 5 of ASHRAE 1365-RP.

Table A.1. Air film resistances

Location	Description of Condition	Heat Transfer Coefficient Btu/h·ft ² ·°F (W/m ² ·K)
Exterior wall surface with generic cladding	Heat transfer coefficient to account for vented air space and cladding; surface is not directly exposed to wind	1.5 (8.3)
Exterior brick veneer and Precast Concrete surface	Surface exposed to 15 mph (24 km/h) wind	6.0 (34)
Exterior roof surface	Horizontal roof surface exposed to 15 mph (24 km/h) wind	6.0 (34)
Interior wall surface	Vertical surface exposed to indoor air and surfaces	1.5 (8.3)
Interior ceiling surface	Horizontal surface exposed to indoor air and surfaces with upward heat flow	1.6 (9.3)
Interior floor surface	Horizontal surface exposed to indoor air and surface with downward heat flow	1.1 (6.1)

Table A.2. Contact resistances

Location	Contact Resistance hr·ft ² ·°F /Btu (m ² °C/W)
Steel flanges at sheathing interfaces	0.17 (0.030)
Insulation interfaces	0.057 (0.010)
Steel to concrete interfaces	0.057 (0.010)
Steel to steel interfaces	0.011 (0.0020)

Material Data Sheets

Each material data sheet contains several pieces of information. An example material data sheet is shown below with a description for each section following.

Building Envelope Thermal Bridging Guide

1 Detail 1.1.1 Window Wall System – Steel Stud Cavity Insulation

2 Panel Clear Wall with No Interior Mullion Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m·K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² ·K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg·K)	
1	Interior Films (right side) ¹	-	-	R-0.6 (0.12 RSI) to R-1.1 (0.20 RSI)	-	-	
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)	
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)	
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)	
5	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)	
6	1 5/8" x 1 5/8" Steel Stud with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)	
7	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame ²						
8	Backpan Insulation	Varies	-	R-8.4 (1.48 RSI) to R-16.8 (2.96 RSI)	4 (64)	0.20 (850)	
9	Aluminum Window Wall Vision System: thermally broken frame, double glazed IGU U _{IGU} =0.31 BTU/hr·ft ² ·°F (1.77 W/m ² ·K) ²						
10	Exterior Film (left side) ³	-	-	R-0.2 (0.03 RSI)	-	-	

¹ U_{film} from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation
² Conductivity of air spaces within framing was found using ISO 100077-2

A. 1.1

1) Detail Name

Each detail is named based on position within the catalogue index. The first number 1.x.x indicates the construction type according to the main index (ie 1 is Window-Wall, 5 is Steel Framed, 7 is Wood Framed etc). The second number x.1.x indicates detail group (ie. 1 is clear field values, 2 may be all slabs and 3 may be all parapets). The last number x.x.1. is simply the order in which the detail appears within that grouping (ie slab detail 1, slab detail 2 etc).

2) Detail Description

Each material data sheet has a basic description that denotes the construction system or type, along with additional detail identifiers such as limited dimension information, transmittance type and insulation locations

3) Detail Image

An isometric image of each detail is provided that includes cut away sections to view interior portions of the assembly. The images include dimensional information on the modeled assembly, along with ID numbers of key components. Each image is shown from the exterior side.

4) Close Up Image

Some material data sheets also contain close up images for further information on key components in an assembly. These callouts are usually from the same angle as the full assembly, however when an interior feature cannot be seen from that angle, the close up image may indicate it is from an interior view.

5) Material Information

For each component ID number given in the Detail Image, the material data sheets contain a description, thickness, thermal conductivity, nominal resistance (if applicable), material density and specific heat. For full systems that may contain multiple parts, such as window wall, a general description is given. Material properties were taken from standard tabulated values (typically measured at 24°C or 75°F).

6) Additional References

References for the conductivity of air spaces and other information are provided underneath the material tables.

7) PDF Version

With the PDF version of the catalogue, each entry in the catalogue index is linked to each construction section. Within each section, there is an additional index for the details, which are also linked directly to each detail data sheet. To return to the index, simply click on the Building Envelope Thermal Bridging Guide header.

1.0 Window Wall

Detail 1.1.1	A.1.1
Window Wall System – Spandrel Panel Clear Wall with No Interior Stud Cavity Insulation	
Detail 1.1.2	A.1.2
Window Wall System – Spandrel Panel Clear Wall with Interior Spray Foam Insulation	
Detail 1.2.1	A.1.3
Window Wall System – Intermediate Floor Intersection with Spandrel Bypass and no Interior Stud Cavity Insulation	
Detail 1.2.2	A.1.4
Window Wall System – Intermediate Floor Intersection with Spandrel Bypass and Interior Spray Foam Insulation	
Detail 1.2.3	A.1.5
Window Wall System with 3' x 3' Spandrel Section – AIM Applications at Intermediate Floor Intersection	
Detail 1.2.4	A.1.6
Window Wall System – Triple Glazed Insulated Frame at Slab Intersection with Improved Spandrel Bypass & No Interior Stud Cavity Insulation	
Detail 1.2.5	A.1.7
Window Wall System – Full Height Spandrel at Slab Intersection with Spandrel Bypass & No Interior Stud Cavity Insulation	
Detail 1.2.6	A.1.8
Window Wall System – Full Height Spandrel at Slab Intersection with Spandrel Bypass & Interior Spray Foam Insulation	
Detail 1.2.7	A.1.9
Window Wall System – Full Height Insulated Frame at Slab Intersection with Improved Spandrel Bypass & No Interior Stud Cavity Insulation	
Detail 1.2.8	A.1.10
Window Wall System – Full Height Insulated Frame at Slab Intersection with Hybridized Clipped Spandrel & No Interior Stud Cavity Insulation	
Detail 1.3.1	A.1.11
Window Wall System – Uninsulated Concrete Parapet & Roof Intersection	
Detail 1.3.2	A.1.12
Window Wall System – Partially Insulated Concrete Parapet & Roof Intersection	
Detail 1.4.1	A.1.13
Window Wall System – Inside Corner with Spandrel to Vision Transition & No Interior Stud Cavity Insulation	
Detail 1.4.2	A.1.14

Window Wall System – Inside Corner with Spandrel to Vision Transition & Interior
Spray Foam Insulation

Detail 1.5.1 **A.1.15**



Window Wall System with Insulated Spandrel Panel – Uninsulated Interior
Concrete Wall and Intermediate Floor Intersection

Detail 1.5.2 **A.1.16**

Window Wall System with Insulated Spandrel Panel – Insulated Interior Concrete
Wall and Intermediate Floor Intersection

Detail 1.1.1

Window Wall System – Spandrel Panel Clear Wall with No Interior Stud Cavity Insulation

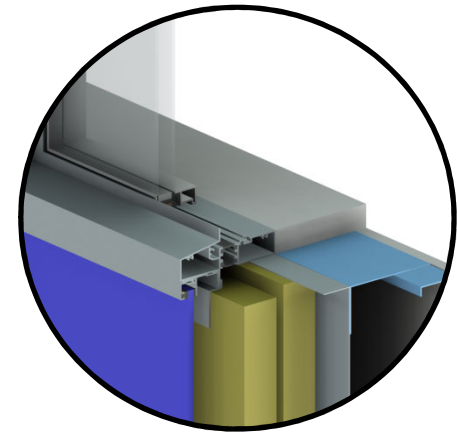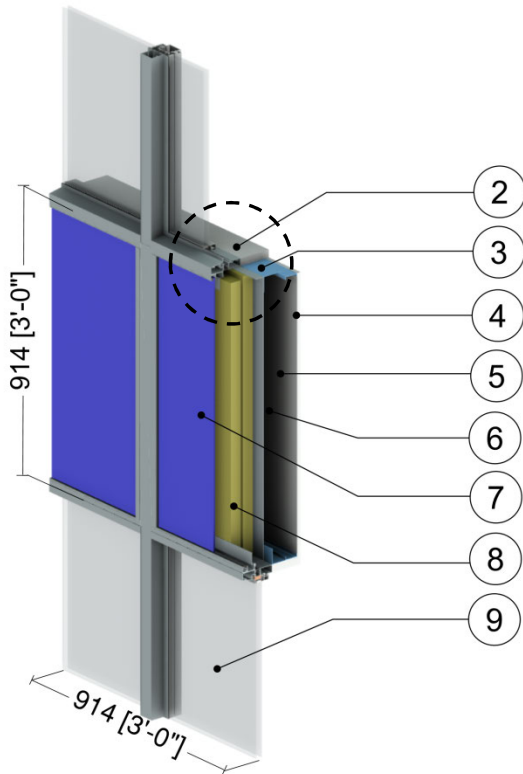



Mullion Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.1.2 | Window Wall System – Spandrel Panel Clear Wall with Interior Spray Foam Insulation

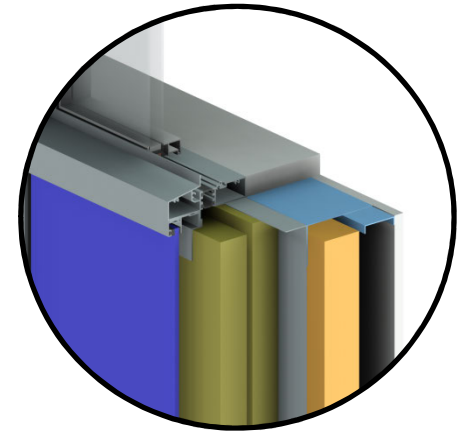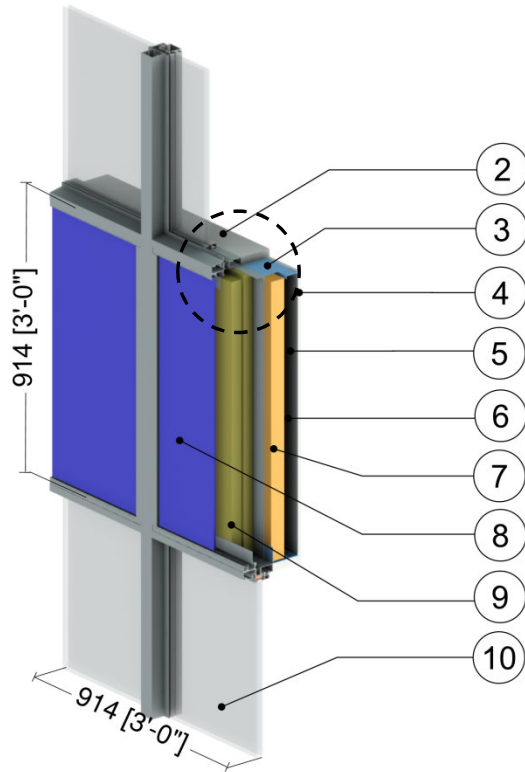

Mullion Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Metal Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Continuous Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12 (2.11 RSI)	2.8 (39)	0.35 (1470)
8	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
9	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 10077-2

Detail 1.2.1

Window Wall System – Intermediate Floor Intersection with Spandrel Bypass and no Interior Stud Cavity Insulation

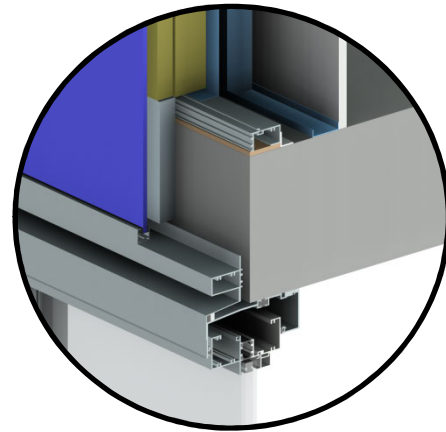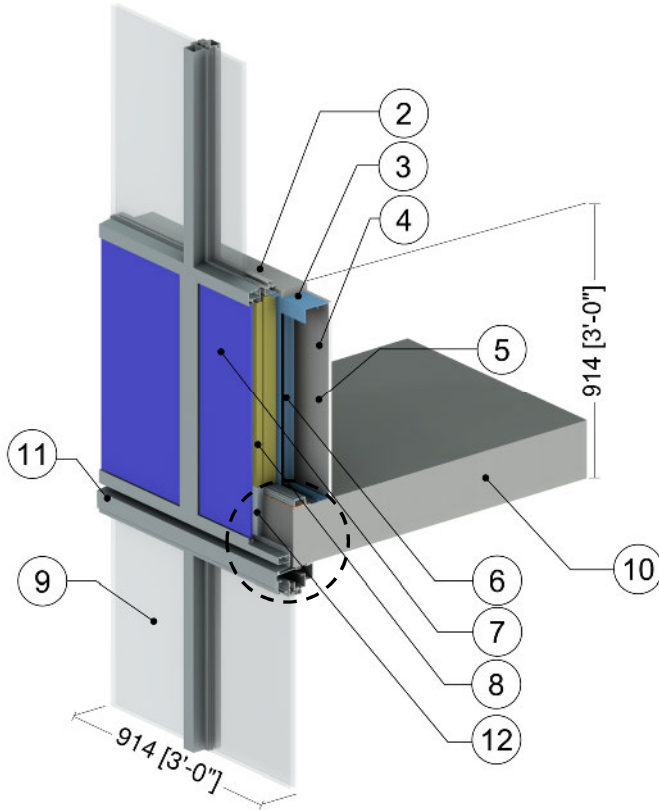



Bypass Detail with Deflection Header and 1/2" (12mm) Air Gap Behind Horizontal Mullion

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.2 | Window Wall System – Intermediate Floor Intersection with Spandrel Bypass and Interior Spray Foam Insulation

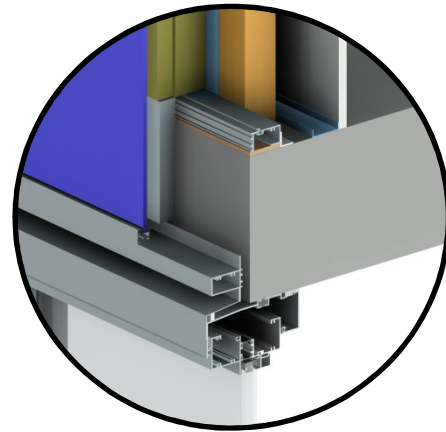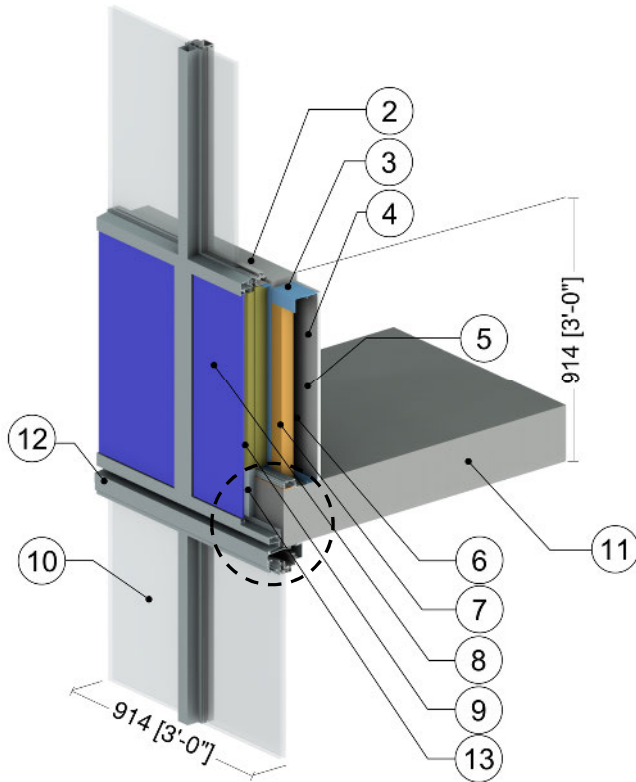

Bypass Detail with Deflection Header and 1/2" (12mm) Air Gap Behind Horizontal Mullion



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Continuous Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12 (2.11 RSI)	2.8 (39)	0.35 (1470)
8	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
9	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.3

Window Wall System with 3' x 3' Spandrel Section – AIM Applications at Intermediate Floor Intersection

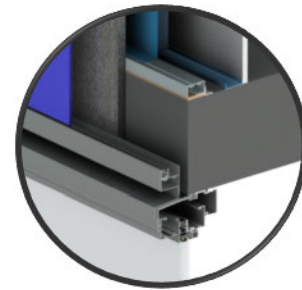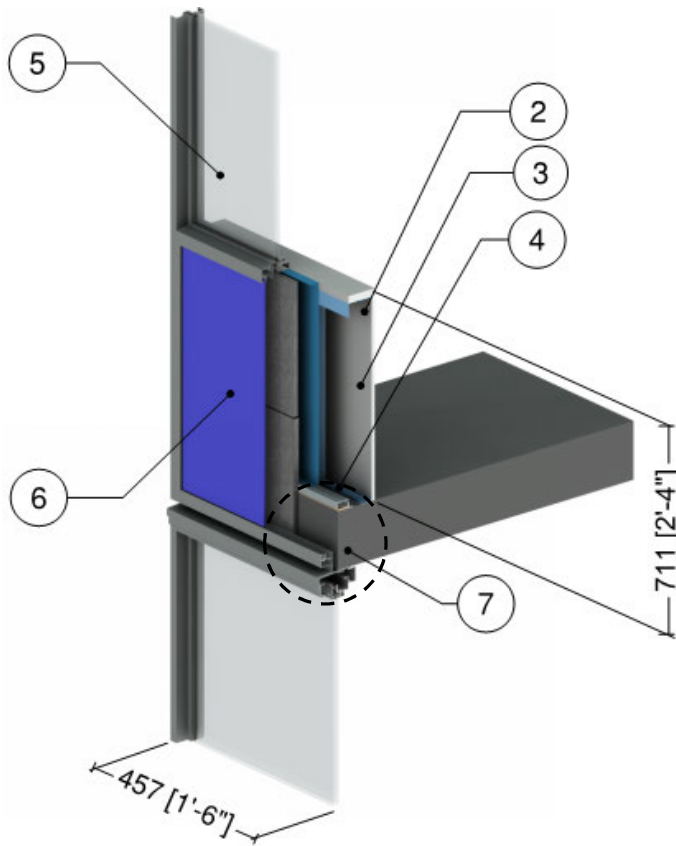

G1 – 3/4" (19 mm) AIM adhered to Frame without Backpan Insulation



G2 – 3/4" (19 mm) AIM adhered to Frame with 2" (51 mm) Backpan Insulation

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Window Wall Vision Section: double glazed IGU with silicone warm edge spacer ²					
6	Aluminum Window Wall Spandrel Section with varied insulation (see G1 to G2 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 40%


AIM = Architectural Insulation Module

Detail 1.2.4

Window Wall System – Triple Glazed Insulated Frame at Slab Intersection with Improved Spandrel Bypass & No Interior Stud Cavity Insulation

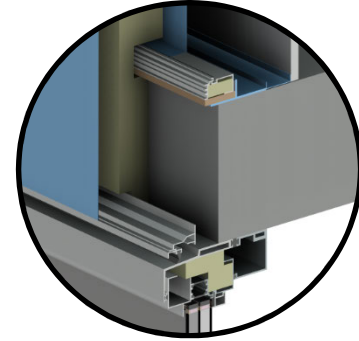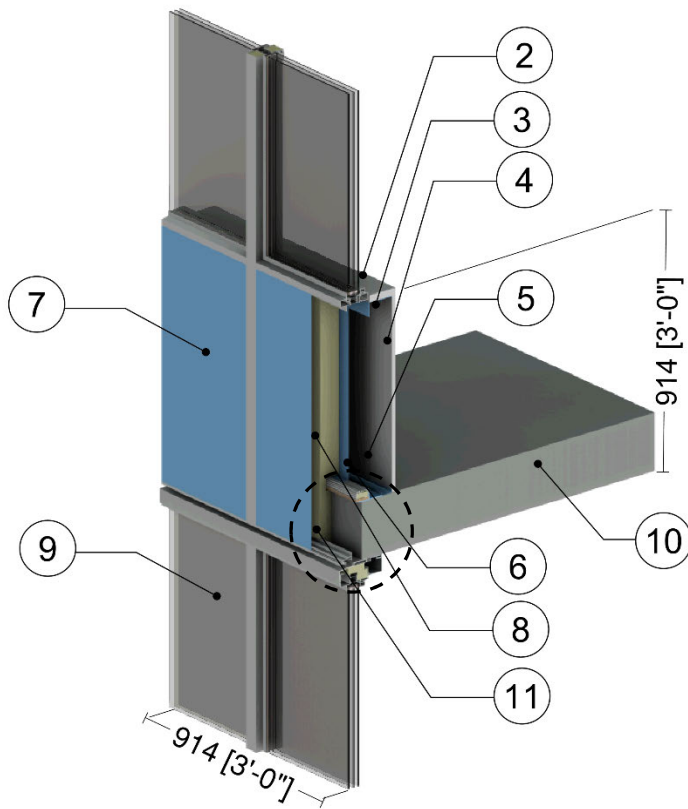

A. Improved Bypass with 1" (25mm) insulation behind horizontal mullion, *Standard* Deflection Header Thermal Break Placement

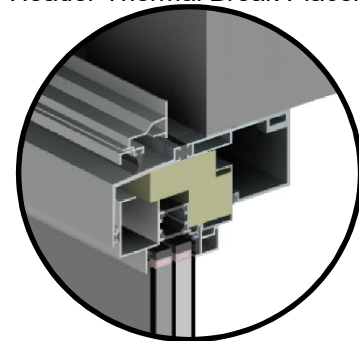

B. Improved Bypass with 1" (25mm) insulation behind horizontal mullion, and Deflection Header Thermal Break in line with Bypass Insulation



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame with insulation within mullions, additional bypass insulation and two deflection header thermal break scenarios, A) Standard, B) Inline with Slab Insulation ²					
8	Backpan Insulation	3" (76)	0.24 (0.034)	R-12.6 (2.22 RSI)	4 (64)	0.20 (850)
9	Aluminum Window Wall Vision System: thermally broken frame ² , triple glazed IGU U _{COG} = 0.14 BTU/hr·ft ² ·°F (0.81 W/m ² K)					
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Bypass Insulation	2" (51)	0.24 (0.034)	R-8.4 (1.48 RSI)	4 (64)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.5

Window Wall System – Full Height Spandrel at Slab Intersection with Spandrel Bypass & No Interior Stud Cavity Insulation

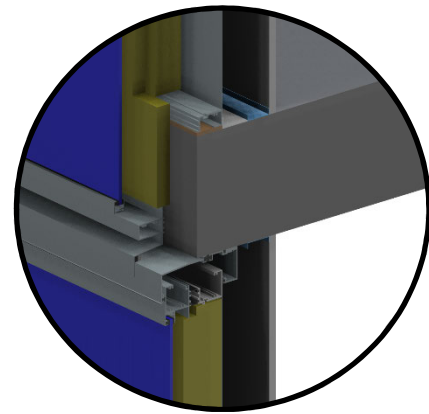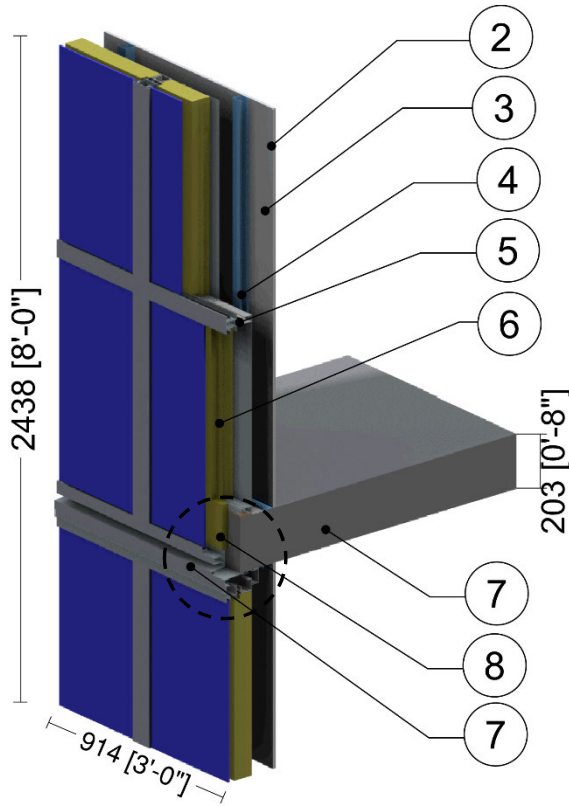

Bypass Detail with Deflection Header and 1/2" (12mm) Air Gap Behind Horizontal Mullion



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
6	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
9	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.6

Window Wall System – Full Height Spandrel at Slab Intersection with Spandrel Bypass & Interior Spray Foam Insulation

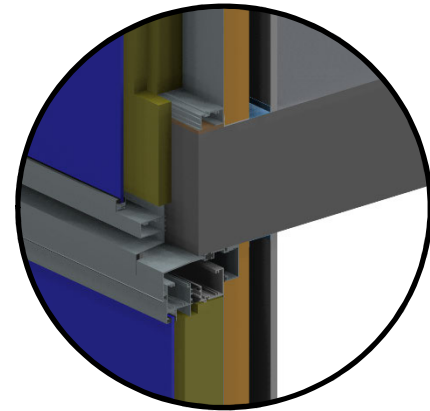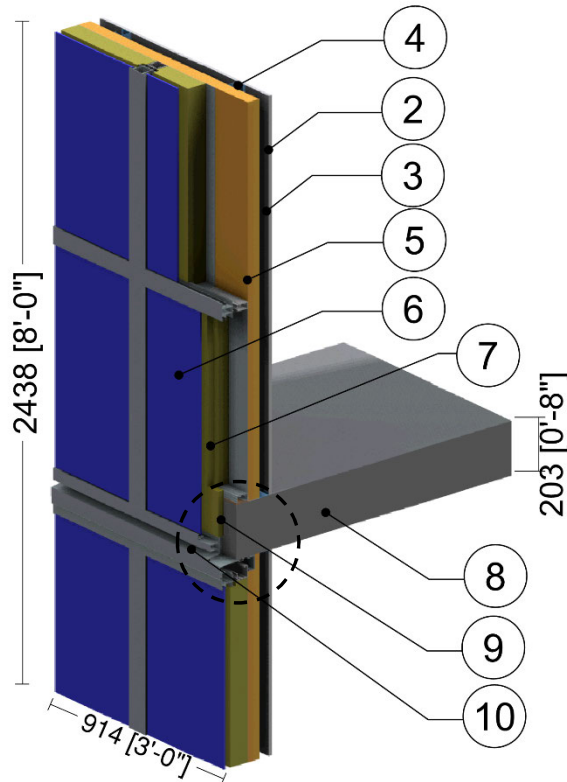

Bypass Detail with Deflection Header and 1/2" (12mm) Air Gap Behind Horizontal Mullion



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Continuous Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12 (2.11 RSI)	2.8 (39)	0.35 (1470)
6	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
10	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.7

Window Wall System – Full Height Insulated Frame at Slab Intersection with Improved Spandrel Bypass & No Interior Stud Cavity Insulation

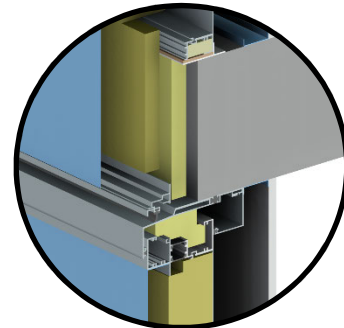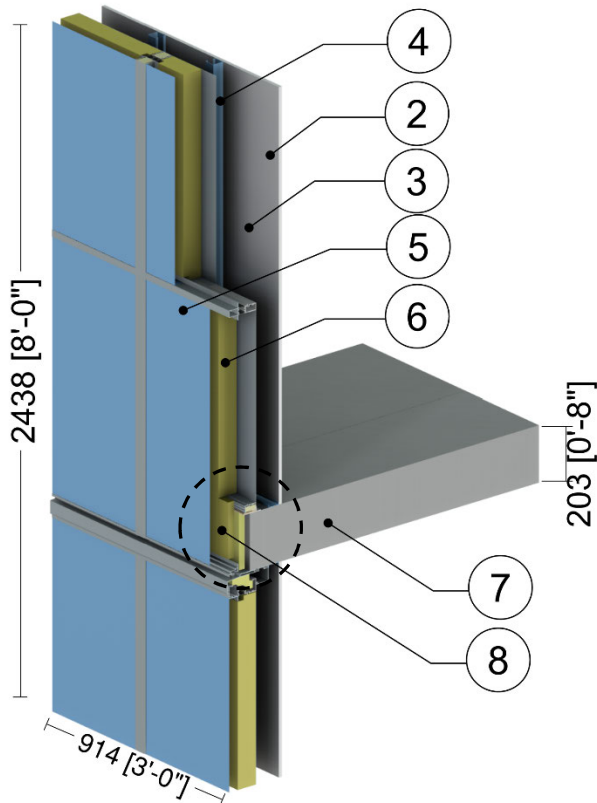

A. Improved Bypass with 1" (25mm) insulation behind horizontal mullion, *Standard* Deflection Header Thermal Break Placement

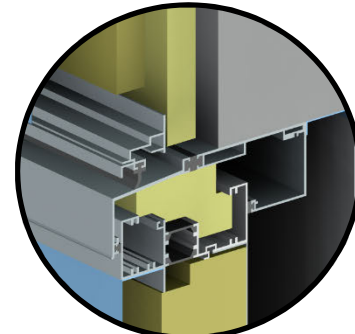

B. Improved Bypass with 1" (25mm) insulation behind horizontal mullion, and Deflection Header Thermal Break in line with Bypass Insulation



ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame with insulation within mullions, additional bypass insulation and two deflection header thermal break scenarios, A) Standard, B) Inline with Slab Insulation ²					
6	Backpan Insulation	3" (76)	0.24 (0.034)	R-12.6 (2.22 RSI)	4 (64)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Bypass Insulation	2" (51)	0.24 (0.034)	R-8.4 (1.48 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.2.8

Window Wall System – Full Height Insulated Frame at Slab Intersection with Hybridized Clipped Spandrel & No Interior Stud Cavity Insulation

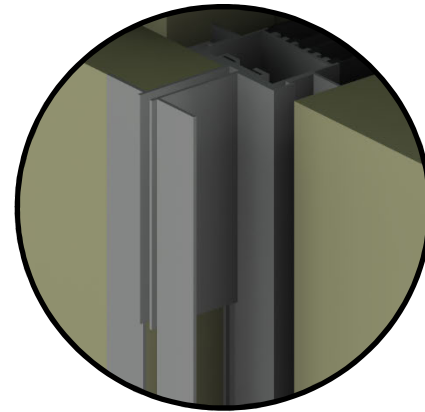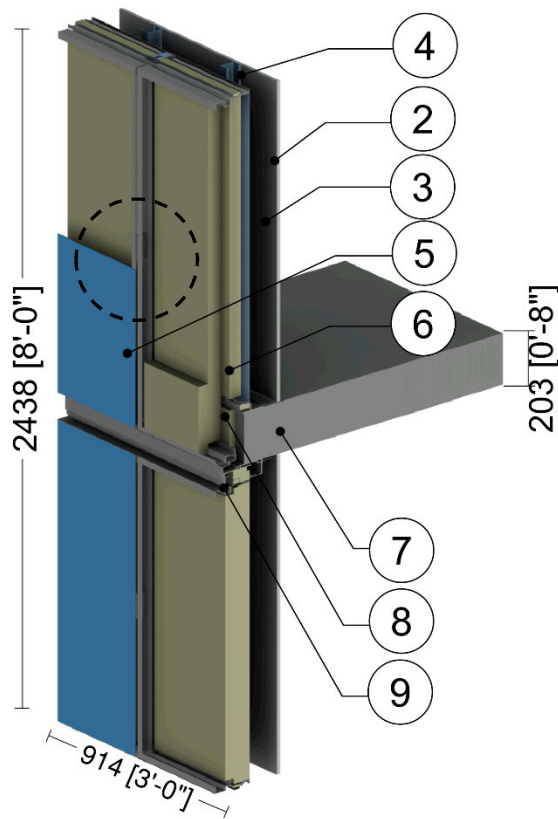



Spandrel Clip and Insulation outboard of vertical mullions

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame with hybrid clip system on mullions holding up metal panel, allowing for extended amounts of insulation in the backpan and 1" of insulation in front of the mullions ²					
6	Backpan Insulation	5.5" (140)	0.24 (0.034)	R-23.1 (4.07 RSI)	4 (64)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Bypass Insulation	5.25" (133)	0.24 (0.034)	R-22.1 (3.88 RSI)	4 (64)	0.20 (850)
9	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.3.1 | Window Wall System – Uninsulated Concrete Parapet & Roof Intersection

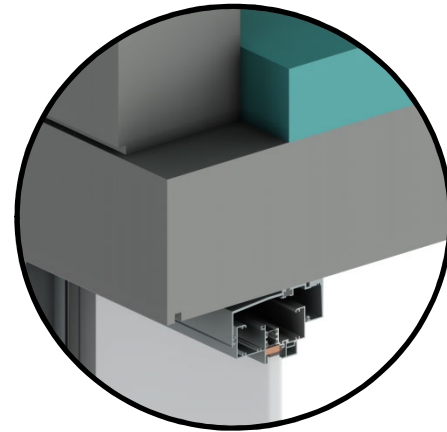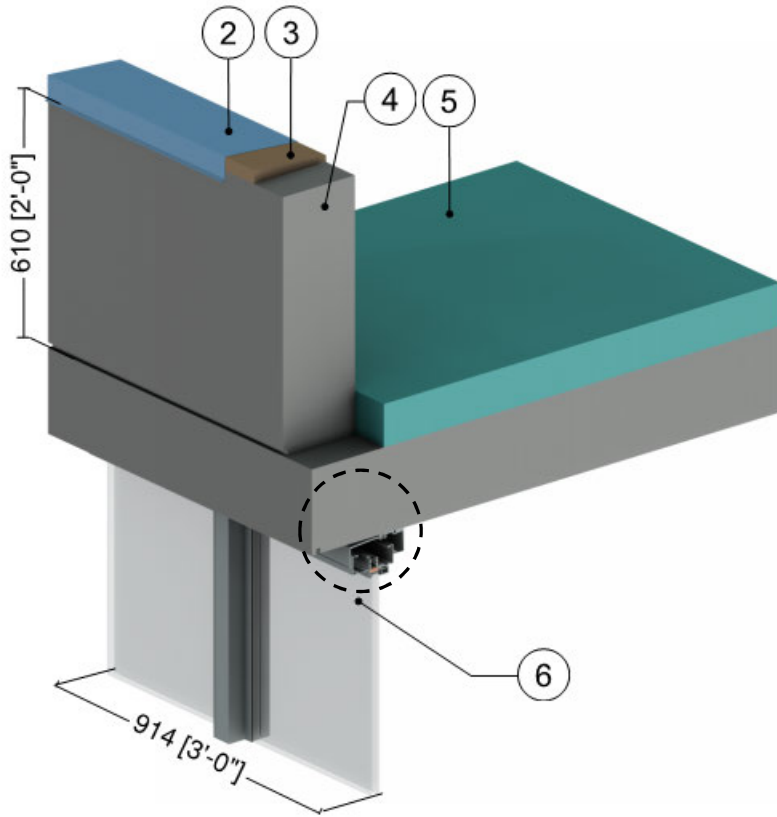



Parapet Intersection Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Parapet Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
3	Wood Blocking	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
4	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
5	Roof Insulation	4" (102)	0.20 (0.029)	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
6	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{COG} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
7	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.3.2 Window Wall System – Partially Insulated Concrete Parapet & Roof Intersection

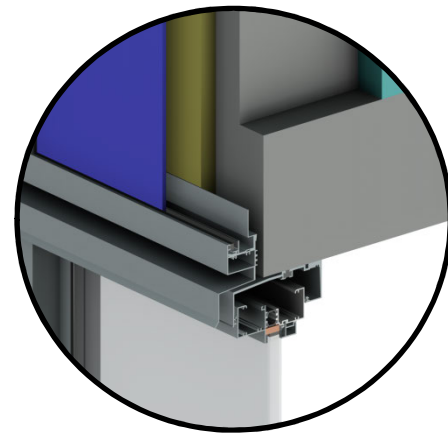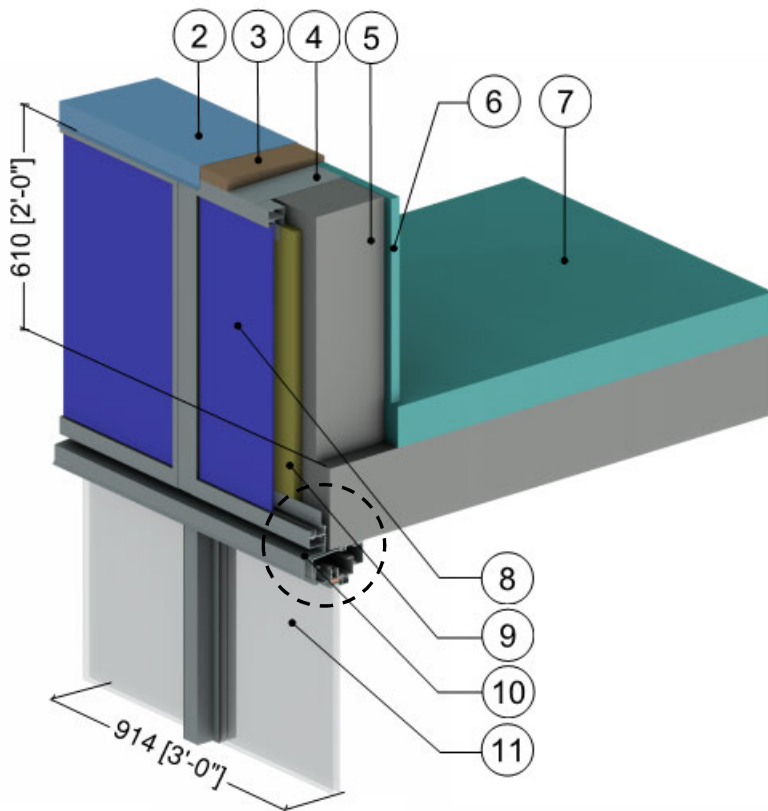

Parapet Intersection Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Parapet Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
3	Wood Blocking	1 1/4" (30)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
4	Steel Connector Plate	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Parapet Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
7	Roof Insulation	4" (102)	0.20 (0.029)	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
8	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
9	Window Wall Mineral Wool Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
11	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{COG} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.4.1

Window Wall System – Inside Corner with Spandrel to Vision Transition & No Interior Stud Cavity Insulation

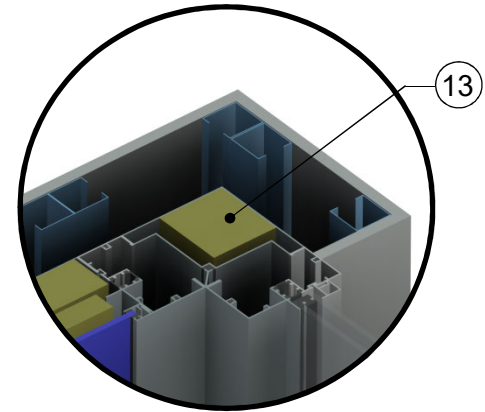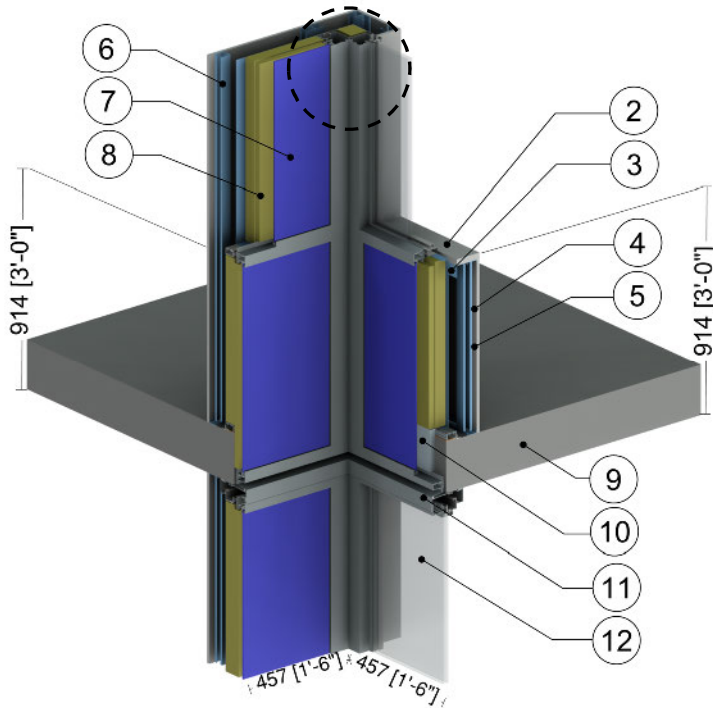



Corner Post Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{coe} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Post Insulation	3" (76)	0.24 (0.034)	R-12.6 (2.22 RSI)	4 (64)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.4.2 Window Wall System – Inside Corner with Spandrel to Vision Transition & Interior Spray Foam Insulation

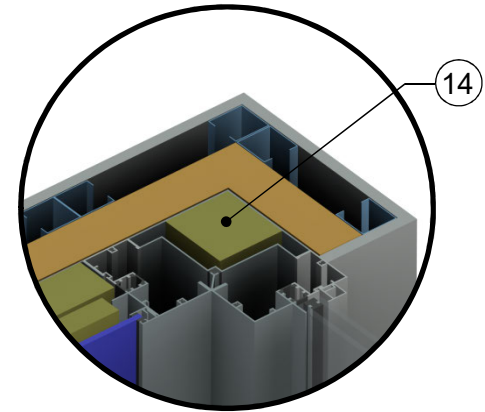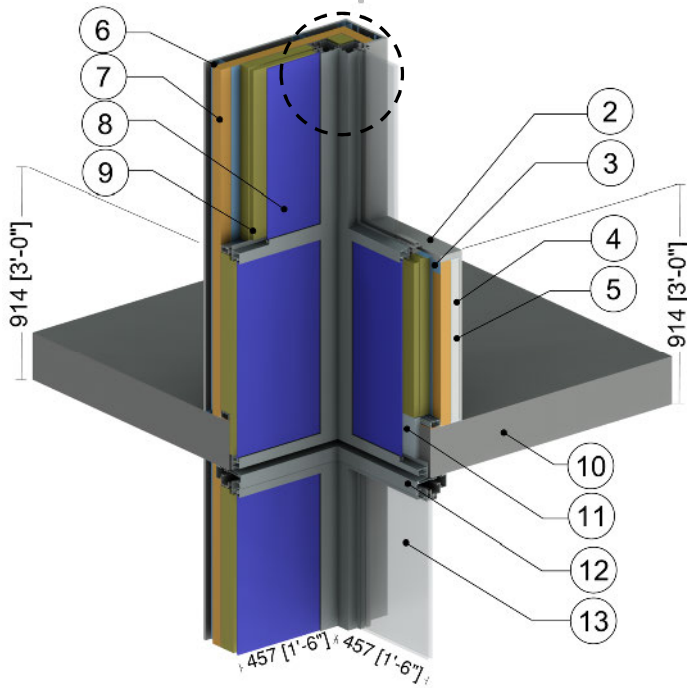

Corner Post Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Continuous Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12 (2.11 RSI)	2.8 (39)	0.35 (1470)
8	Full Height Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame, no insulation in mullions ²					
9	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Bypass Insulation	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
14	Post Insulation	3" (76)	0.24 (0.034)	R-12.6 (2.22 RSI)	4 (64)	0.20 (850)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.5.1

Window Wall System with Insulated Spandrel Panel – Uninsulated Interior Concrete Wall and Intermediate Floor Intersection

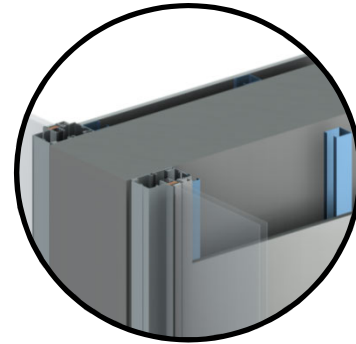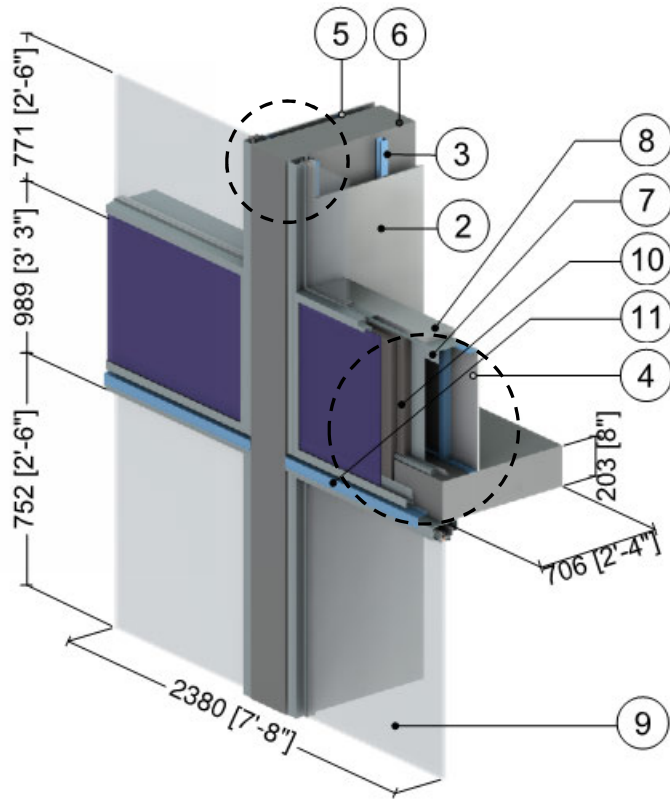

Concrete Wall Intersection Detail with no Interior Insulation

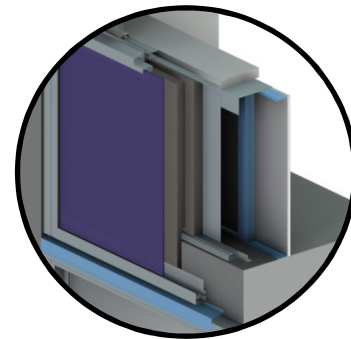



Spandrel Bypass Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Sill Stud Cavity	3 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Air in Partition Wall Cavity	1 5/8" (41)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
6	Concrete Wall/Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{coG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
10	Backpan insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Air Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 1.5.2 Window Wall System with Insulated Spandrel Panel – Insulated Interior Concrete Wall and Intermediate Floor Intersection

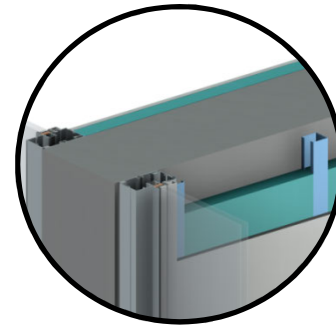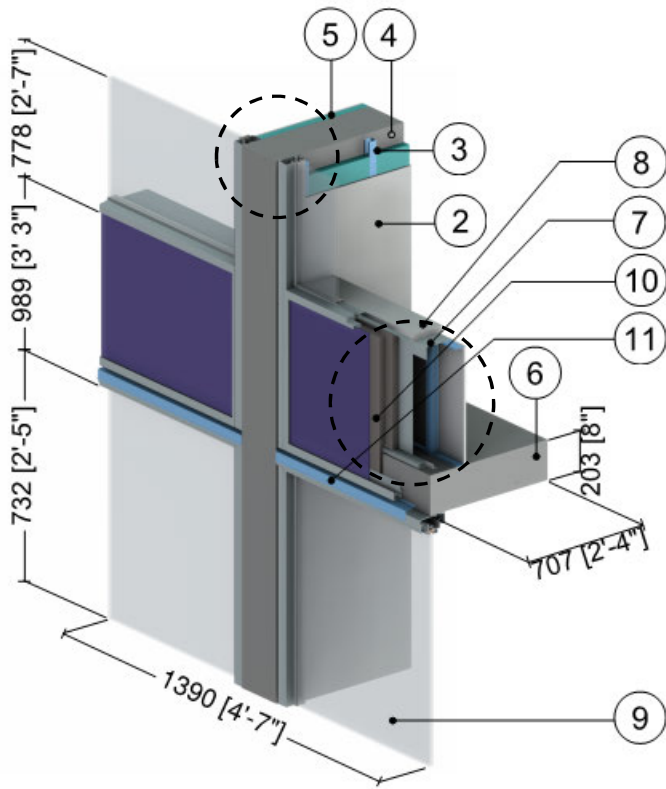

Interior Concrete Wall Intersection Detail with Interior Insulation

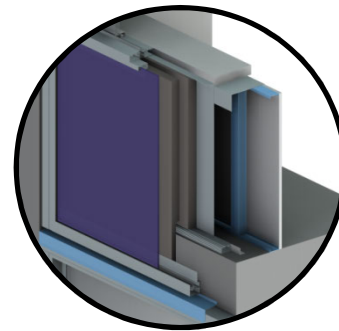

Spandrel Bypass Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Sill Stud Cavity	3 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Rigid Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	Aluminum Window Wall Vision System: thermally broken frame ² , no insulation in mullions, double glazed IGU U _{coe} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
10	Backpan insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

2.0 Conventional Curtain Wall

Detail 2.1.1	A.2.1
Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection & No Interior Insulation in Stud Cavity	
Detail 2.1.2	A.2.2
Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection & Spray Foam Insulation in Stud Cavity	
Detail 2.1.3	A.2.3
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Metal Backpan and Intermediate Floor Intersection	
Detail 2.1.4	A.2.4
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection	
Detail 2.1.5	A.2.5
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Metal Backpan and Intermediate Floor Intersection	
Detail 2.1.6	A.2.6
Conventional Curtain Wall System with 5' x 5' Spandrel Section – Alternative Glazing Methods and Intermediate Floor Intersection	
Detail 2.1.7	A.2.7
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Backpan and Improved Glazing at Intermediate Floor Intersection	
Detail 2.1.8	A.2.8
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – AIM Applications and Improved Glazing at Intermediate Floor Intersection	
Detail 2.1.9	A.2.9
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates – Intermediate Mullion and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection	
Detail 2.1.10	A.2.10
Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates – Intermediate Mullion and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection	
Detail 2.1.11	A.2.11

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Slab Intersection & Spray Foam Insulation in Stud Cavity with Thermal Break Under Stud Cavity and at Anchors	
Detail 2.1.12	A.2.12
Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Studs (16" o.c.) – Slab Intersection & No Metal Back Pan	
Detail 2.1.13	A.2.13
Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Studs (16" o.c.) – Slab Intersection & Metal Back Pan Connected to Side of Frame	
Detail 2.2.1	A.2.14
Conventional Curtain Wall System with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Un-insulated Concrete with Spandrel & Roof Intersection	
Detail 2.2.2	A.2.15
Conventional Curtain Wall System – Insulated Spandrel & Roof Intersection	
Detail 2.2.3	A.2.16
Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Concrete Parapet Roof Intersection & Spray Foam Insulation in Stud Cavity	
Detail 2.2.4	A.2.17
Conventional Curtain Wall System with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Insulated Concrete with Spandrel & Roof Intersection	
Detail 2.3.1	A.2.18
Conventional Curtain Wall System with Insulated Spandrel Panel– Uninsulated Jamb Intersection with Vision Section	
Detail 2.3.2	A.2.19
Conventional Curtain Wall System with Insulated Spandrel Panel– Rigid Insulated Jamb Intersection with Vision Section	
Detail 2.3.3	A.2.20
Conventional Curtain Wall System with Insulated Spandrel Panel –Aerogel Insulated Jamb Intersection with Vision Section	
Detail 2.4.1	A.2.21
Conventional Curtain Wall with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Concrete Slab	
Detail 2.4.2	A.2.22
Conventional Curtain Wall with Insulated Spandrel Panel & 5 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Steel Beam	
Detail 2.4.3	A.2.23

Conventional Curtain Wall with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) - Canopy Beam & Gutter Intersection

Detail 2.4.4 **A.2.24**


Conventional Curtain Wall with Insulated Spandrel Panel & 5 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Steel Beam with Additional Mullions

Detail 2.5.1 **A.2.25**

Conventional Curtain Wall System - At-Grade Slab Transition

Detail 2.1.1

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection & No Interior Insulation in Stud Cavity

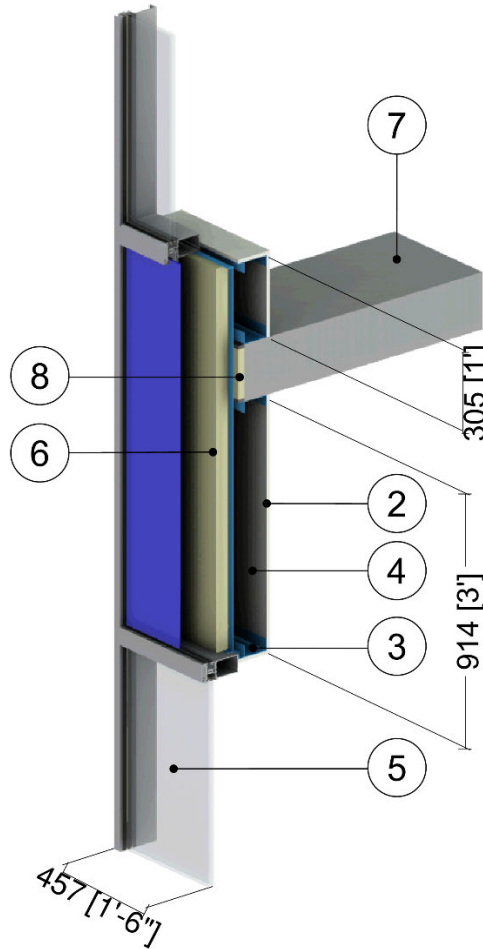


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 5/8" (118)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
6	Backpan Insulation	Varies	-	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	1.8 (28)	0.29 (1220)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Firestop Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2.

Detail 2.1.2

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection & Spray Foam Insulation in Stud Cavity

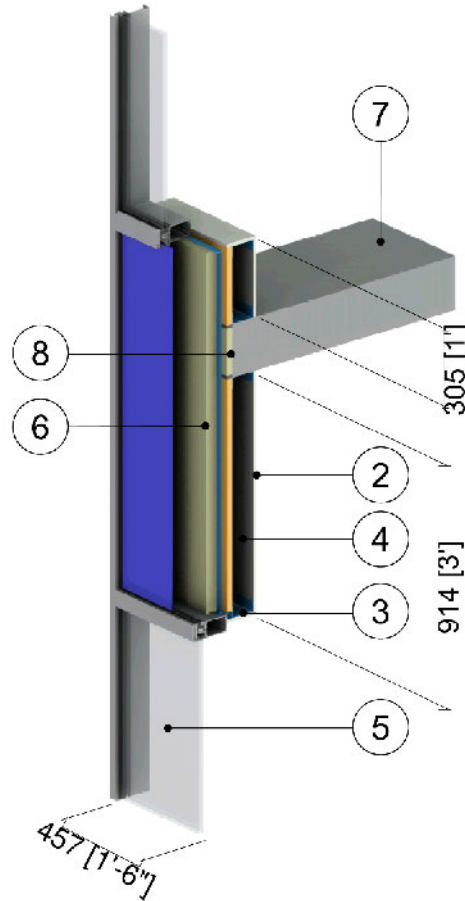


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
6	Backpan Insulation	Varies	-	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	1.8 (28)	0.29 (1220)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Firestop Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12.0 (2.11 RSI)	2.4 (39)	0.35 (1470)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2.

Detail 2.1.3

Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Metal Backpan and Intermediate Floor Intersection

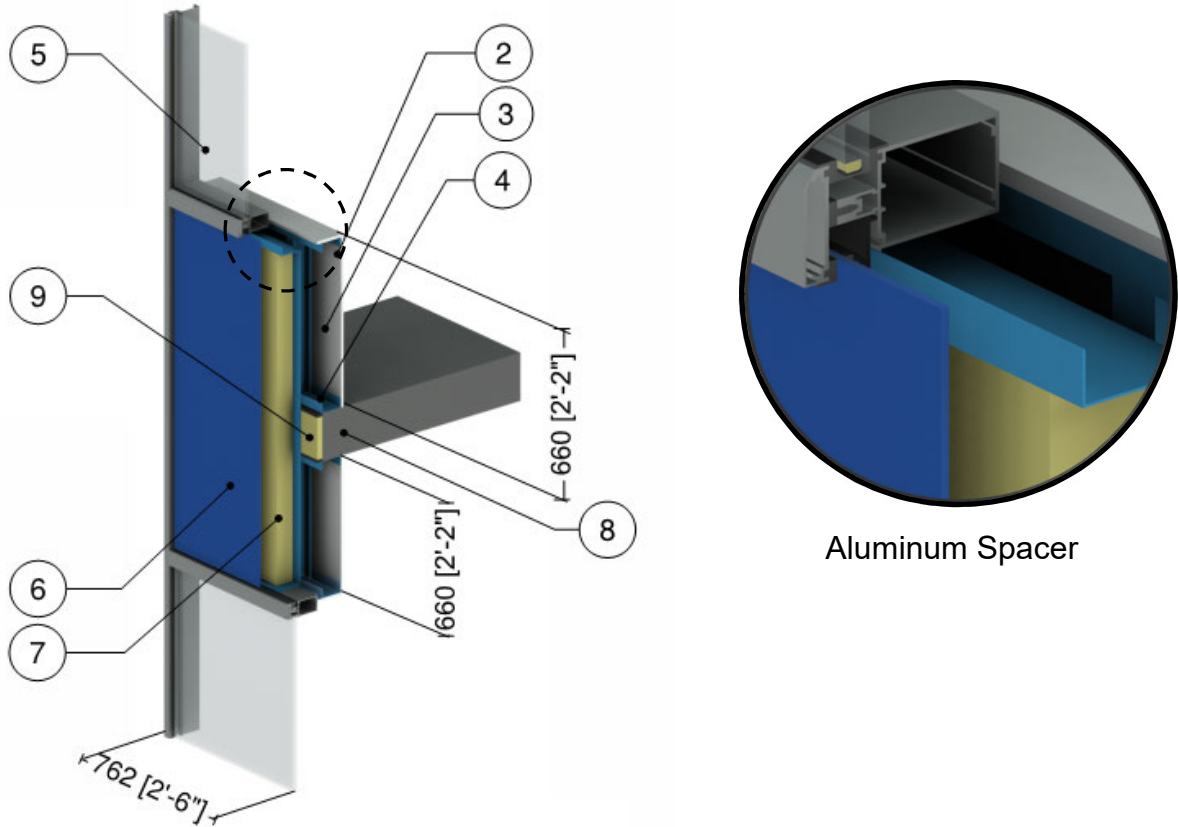



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU with aluminum spacer ²					
6	Conventional Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%


Detail 2.1.4 Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection

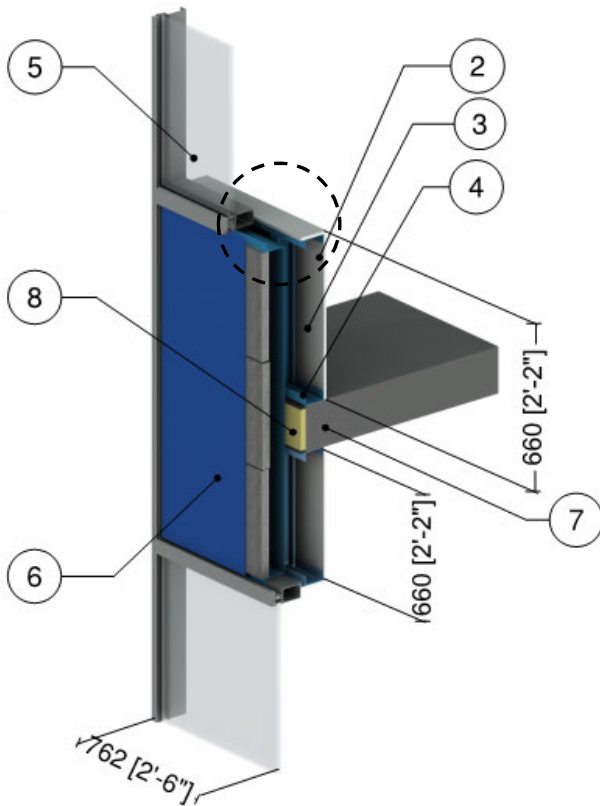


A1 – 1.5" (38 mm) AIM Adhered to Monolithic Glass

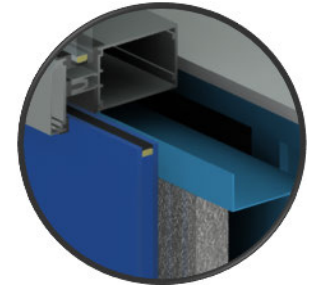

A2 – 1.5" (38 mm) AIM Adhered to Double Glazed IGU



A3 – Aluminum Spacer, 0.75" (19 mm) AIM between Glass

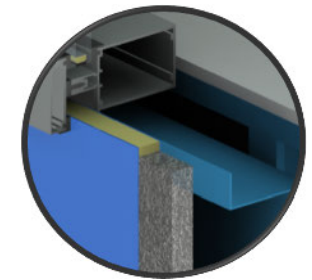

A4 – Rigid Insulation Spacer, 1" (25 mm) AIM between Metal Skins

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU ²					
6	Conventional Curtain Wall Spandrel Section with varied insulation (see A1 to A4 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 2.1.5 Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Metal Backpan and Intermediate Floor Intersection

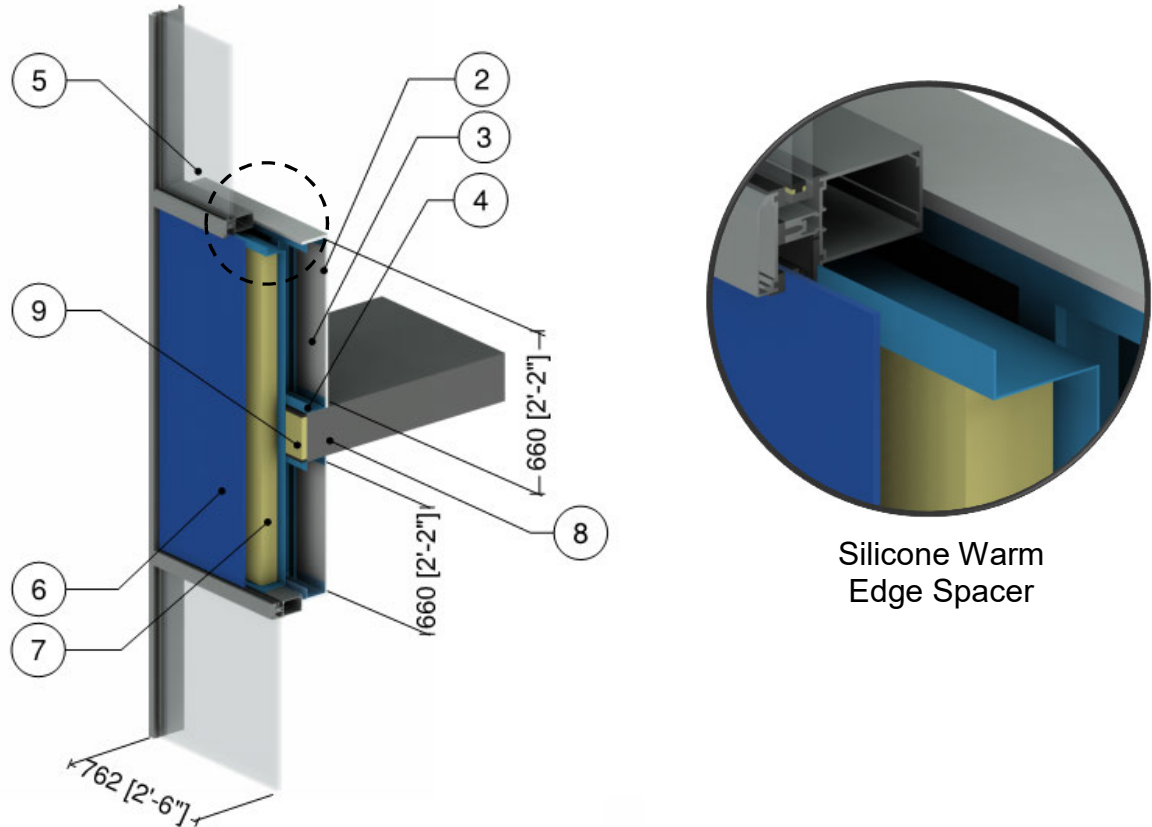

Silicone Warm Edge Spacer



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU silicone warm edge spacer ²					
6	Conventional Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

Detail 2.1.6 Conventional Curtain Wall System with 5' x 5' Spandrel Section – Alternative Glazing Methods and Intermediate Floor Intersection

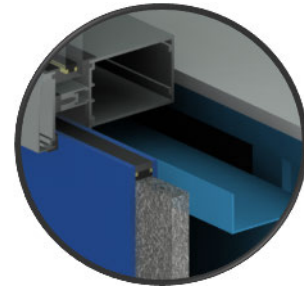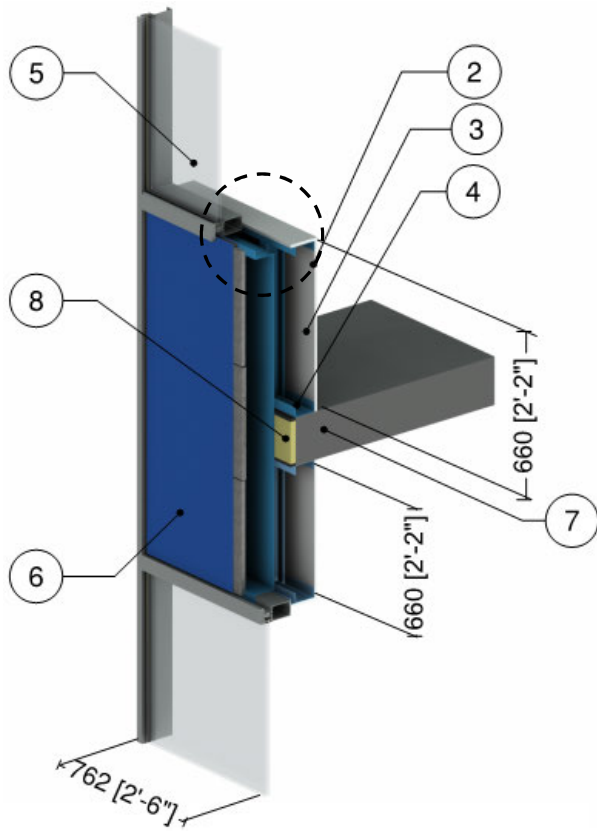

B1 – Vertical & Horizontal Pressure Plates, Warm Edge Spacer, 0.75" (19 mm) AIM between Glass

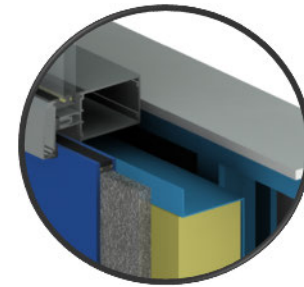

B2 – Vertical Structural Silicone & Horizontal Pressure Plates, Warm Edge Spacer, 0.75" (19 mm) AIM between Glass with 4" (100 mm) Backpan Insulation

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU with silicone warm edge spacer ²					
6	Conventional Curtain Wall Spandrel Section with varied insulation (see B1 to B2 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 2.1.7

Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Backpan and Improved Glazing at Intermediate Floor Intersection

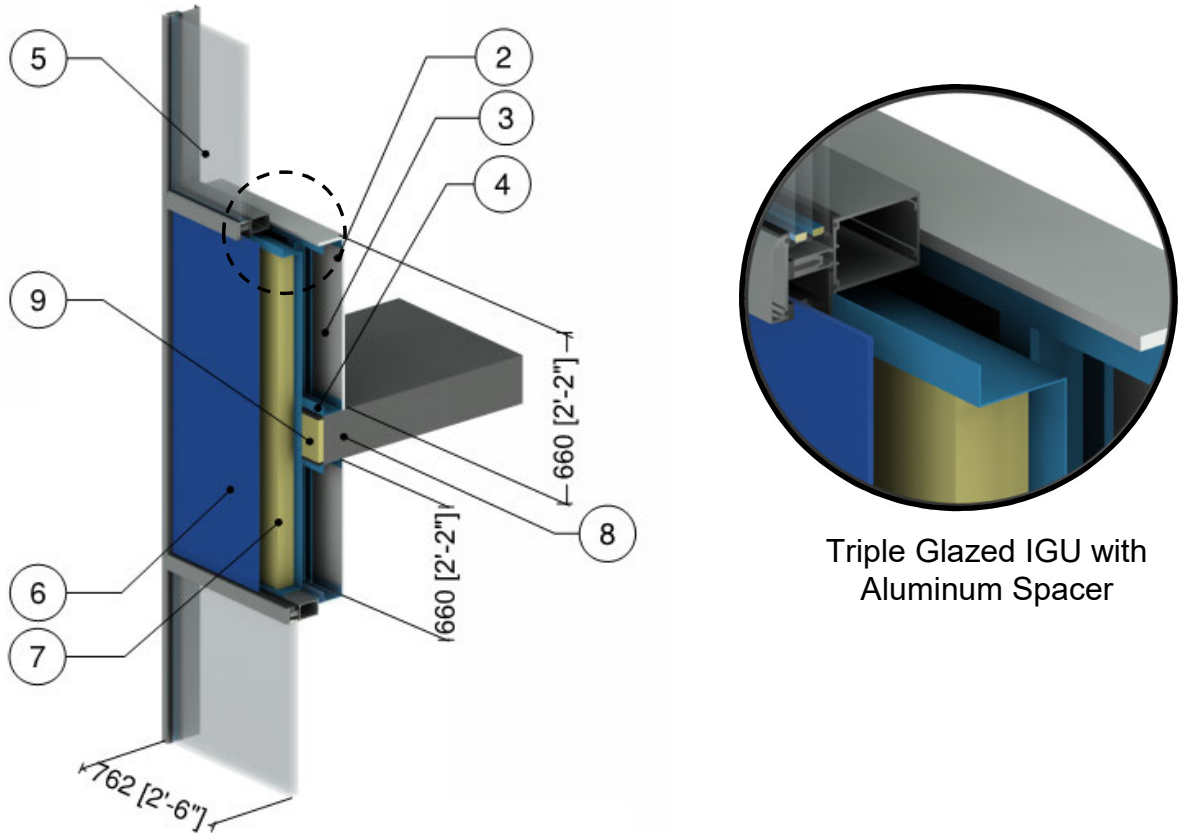

Triple Glazed IGU with Aluminum Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: triple glazed IGU with aluminum spacer ²					
6	Conventional Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³For a window to wall ratio of 50%

Detail 2.1.8

Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – AIM Applications and Improved Glazing at Intermediate Floor Intersection

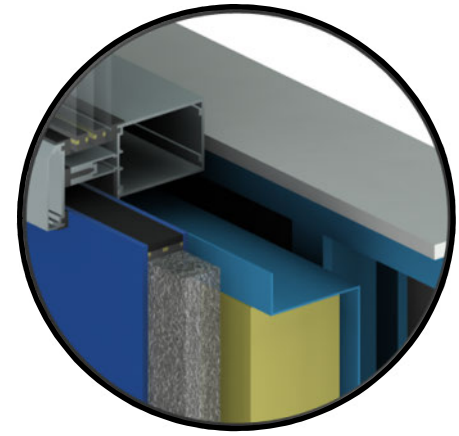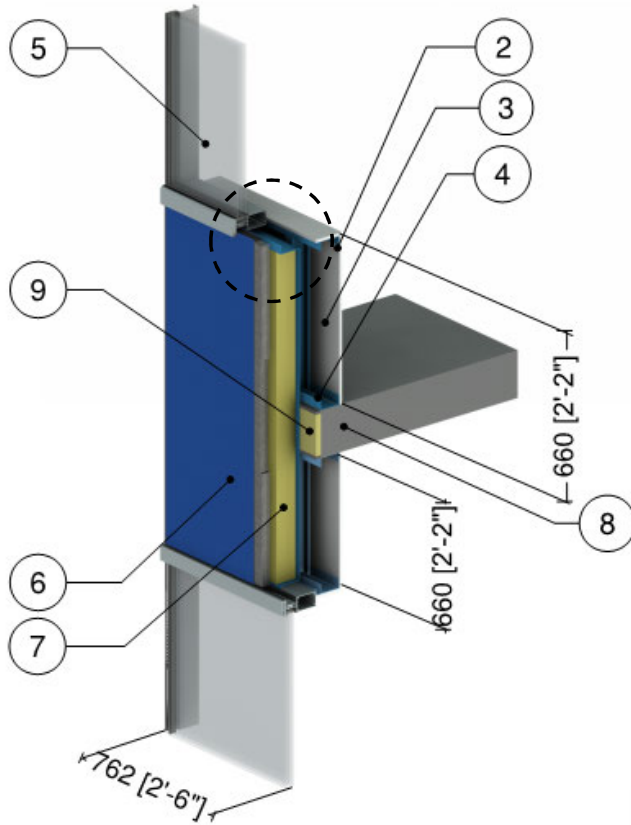

Triple Glazed IGU with Silicone Warm Edge Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: triple glazed IGU with silicone warm edge spacer ²					
6	Conventional Curtain Wall Spandrel Section with 1.5" (38) AIM between Glass and Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 2.1.9 Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates – Intermediate Mullion and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection

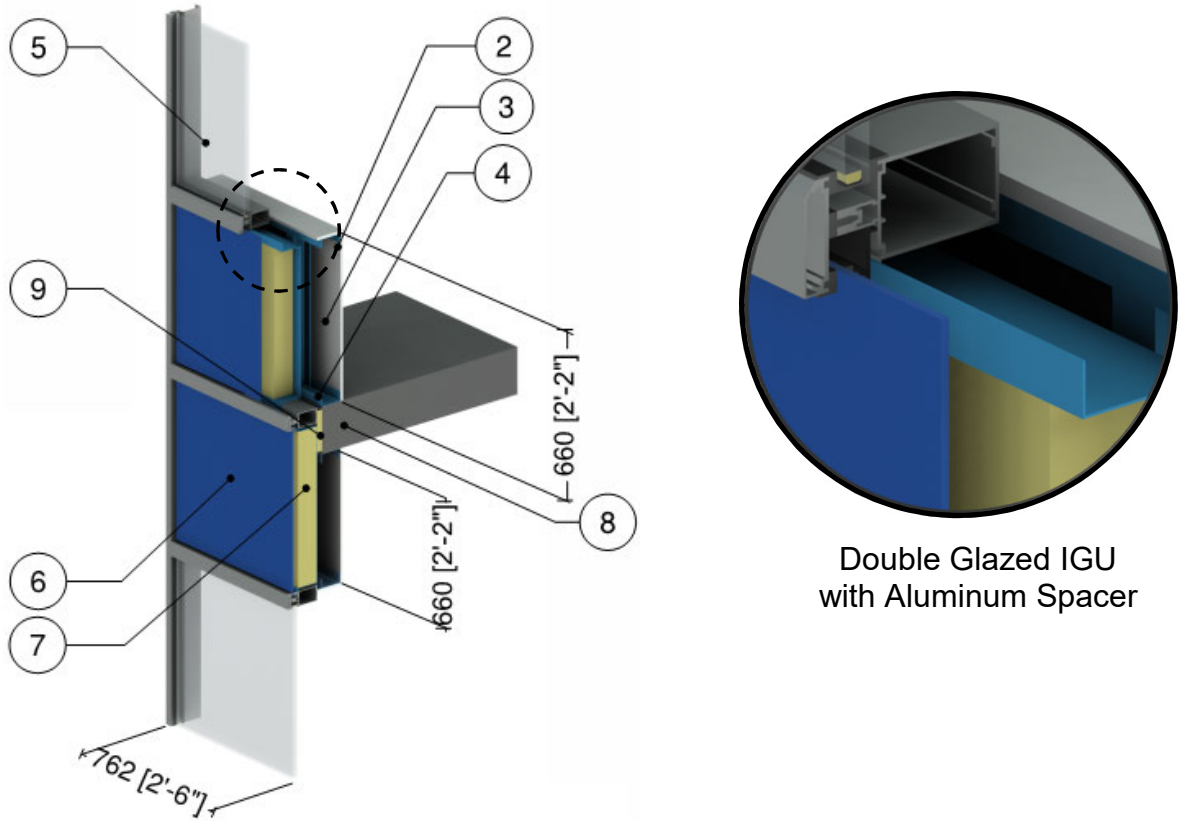

Double Glazed IGU with Aluminum Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU with aluminum spacer ²					
6	Conventional Curtain Wall Spandrel with Intermediate Mullion Section and Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


³ For a window to wall ratio of 50%

Detail 2.1.10


Conventional Curtain Wall System with Vertical and Horizontal Pressure Plates – Intermediate Mullion and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection

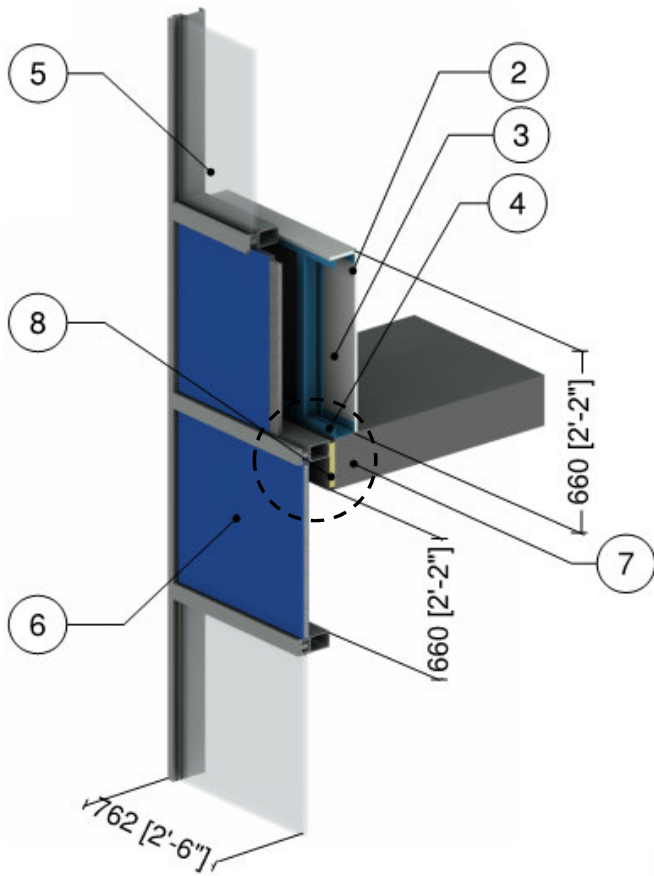


D1 – Vertical & Horizontal Pressure Plates, Warm Edge Spacer, 0.75" (19 mm) AIM Between Glass



D2 – Vertical Structural Silicone & Horizontal Pressure Plates, Warm Edge Spacer, 0.75" (19 mm) AIM between Glass



D3 – Vertical Structural Silicone & Horizontal Pressure Plates, Rigid Insulation Spacer, 1" (25 mm) AIM between Metal Skins



D4 – Vertical Structural Silicone & Horizontal Pressure Plates, Warm Edge Spacer, 1.5" (38 mm) AIM between Glass

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed (D1 to D3) or Triple Glazed (D4) IGU ²					
6	Conventional Curtain Wall Spandrel Section with varied insulation (see D1 to D4 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 2.1.11

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Slab Intersection & Spray Foam Insulation in Stud Cavity with Thermal Break Under Stud Cavity and at Anchors

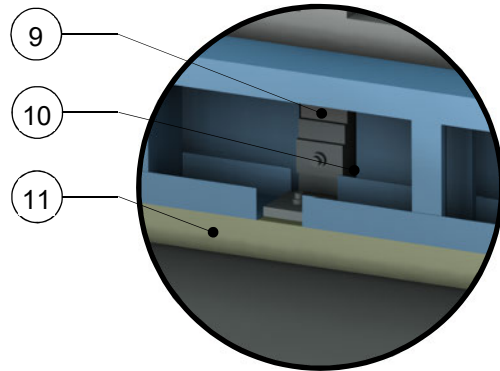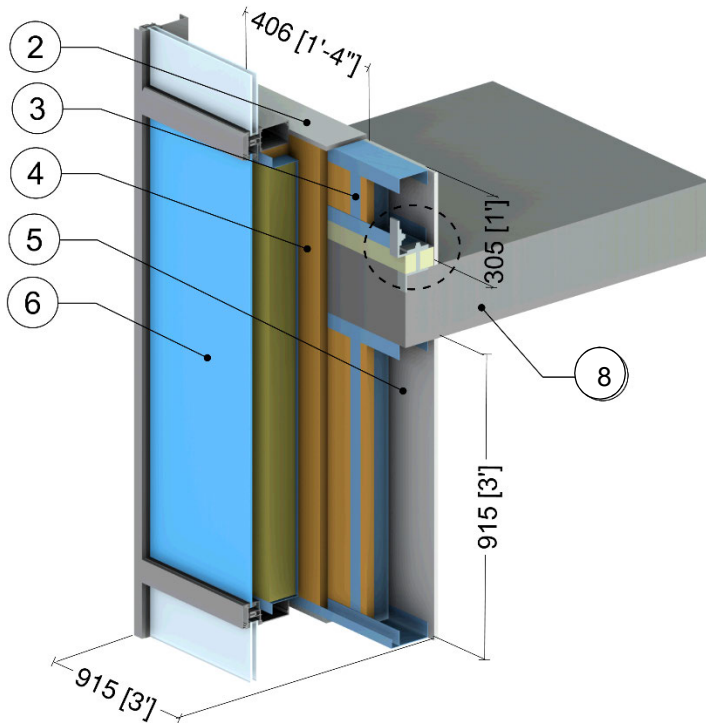

Anchor Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Spray Foam Insulation	2" (51)	0.17 (0.025)	-	2.4 (39)	0.35 (1470)
5	Air in Stud Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
7	Backpan Insulation	-	-	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Steel Anchor at vertical mullions	-	347 (50)	-	489 (7830)	0.12 (500)
10	Armatherm FRR	3/8" (10)	1.4 (0.20)	-	85 (5.3)	-
11	Armatherm 500	2" (50)	0.32 (0.05)	R-6.2 (1.09 RSI)	-	-
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 2.1.12

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Studs (16" o.c.) – Slab Intersection & No Metal Back Pan

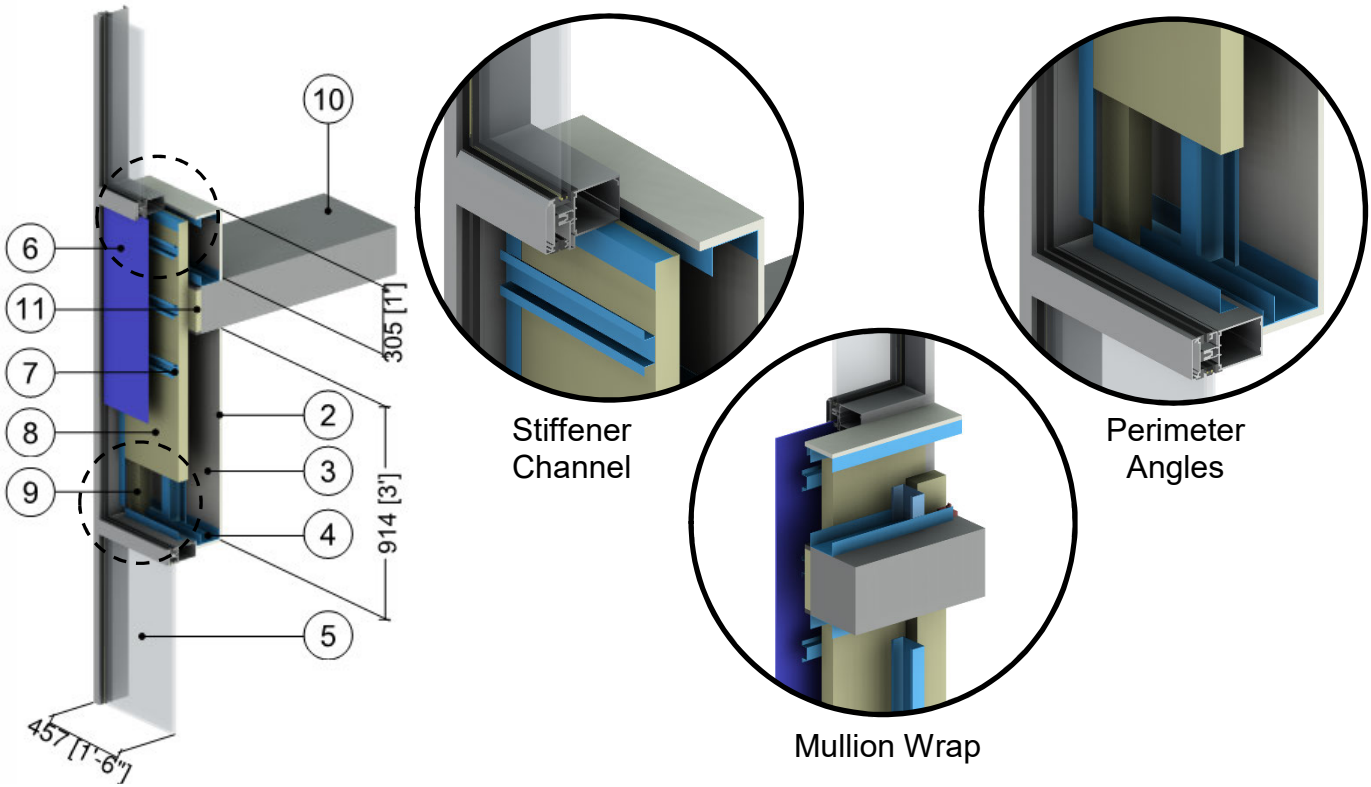


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU with warm edge spacer ²					
6	Conventional Curtain Wall Spandrel Section with Spandrel Insulation ²					
7	Spandrel Insulation Stiffeners	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Spandrel Insulation	2" (51)	-	R-8.4 (1.48 RSI)	1.8 (28)	0.29 (1220)
9	Mullion Wrap Insulation	With and Without	-	R-8.4 (1.48 RSI)	1.8 (28)	0.29 (1220)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Mineral Wool Insulation	1"	0.24 (0.034)	-	1.8 (28)	0.29 (1220)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 2.1.13 Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Studs (16" o.c.) – Slab Intersection & Metal Back Pan Connected to Side of Frame

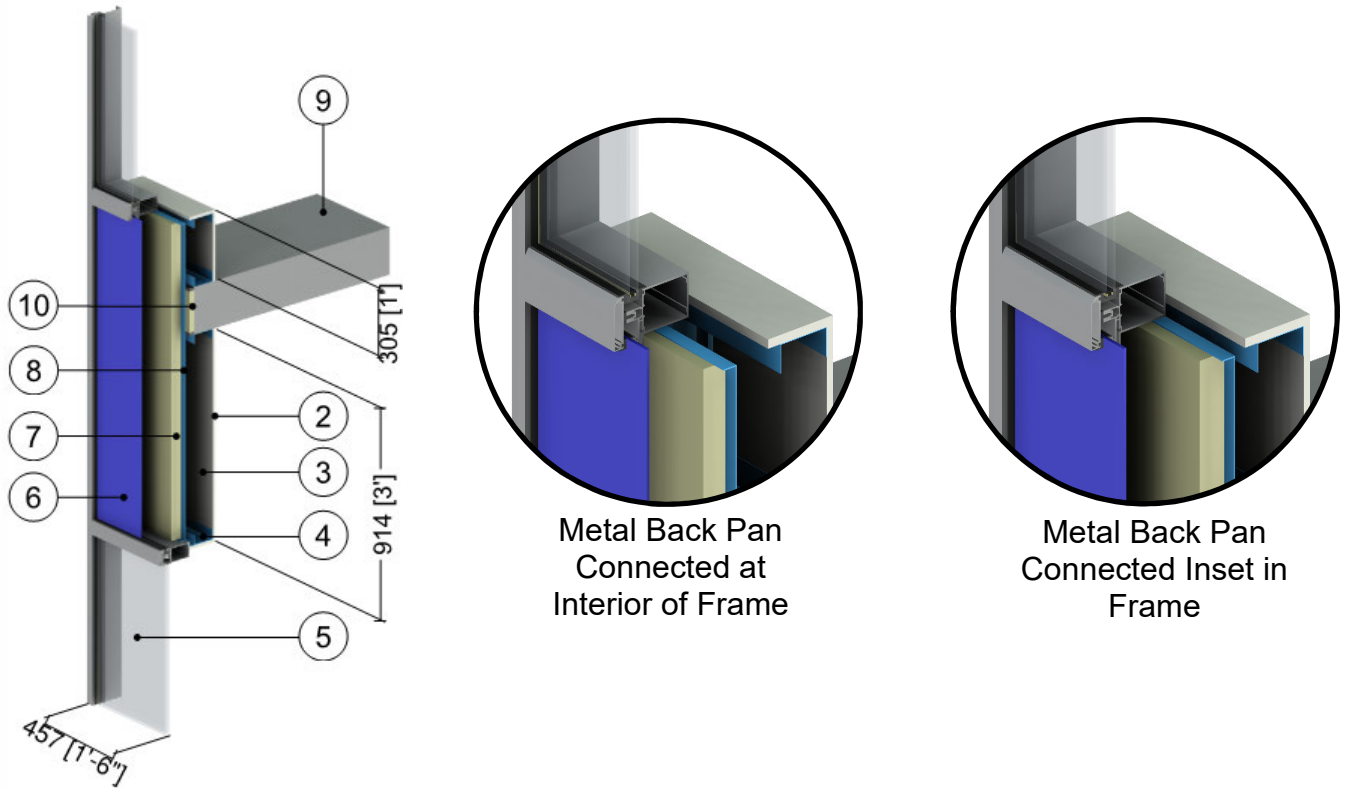



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Conventional Curtain Wall Vision Section: double glazed IGU with warm edge spacer ²					
6	Conventional Curtain Wall Spandrel Section with Insulated Metal Back Pan ²					
7	Backpan Insulation	Varies	-	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	1.8 (28)	0.29 (1220)
8	Metal Back Pan	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Mineral Wool Insulation	1"	0.24 (0.034)	-	1.8 (28)	0.29 (1220)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.2.1

Conventional Curtain Wall System with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Un-insulated Concrete with Spandrel & Roof Intersection

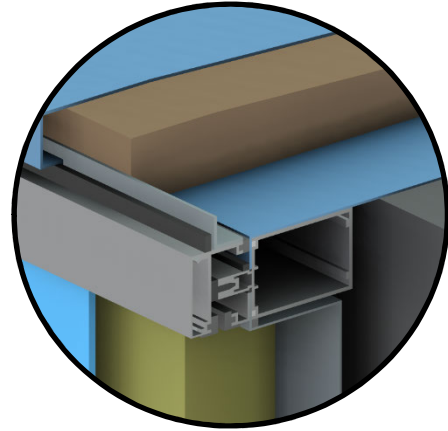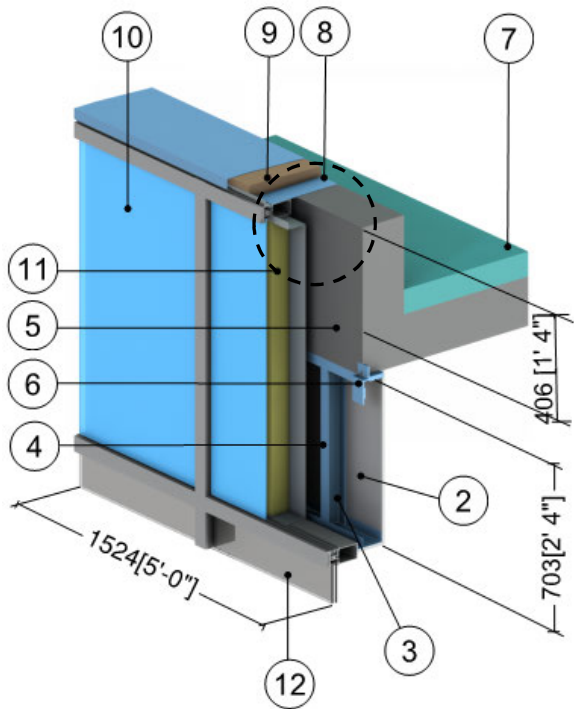



Parapet Cap Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	R-0.6 (0.11 RSI)	140 (2250)	0.20 (850)
6	Anchor at Vertical Mullions	-	347 (50)	-	489 (7830)	0.12 (500)
7	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
8	Parapet Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Wood Blocking	-	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
10	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
11	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
12	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.2.2 | Conventional Curtain Wall System – Insulated Spandrel & Roof Intersection

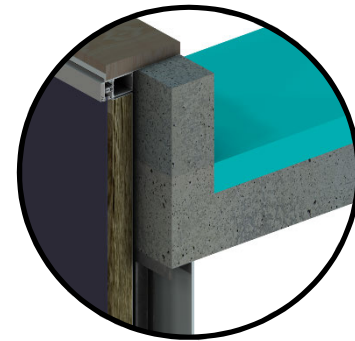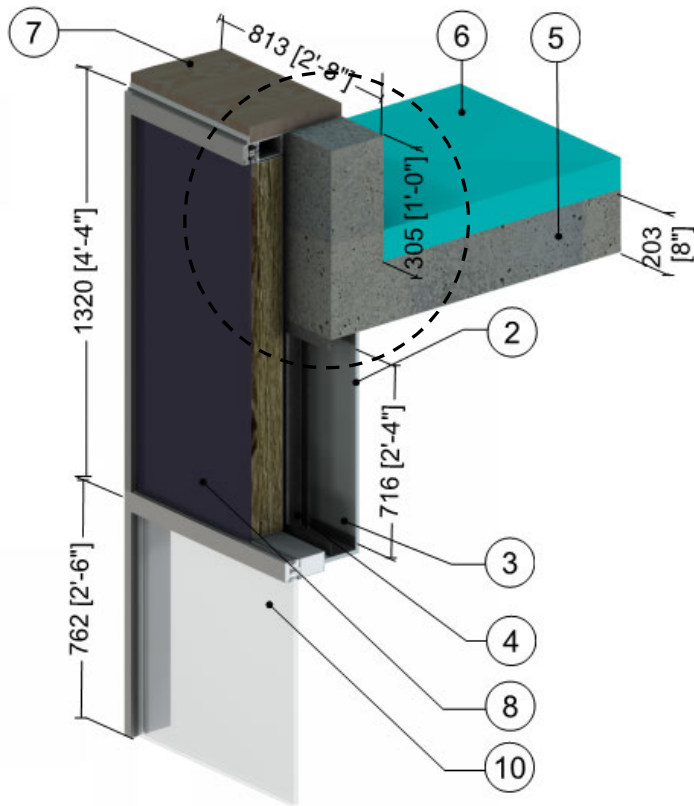

Without Aerogel Detail

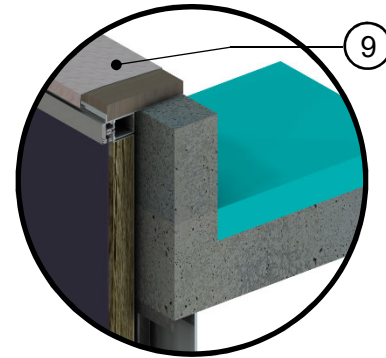

With Aerogel Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.12 RSI) to R-0.9 (0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	R-0.6 (0.11 RSI)	140 (2250)	0.20 (850)
6	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
7	Wood Blocking	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
9	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
10	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.2.3

Conventional Curtain Wall System with Insulated Spandrel Panel and 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Concrete Parapet Roof Intersection & Spray Foam Insulation in Stud Cavity

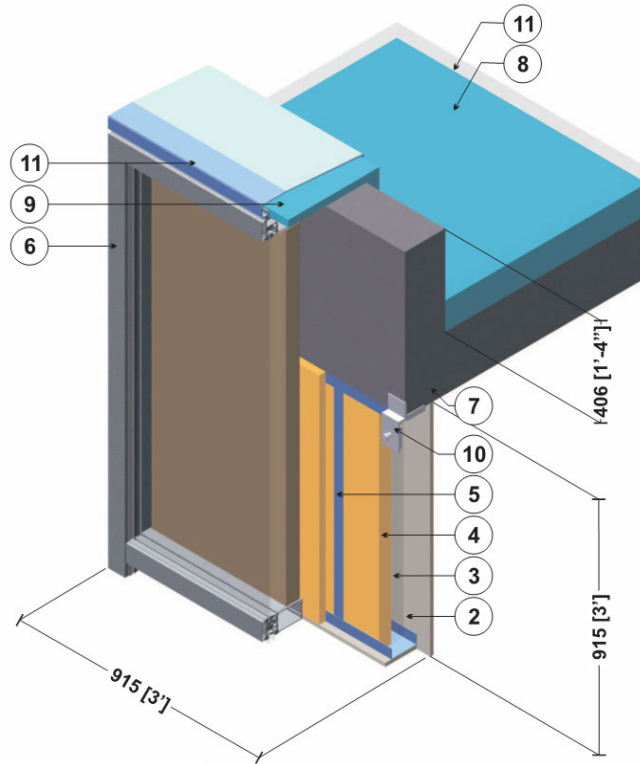



ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Spray Foam Insulation	2" (51)	0.17 (0.025)	-	2.8 (39)	0.35 (1470)
5	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
7	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
9	Parapet Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
10	Steel Anchor at vertical mullions	-	347 (50)	-	489 (7830)	0.12 (500)
11	Metal cap flashing/ finish roof materials is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2

Detail 2.2.4

Conventional Curtain Wall System with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Insulated Concrete with Spandrel & Roof Intersection

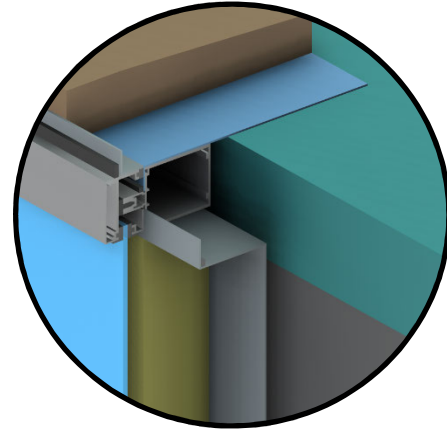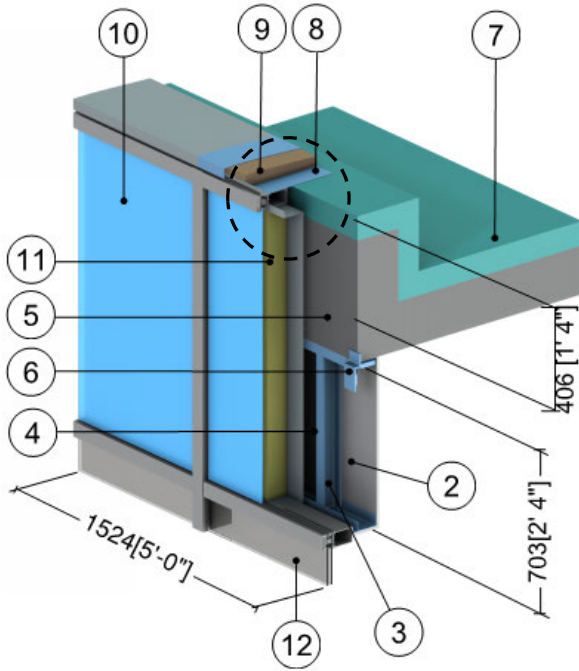


Parapet Cap Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	R-0.6 (0.11 RSI)	140 (2250)	0.20 (850)
6	Anchor at Vertical Mullions	-	347 (50)	-	489 (7830)	0.12 (500)
7	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
8	Parapet Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Wood Blocking		0.69 (0.10)	-	27.8 (445)	0.45 (1880)
10	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
11	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
12	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.3.1 Conventional Curtain Wall System with Insulated Spandrel Panel– Uninsulated Jamb Intersection with Vision Section

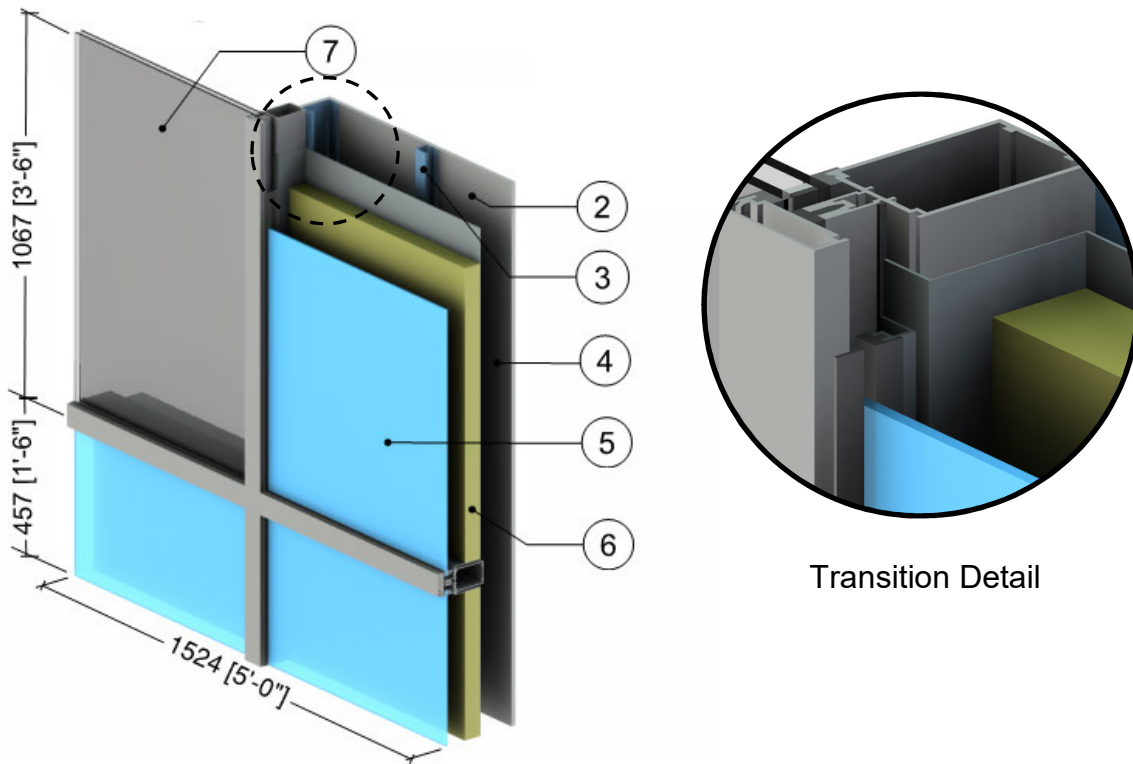


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
6	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
7	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{cog} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.3.2 Conventional Curtain Wall System with Insulated Spandrel Panel–Rigid Insulated Jamb Intersection with Vision Section

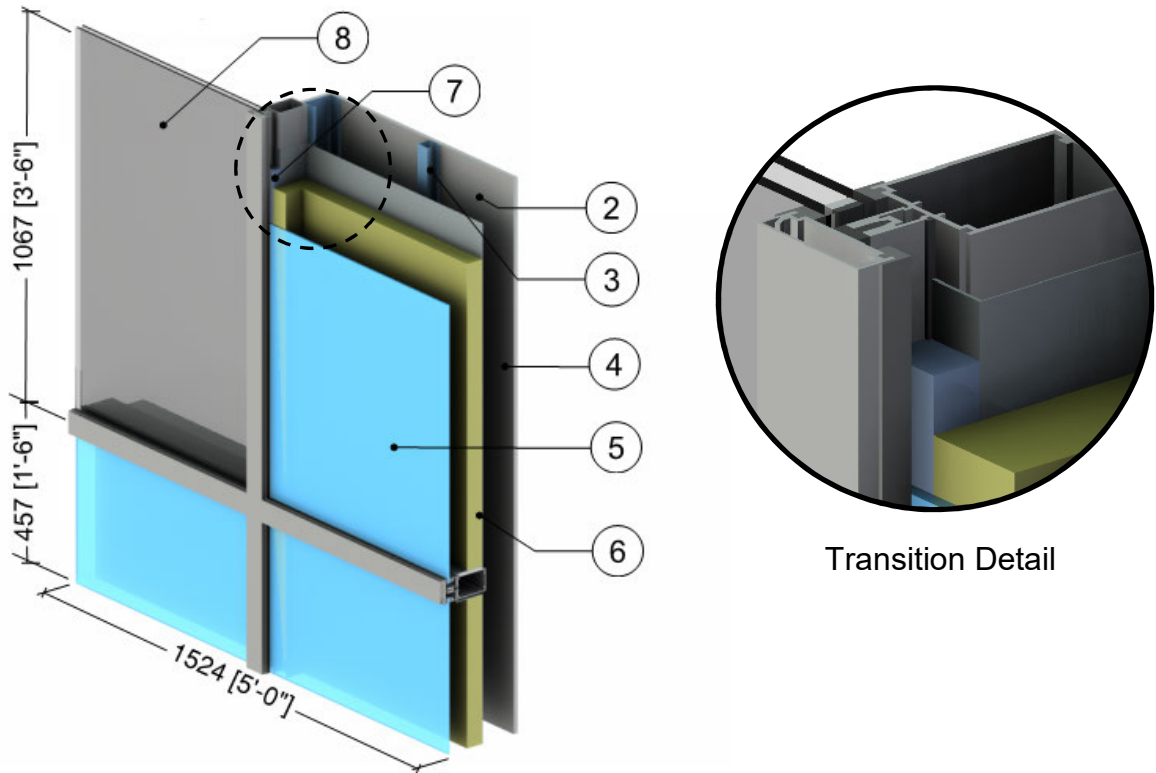


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
6	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
7	Curtain Wall Insulation	1" (25)	0.24 (0.034)	R-4.0 (0.7 RSI)	4 (64)	0.20 (850)
8	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{coG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.3.3

Conventional Curtain Wall System with Insulated Spandrel Panel – Aerogel Insulated Jamb Intersection with Vision Section

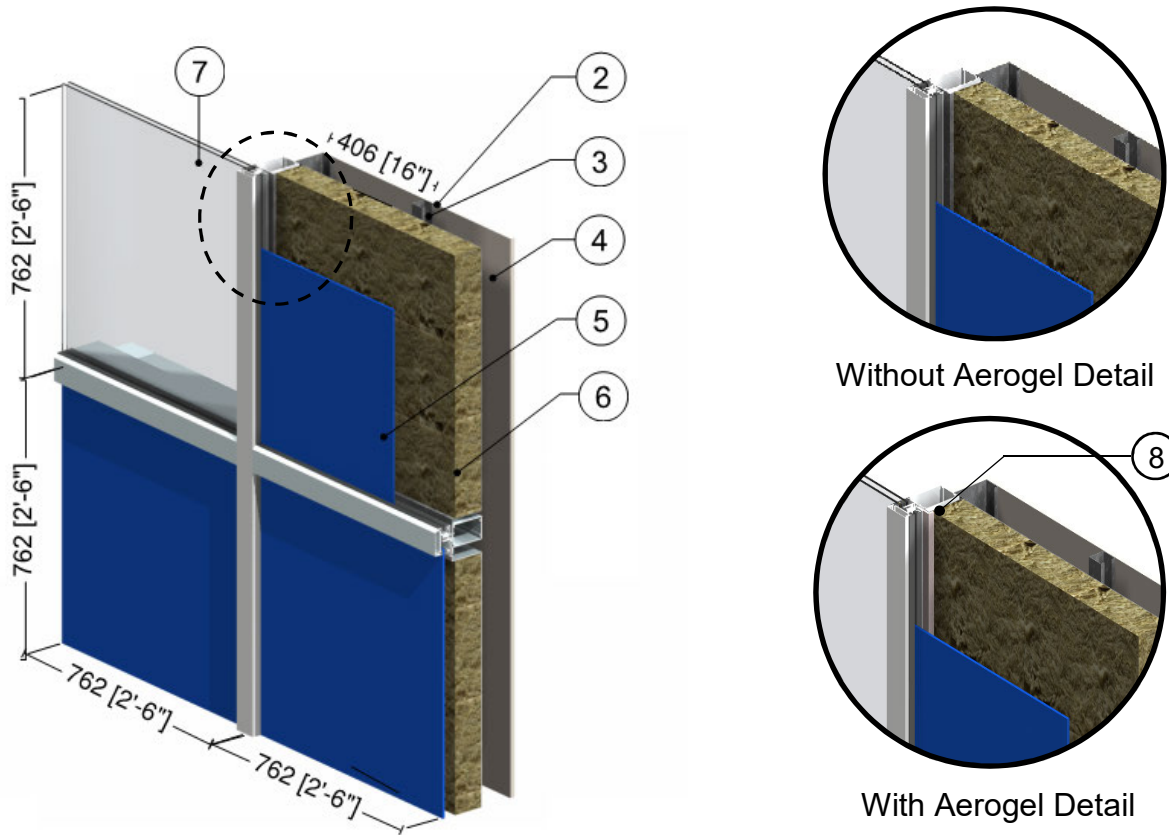



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Conventional Curtain Wall Spandrel System with Insulated Backpan: minimal thermally broken frame ²					
6	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
7	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
8	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.4.1

Conventional Curtain Wall with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Concrete Slab

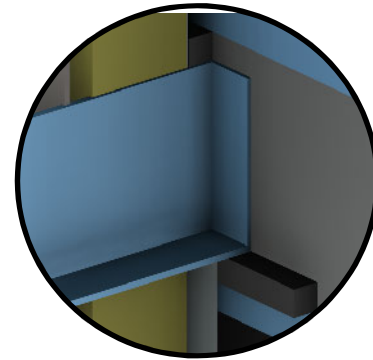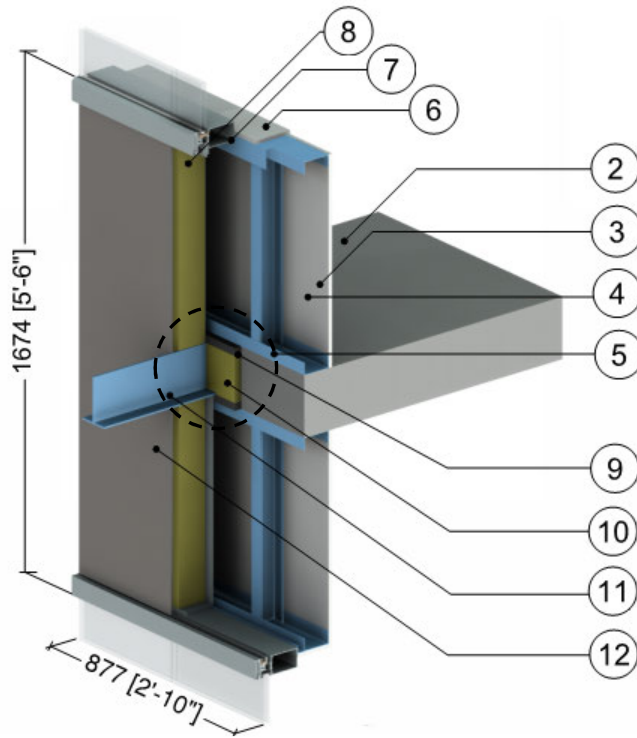

Beam Intersection Detail
(Insulation on slab not shown)



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	4 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	3 5/8" x 1 5/8" Steel Studs (16" o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	31 (500)	0.45 (1880)
7	Conventional Curtain wall system:minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.5 RSI to 3.0 RSI)	4 (64)	0.20 (850)
9	Silicone Sealant	1" (25)	2.4 (0.35)	-	174 (2800)	0.17 (700)
10	Semi-Rigid Insulation	1" (25)	0.24 (0.034)	-	4 (64)	0.20 (850)
11	Steel Beam (W6x12)	-	347 (50)	-	489 (7830)	0.12 (500)
12	Composite Metal Panel	3/16" (4)	347 (50)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.4.2

Conventional Curtain Wall with Insulated Spandrel Panel & 5 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Steel Beam

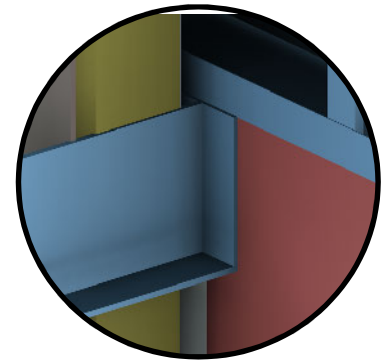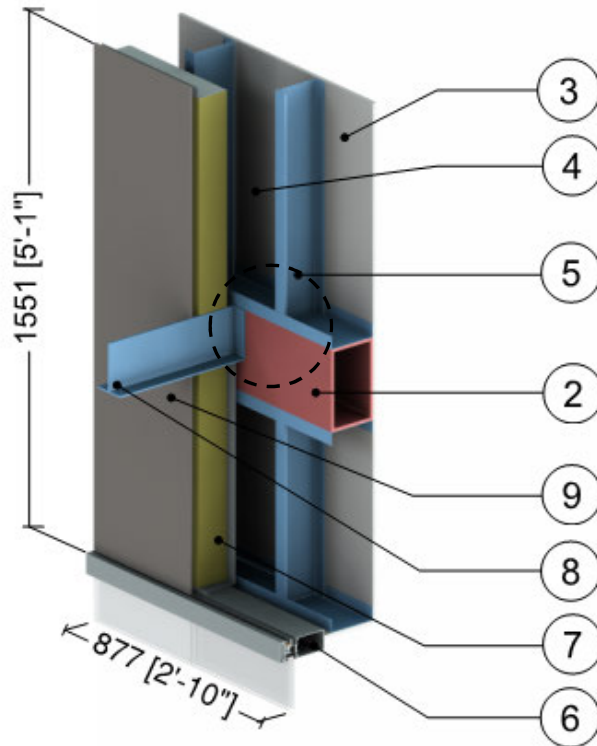

Beam Intersection Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Structural Steel Beam (10" x 6" x 3/8" HSS)	-	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	5 5/8" (168)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	5 5/8" x 1 5/8" Steel Studs (16" o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Curtain wall system: minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.5 RSI to 3.0 RSI)	4 (64)	0.20 (850)
8	Steel Beam (W6x12)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Composite Metal Panel	3/16" (4)	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.4.3

Conventional Curtain Wall with Insulated Spandrel Panel & 3 5/8" x 1 5/8" Steel Stud (16" o.c.) - Canopy Beam & Gutter Intersection

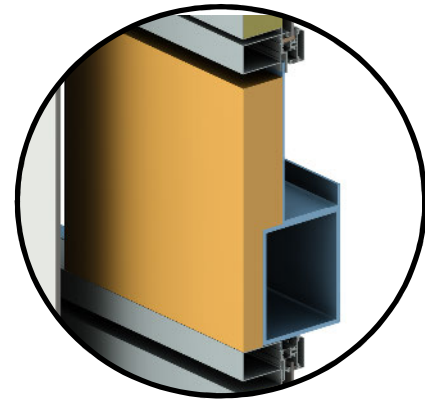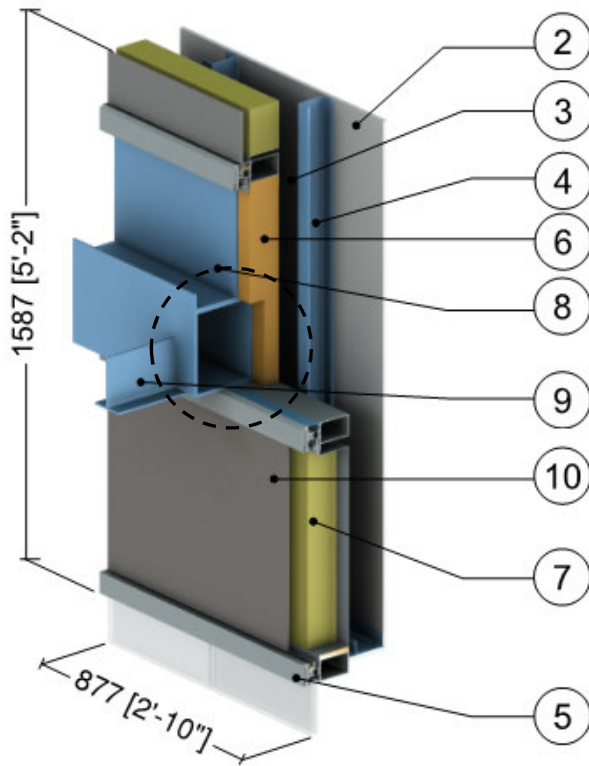

Gutter Intersection Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	4 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Curtain wall system: minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
6	Polyurethane Foam Insulation	4" (102)	0.17 (0.024)	R-24 (4.20 RSI)	1.8 (28)	0.29 (1220)
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.5 RSI to 3.0 RSI)	4 (64)	0.20 (850)
8	Steel Beam (HSS 8x10x3/8) & Gutter	-	347 (50)	-	489 (7830)	0.12 (500)
9	Steel Beam (W6x12)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Composite Metal Panel	3/16" (4)	347 (50)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.4.4

Conventional Curtain Wall with Insulated Spandrel Panel & 5 5/8" x 1 5/8" Steel Stud (16" o.c.) - Beam Intersection Connected to Steel Beam with Additional Mullions

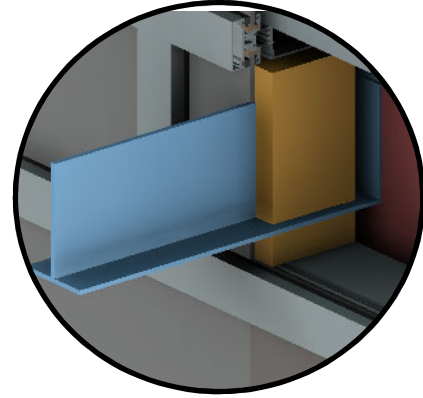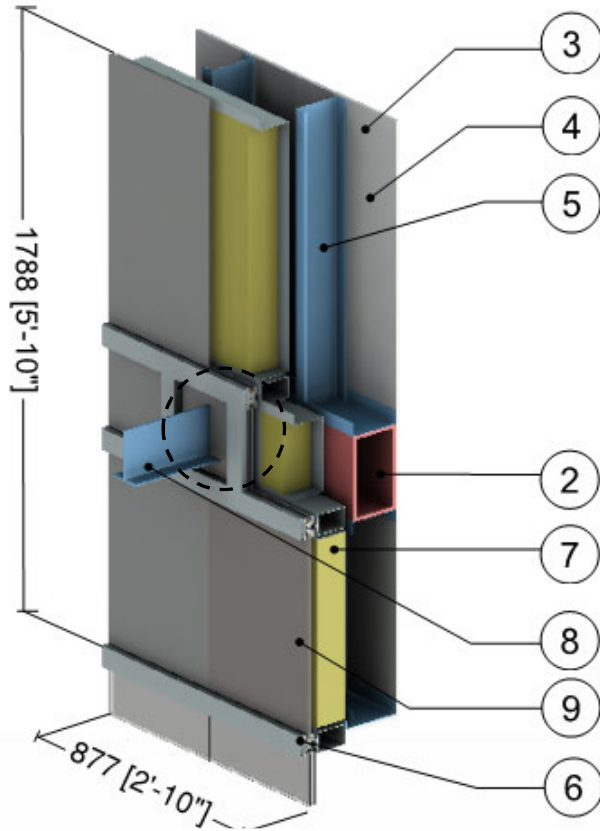



Beam Intersection Detail (Mullions, cladding and insulation not shown)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Structural Steel Beam (10" x 6" x 3/8" HSS)	-	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	6 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	5 5/8" x 1 5/8" Steel Studs (16" o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Curtain wall system: minimal thermally broken frame ² , double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.5 RSI to 3.0 RSI)	4 (64)	0.20 (850)
8	Steel Beam (W6 x12)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Composite Metal Panel	3/16" (4)	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 2.5.1 | Conventional Curtain Wall System - At-Grade Slab Transition

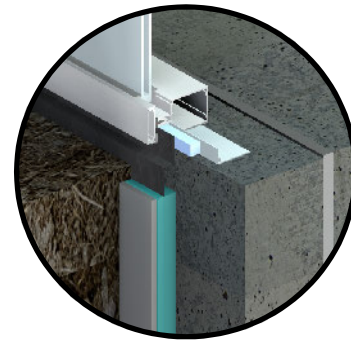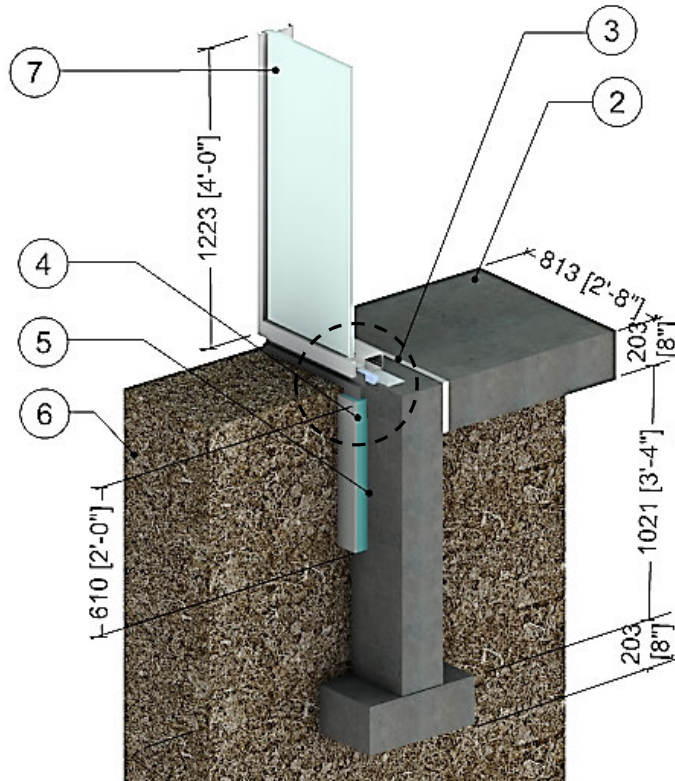

Without Aerogel Detail

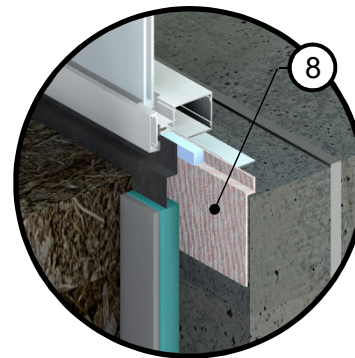

With Aerogel Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.12 to 0.16 RSI)	-	-
2	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Silicone Sealant	1/2" (13)	2.4 (3.5)	-	-	-
4	Foundation Insulation	2" (50)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
5	Concrete Footing	3 5/8" (92)	12.5 (1.8)	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	Soil	-	-	-	-	-
7	Conventional Curtain Wall Vision System : minimal thermally broken frame ² , double glazed IGU U _{cog} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
8	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

3.0 Unitized Curtain Wall

Detail 3.1.1	A.3.1
Unitized Curtain Wall System – Spandrel Clear Wall & No Interior Stud Cavity Insulation	
Detail 3.1.2	A.3.2
Unitized Curtain Wall System – Spandrel Clear Wall & Interior Spray Foam Insulation	
Detail 3.2.1	A.3.3
Unitized Curtain Wall System – Intermediate Floor Intersection & No Interior Stud Cavity Insulation	
Detail 3.2.2	A.3.4
Unitized Curtain Wall System – Intermediate Floor Intersection & Interior Spray Foam Insulation	
Detail 3.2.3	A.3.5
Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection	
Detail 3.2.4	A.3.6
Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection	
Detail 3.2.5	A.3.7
Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – Insulated Backpan and Improved Glazing at Intermediate Floor Intersection	
Detail 3.2.6	A.3.8
Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – AIM Applications and Improved Glazing at Intermediate Floor Intersection	
Detail 3.3.1	A.3.9
Unitized Curtain Wall System – Window Wall Transition	
Detail 3.3.2	A.3.10
Unitized Curtain Wall System – Window Wall Transition with Foam Insulation	

Detail 3.1.1

Unitized Curtain Wall System – Spandrel Clear Wall & No Interior Stud Cavity Insulation

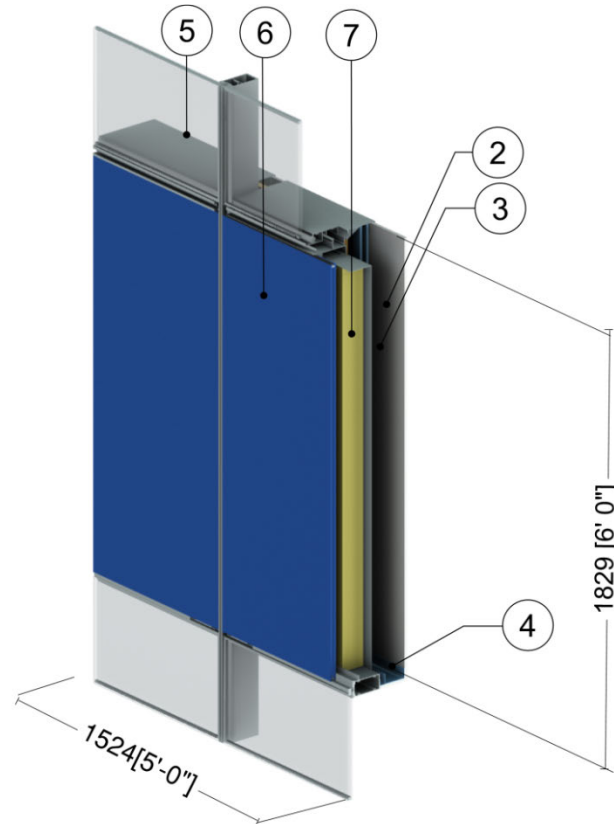


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	4 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
6	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 3.1.2

Unitized Curtain Wall System – Spandrel Clear Wall & Interior Spray Foam Insulation


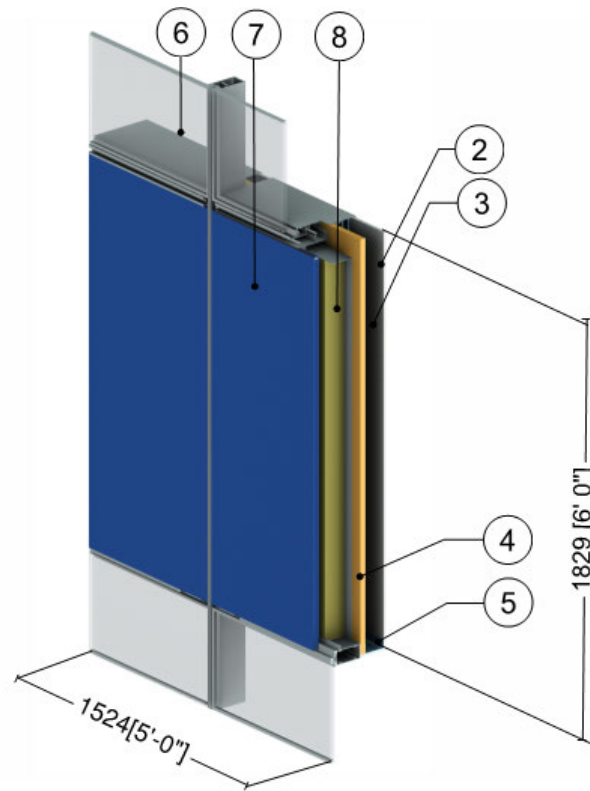


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Spray Foam Insulation	2" (51)	0.17 (0.025)	R-11.5 (2.0 RSI)	2.8 (39)	0.35 (1470)
5	3 5/8" x 1 5/8" Steel Studs (16"o.c.) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
7	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 3.2.1 | Unitized Curtain Wall System – Intermediate Floor Intersection & No Interior Stud Cavity Insulation

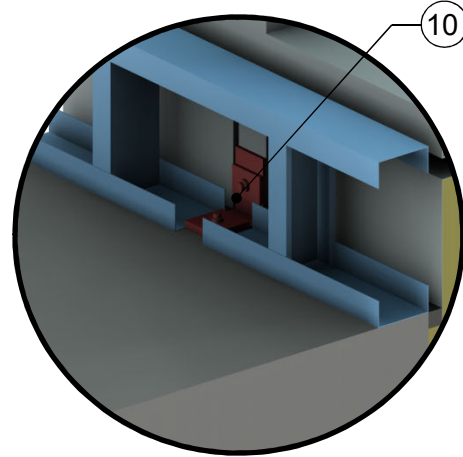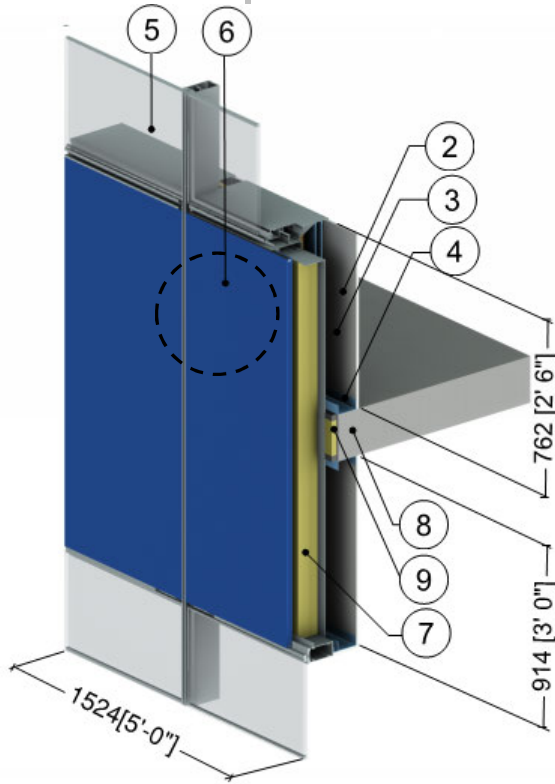



Connection Detail from Interior

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
6	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
7	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Steel Connection Bracket	-	347 (50)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 3.2.2 | Unitized Curtain Wall System – Intermediate Floor Intersection & Interior Spray Foam Insulation

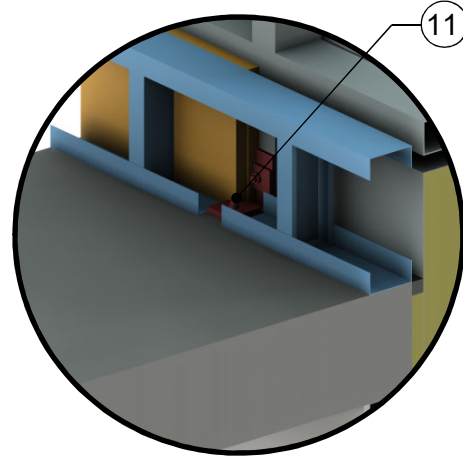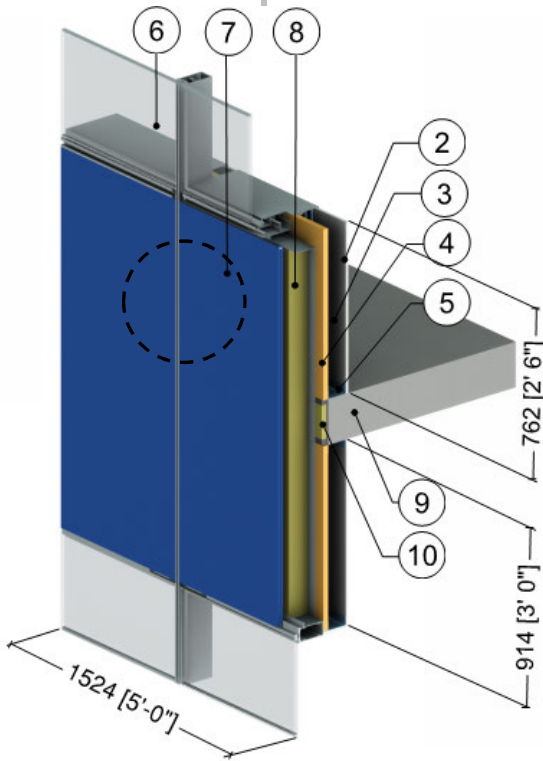

Connection Detail from Interior



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Spray Foam Insulation	2" (51)	0.17 (0.024)	R-12.0 (2.1 RSI)	2.8 (39)	0.35 (1470)
5	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
7	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
8	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
11	Steel Connection Bracket	-	347 (50)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 3.2.3

Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection

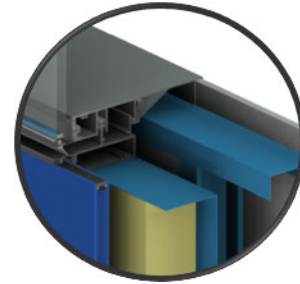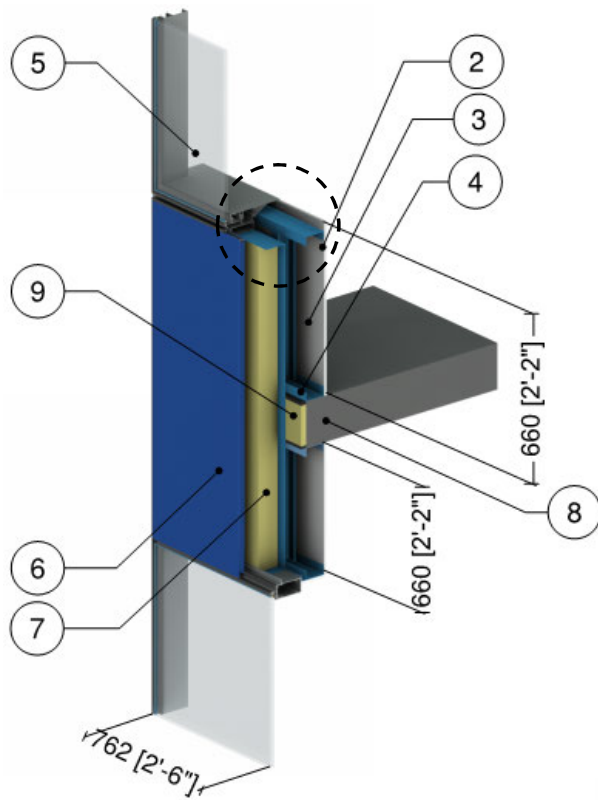

H0.1 – Double Glazed IGU with Aluminum Spacer



H0.2 – Double Glazed IGU with Silicone Warm Edge Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision Section: double glazed IGU with aluminum spacer (H0.1) or warm edge spacer (H0.2) ²					
6	Unitized Curtain Wall Spandrel Section with backpan insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


³ For a window to wall ratio of 50%

Detail 3.2.4


Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection

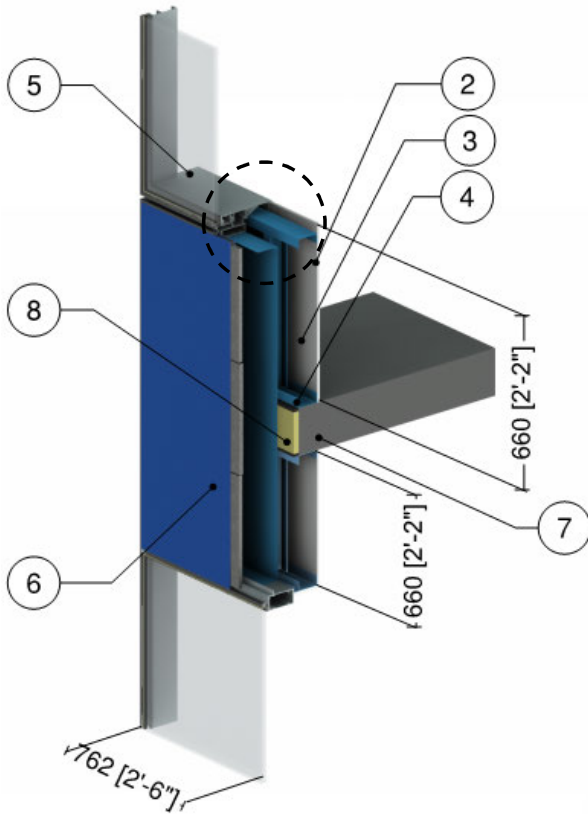

H1 – Warm Edge Spacer, 0.75" (19 mm) AIM between Glass

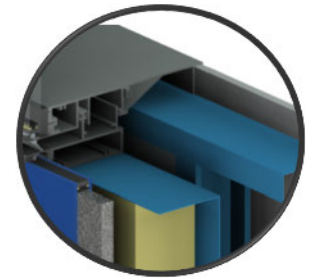

H2 – Warm Edge Spacer, 0.75" (19 mm) AIM between Glass with 4" (100 mm) Backpan Insulation

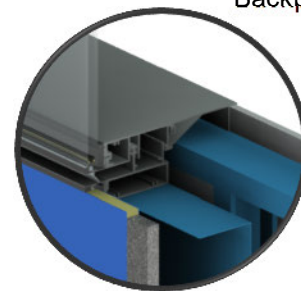

H3 – Rigid Insulation Spacer, 1" (25 mm) AIM between Metal Skins

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision Section: double glazed IGU with silicone warm edge spacer ²					
6	Unitized Curtain Wall Spandrel Section with varied insulation (see H1 to H3 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 3.2.5

Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – Insulated Backpan and Improved Glazing at Intermediate Floor Intersection

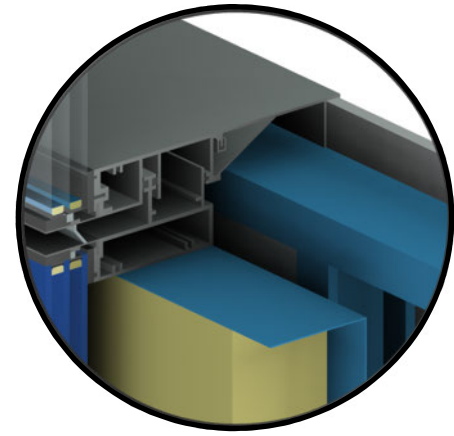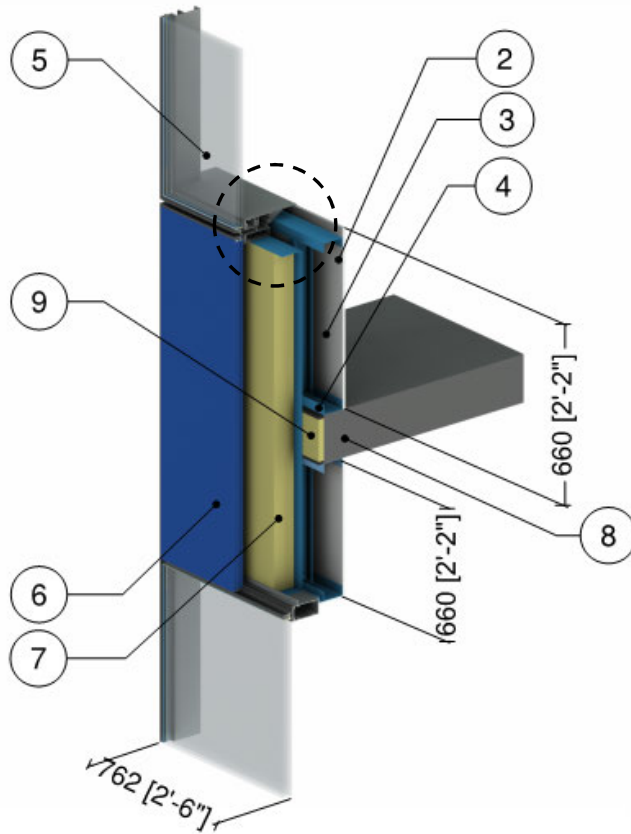

Triple Glazed IGU with Aluminum Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision Section: triple glazed IGU with aluminum spacer ²					
6	Unitized Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


³ For a window to wall ratio of 50%

Detail 3.2.6

Unitized Curtain Wall System with 4-Sided Structural Silicone Joints and 5' x 5' Spandrel Section – AIM Applications and Improved Glazing at Intermediate Floor Intersection

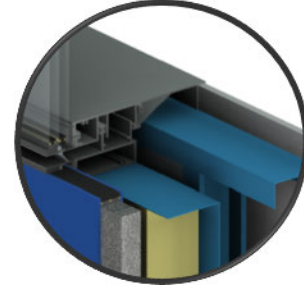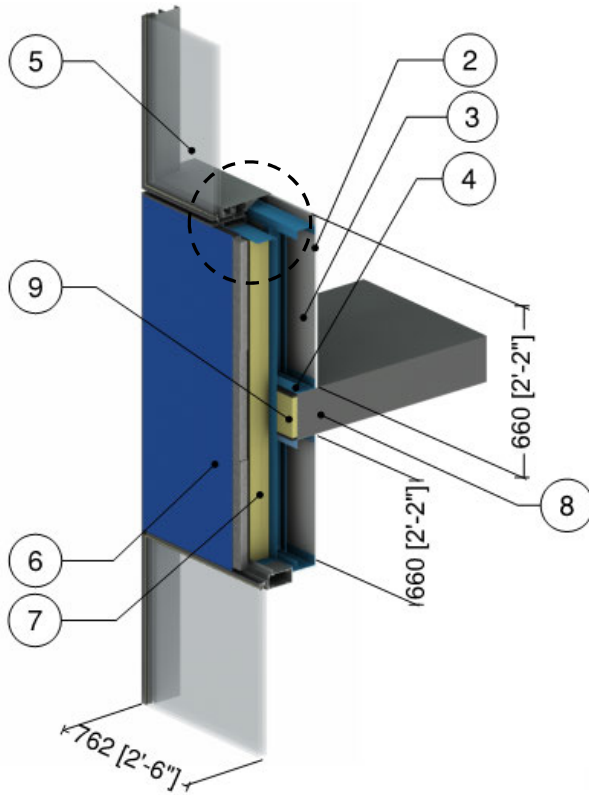

I1 – Warm Edge Spacer, 1.5" (38 mm) AIM between Glass

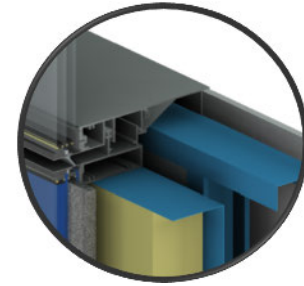

I2 – Warm Edge Spacer, Shadow AIM with 5/8" (16 mm) AIM between Glass

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Unitized Curtain Wall Vision Section: triple glazed IGU with silicone warm edge spacer ²					
6	Unitized Curtain Wall Spandrel Section with varied insulation (see I1 to I2 above) ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 3.3.1 | Unitized Curtain Wall System – Window Wall Transition

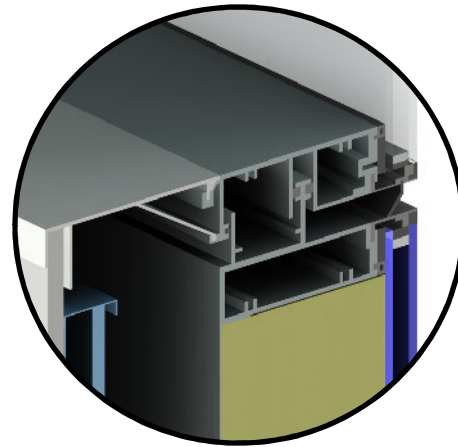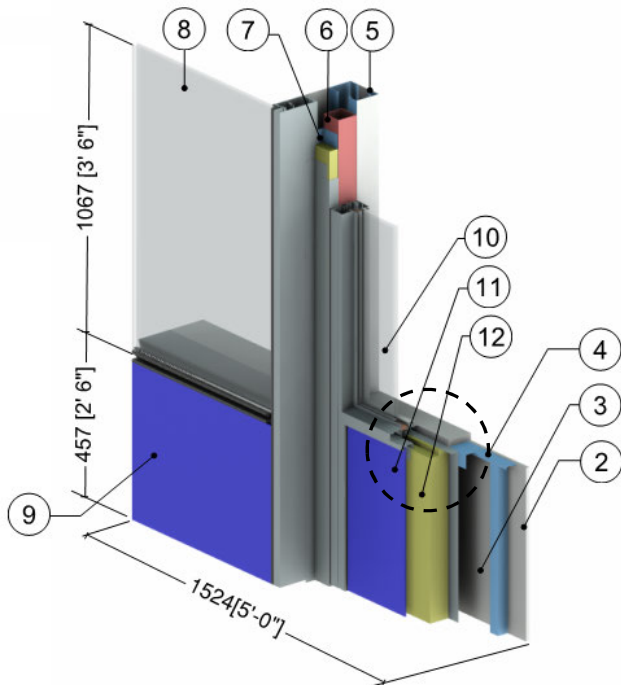



Unitized Curtain Wall Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 1/8" (79)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	3" x 3" x 1/8" HSS Column	1/8" (3.2)	430 (62)	-	489 (7830)	0.12 (500)
7	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
9	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
10	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
11	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
12	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 3.3.2 | Unitized Curtain Wall System – Window Wall Transition with Foam Insulation

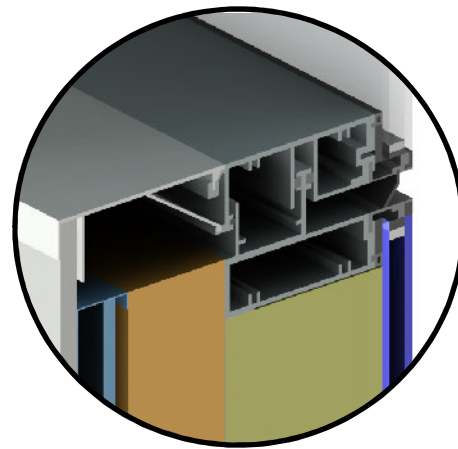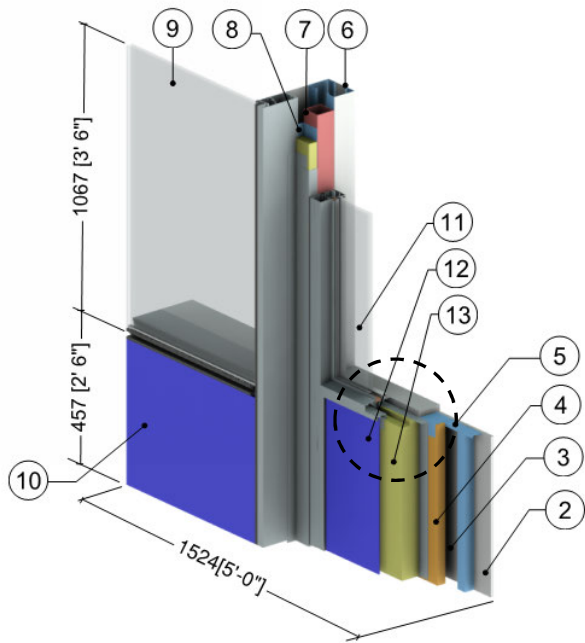

Unitized Curtain Wall Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Continuous Spray Foam Insulation	1 1/2" (38)	0.17 (0.024)	R-9.0 (1.58 RSI)	2.8 (39)	0.35 (1470)
5	1 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	3" x 3" x 1/8" HSS Column	1/8" (3.2)	430 (62)	-	489 (7830)	0.12 (500)
8	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Unitized Curtain Wall Vision System: structural silicone joints ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
10	Unitized Curtain Wall Spandrel System with Insulated Backpan: structural silicone joints ²					
11	Aluminum Window Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
12	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
13	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

4.0 High Performance Curtain Wall

Detail 4.1.1	A.4.1
High Performance Curtain Wall System – Spandrel Clear Wall & No Interior Stud Cavity Insulation	
Detail 4.1.2	A.4.2
High Performance Curtain Wall System – Spandrel Clear Wall & Interior Spray Foam Insulation	
Detail 4.2.1	A.4.3
High Performance Curtain Wall System – Intermediate Floor Intersection & No Interior Stud Cavity Insulation	
Detail 4.2.2	A.4.4
High Performance Curtain Wall System – Intermediate Floor Intersection & Interior Spray Foam Insulation	
Detail 4.2.3	A.4.5
High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates and 5’ x 5’ Spandrel Section – Insulated Backpan and Intermediate Floor Intersection	
Detail 4.2.4	A.4.6
High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates and 5’ x 5’ Spandrel Section – AIM Applications and Intermediate Floor Intersection	
Detail 4.2.5	A.4.7
High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates, Intermediate Mullion and 5’ x 5’ Spandrel Section – Insulated Backpan and Intermediate Floor Intersection	
Detail 4.2.6	A.4.8
High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates, Intermediate Mullion and 5’ x 5’ Spandrel Section – AIM Applications and Intermediate Floor Intersection	

Detail 4.1.1

High Performance Curtain Wall System – Spandrel Clear Wall & No Interior Stud Cavity Insulation

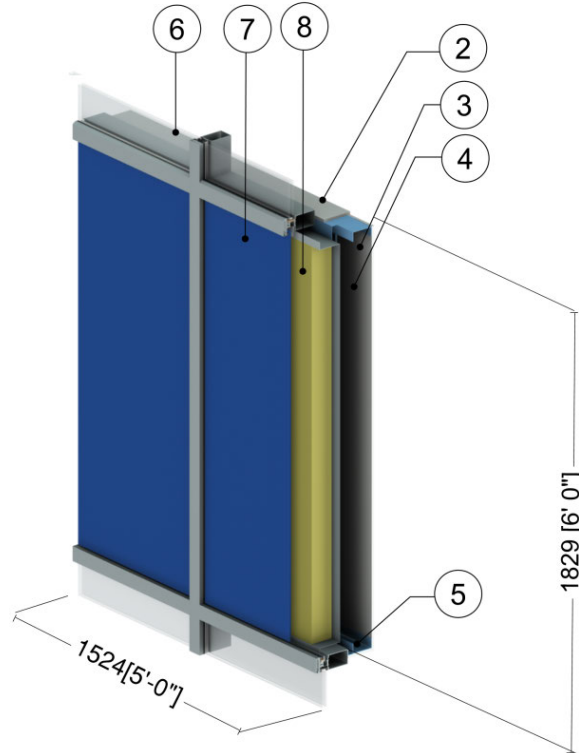


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	4 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	High Perf. Curtain Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82W/m ² K)					
7	High Perf. Curtain Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 4.1.2

High Performance Curtain Wall System – Spandrel Clear Wall & Interior Spray Foam Insulation


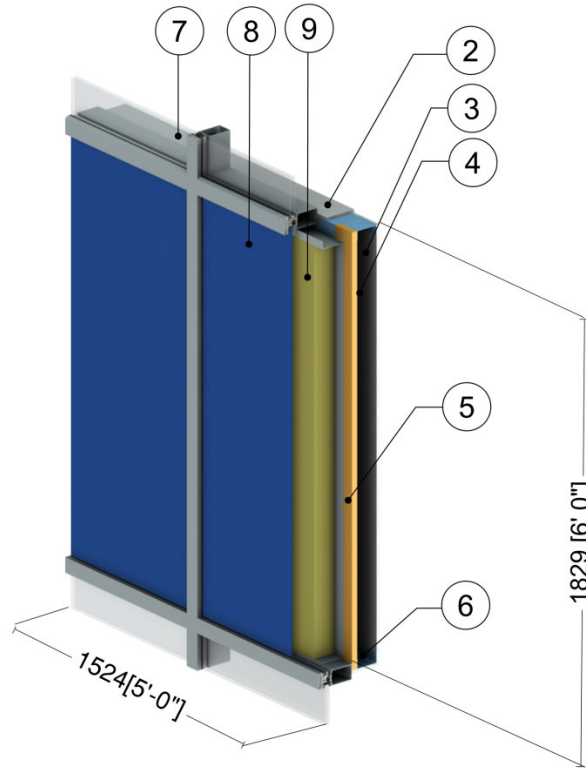


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	4 5/8" (117)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	2" (51)	0.17 (0.025)	R-11.5 (2.0 RSI)	2.8 (39)	0.35 (1470)
6	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	High Perf. Curtain Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82W/m ² K)					
8	High Perf. Curtain Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
9	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 4.2.1 High Performance Curtain Wall System – Intermediate Floor Intersection & No Interior Stud Cavity Insulation

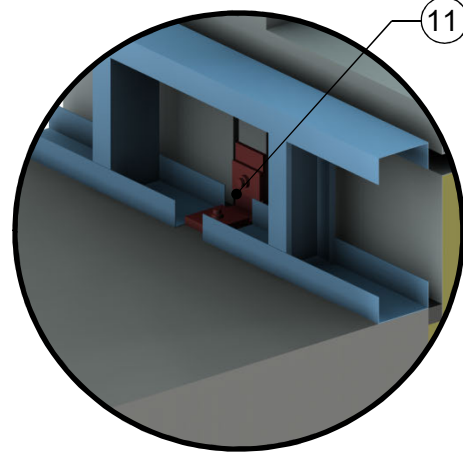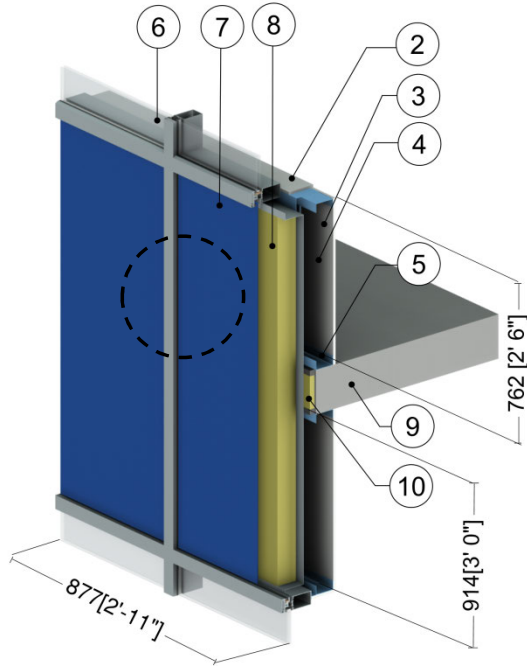



Connection Detail from Interior

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	High Perf. Curtain Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82W/m ² K)					
7	High Perf. Curtain Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
8	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
11	Steel Connection Bracket	-	347 (50)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 4.2.2 High Performance Curtain Wall System – Intermediate Floor Intersection & Interior Spray Foam Insulation

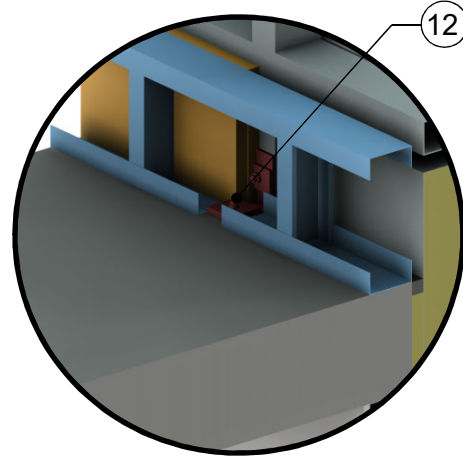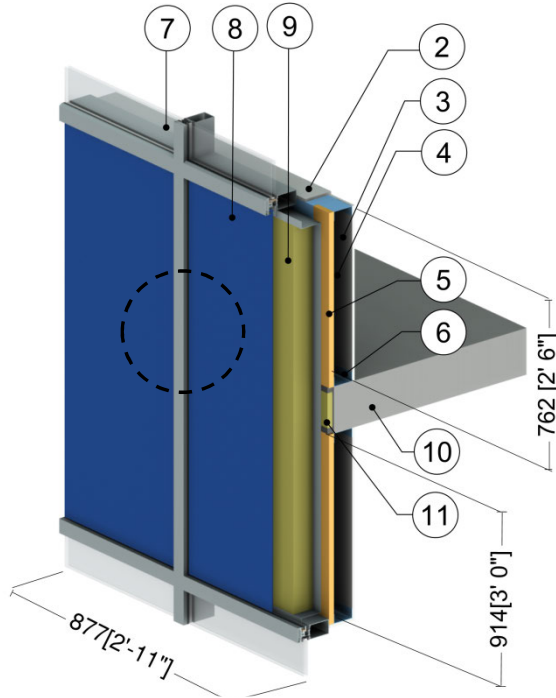

Connection Detail from Interior


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	1 1/2" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Air Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	2" (51)	0.17 (0.025)	R-11.5 (2.0 RSI)	2.8 (39)	0.35 (1470)
6	3 5/8" x 1 5/8" Steel Studs (16"o.c) w/ Top & Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	High Perf. Curtain Wall Vision System: thermally broken frame ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82W/m ² K)					
8	High Perf. Curtain Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
9	Backpan Insulation	Varies	0.24 (0.034)	R-8.4 to R-16.8 (1.48 to 2.96 RSI)	4 (64)	0.20 (850)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
12	Steel Connection Bracket	-	347 (50)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 4.2.3

High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection

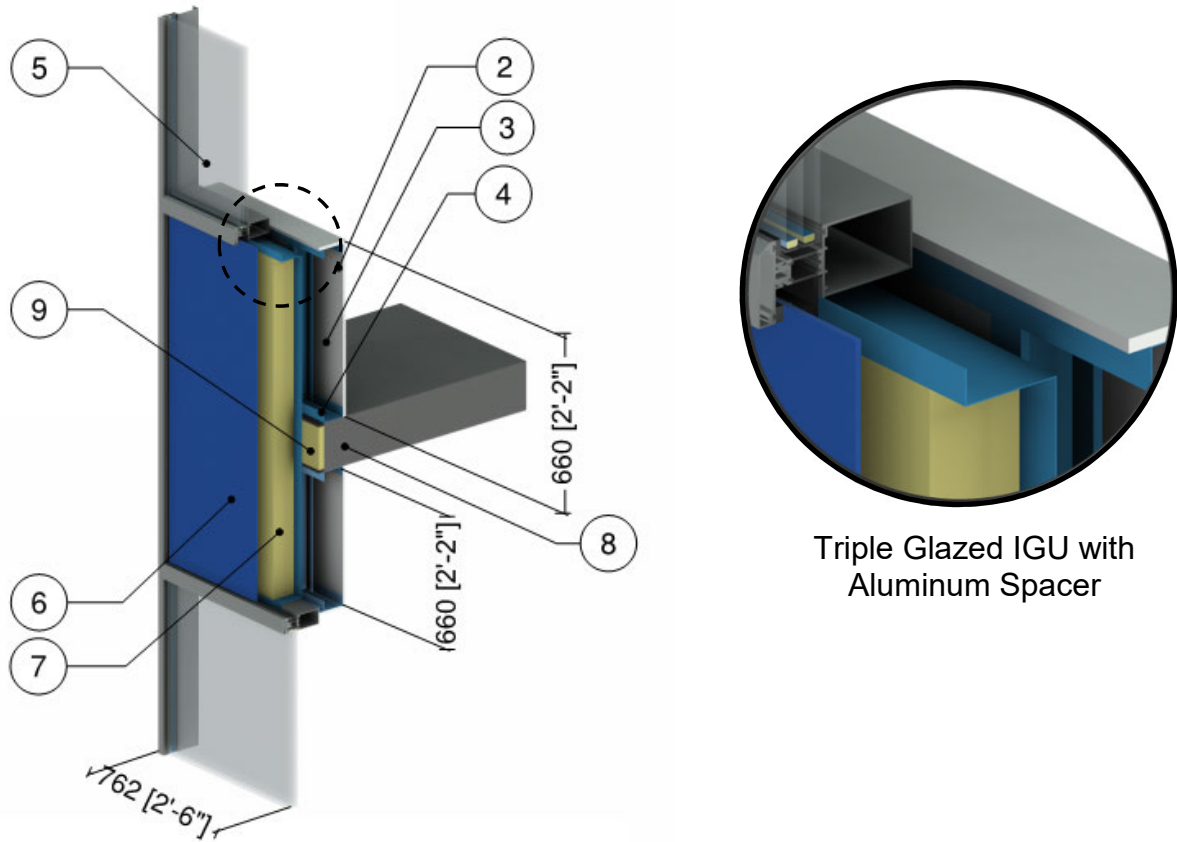

Triple Glazed IGU with Aluminum Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	High Performance Curtain Wall Vision Section: triple glazed IGU with aluminum spacer ²					
6	High Performance Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


³ For a window to wall ratio of 50%

Detail 4.2.4


High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection

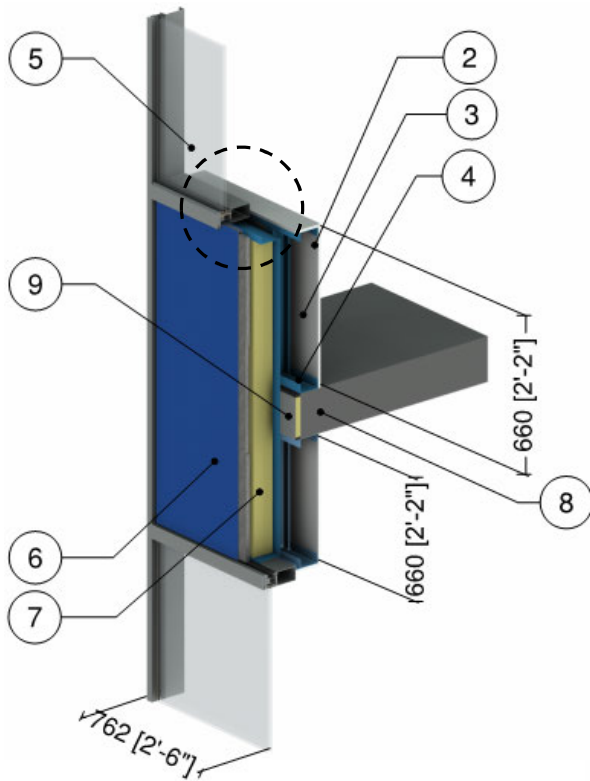


E1 – Warm Edge Spacer, 0.75" (19 mm) AIM between Glass

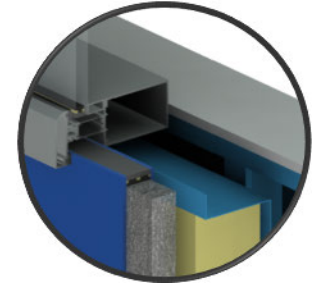

E2 – Warm Edge Spacer, 1.5" (38 mm) AIM between Glass



E3 – Warm Edge Spacer, 1.5" (38 mm) AIM between Glass

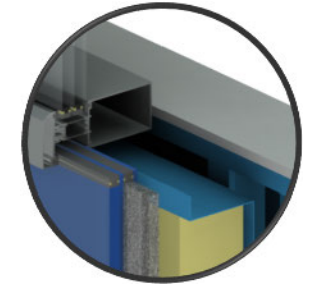

E4 – Warm Edge Saproer, Shadow AIM with 5/8" (16 mm) AIM in Secondary Unit

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	High Performance Curtain Wall Vision Section: double glazed (E1 & E2) or triple glazed (E3 & E4) IGU with warm edge spacer ²					
6	High Performance Curtain Wall Spandrel Section with varied insulation (see E1 to E4 above) ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

Detail 4.2.5

High Performance Curtain Wall System with Vertical and Horizontal Pressure Plates, Intermediate Mullion and 5' x 5' Spandrel Section – Insulated Backpan and Intermediate Floor Intersection

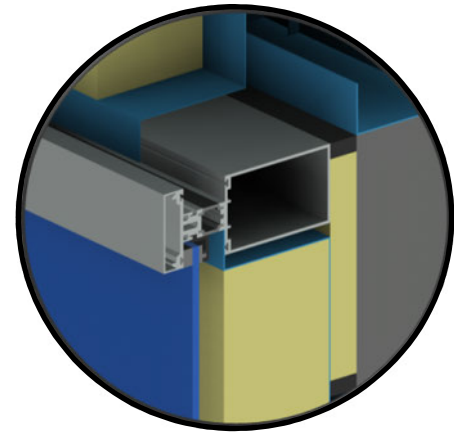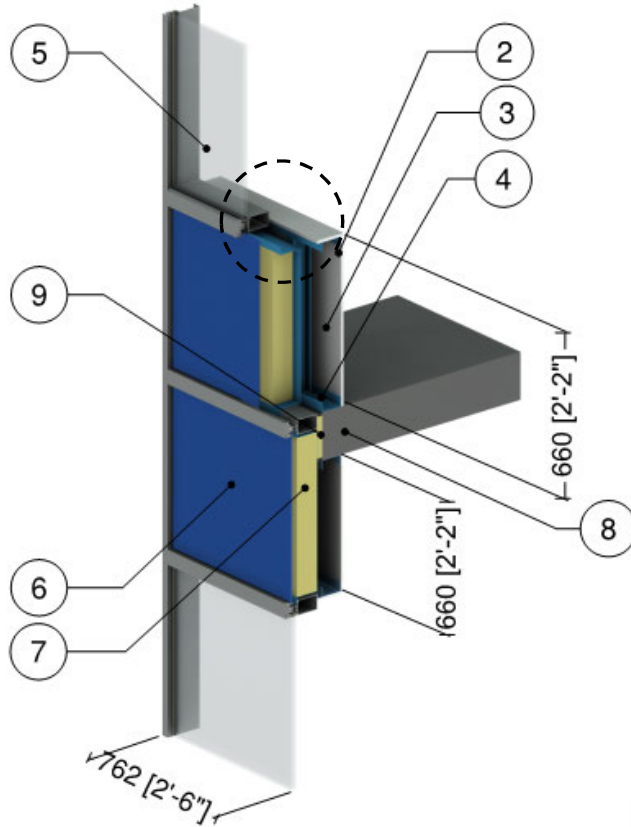

Double Glazed IGU with Silicone Warm Edge Spacer

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	High Performance Curtain Wall Vision Section: double glazed IGU with silicone warm edge spacer ²					
6	High Performance Curtain Wall Spandrel Section with Backpan Insulation ^{2,3}					
7	Backpan Insulation	4" (100)	0.24 (0.034)	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


³ For a window to wall ratio of 50%

Detail 4.2.6


High Performance Curtain Wall System with Vertical Pressure Plates, Intermediate Mullion and 5' x 5' Spandrel Section – AIM Applications and Intermediate Floor Intersection

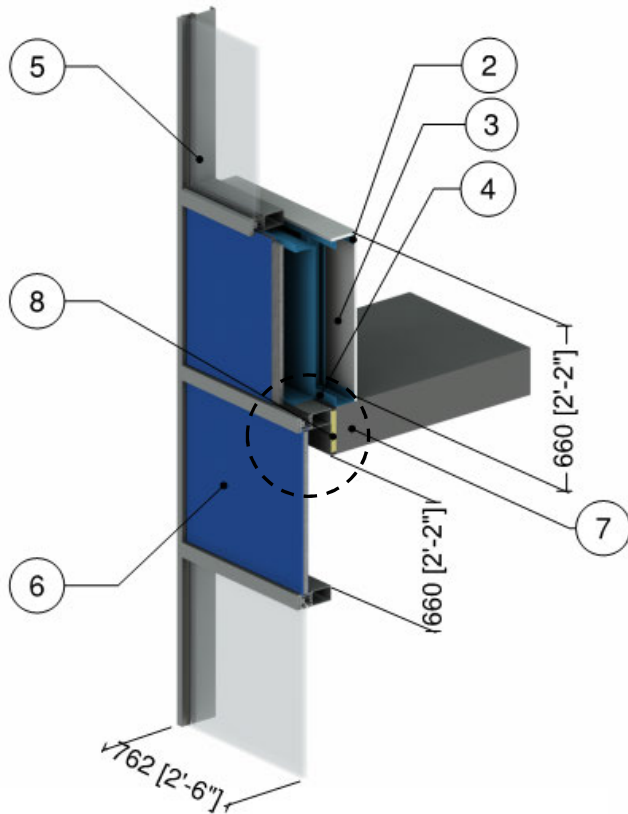

F1 – Warm Edge Spacer, 0.75" (19 mm) AIM between Glass

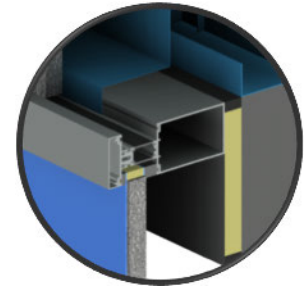

F2 – Rigid Insulation Spacer, 1" (25 mm) AIM between Metal Skins



F3 – Warm Edge Spacer, 1.5" (38 mm) AIM between Glass

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.12 RSI) to R-1.1 (0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	High Performance Curtain Wall Vision Section: double glazed (F1 & F2) or triple glazed (F3) IGU with warm edge spacer ²					
6	High Performance Curtain Wall Spandrel Section with varied insulation (see F1 to F3 above) ^{2,3}					
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Mineral Wool Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.74 RSI)	4 (64)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ For a window to wall ratio of 50%

AIM = Architectural Insulation Module

5.0 Steel Frame Construction

Detail 5.1.1	A.5.1
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Clear Wall	
Detail 5.1.2	A.5.2
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Clear Wall	
Detail 5.1.3	A.5.3
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (16" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.4	A.5.4
Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (16" o.c.) – Clear Wall	
Detail 5.1.5	A.5.5
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.6	A.5.6
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-girts (16" o.c.) Supporting Stucco Cladding – Clear Wall	
Detail 5.1.7	A.5.7
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.8	A.5.8
Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) – Clear Wall	
Detail 5.1.9	A.5.9
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (24" o.c.) & Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.10	A.5.10
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-Girts (16" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.11	A.5.11
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Clips (24" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.12	A.5.12
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Clips (24" o.c.) Supporting Metal Cladding – Clear Wall	
Detail 5.1.13	A.5.13

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Clips (16" o.c.) Supporting Stucco Cladding – Clear Wall	
Detail 5.1.14	A.5.14
Exterior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 5.1.15	A.5.15
Exterior and Interior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 5.1.16	A.5.16
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with CL-Talon 300 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.17	A.5.17
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Supporting Cladding – Clear Wall	
Detail 5.1.18	A.5.18
Exterior Insulated 3 5/8" x 1/58" Steel Stud (16"o.c.) Wall Assembly with TAC Fiber Reinforced Plastic Girts Supporting Cladding – Clear Wall	
Detail 5.1.19	A.5.19
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 5.1.20	A.5.20
Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (8" o.c.) – Clear Wall	
Detail 5.1.21	A.5.21
Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (16" o.c.) – Clear Wall	
Detail 5.1.22	A.5.22
Exterior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (8" o.c.) – Clear Wall	
Detail 5.1.23	A.5.23
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with R-TEC CI Bracket System Supporting Vertical Sub-girts – Clear Wall	
Detail 5.1.24	A.5.24
Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with R-TEC CI Bracket System Supporting Vertical Sub-girts – Clear Wall	
Detail 5.1.25	A.5.25
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts – Clear Wall	

Detail 5.1.26	A.5.26
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Clear Wall	
Detail 5.1.27	A.5.27
Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts – Clear Wall	
Detail 5.1.28	A.5.28
Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Clear Wall	
Detail 5.1.29	A.5.29
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.30	A.5.30
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.31	A.5.31
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Cascadia Clip Fiberglass Thermal Spacers – Clear Wall	
Detail 5.1.32	A.5.32
Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-20 Batt Insulation in Stud Cavity– Clear Wall	
Detail 5.1.33	A.5.33
Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-22.5 Batt Insulation in Stud Cavity– Clear Wall	
Detail 5.1.34	A.5.34
Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-24 Batt Insulation in Stud Cavity– Clear Wall	
Detail 5.1.35	A.5.35
Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-20 Batt Insulation in Stud Cavity – Clear Wall	
Detail 5.1.36	A.5.36
Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-22.5 Batt Insulation in Stud Cavity – Clear Wall	
Detail 5.1.37	A.5.37

Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-24 Batt Insulation in Stud Cavity – Clear Wall

Detail 5.1.38 **A.5.38**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Zinc 2-Seal Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.39 **A.5.39**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.40 **A.5.40**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Wing Nut Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.41 **A.5.41**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel X-Seal Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.42 **A.5.42**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel X-Seal Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.43 **A.5.43**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel HB-213 2X Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.44 **A.5.44**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel HB-213 2X Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.45 **A.5.45**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel HB-200-X Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.46 **A.5.46**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel HB-200-X Anchor Supporting Brick Veneer – Clear Wall

Detail 5.1.47 **A.5.47**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel BL-407 Anchor Supporting Brick Veneer – Clear Wall	
Detail 5.1.48	A.5.48
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel BL-407 Anchor Supporting Brick Veneer – Clear Wall	
Detail 5.1.49	A.5.49
Vertical Insulated Metal Panel – Clear Wall with Vertical Connection Joint and Support Girt/Hat Track Backup Wall	
Detail 5.1.50	A.5.50
Vertical Insulated Metal Panel – Metal Stack Joint and Support Girt Back/Hat Track Backup Wall	
Detail 5.1.51	A.5.51
Horizontal Insulated Metal Panel – Clear Wall with Horizontal Connection Joint and Steel Stud Backup Wall	
Detail 5.1.52	A.5.52
Horizontal Insulated Metal Panel – Vertical Gasket Joint with Steel Stud Backup Wall	
Detail 5.1.53	A.5.53
Structural Sheet Steel Wall with Cladding Supported by Notched Z-Bar for Baseline System – Clear Wall	
Detail 5.1.54	A.5.54
Structural Sheet Steel Wall with Cladding Supported by Intermittent Notched Z- Bar – Clear Wall	
Detail 5.1.55	A.5.55
Structural Sheet Steel Wall with Cladding Supported by Thermal Chairs – Clear Wall	
Detail 5.1.56	A.5.56
2 Hour Fire Rated Structural Steel Sheet Wall with Cladding Supported by Notched Z-bar with Ceramic Blanket – Clear Wall	
Detail 5.1.57	A.5.57
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System (16" o.c.) Supporting Horizontal and Vertical Sub-girts – Clear Wall	
Detail 5.1.58	A.5.58
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System (32" o.c.) Supporting Horizontal and Vertical Sub-girts – Clear Wall	
Detail 5.1.59	A.5.59

Exterior and Interior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.60	A.5.60
Exterior and Interior Insulated 6" x 1 5/8" Slotted Steel R-Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.61	A.5.61
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobacket Clip System Supporting Cladding – Clear Wall	
Detail 5.1.62	A.5.62
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobacket and NV1 Clip System Supporting Cladding – Clear Wall	
Detail 5.1.63	A.5.63
Exterior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Vci Vertical System – Clear Wall	
Detail 5.1.64	A.5.64
Exterior and Interior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Vci Vertical System – Clear Wall	
Detail 5.1.65	A.5.65
Exterior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Hci Horizontal System – Clear Wall	
Detail 5.1.66	A.5.66
Exterior and Interior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Hci Horizontal System – Clear Wall	
Detail 5.1.67	A.5.67
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Horizontal Z-Girts Supporting Cladding – Clear Wall	
Detail 5.1.68	A.5.68
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Horizontal Z-Girts Supporting Cladding – Clear Wall	
Detail 5.1.69	A.5.69
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Vertical Z-Girts Supporting Cladding – Clear Wall	
Detail 5.1.70	A.5.70
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Vertical Z-Girts Supporting Cladding – Clear Wall	
Detail 5.2.1	A.5.71

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection	
Detail 5.2.2	A.5.72
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection with Top Side Insulation	
Detail 5.2.3	A.5.73
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection with Top & Under Side Insulation	
Detail 5.2.4	A.5.74
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Uninsulated Curb	
Detail 5.2.5	A.5.75
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Uninsulated Curb	
Detail 5.2.6	A.5.76
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Insulated Curb	
Detail 5.2.7	A.5.77
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Insulated Curb	
Detail 5.2.8	A.5.78
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Uninsulated Intermediate Floor Intersection	
Detail 5.2.9	A.5.79
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Isokorb CM20 Thermally Broken Slab Projection without Concrete Curb	
Detail 5.2.10	A.5.80
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Isokorb CM20 Thermally Broken Slab Projection without Concrete Curb	
Detail 5.2.11	A.5.81

- Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Uninsulated Curb
- Detail 5.2.12** **A.5.82**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Uninsulated Curb
- Detail 5.2.13** **A.5.83**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Insulated Curb
- Detail 5.2.14** **A.5.84**
- Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Insulated Curb
- Detail 5.2.15** **A.5.85**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Intermediate Floor Intersection
- Detail 5.2.16** **A.5.86**
- Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Intermediate Floor Intersection
- Detail 5.2.17** **A.5.87**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts – Intermediate Concrete Floor Intersection
- Detail 5.2.18** **A.5.88**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Intermediate Concrete Floor Intersection
- Detail 5.2.19** **A.5.89**
- Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-girts (16" o.c.) Supporting Stucco Cladding – Steel Framed Floor with Cross Cavity Flashing
- Detail 5.2.20** **A.5.90**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Fiberglass Spacer and Through Insulation Fasteners Supporting Cladding – Insulated Intermediate Floor Intersection
- Detail 5.2.21** **A.5.91**
- Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Aluminum Clip Horizontal Sub-girt System Supporting Cladding – Intermediate Floor Intersection

Detail 5.2.22	A.5.92
Exterior Insulated 3 5/8" x 1/58" Steel Stud (16"o.c.) Wall Assembly with TAC Fiber Reinforced Plastic Girts Supporting Cladding – Intermediate Floor Intersection	
Detail 5.2.23	A.5.93
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Intermediate Floor Intersection	
Detail 5.2.24	A.5.94
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Framed Floor Intersection	
Detail 5.2.25	A.5.95
Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Framed Floor Intersection	
Detail 5.2.26	A.5.96
Vertical Insulated Metal Panel - Corrugated Slab Intersection with I-beam – Open Web Steel Joist and Support Girt/Hat Track Backup Wall	
Detail 5.2.27	A.5.97
Horizontal Insulated Metal Panel – Corrugated Slab Intersection with I-beam – Open Web Steel Joist and Steel Stud Backup Wall	
Detail 5.2.28	A.5.98
Exterior and Interior Insulated Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection	
Detail 5.2.29	A.5.99
Exterior and Interior Insulated Wall Assembly with Spaced Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection	
Detail 5.2.30	A.5.100
Exterior and Interior Insulated Wall Assembly with Thermally Broken Steel Shelf Angle & Brick Ties Supporting Brick Veneer – Slab Intersection	
Detail 5.2.31	A.5.101
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud Wall Assembly with Horizontal Z-girts Supporting Metal Cladding – Armatherm 500 Thermally Broken Slab Projection with Insulated Curb	
Detail 5.2.32	A.5.102
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud Wall Assembly with Armatherm Z-girts Supporting Metal Cladding – Armatherm 500-080 Thermally Broken Slab Projection with Insulated Curb	
Detail 5.2.33	A.5.103

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobrace and NV1 Clip System Supporting Cladding – Intermediate Floor Intersection	
Detail 5.3.1	A.5.104
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection	
Detail 5.3.2	A.5.105
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection	
Detail 5.3.3	A.5.106
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Window & Intermediate Floor Intersection	
Detail 5.3.4	A.5.107
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Window and Intermediate Floor Intersection	
Detail 5.3.5	A.5.108
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Window and Intermediate Floor Intersection	
Detail 5.3.6	A.5.109
Vertical Insulated Metal Panel – Window Glazing Transition with Steel Support Framing	
Detail 5.3.7	A.5.110
Horizontal Insulated Metal Panel – Window Glazing Transition with Steel Support Framing	
Detail 5.3.8	A.5.111
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window with Aerogel and Intermediate Floor Intersection	
Detail 5.3.9	A.5.112
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window with Aerogel and Floor Slab Intersection	
Detail 5.3.10	A.5.113
Interior Insulated Steel Frame Wall Assembly with Brick Cladding – Window Intersection	
Detail 5.3.11	A.5.114
Interior Insulated Steel Frame Wall Assembly with Brick Cladding – Window Intersection Aligned with Insulation	
Detail 5.3.12	A.5.115

Exterior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Steel Framing	
Detail 5.3.13	A.5.116
Exterior and Interior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Steel Framing	
Detail 5.3.14	A.5.117
Exterior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation	
Detail 5.3.15	A.5.118
Exterior and Interior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation	
Detail 5.4.1	A.5.119
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Conventional Curtain Wall Transition	
Detail 5.4.2	A.5.120
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Conventional Curtain Wall Transition	
Detail 5.4.3	A.5.121
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly – Curtain Wall Transition	
Detail 5.4.4	A.5.122
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Conventional Curtain Wall Intersection	
Detail 5.4.5	A.5.123
Exterior Insulated Concrete Wall and Steel Stud Assembly Supporting Metal Cladding – Curtain Wall Transition Intersection	
Detail 5.4.6	A.5.124
Exterior Insulated Concrete Wall and Steel Stud Assembly Supporting Metal Cladding with Cavity Insulation – Curtain Wall Transition Intersection	
Detail 5.5.1	A.5.125
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection	

Detail 5.5.2	A.5.126
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection	
Detail 5.5.3	A.5.127
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection	
Detail 5.5.4	A.5.128
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection	
Detail 5.5.5	A.5.129
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Concrete Parapet & Slab Intersection	
Detail 5.5.6	A.5.130
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Concrete Parapet and Slab Intersection	
Detail 5.5.7	A.5.131
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Concrete Parapet & Slab Intersection	
Detail 5.5.8	A.5.132
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z Girts (16" o.c.) Supporting Metal Cladding – Concrete Roof Deck at Continuous Concrete Parapet	
Detail 5.5.9	A.5.133
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z Girts (16" o.c.) Supporting Metal Cladding – Concrete Roof Deck at Isokorb AXT1 Thermally Broken Concrete Parapet	
Detail 5.5.10	A.5.134
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection	
Detail 5.5.11	A.5.135
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection with Thermal Break under Parapet Stud Cavity	
Detail 5.5.12	A.5.136
Vertical Insulated Metal Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection	

Detail 5.5.13	A.5.138
Horizontal Insulated Metal Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection	
Detail 5.6.1	A.5.139
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Corner Intersection	
Detail 5.6.2	A.5.140
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Corner Intersection	
Detail 5.6.3	A.5.141
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Corner Intersection	
Detail 5.6.4	A.5.142
Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Corner Intersection with Alternative Framing	
Detail 5.6.5	A.5.143
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Corner Intersection	
Detail 5.6.6	A.5.144
Window Wall System – Transition to Exterior Insulated Steel Stud Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding & No Interior Stud Cavity Insulation	
Detail 5.6.7	A.5.145
Window Wall System – Transition to Exterior Insulated Steel Stud Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding & Interior Sprayfoam and Fibreglass Batt Insulation	
Detail 5.6.8	A.5.146
Vertical Insulated Metal Panel – Corner Intersection with Post and Support Girt/Hat Track Backup Wall	
Detail 5.6.9	A.5.147
Horizontal Insulated Metal Panel – Corner Intersection with Post and Steel Stud Backup Wall	
Detail 5.7.1	A.5.148
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Column & Cantilever Beam Intersection (Canopy Support)	
Detail 5.7.2	A.5.149

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Uninterrupted Beam

Detail 5.7.3 **A.5.150**

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Isolator Pad

Detail 5.7.4 **A.5.151**

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Isokorb S22 Thermally Broken Beam

Detail 5.7.5 **A.5.152**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam Connection

Detail 5.7.6 **A.5.153**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam with a Thermal Isolator Pad Connection

Detail 5.7.7 **A.5.154**

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam with Isokorb KS14 Connection

Detail 5.7.8 **A.5.155**

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Beam Thermal Break


Detail 5.7.9 **A.5.156**

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Aerolon Coating

Detail 5.8.1 **A.5.157**

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Interior Wall Intersection

Detail 5.1.1 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Clear Wall

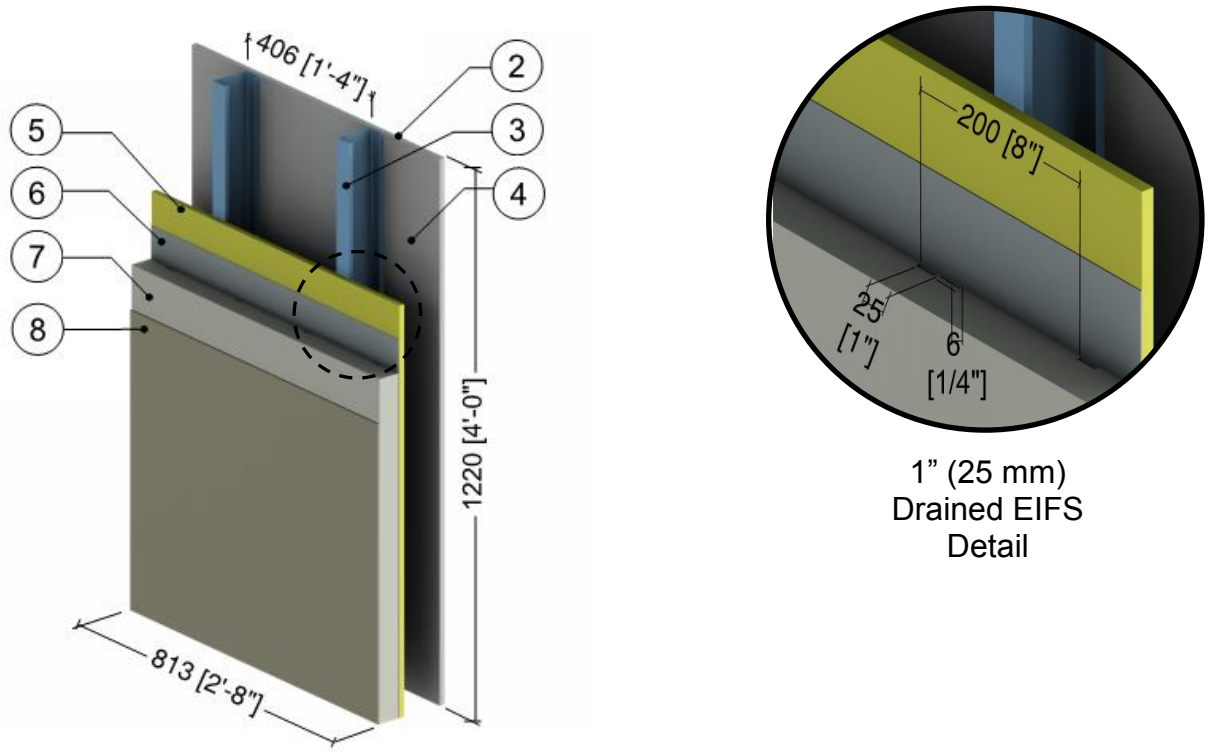



1" (25 mm)
Drained EIFS
Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistant Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	2" to 4" (50 to 100)	0.27 (0.039)	R-7.5 to R-15 (1.32 to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.2

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Clear Wall

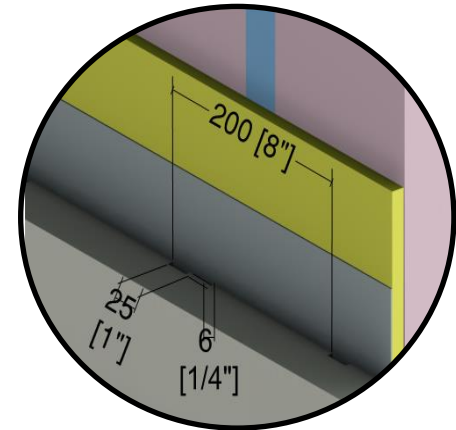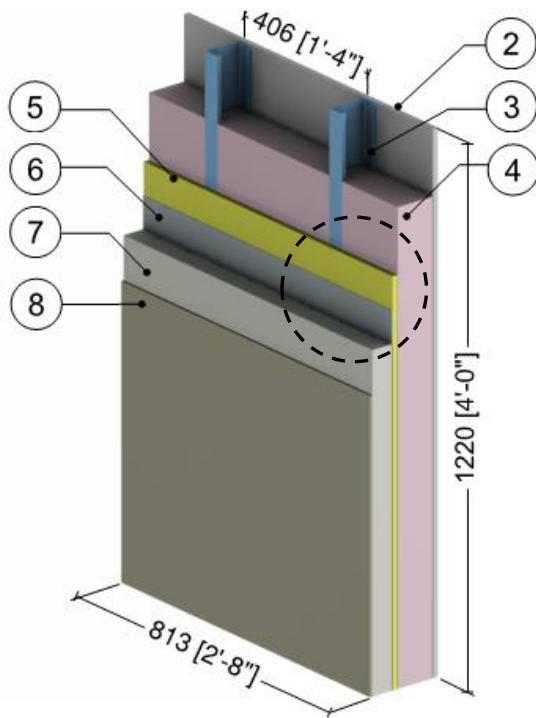


1" (25 mm)
Drained EIFS
Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistant Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	2" to 4" (50 to 100)	0.27 (0.039)	R-7.5 to R-15 (1.32 to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.3


Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (16" o.c.) Supporting Metal Cladding – Clear Wall

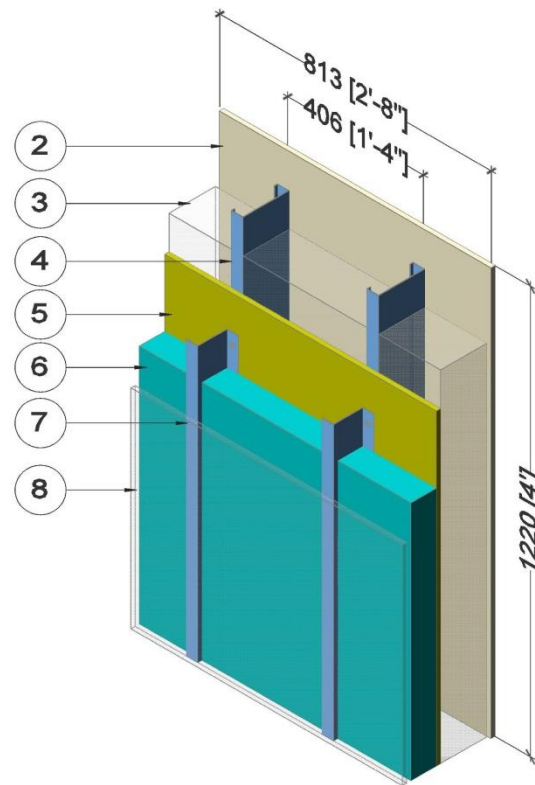

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Vertical Z-Girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.4 Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (16" o.c.) – Clear Wall

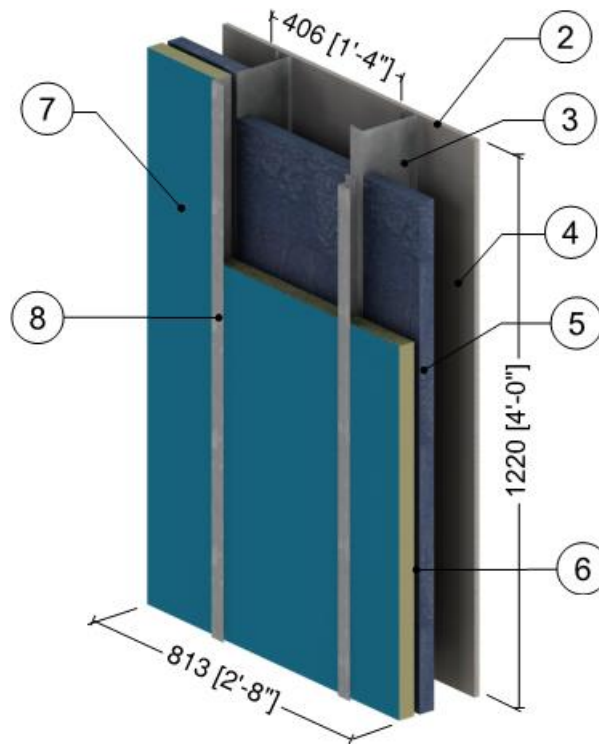


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	5/8" (16)	0.09 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (105)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	1 1/2" (38)	-	R-9.8 (1.73 RSI)	-	-
6	Exterior Sheathing	5/8" (16)	0.09 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
7	Exterior Polyisocyanurate Insulation	1 1/2" (38)	-	R-10.1 (1.78 RSI)	-	-
8	Vertical Z-Girts (16" o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
9	Metal Cladding with vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.5

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall


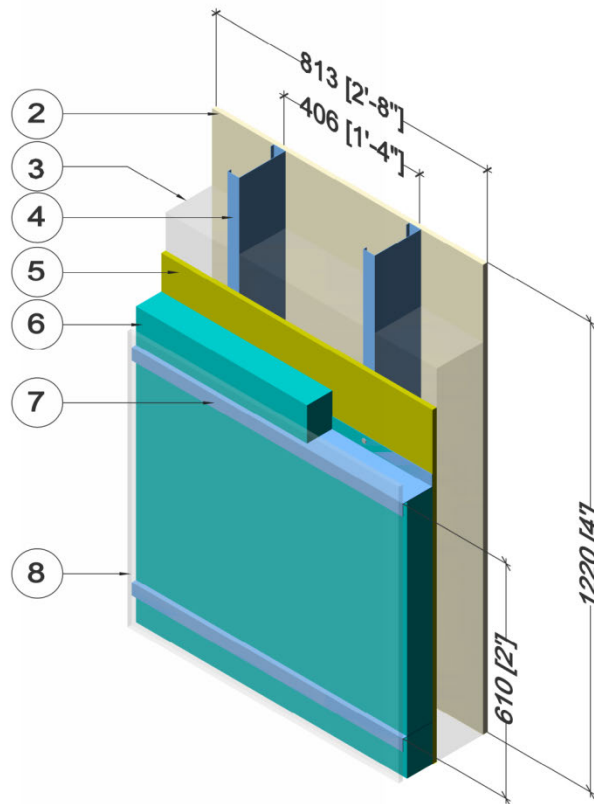


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.6

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-girts (16" o.c.) Supporting Stucco Cladding – Clear Wall

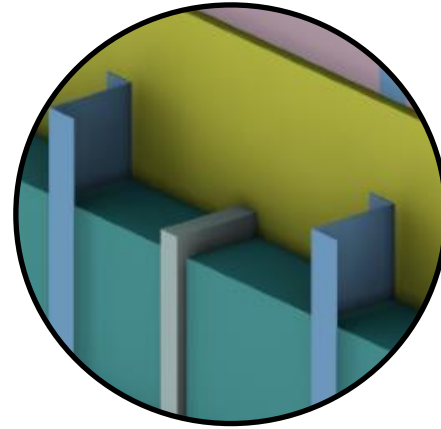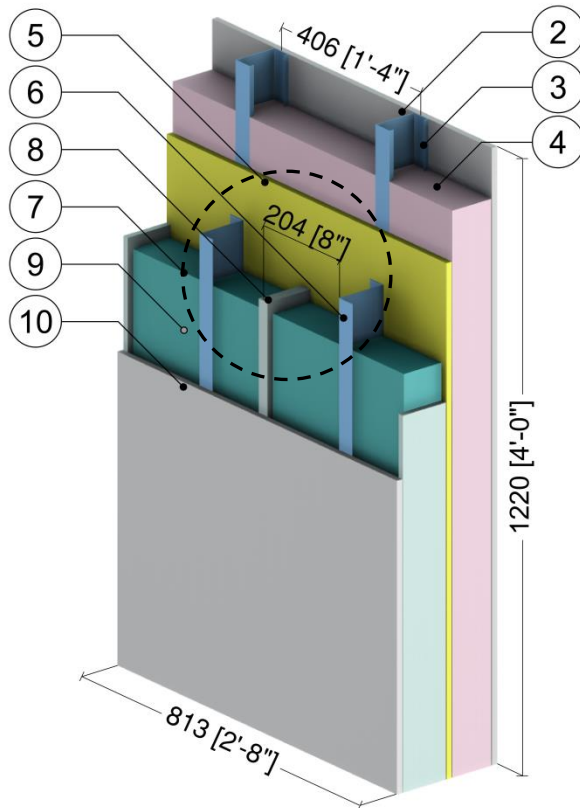


Bracing Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-20 (1.76 to 3.52 RSI)	1.8 (28)	0.29 (1220)
8	Rigid Insulation Bracing	Varies	0.2 (0.029)	-	1.8 (28)	0.29 (1220)
9	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
10	Stucco Cement with Breather Board	1/2" (13)	6 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.7


Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall

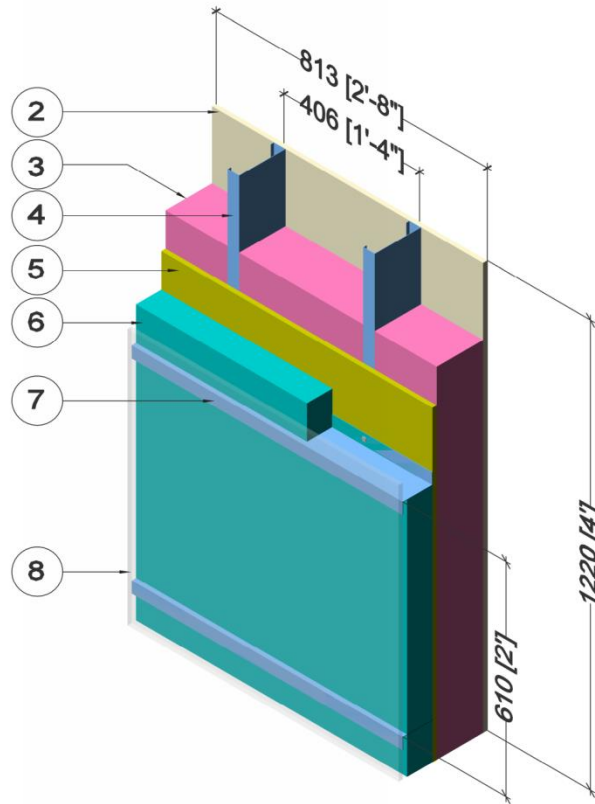

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.8 Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) – Clear Wall

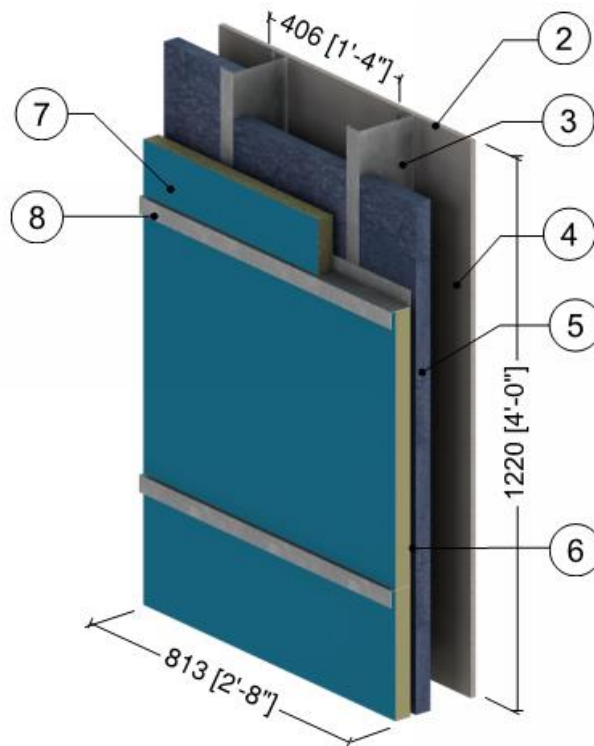


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (105)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	1 1/2" (38)	-	R-9.8 (1.73 RSI)	-	-
6	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
7	Exterior Polyisocyanurate Insulation	1 1/2" (38)	-	R-10.1 (1.78 RSI)	-	-
8	Horizontal Z-Girts (24" o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
9	Metal Cladding with vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.9

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-Girts (24" o.c.) & Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Clear Wall

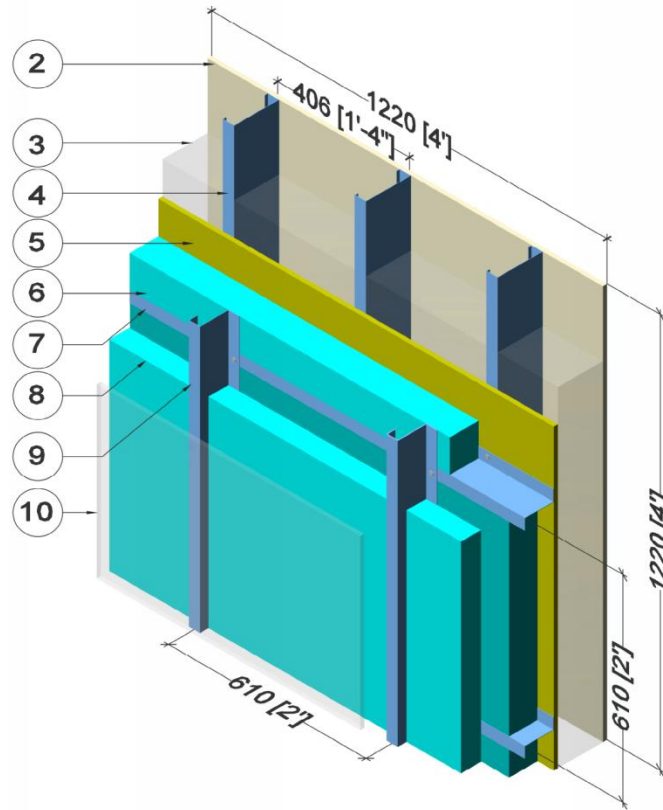


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation – Horizontal Z-Girts	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Insulation – Vertical Z-girts	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
9	Vertical Z-Girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.10

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-Girts (16" o.c.) Supporting Metal Cladding – Clear Wall

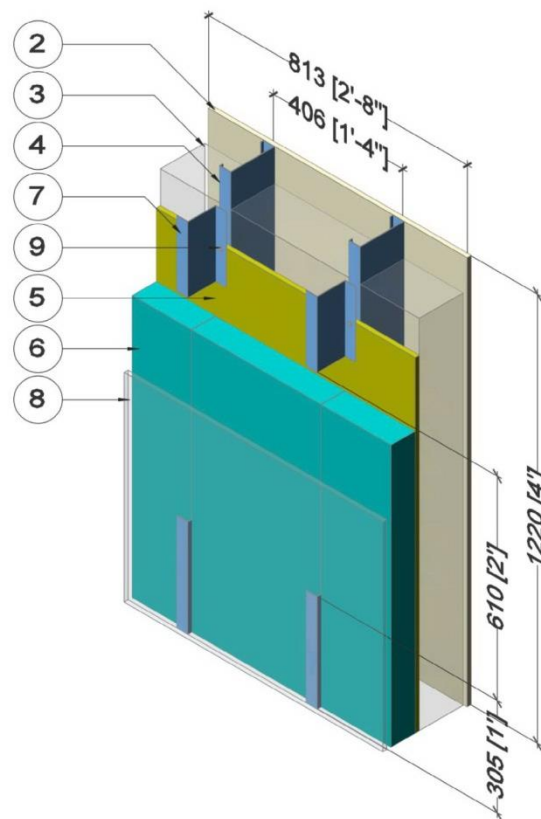


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Intermittent vertical Z-Girts w/ 1 1/2" Flange ²	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² Vertical spacing of the girts Varies at 12" (304mm), 24" (610mm) & 36" (915mm)

Detail 5.1.11

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Clips (24" o.c.) Supporting Metal Cladding – Clear Wall


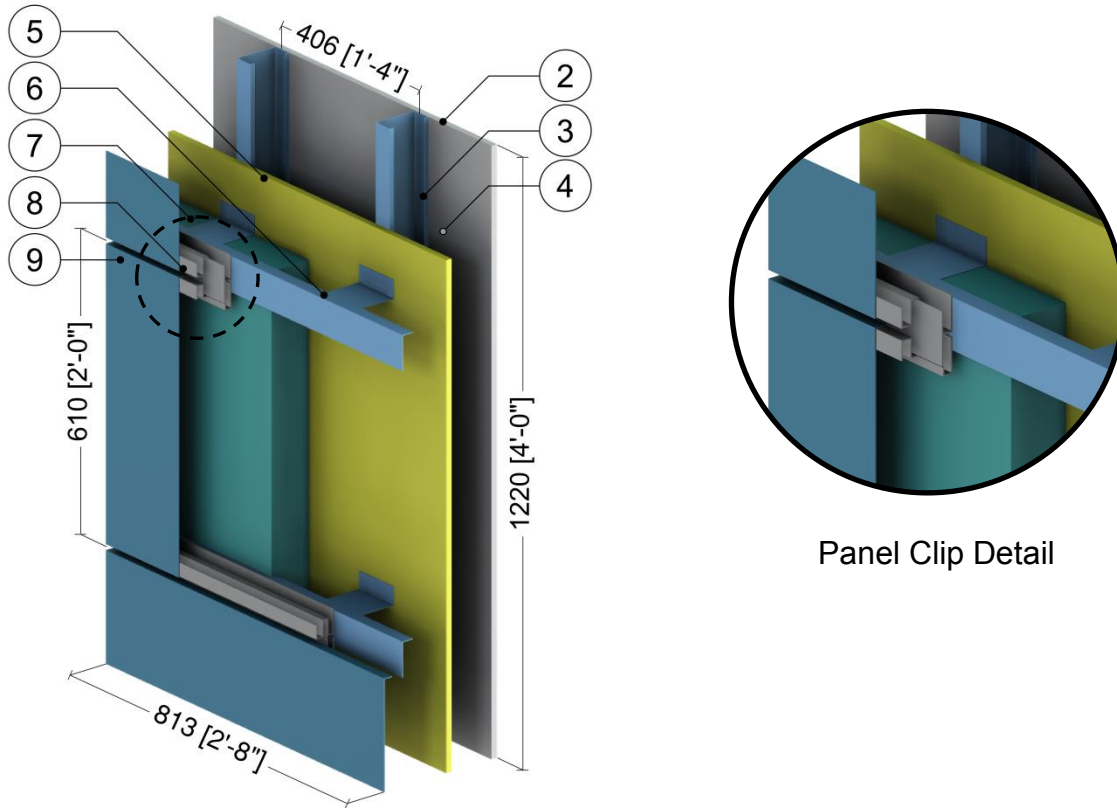


Panel Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
6	Horizontal Clips w/ 1 1/2" Horizontal Rail	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.12 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Clips (24" o.c.) Supporting Metal Cladding – Clear Wall

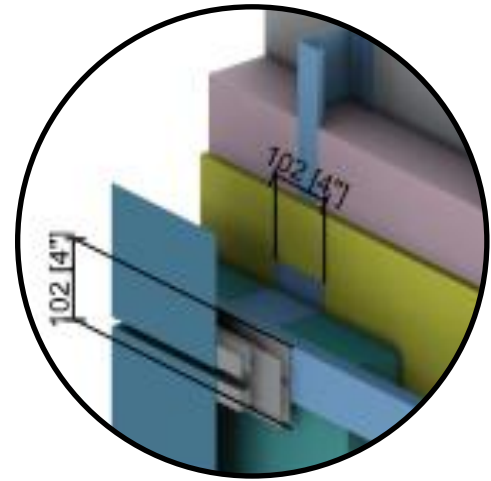
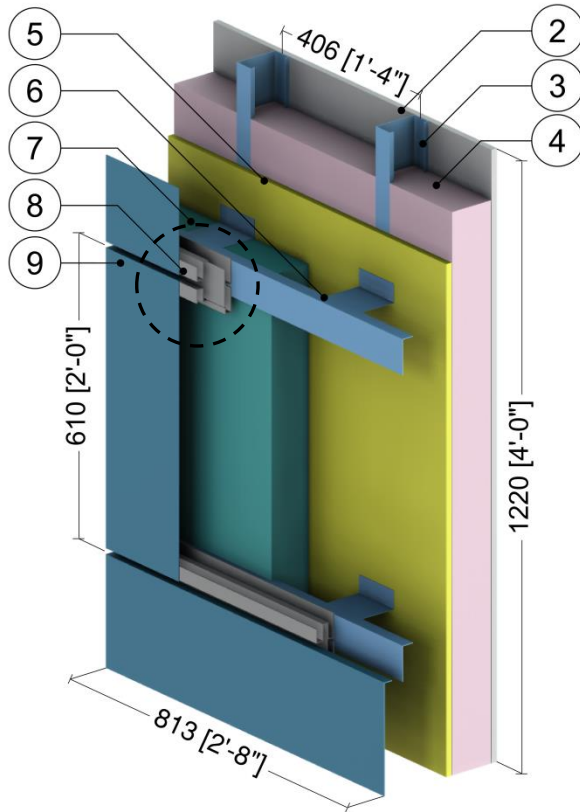


Panel Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Clips w/ 1 1/2" Horizontal Rail	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-20 (1.76 to 3.5 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.13 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Clips (16" o.c.) Supporting Stucco Cladding – Clear Wall

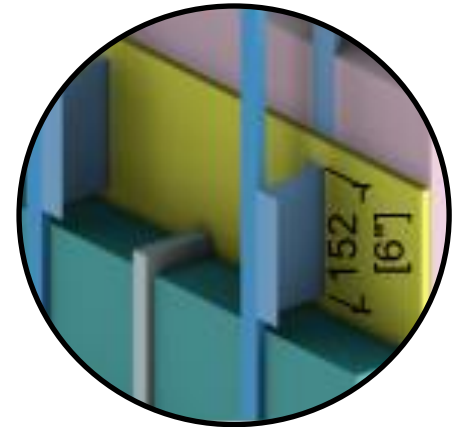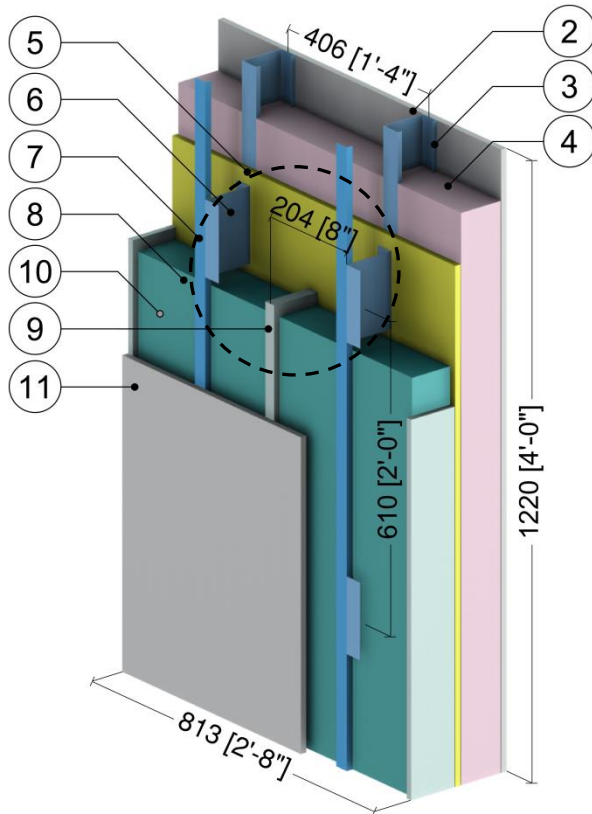



Bracing Detail

+

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-Clips with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Vertical Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Insulation	Varies	-	R-10 to R-20 (1.76 to 3.52 RSI)	1.8 (28)	0.29 (1220)
9	Rigid Insulation Bracing	Varies	0.2 (0.029)	-	1.8 (28)	0.29 (1220)
10	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
11	Stucco Cement with Breather Board	1/2" (13)	6 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.14 Exterior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall

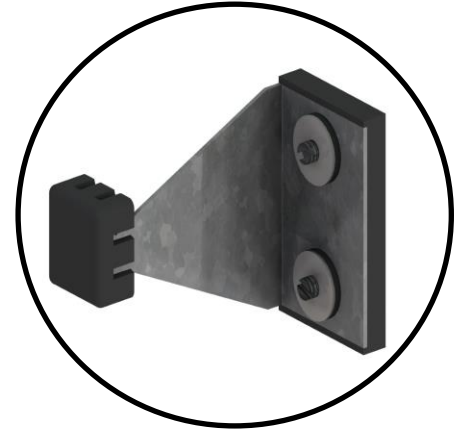
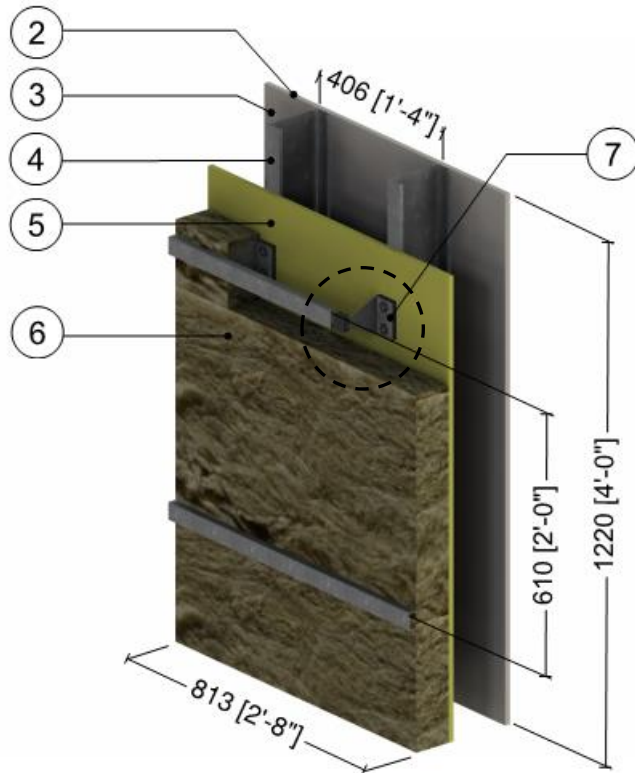


ThermaBracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	6" (152)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	6" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.034)	R-8.4 to R-25.2 (1.48 to 4.44 RSI)	1.8 (28)	0.29 (1220)
7	ThermaBrackets (24" o.c. vertically)	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.15 Exterior and Interior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall

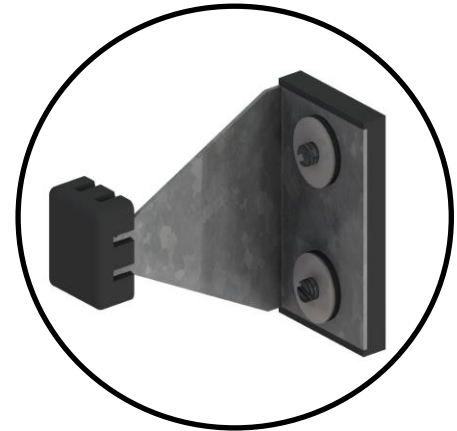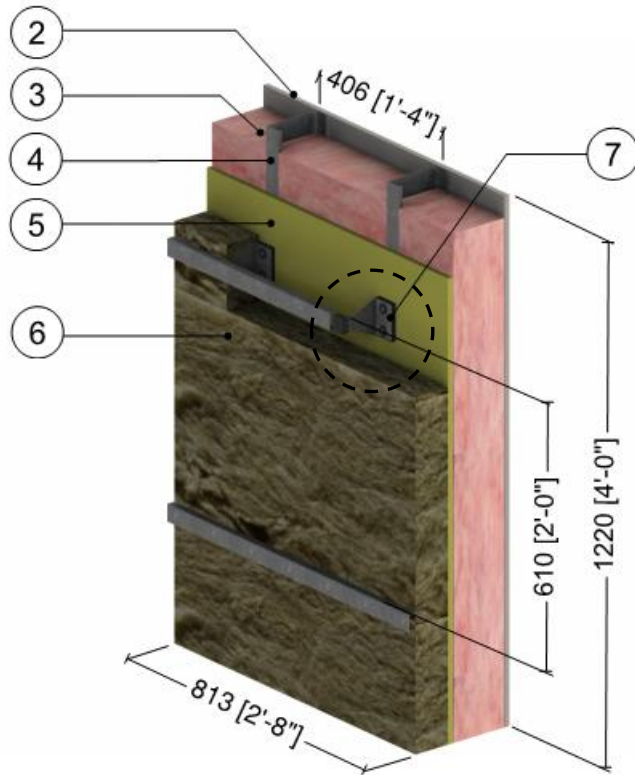


ThermaBracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	6" (152)	-	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
4	6" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.034)	R-8.4 to R-25.2 (1.48 to 4.44 RSI)	1.8 (28)	0.29 (1220)
7	ThermaBrackets (24" o.c. vertically)	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.1.16 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with CL-Talon 300 Clip System Supporting Cladding – Clear Wall

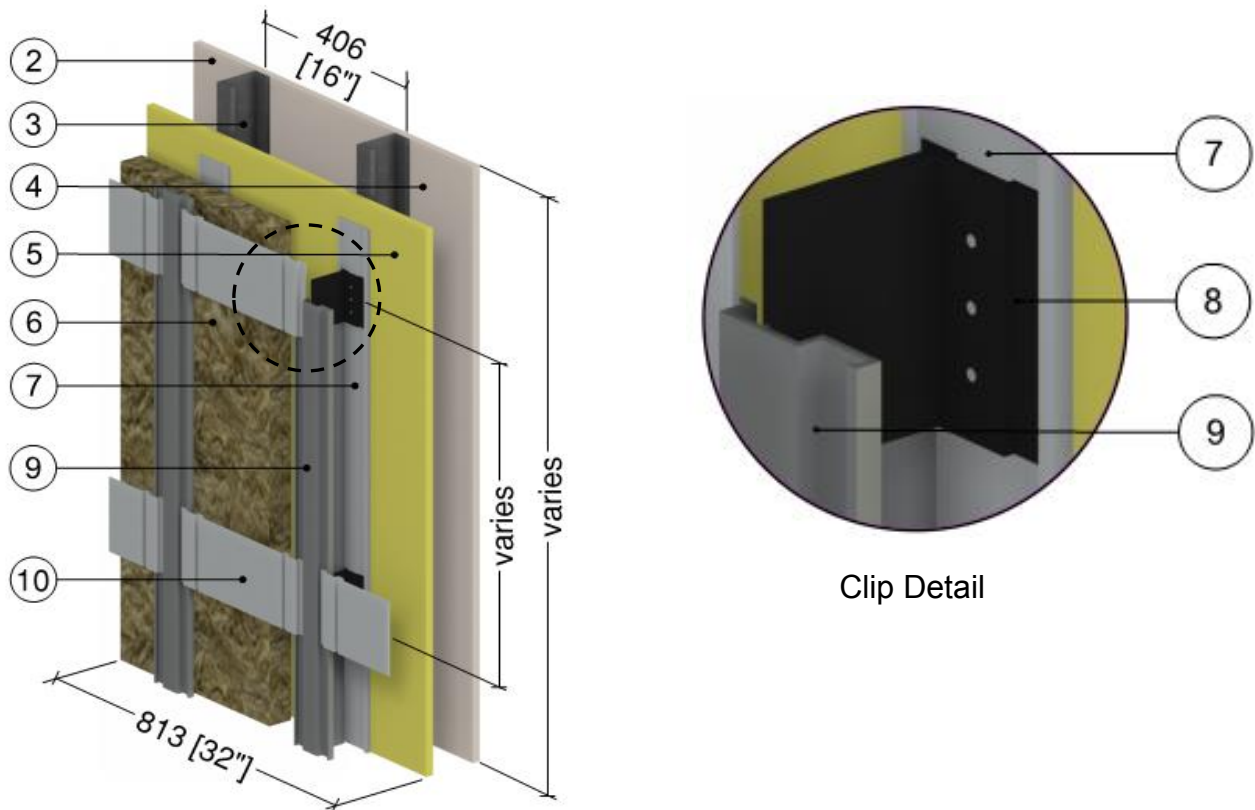

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 4" (51 to 102)	0.24 (0.034)	R-8.4 to R-16.8 (1.48 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Aluminum Base Track, 16" o.c. horizontally	1/8" (3.3)	1422 (205)	-	171 (2739)	0.21 (900)
8	Therme Polyamide Clip	-	1.73 (0.25)	-	-	-
9	Aluminum T-Track, 16" o.c. horizontally	1/8" (3.3)	1422 (205)	-	171 (2739)	0.21 (900)
10	Aluminum Wall Mount Supports	1/8" (3.3)	1422 (205)	-	171 (2739)	0.21 (900)
11	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.1.17 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Supporting Cladding – Clear Wall

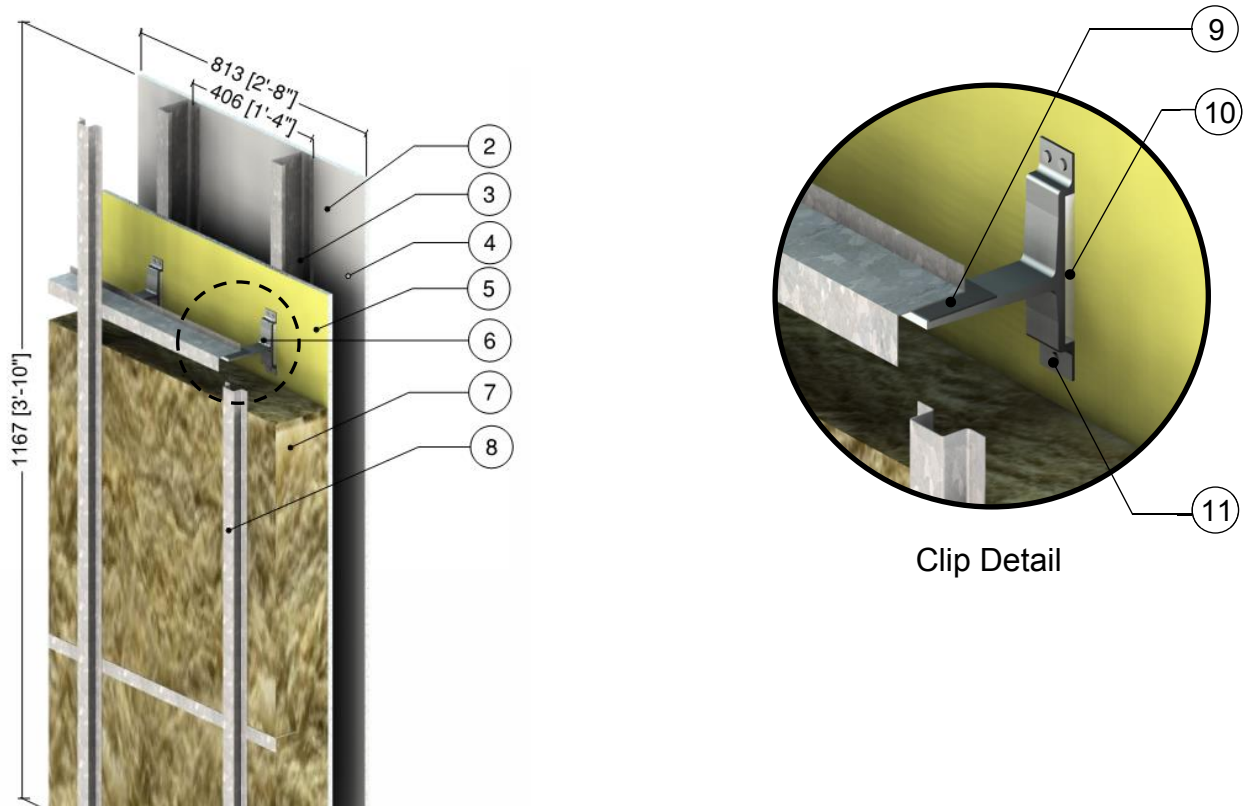

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Engineered Assemblies Aluminum Panel Clip (models T100 T125 150)	1/5" to 3/8" (5 to 10)	1109 (160)	-	-	-
7	Exterior Insulation	Varies	0.24 (0.034)	R-16.8 to R-25.2 (2.96 to 4.44 RSI)	1.8 (28)	0.29 (1220)
8	Vertical/Horizontal Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Cork/Neoprene pad	1/16" (1.5)	0.329 (0.058)	R-0.15 (0.03 RSI)	-	-
10	Aerogel	3/8" (10)	0.086 (0.015)	R-3.9 (0.68 RSI)		
11	Steel Fasteners	5/16" (8) Ø	347 (50)	-	489 (7830)	0.12 (500)
12	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.18 Exterior Insulated 3 5/8" x 1/58" Steel Stud (16"o.c.) Wall Assembly with TAC Fiber Reinforced Plastic Girts Supporting Cladding – Clear Wall

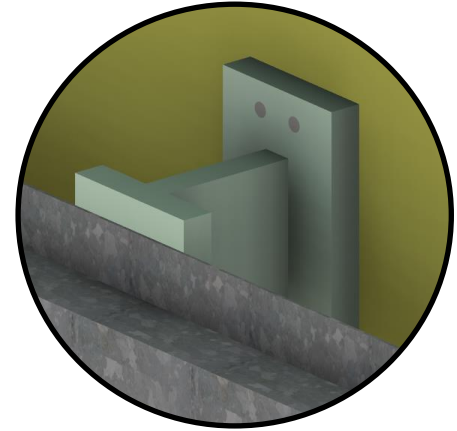
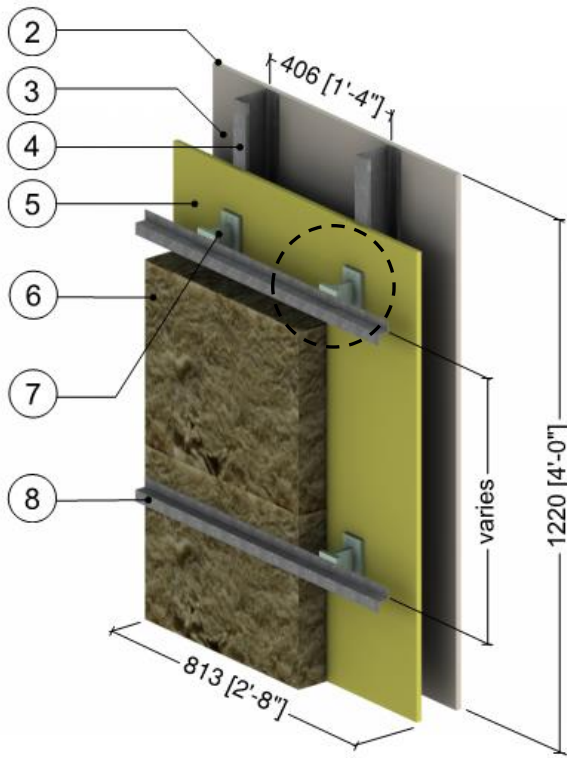


Fiber Reinforced Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.034)	R-12.6 to R-25.2 (2.22 to 4.40 RSI)	489 (7830)	0.12 (500)
7	Fiber Reinforced Plastic (FRP) Girts	-	2.4 (0.35)	-	-	-
8	Horizontal Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.19 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall

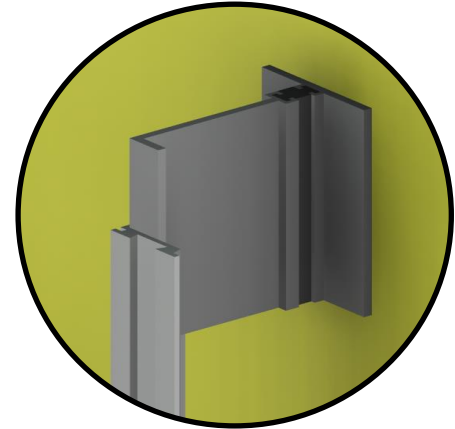
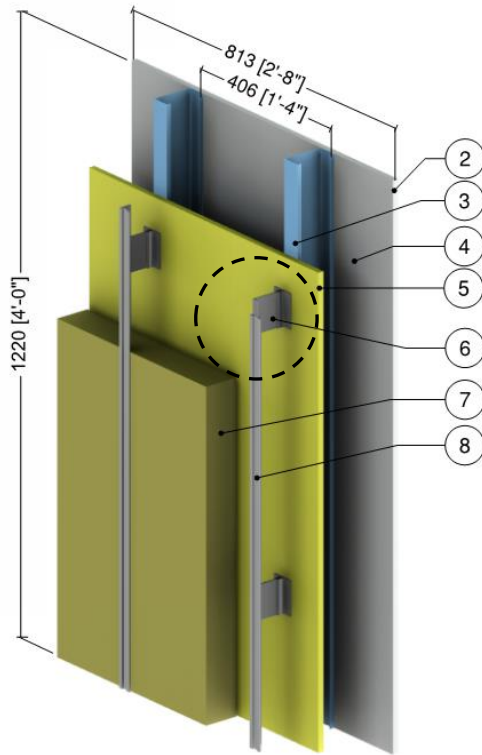


Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Longboard Aluminum Panel Clip	1/5" to 3/8" (5 to 10)	1109 (160)	-	-	-
7	Exterior Insulation	Varies	-	R-12.6 to R-25.2 (2.22 to 4.44 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.20 Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (8" o.c.) – Clear Wall

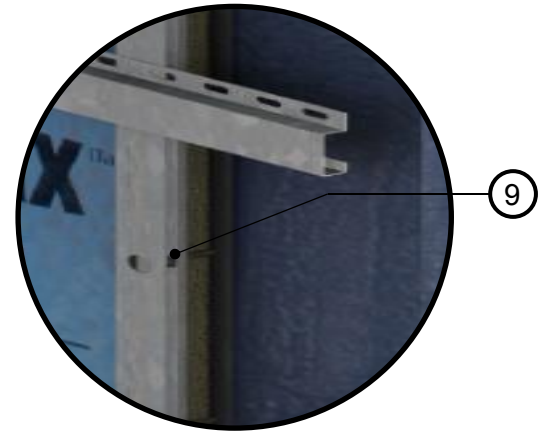
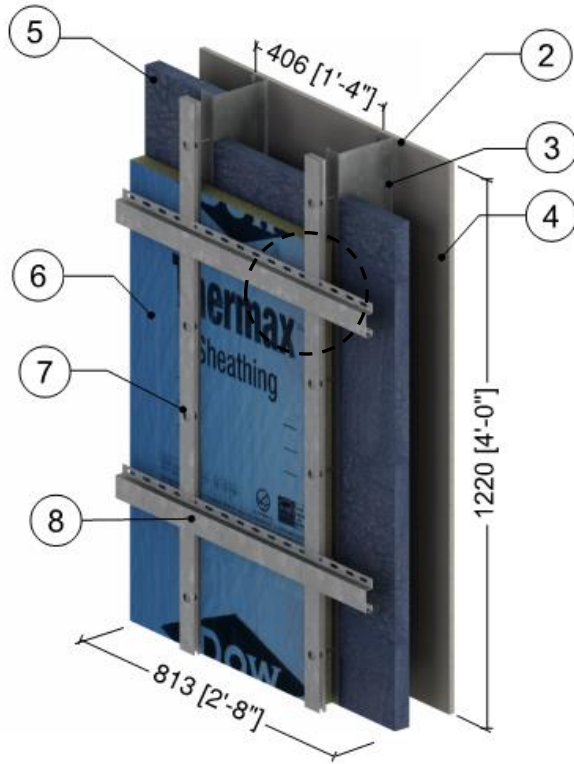


Isolator Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (105)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	1 1/2" (38)	-	R-9.8 (1.73 RSI)	-	-
6	Exterior Polyisocyanurate Insulation	Varies	-	R-10.1 to R-19.0 (1.78 to 3.35 RSI)	-	-
7	#12 Stainless Steel Fasteners (8" o.c.)	0.21" (5.3) Ø	12 (20)	-	489 (7830)	0.12 (500)
8	Steel Vertical and Horizontal Rails	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
9	Isolator	3/16" (4)	0.12 (0.21)	-	-	-
10	Metal Cladding with vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.21 Exterior and Interior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (16" o.c.) – Clear Wall

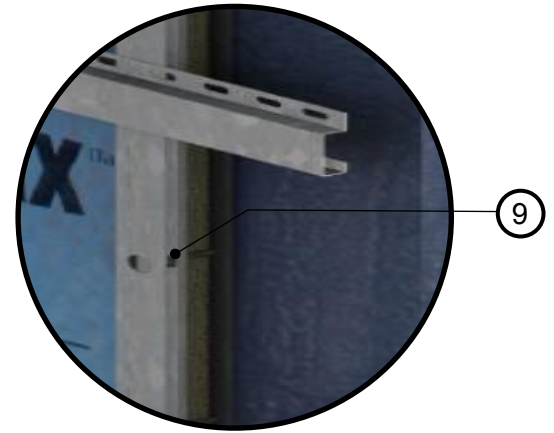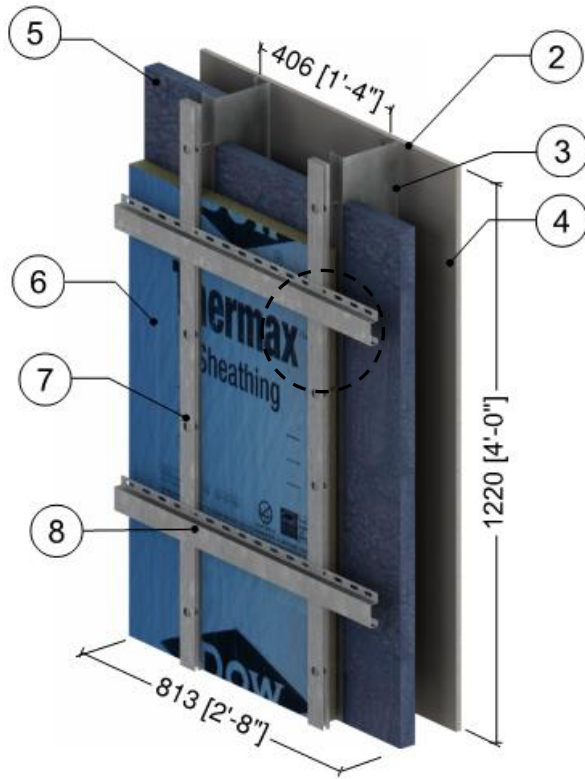


Isolator Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (105)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Spray Foam Insulation	1 1/2" (38)	-	R-9.8 (1.73 RSI)	-	-
6	Exterior Polyisocyanurate Insulation	Varies	-	R-10.1 to R-19.0 (1.78 to 3.35 RSI)	-	-
7	#12 Stainless Steel Fasteners (16" o.c.)	0.21" (5.3) Ø	12 (20)	-	489 (7830)	0.12 (500)
8	Steel Vertical and Horizontal Rails	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
9	Isolator	3/16" (4)	0.12 (0.21)	-	-	-
10	Metal Cladding with vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.1.22 Exterior Insulated 5 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Knight CI-System (8" o.c.) – Clear Wall

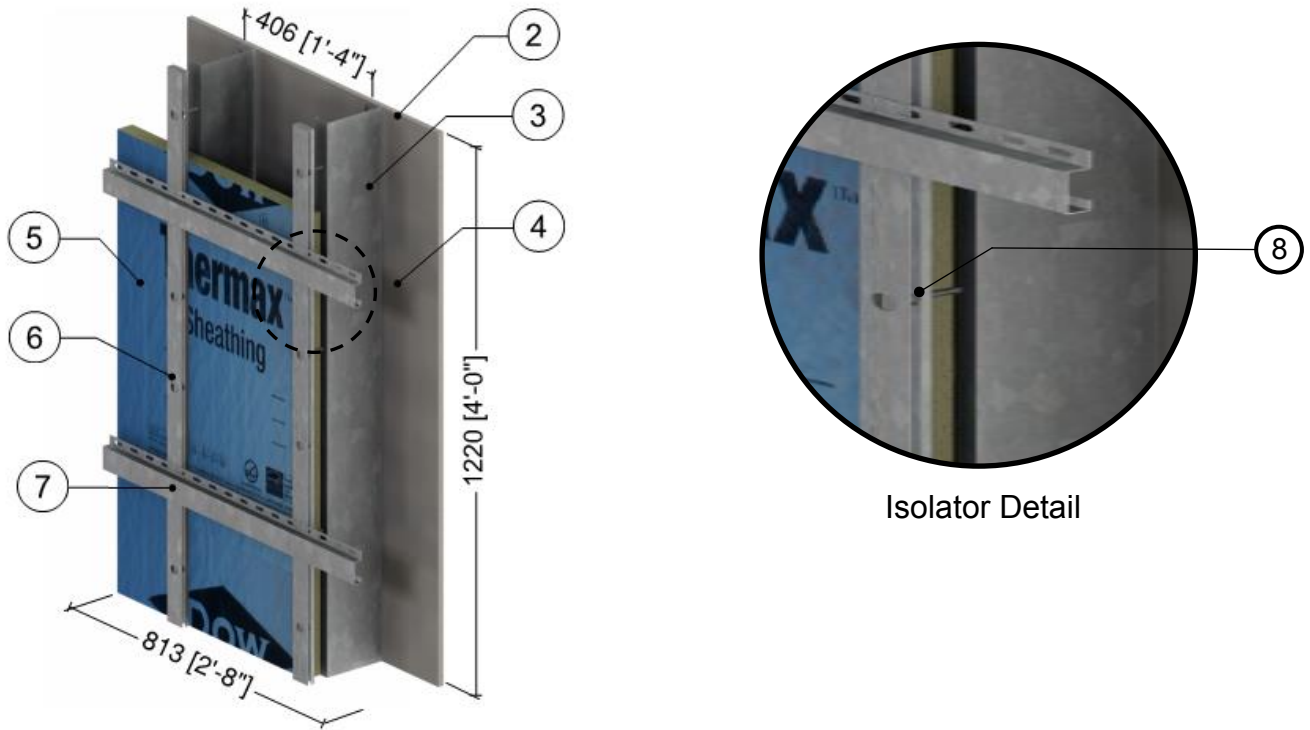

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (105)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Polyisocyanurate Insulation	Varies	-	R-10.1 to R-19.0 (1.78 to 3.35 RSI)	-	-
6	#12 Stainless Steel Fasteners (8" o.c.)	0.21" (5.3) Ø	12 (20)	-	489 (7830)	0.12 (500)
7	Steel Vertical and Horizontal Rails	18 Gauge	250 (36)	-	489 (7830)	0.12 (500)
8	Isolator	3/16" (4)	0.12 (0.21)	-	-	-
9	Metal Cladding with vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.23 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with R-TEC CI Bracket System Supporting Vertical Sub-girts – Clear Wall

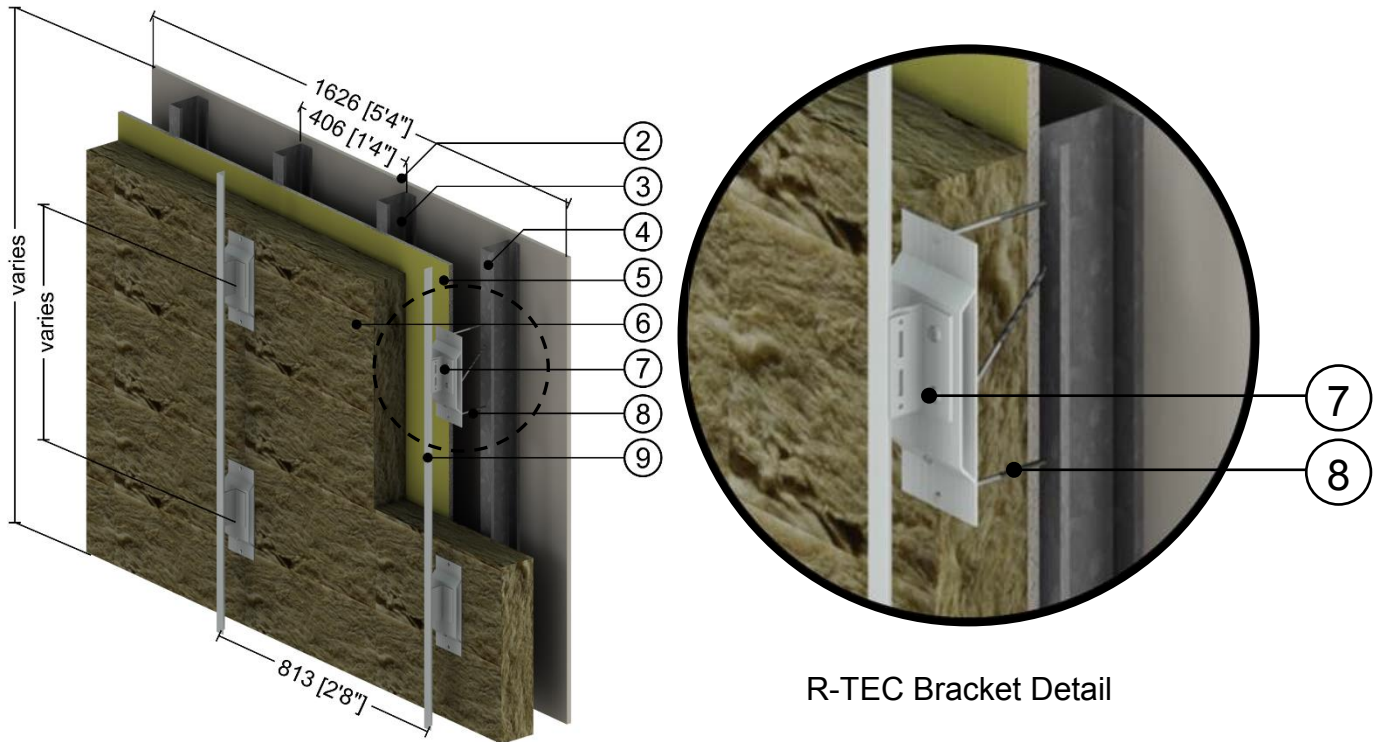


R-TEC Bracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	3" to 6" (76 to 152)	0.24 (0.034)	R-12.6 to R-25.2 (2.22 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	R-TEC CI Bracket Aluminum 6063	-	1390 (200)	-	168 (2700)	0.22 (900)
8	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.13 (530)
9	Vertical Sub-girt	0.09" (2.2)	1390 (200)	-	168 (2700)	0.22 (900)
10	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.24

Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with R-TEC CI Bracket System Supporting Vertical Sub-girts – Clear Wall

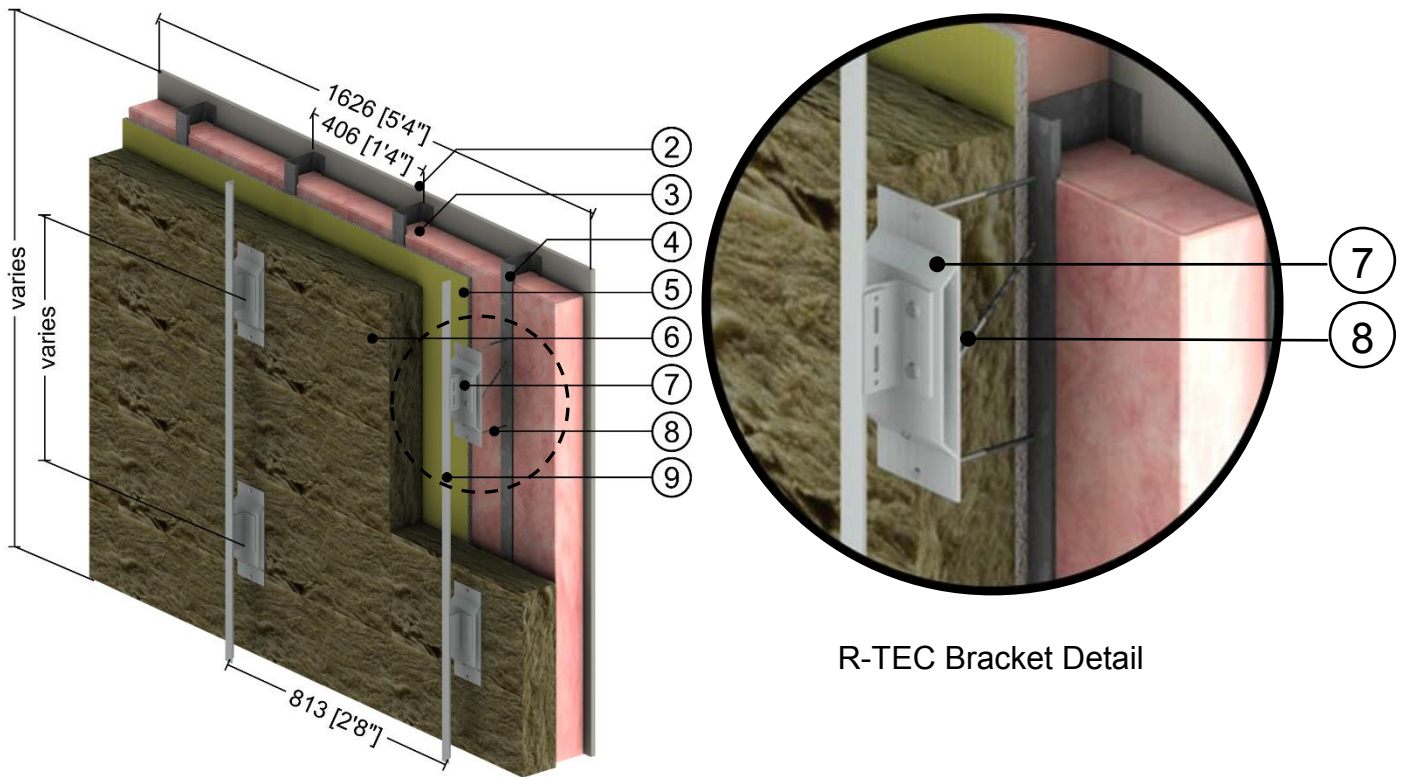



R-TEC Bracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-13 (2.29 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	3" to 6" (76 to 152)	0.24 (0.034)	R-12.6 to R-25.2 (2.22 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	R-TEC CI Bracket Aluminum 6063	-	1390 (200)	-	168 (2700)	0.22 (900)
8	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.13 (530)
9	Vertical Sub-girt	0.09" (2.2)	1390 (200)	-	168 (2700)	0.22 (900)
10	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.25

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts – Clear Wall

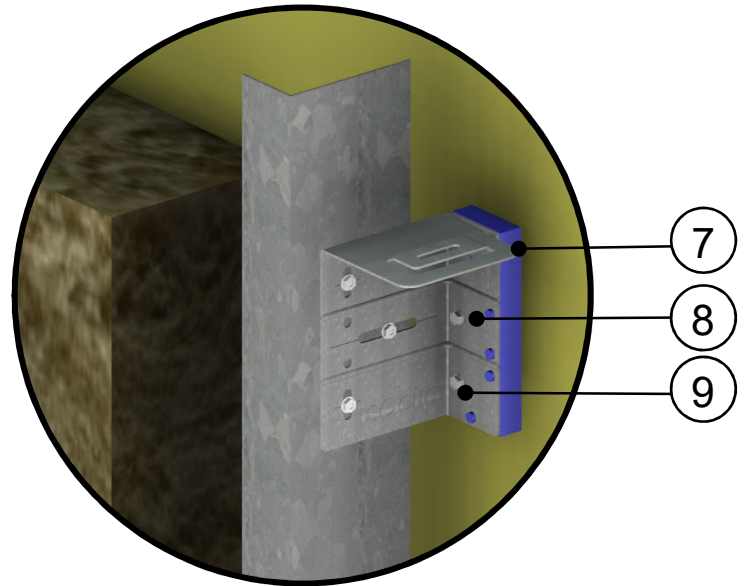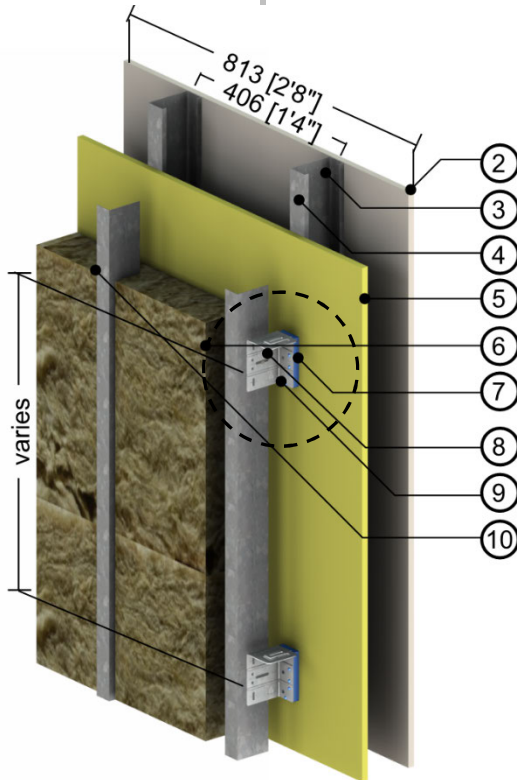



ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Vertical Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.26

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Clear Wall

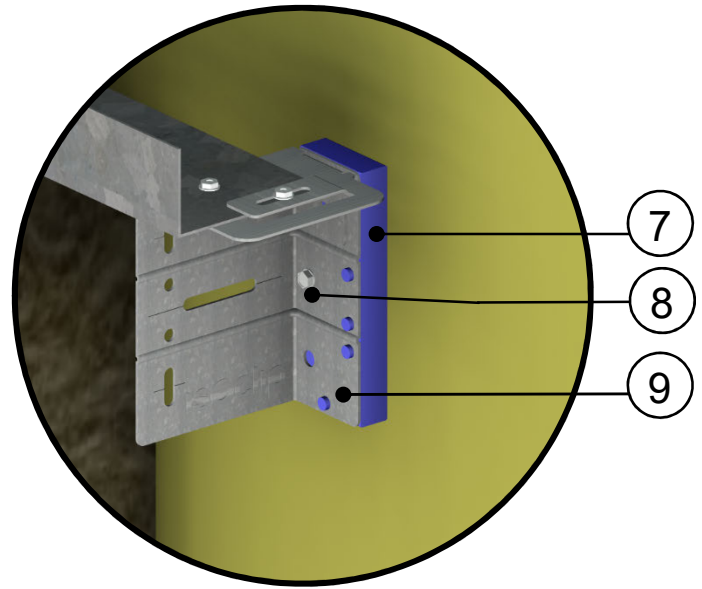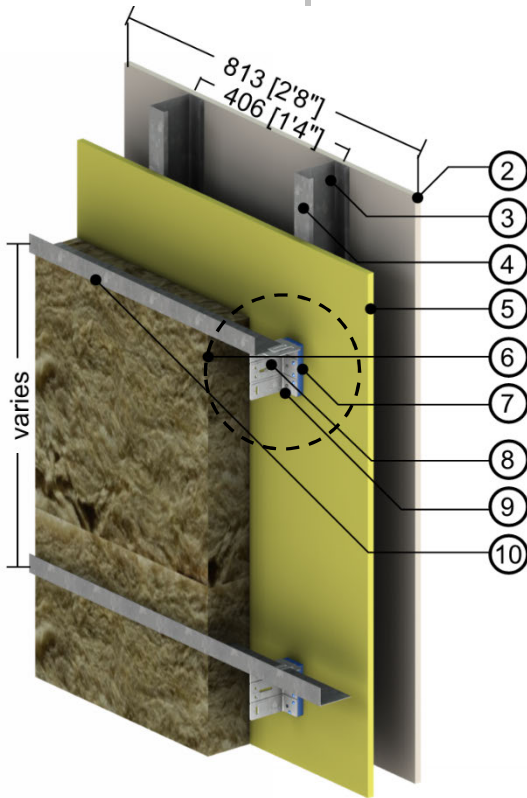



ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.27

Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts – Clear Wall

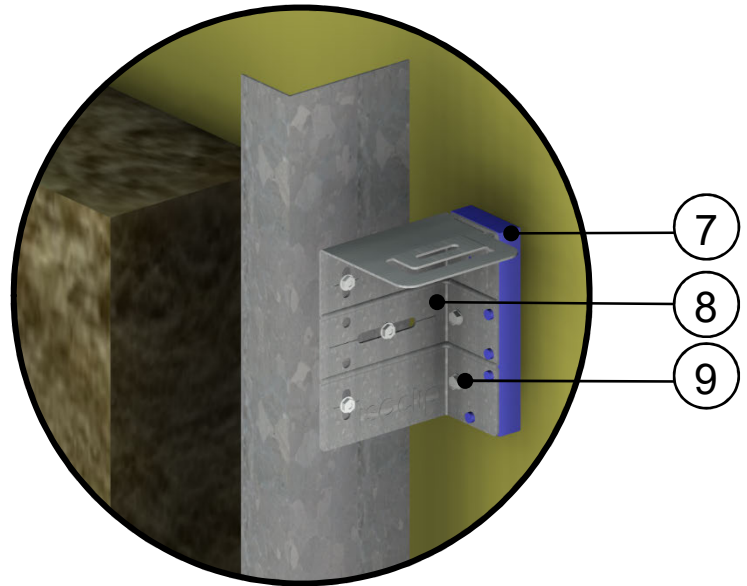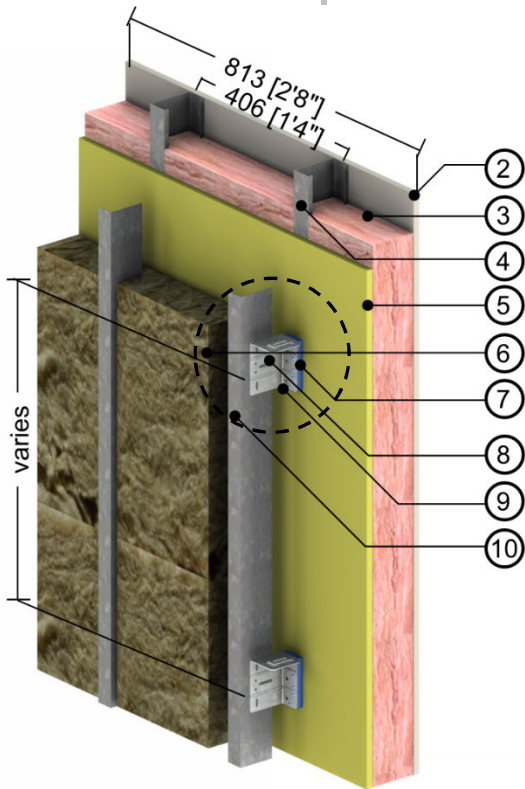


ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.2 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Vertical Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.28

Interior and Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Clear Wall

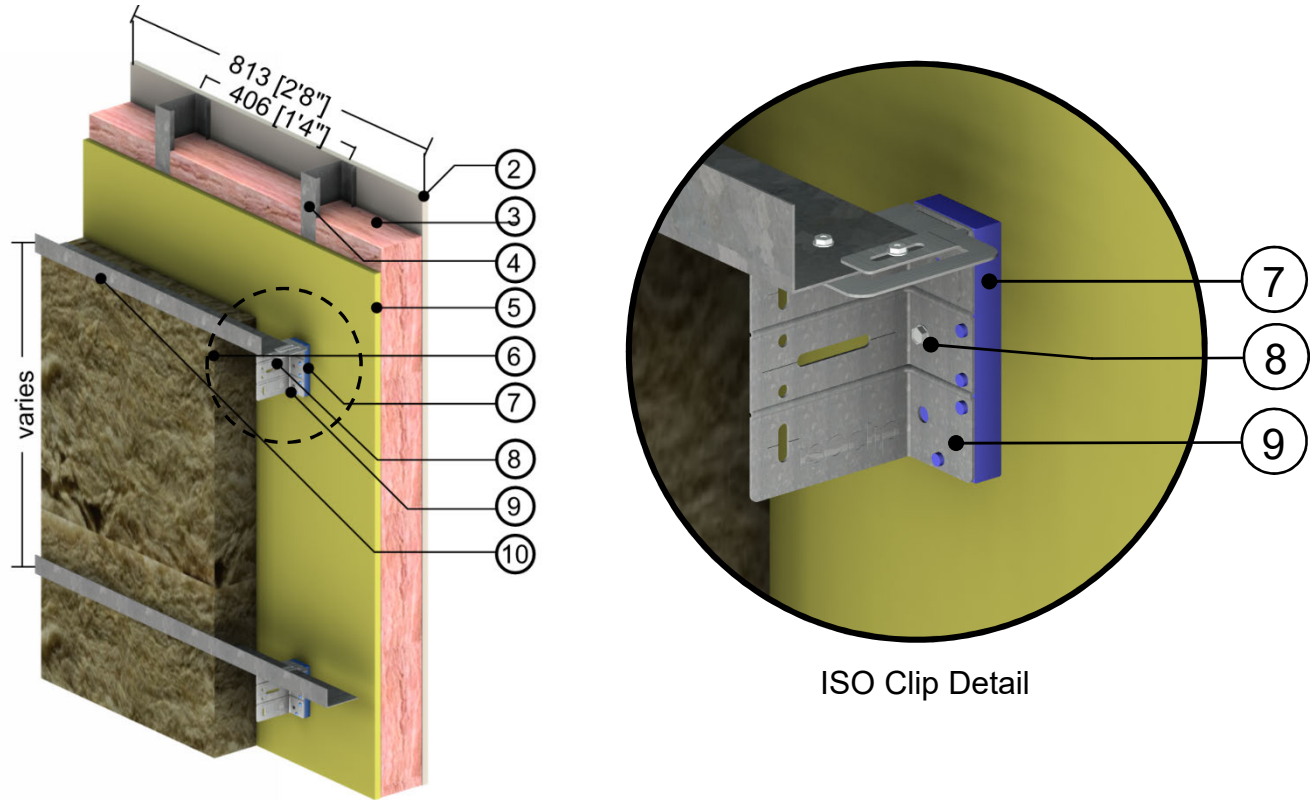


ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.2 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.29

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall

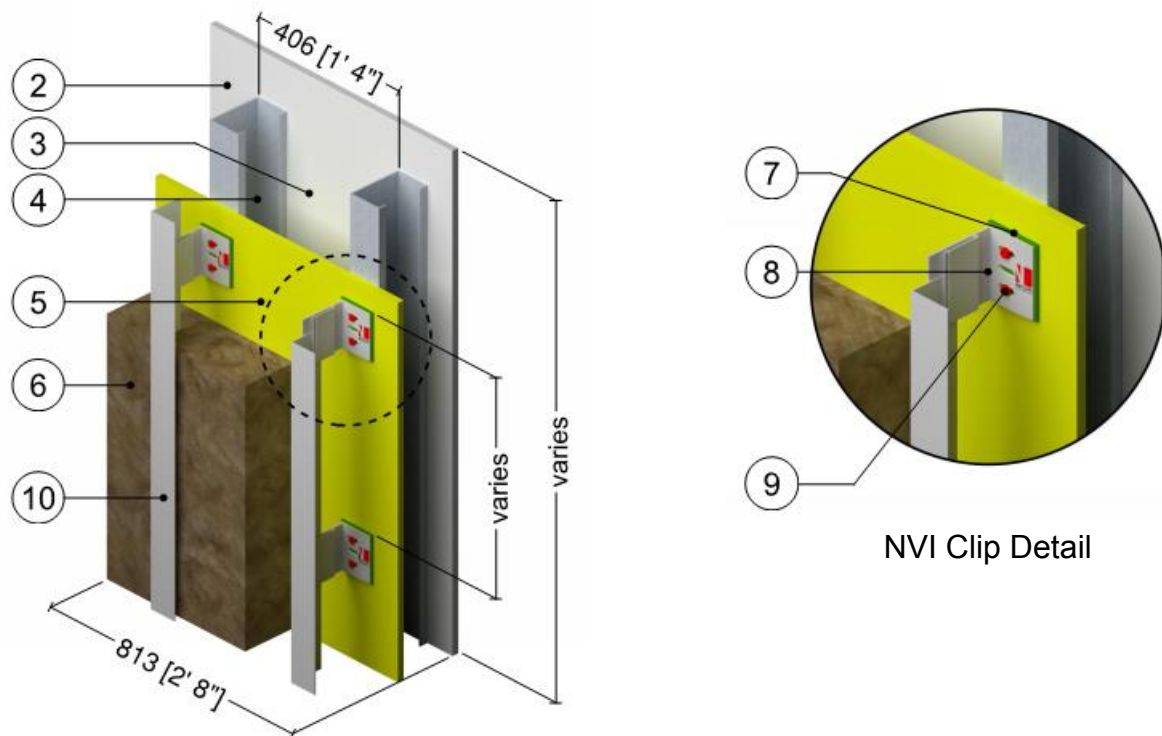


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	3" to 6" (76 to 152)	0.24 (0.034)	R-12.6 to R-25.2 (2.22 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	NV1 Clip Isolator	0.2" (5)	0.82 (0.117)	-	87 (1400)	0.20 (840)
8	NV1 Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	171 (2739)	0.21 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
10	Vertical Sub-girt	0.09" (2.2)	1340 (193)	-	171 (2739)	0.21 (900)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.30


Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall

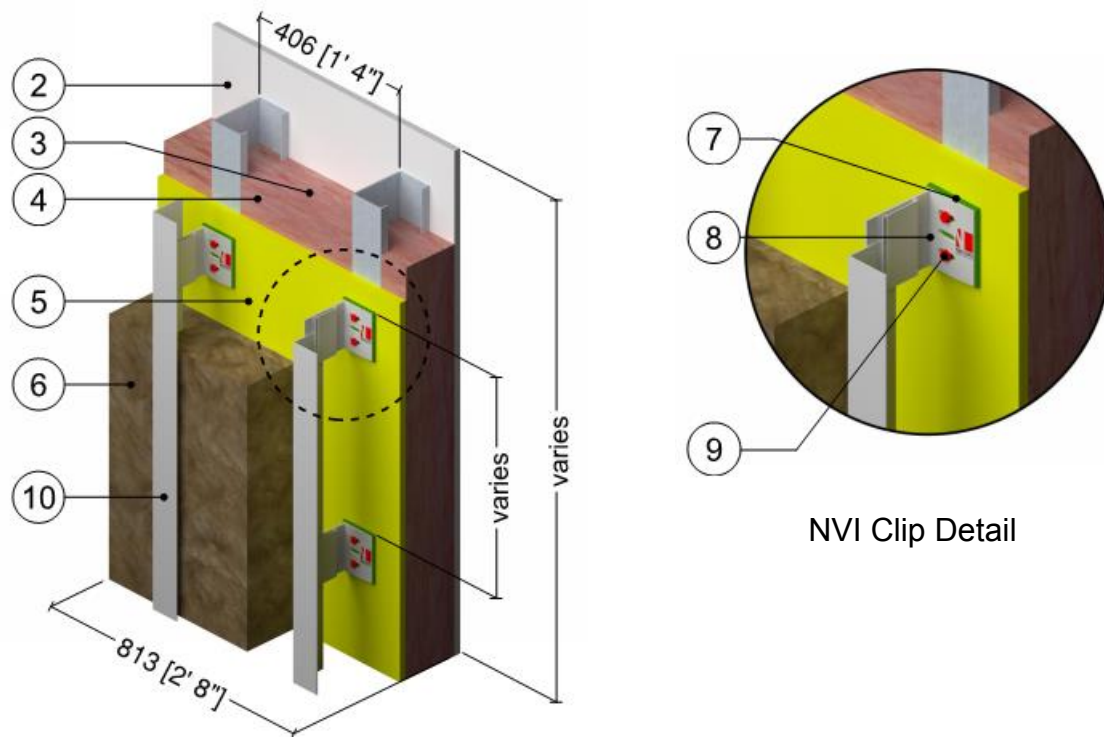

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.2 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 6" (50 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	NV1 Clip Isolator	0.2" (5)	0.82 (0.117)	-	87 (1400)	0.20 (840)
8	NV1 Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	171 (2739)	0.21 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
10	Vertical Sub-girt	0.09" (2.2)	1340 (193)	-	171 (2739)	0.21 (900)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.31 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Cascadia Clip Fiberglass Thermal Spacers – Clear Wall


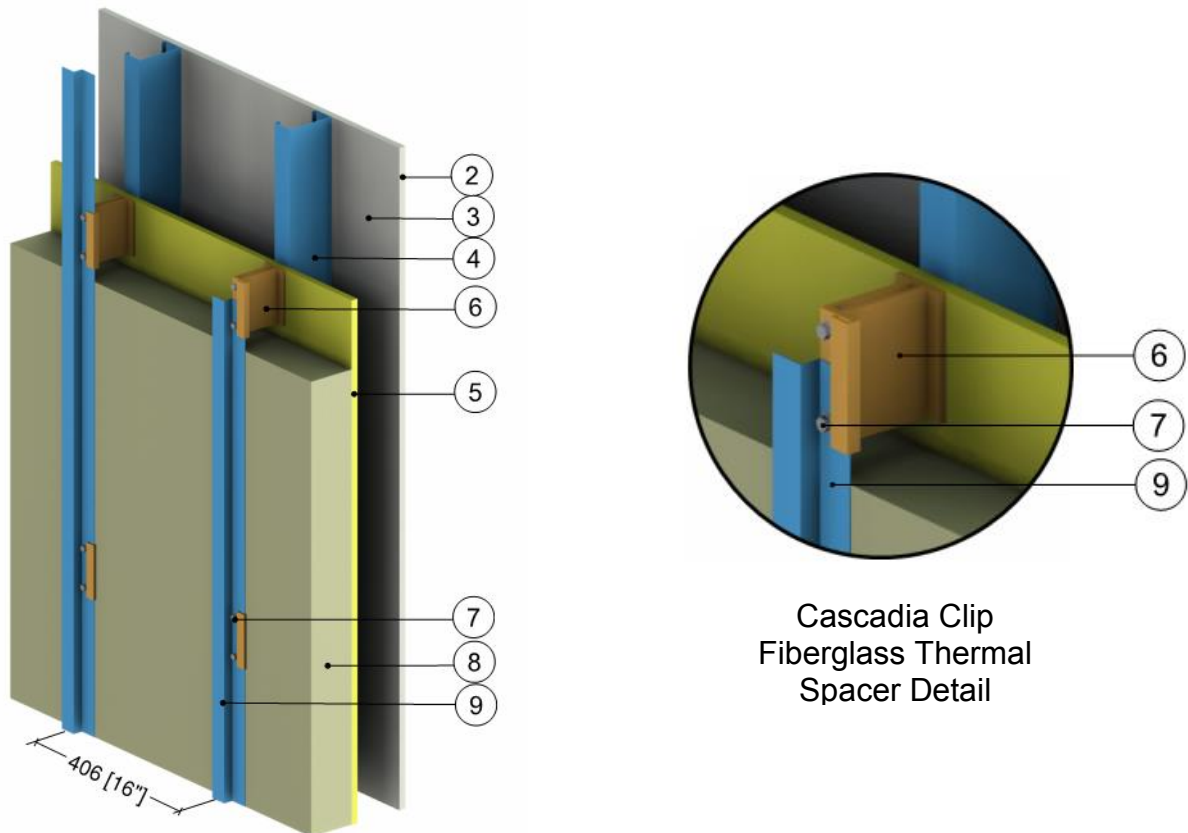


Cascadia Clip
Fiberglass Thermal
Spacer Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
6	Cascadia Clip	Varies	1.7 (0.299)	-	-	-
7	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.12 (500)
8	Exterior Mineral Wool Insulation	Varies	-	R-8.4 to R-33.6 (1.48 to 5.92 RSI)	4 (64)	0.20 (850)
9	Vertical Z-girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.32 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-20 Batt Insulation in Stud Cavity– Clear Wall

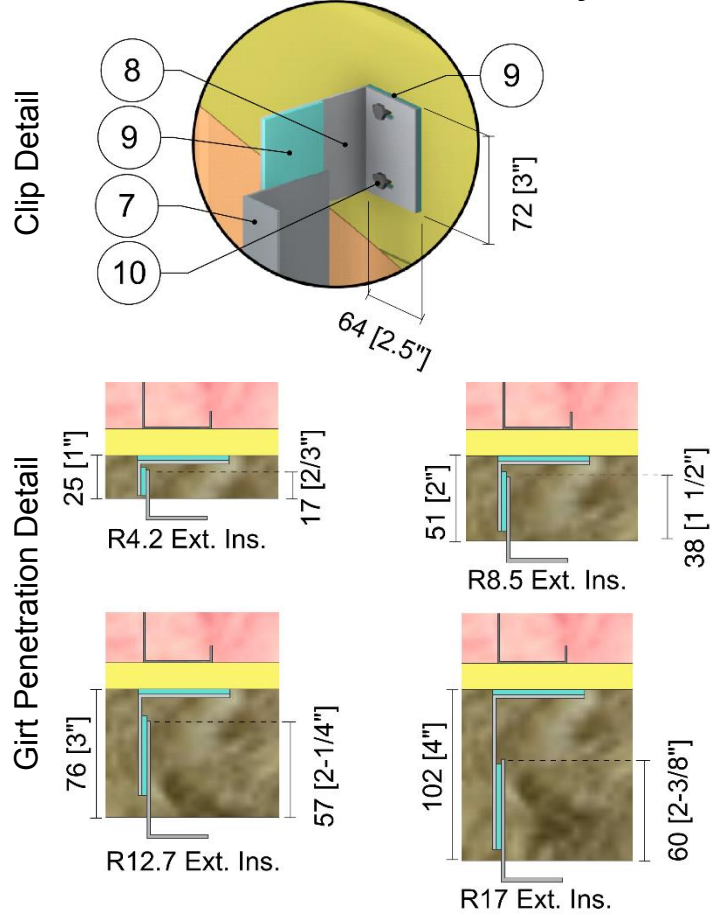
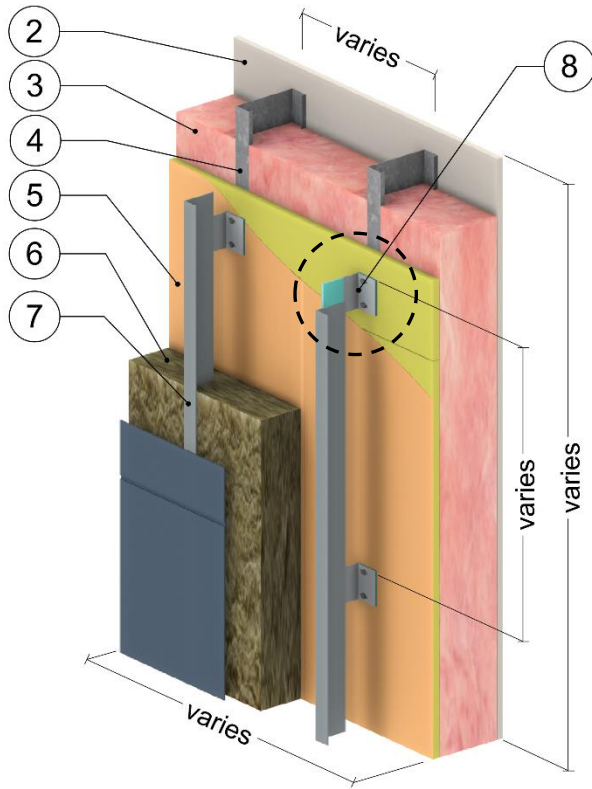


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.28 (0.041)	R-20 (3.5 RSI)	0.55 (8.8)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Thermafiber RainBarrier 45 Mineral Wool Semi Rigid Insulation	Varies	0.24 (0.034)	R-4.2 to R-17 (0.75 to 3.0 RSI)	4.5 (72)	0.20 (850)
7	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
8	Aluminum Clip	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	HDPE Isolator	1/8" (3)	3.5 (0.5)	-	59 (950)	0.48 (2000)
10	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
11	Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation





Detail 5.1.33 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-22.5 Batt Insulation in Stud Cavity– Clear Wall

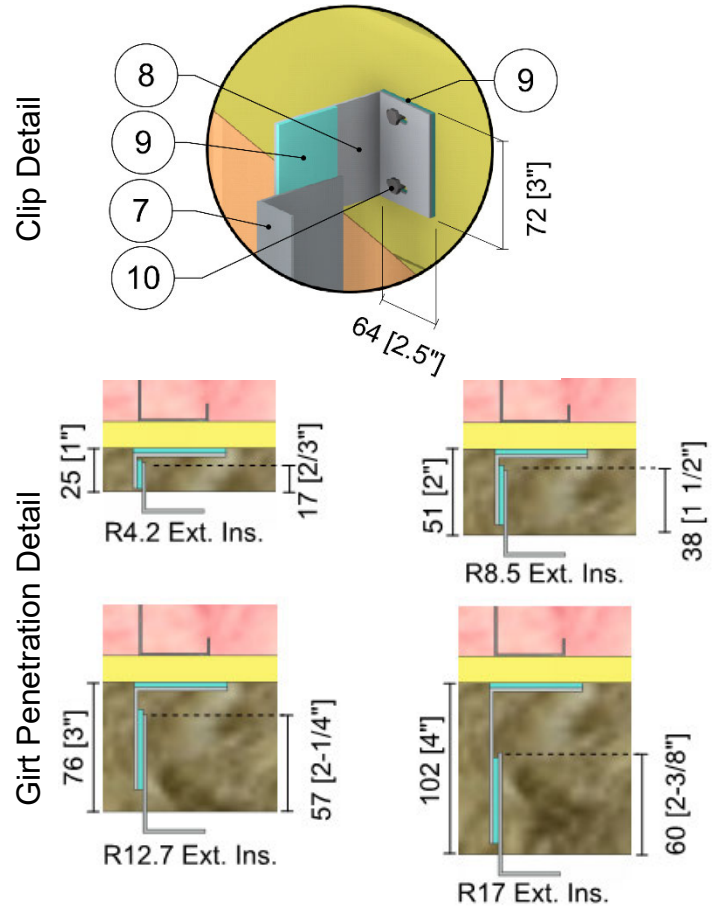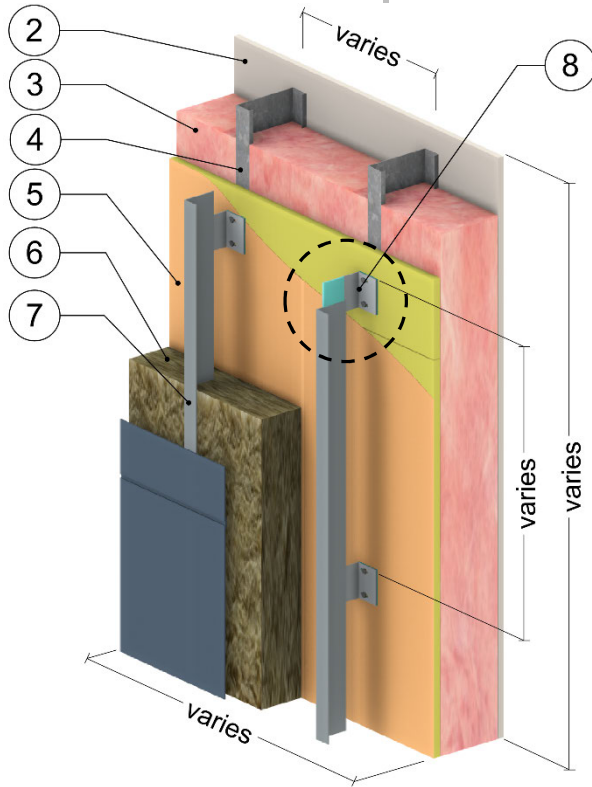

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.26 (0.037)	R-22.5 (4.0 RSI)	0.99 (15.9)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Thermafiber RainBarrier 45 Mineral Wool Semi Rigid Insulation	Varies	0.24 (0.034)	R-4.2 to R-17 (0.75 to 3.0 RSI)	4.5 (72)	0.20 (850)
7	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
8	Aluminum Clip	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	HDPE Isolator	1/8" (3)	3.5 (0.5)	-	59 (950)	0.48 (2000)
10	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
11	Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.1.34 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Vertical Clips (24" o.c. and 36" o.c.) Supporting Cladding and R-24 Batt Insulation in Stud Cavity—Clear Wall

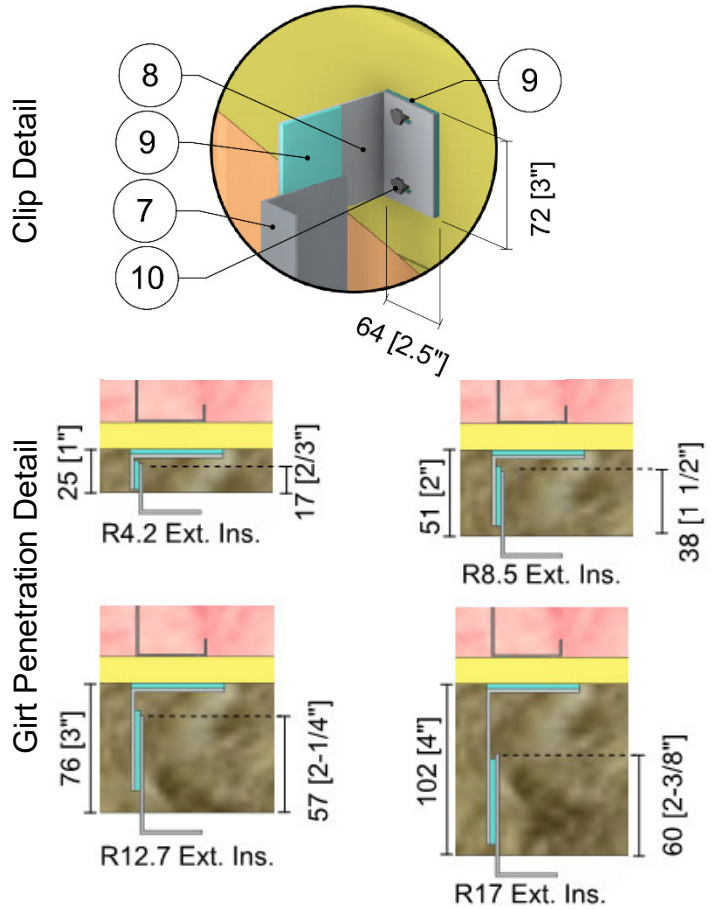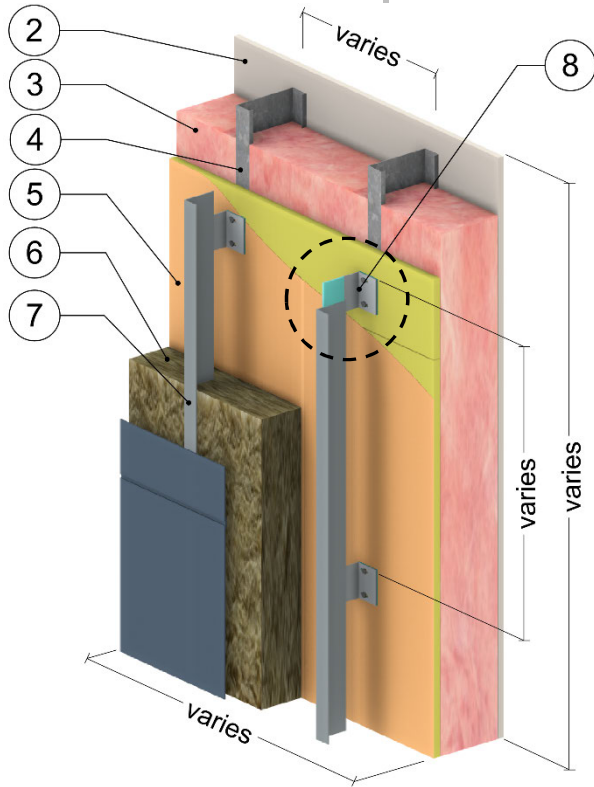

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.23 (0.034)	R-24 (4.2 RSI)	1.42 (22.7)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Thermafiber RainBarrier 45 Mineral Wool Semi Rigid Insulating Sheathing	Varies	0.24 (0.034)	R-4.2 to R-17 (0.75 to 3.0 RSI)	4.5 (72)	0.20 (850)
7	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
8	Aluminum Clip	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	HDPE Isolator	1/8" (3)	3.5 (0.5)	-	59 (950)	0.48 (2000)
10	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
11	Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.1.35 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-20 Batt Insulation in Stud Cavity – Clear Wall

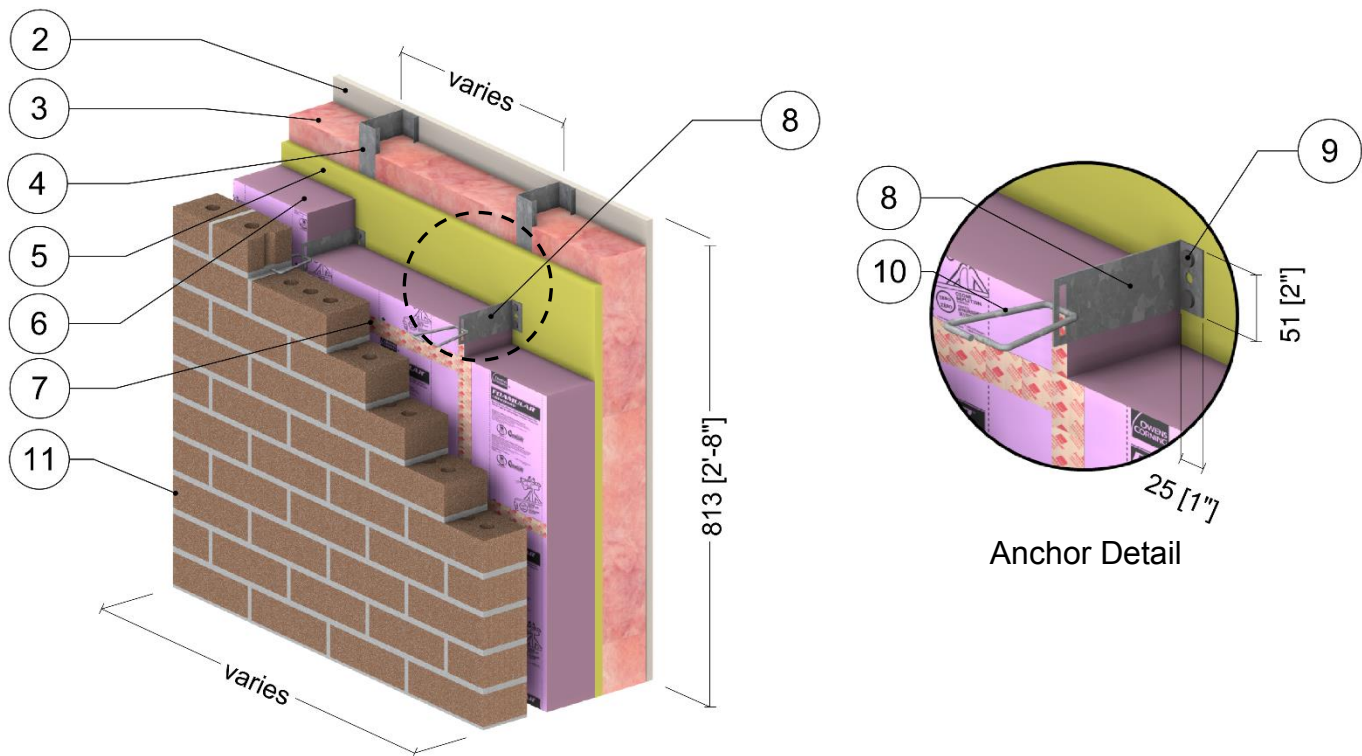

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.28 (0.041)	R-20 (3.5 RSI)	0.55 (8.8)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Foamular CodeBord/C-200 Extruded Polystyrene Rigid Insulation (XPS) Type 3	Varies	0.20 (0.029)	R-5 to R-15 (0.88 to 2.64 RSI)	Varies	0.29 (1220)
7	Vented Air Cavity	1 1/2" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
8	Galvanized Steel Veneer Anchor	Varies	430 (62)	-	489 (7830)	0.12 (500)
9	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
10	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.1.36 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-22.5 Batt Insulation in Stud Cavity – Clear Wall

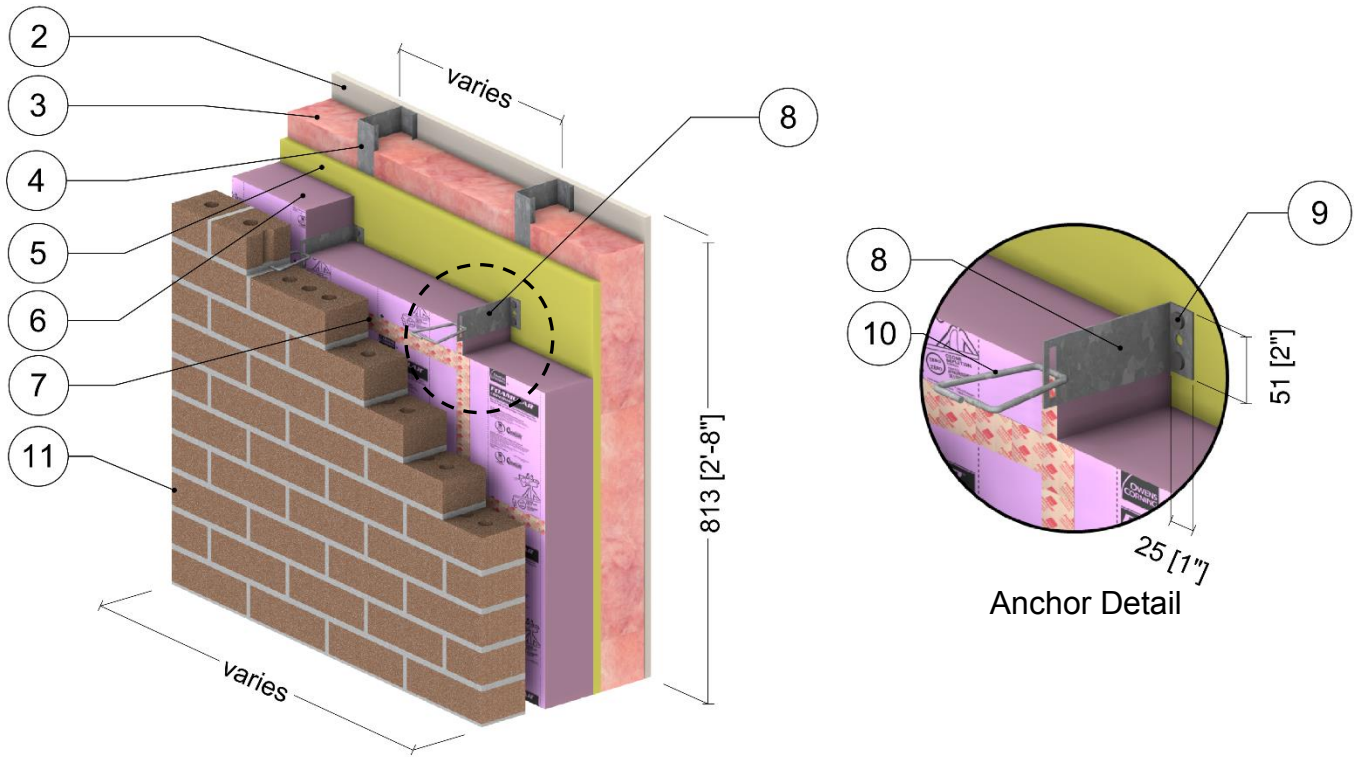

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.26 (0.037)	R-22.5 (4.0 RSI)	0.99 (15.9)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Foamular CodeBord/C-200 Extruded Polystyrene Rigid Insulation (XPS) Type 3	Varies	0.20 (0.029)	R-5 to R-15 (0.88 to 2.64 RSI)	Varies	0.29 (1220)
7	Vented Air Cavity	1 1/2" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
8	Galvanized Steel Veneer Anchor	Varies	430 (62)	-	489 (7830)	0.12 (500)
9	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
10	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.37 Exterior and Interior Insulated 2" x 6" Steel Stud (16" o.c. and 24" o.c.) Wall Assembly with Steel Brick Anchors Supporting Brick Veneer and R-24 Batt Insulation in Stud Cavity – Clear Wall


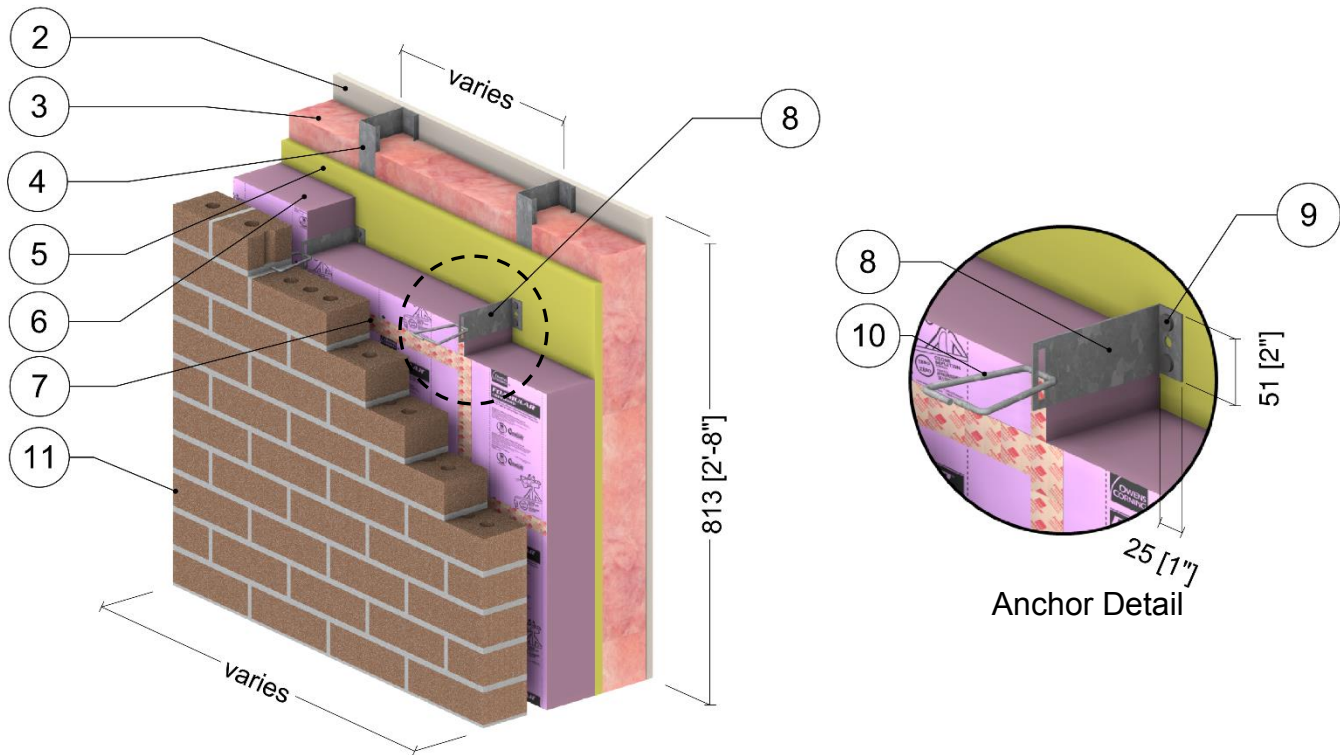


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
3	Ecotouch Pink Fiberglass Batt	6" (152)	0.23 (0.034)	R-24 (4.2 RSI)	1.42 (22.7)	0.17 (710)
4	2" x 6" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Foamular CodeBord/C-200 Extruded Polystyrene Rigid Insulation (XPS) Type 3	Varies	0.20 (0.029)	R-5 to R-15 (0.88 to 2.64 RSI)	Varies	0.29 (1220)
7	Vented Air Cavity	1 1/2" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
8	Galvanized Steel Veneer Anchor	Varies	430 (62)	-	489 (7830)	0.12 (500)
9	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
10	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.38

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Zinc 2-Seal Anchor Supporting Brick Veneer – Clear Wall

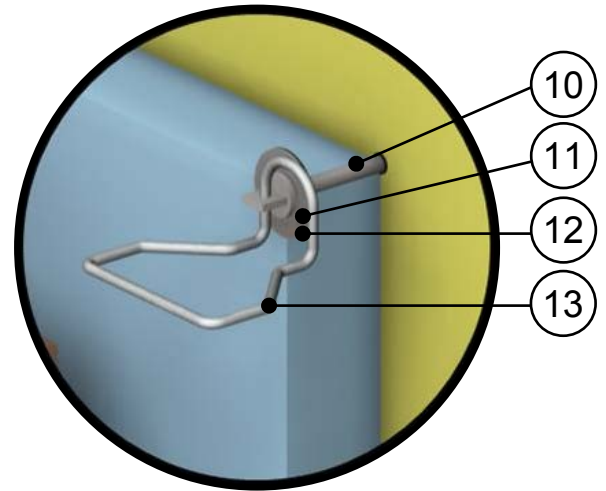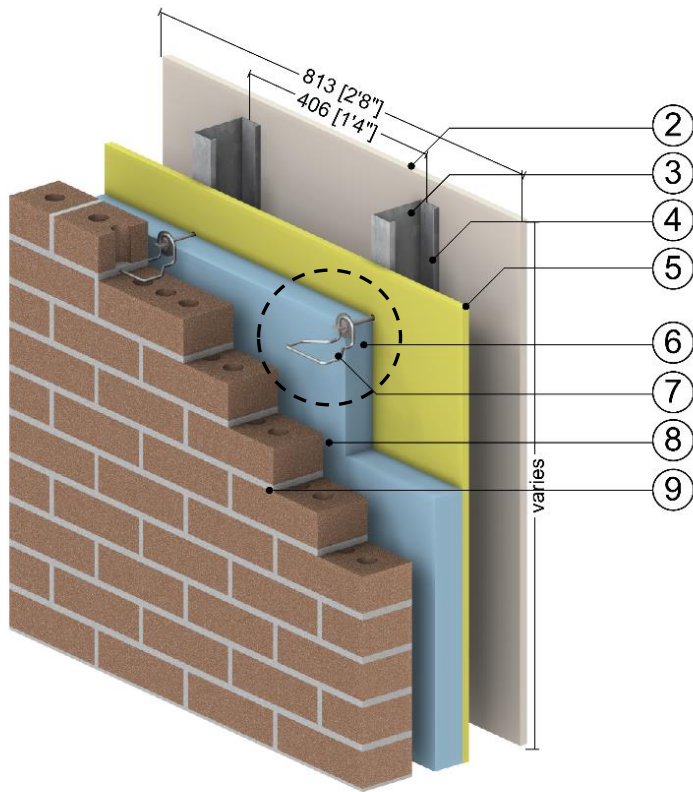


Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Zinc Barrel	-	784 (113)	-	-	-
11	Steel Washer	1.5" (38) Ø	347 (50)	-	489 (7830)	0.12 (500)
12	Rubber Washer (EPDM)	-	1.7 (0.25)	-	-	-
13	Galvanized Steel Wire Pintle	3/16" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.39 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Anchor Supporting Brick Veneer – Clear Wall


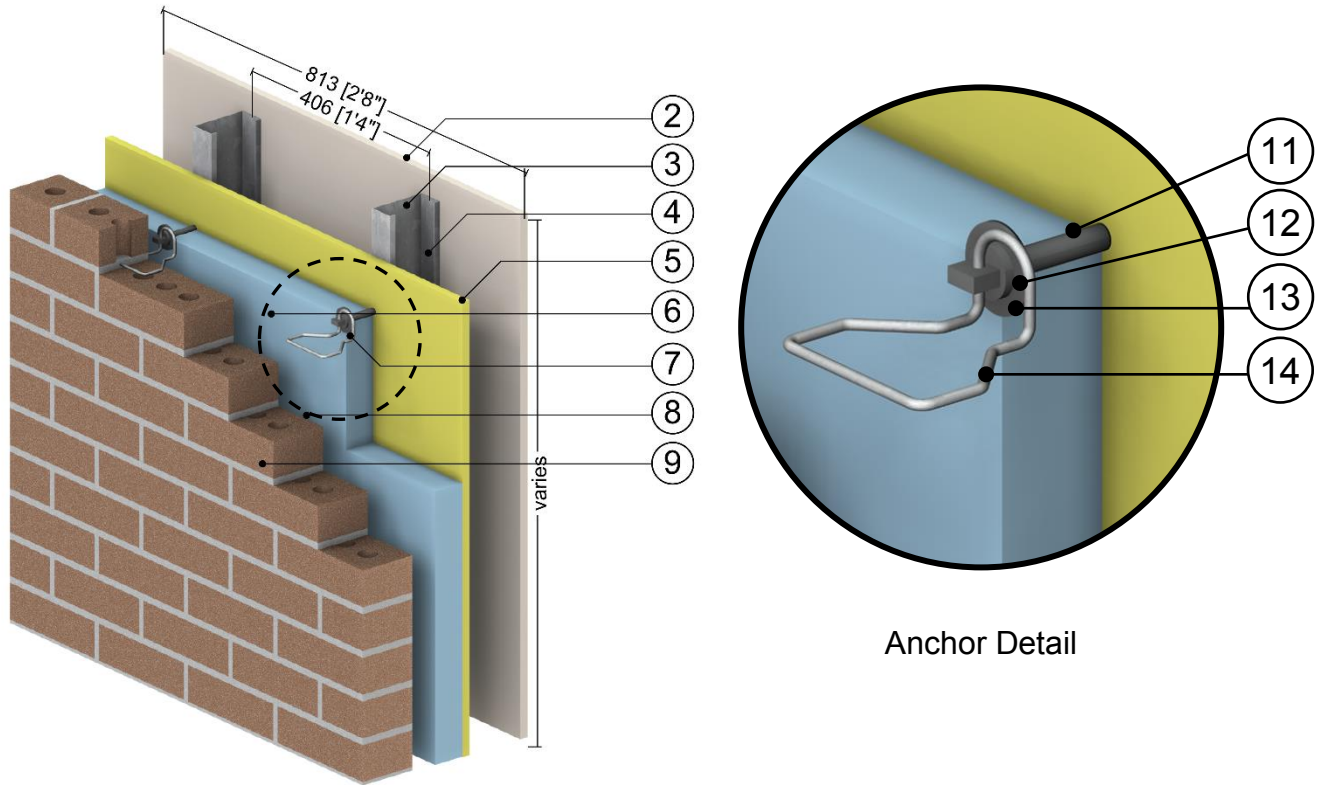


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Barrel	-	118 (17)	-	489 (7830)	0.12 (500)
11	Nylon Coating	Varies	1.7 (0.25)	-	-	-
12	Steel Washer	1.5" (38) Ø	347 (50)	-	489 (7830)	0.12 (500)
13	Rubber Washer (EPDM)	-	1.7 (0.25)	-	-	-
14	Galvanized Steel Wire Pintle	3/16" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.40

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Wing Nut Anchor Supporting Brick Veneer – Clear Wall

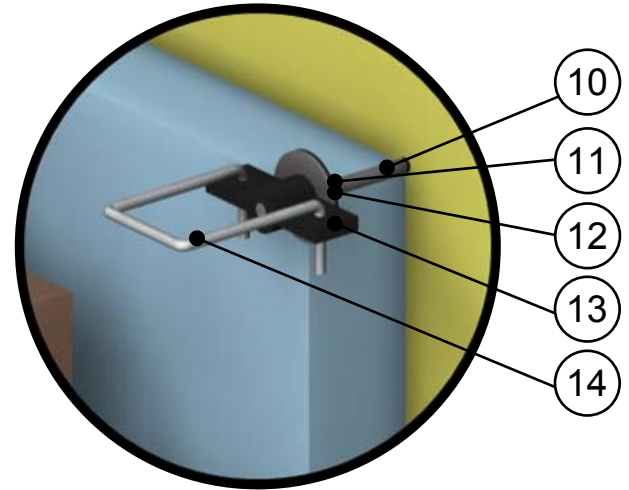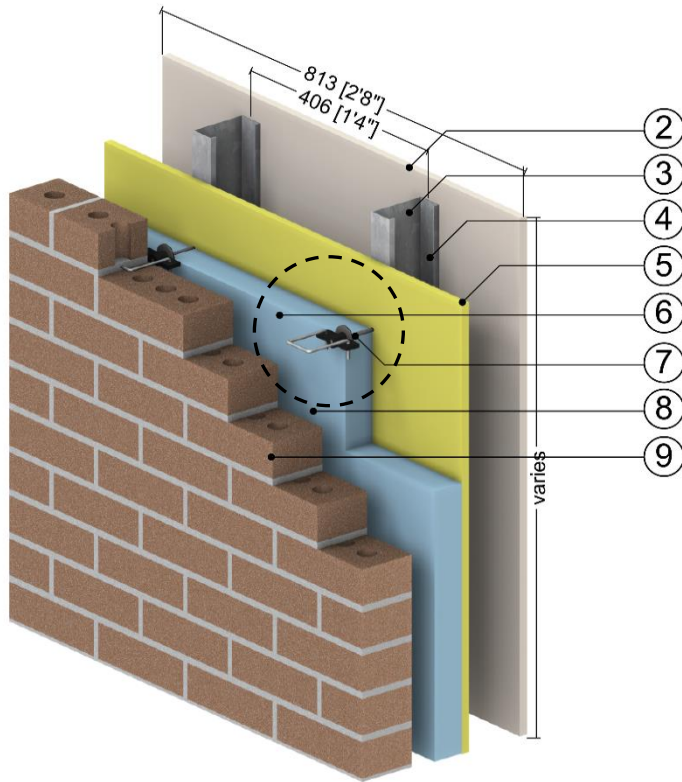



Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation (Mineral Wool)	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Barrel	-	118 (17)	-	489 (7830)	0.12 (500)
11	Steel Washer	1.5" (38) Ø	347 (50)	-	489 (7830)	0.12 (500)
12	Rubber Washer (EPDM)	-	1.7 (0.25)	-	-	-
13	Steel Wing Nut with Plastic Coating	Varies	347 (50)	-	489 (7830)	0.12 (500)
14	Galvanized Steel Wire Pintle	3/16" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.41

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel X-Seal Anchor Supporting Brick Veneer – Clear Wall

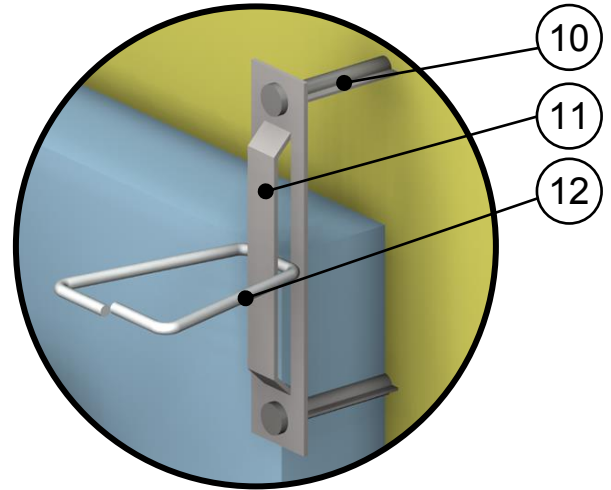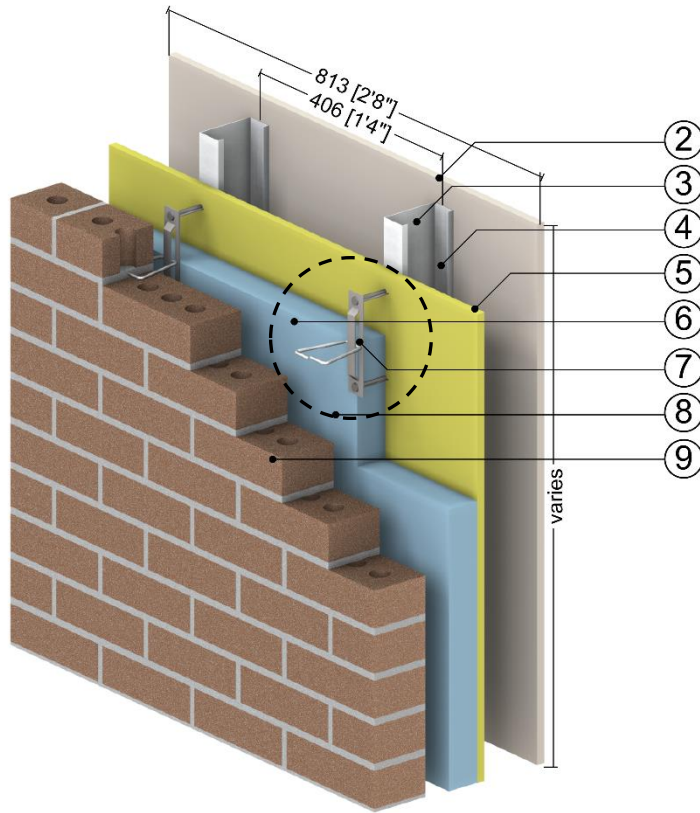


Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	Varies	-	-	-
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Galvanized Steel Fasteners	0.31" (8) Ø	430 (62)	-	489 (7830)	0.12 (500)
11	Galvanized Steel Veneer Anchor	-	430 (62)	-	489 (7830)	0.12 (500)
12	Galvanized Steel Triangle Tie	-	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.42 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel X-Seal Anchor Supporting Brick Veneer – Clear Wall


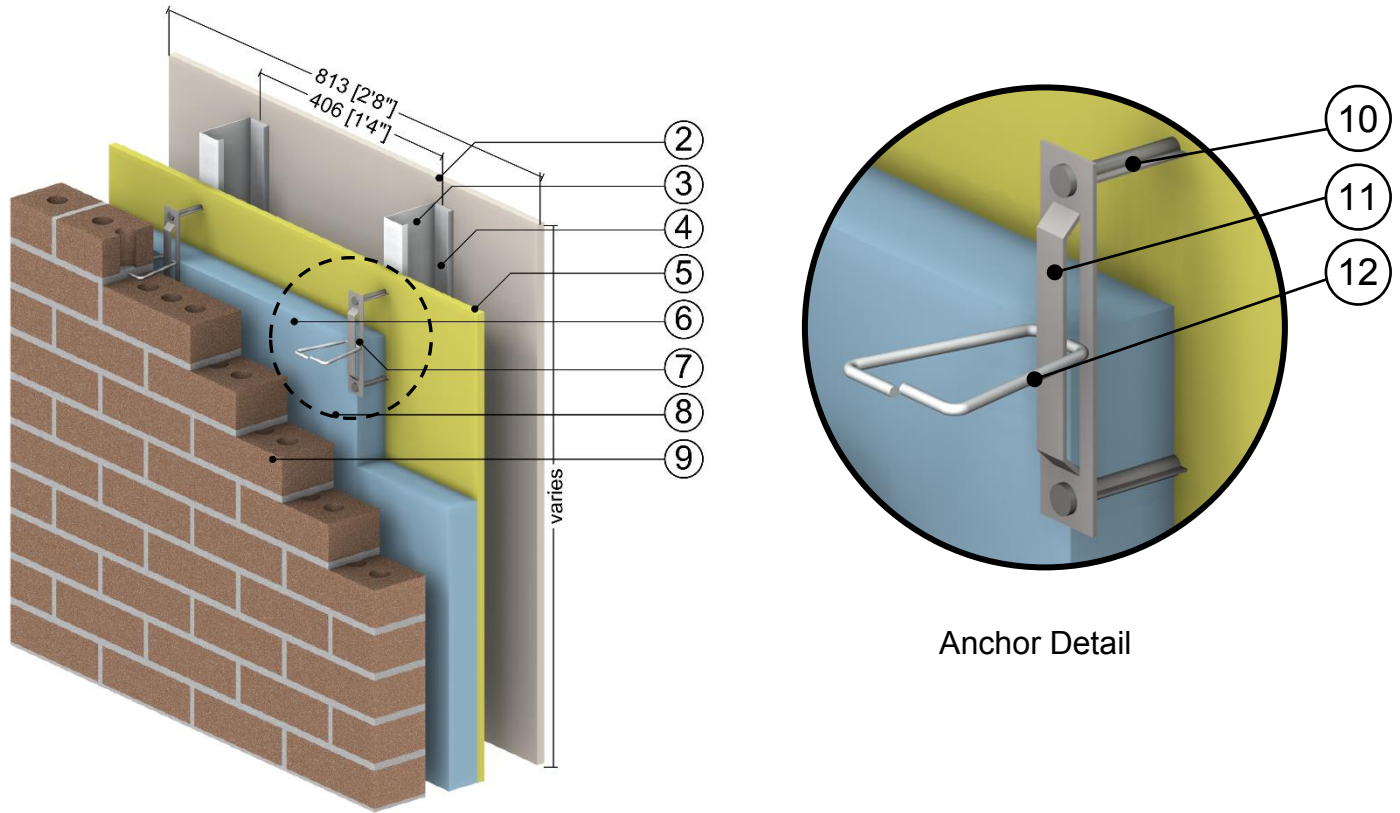


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	Varies	-	-	-
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Fasteners	0.31" (8) Ø	118 (17)	-	489 (7830)	0.12 (500)
11	Stainless Steel Tie	-	118 (17)	-	489 (7830)	0.12 (500)
12	Stainless Steel Triangle Tie	-	118 (17)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.43

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel HB-213 2X Anchor Supporting Brick Veneer – Clear Wall

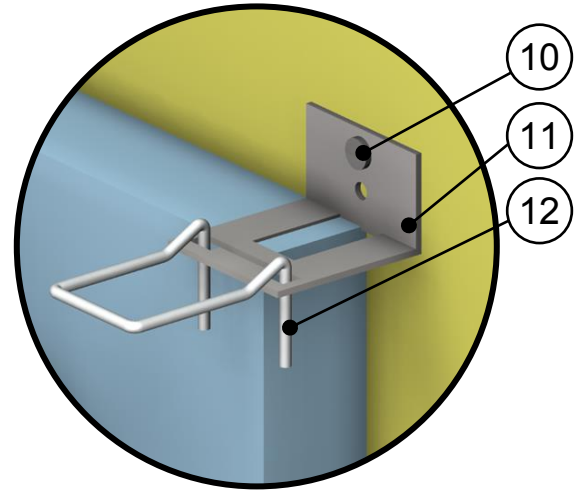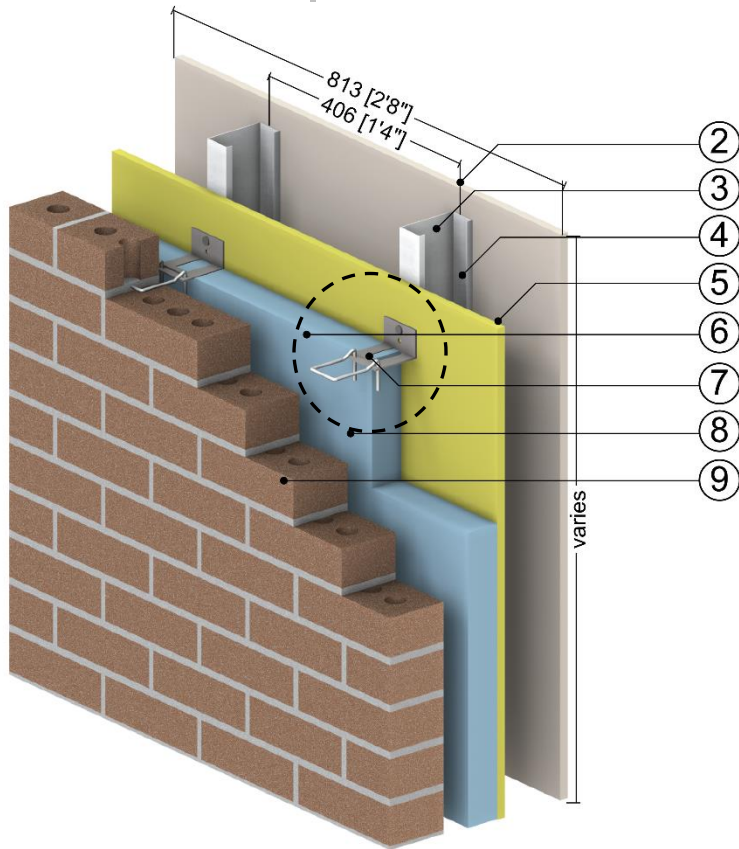



Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.070 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
11	Galvanized Steel Veneer Anchor	-	430 (62)	-	489 (7830)	0.12 (500)
12	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.44

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel HB-213 2X Anchor Supporting Brick Veneer – Clear Wall

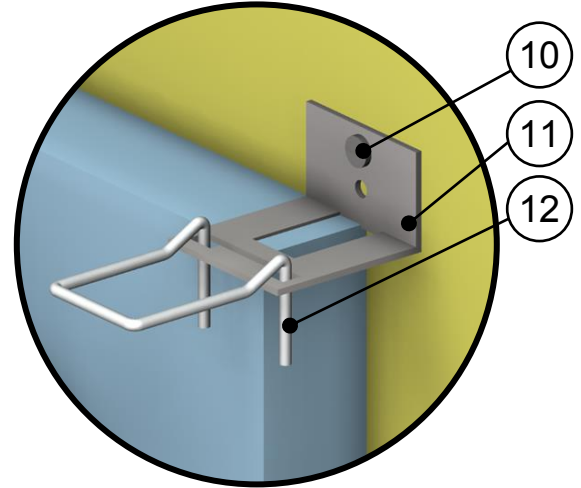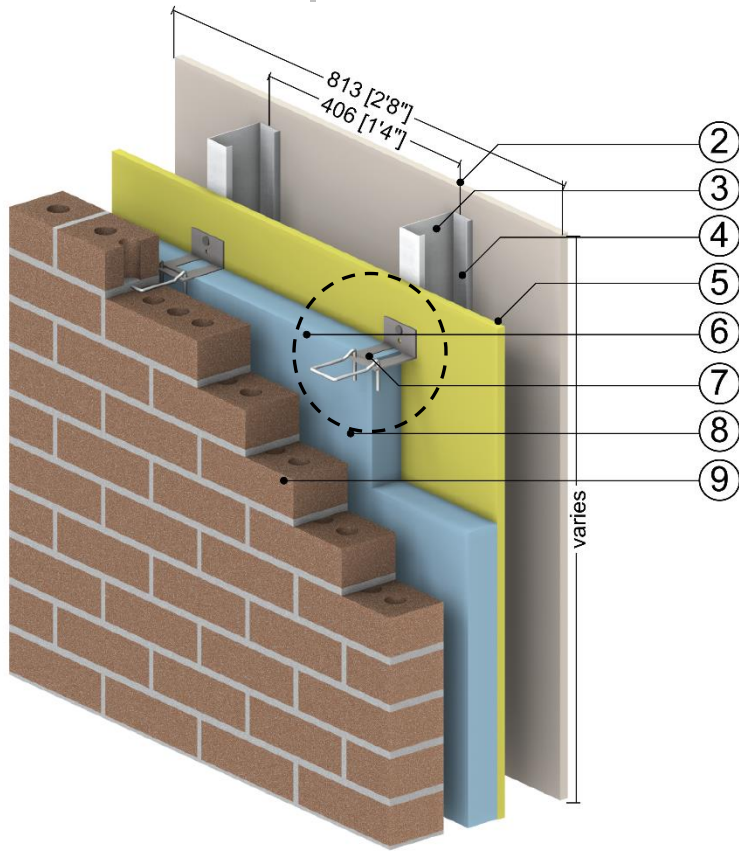


Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Fasteners	0.28" (7) Ø	118 (17)	-	489 (7830)	0.12 (500)
11	Stainless Steel Veneer Anchor	-	118 (17)	-	489 (7830)	0.12 (500)
12	Stainless Steel Wire Pintle	-	118 (17)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.45 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel HB-200-X Anchor Supporting Brick Veneer – Clear Wall

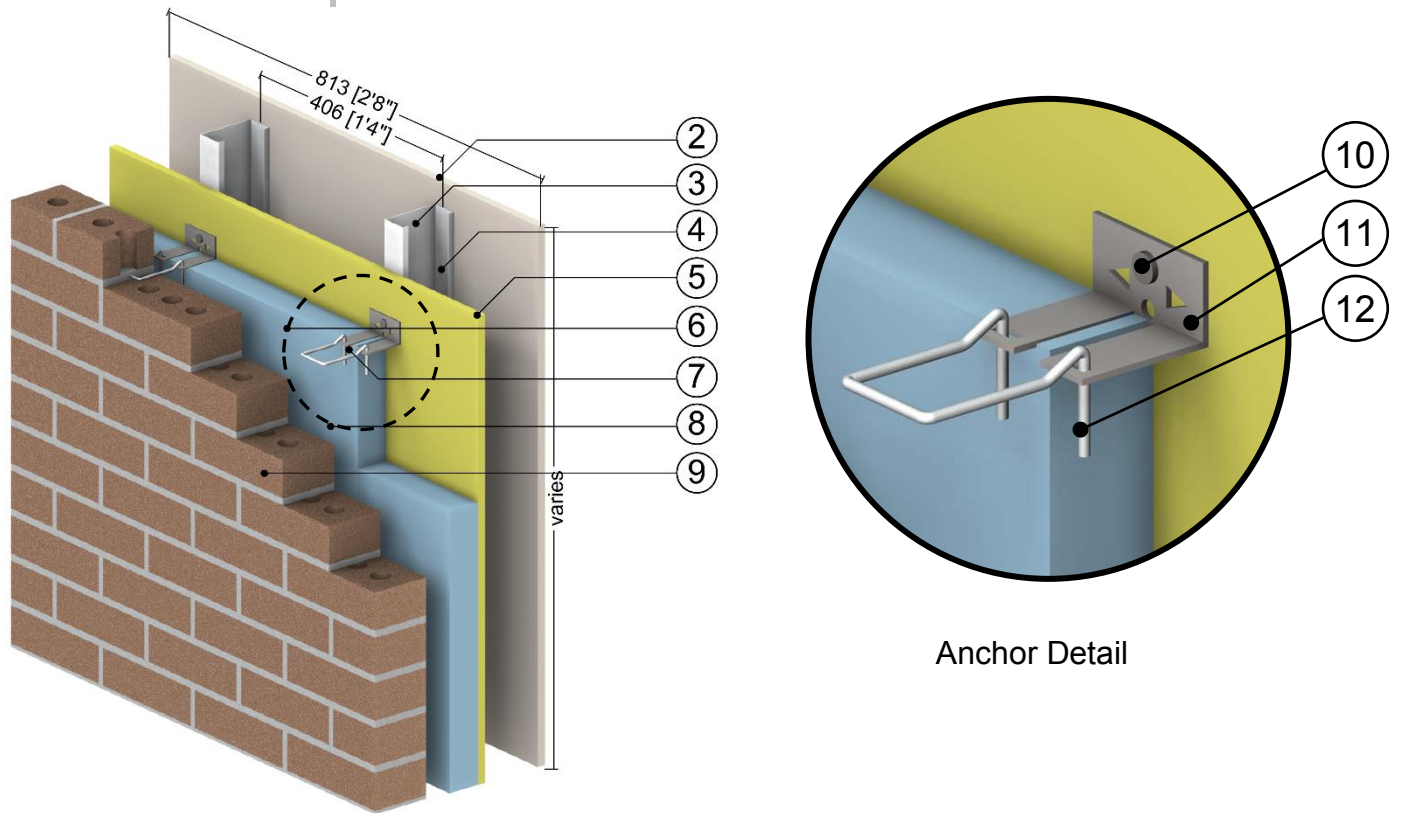


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Galvanized Steel Fasteners	0.31" (8) Ø	430 (62)	-	489 (7830)	0.12 (500)
11	Galvanized Steel Veneer Anchor	-	430 (62)	-	489 (7830)	0.12 (500)
12	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.46


Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel HB-200-X Anchor Supporting Brick Veneer – Clear Wall

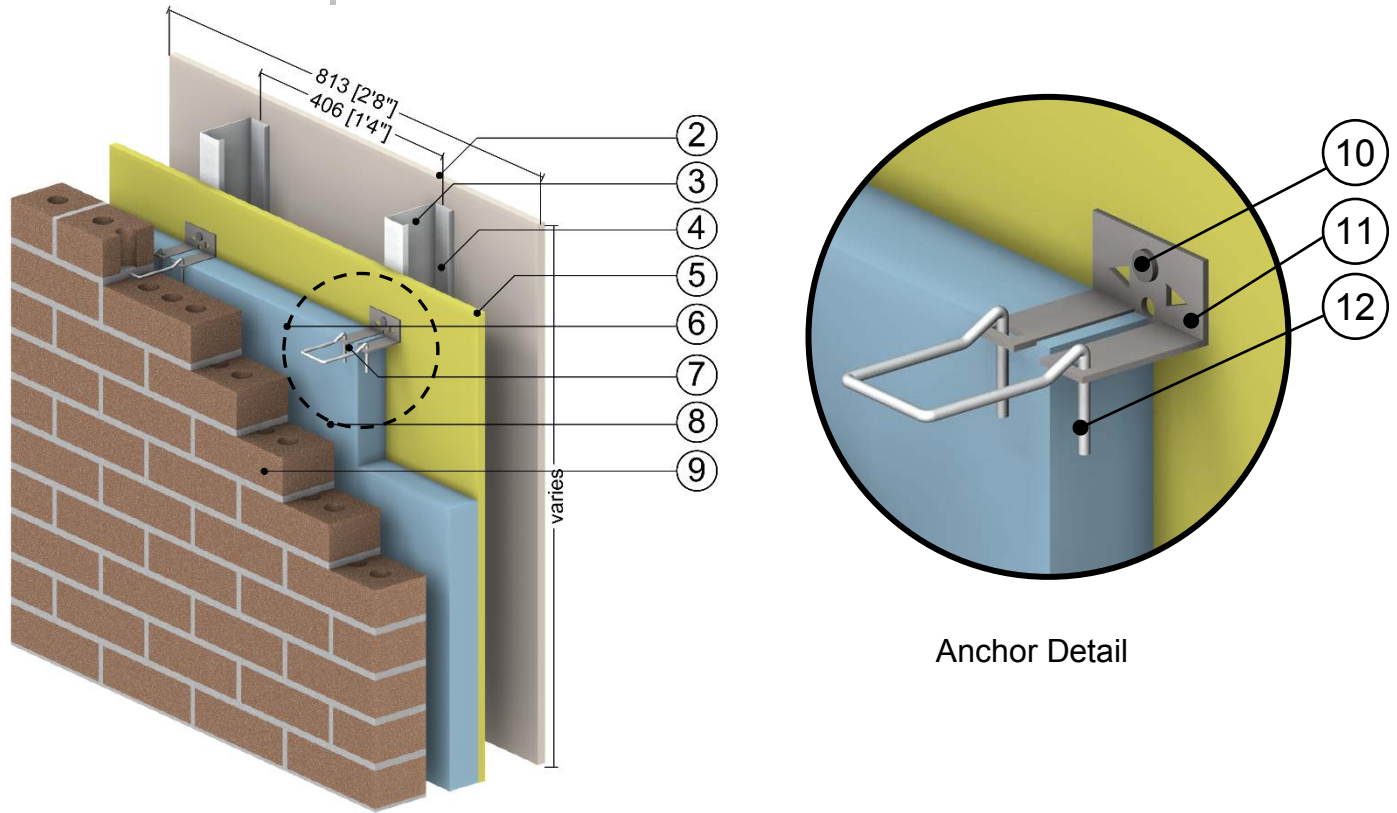

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Fasteners	0.31" (8) Ø	118 (17)	-	489 (7830)	0.12 (500)
11	Stainless Steel Veneer Anchor	-	118 (17)	-	489 (7830)	0.12 (500)
12	Stainless Steel Wire Pintle	-	118 (17)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.47 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Carbon Steel BL-407 Anchor Supporting Brick Veneer – Clear Wall


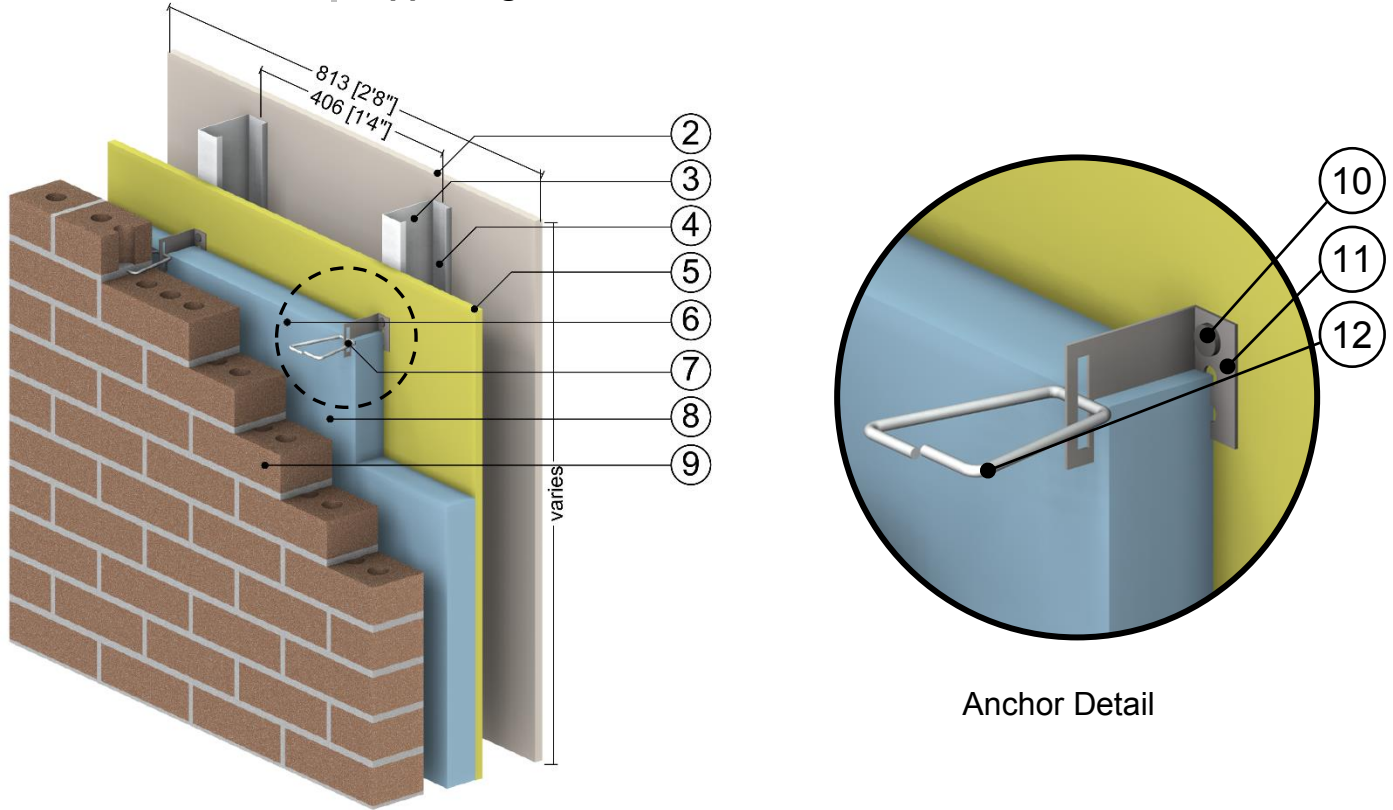


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Galvanized Steel Fasteners	0.28" (7) Ø	430 (62)	-	489 (7830)	0.12 (500)
11	Galvanized Steel Veneer Anchor	-	430 (62)	-	489 (7830)	0.12 (500)
12	Galvanized Steel Wire Pintle	-	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.48

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Hohmann & Barnard Masonry Stainless Steel BL-407 Anchor Supporting Brick Veneer – Clear Wall

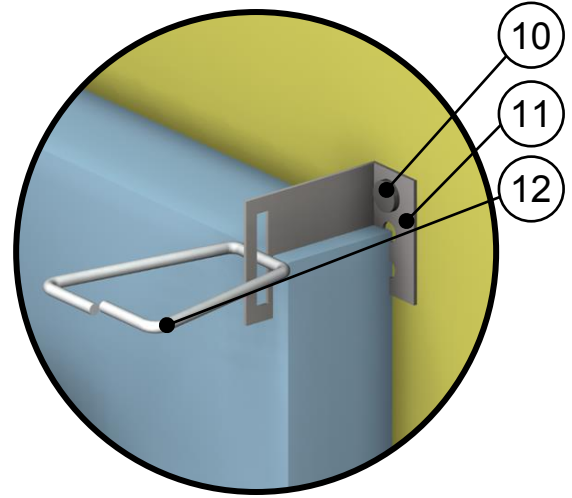
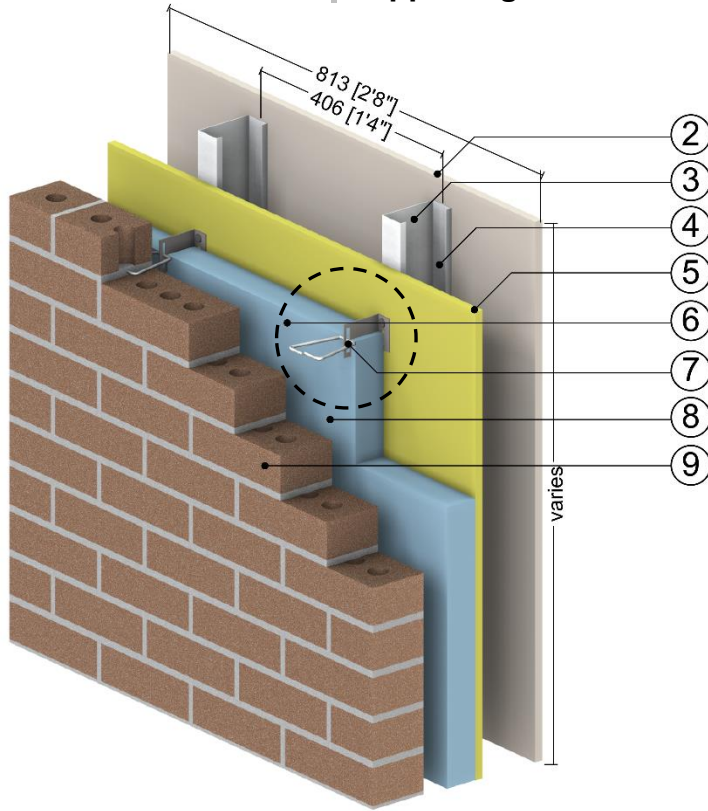


Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (13)	1.1 (0.16)	R-0.56 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Fasteners	0.28" (7) Ø	118 (17)	-	489 (7830)	0.12 (500)
11	Stainless Steel Veneer Anchor	-	118 (17)	-	489 (7830)	0.12 (500)
12	Stainless Steel Wire Pintle	-	118 (17)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.49 Vertical Insulated Metal Panel – Clear Wall with Vertical Connection Joint and Support Girt/Hat Track Backup Wall


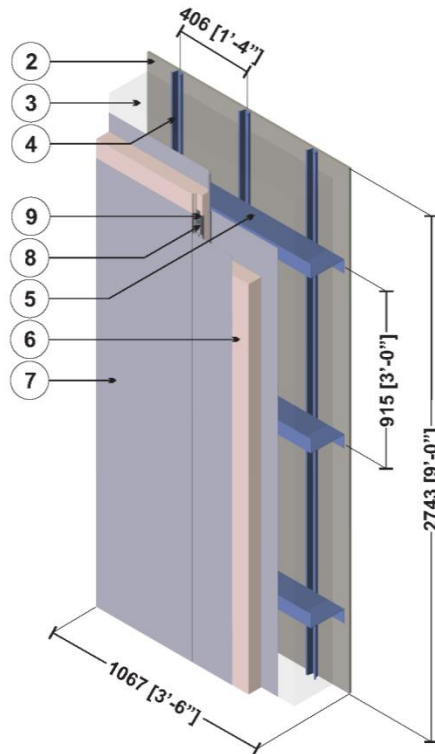


Vertical Joint


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	Varies	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.50 Vertical Insulated Metal Panel – Metal Stack Joint and Support Girt Back/Hat Track Backup Wall

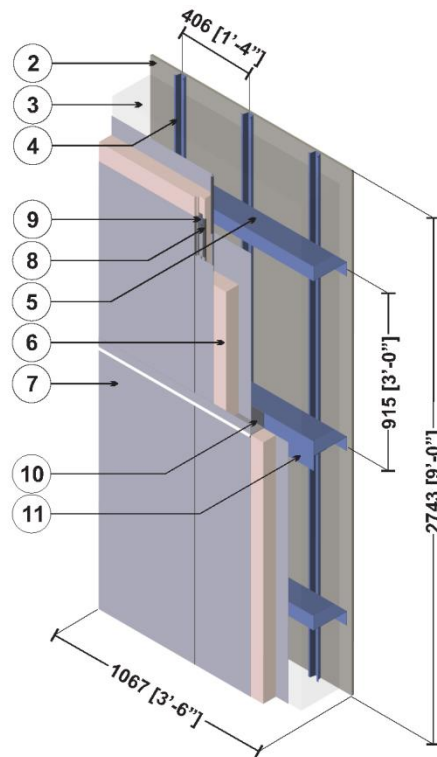

Vertical Joint





Horizontal Joint

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76)	0.143 (0.020)	R-21 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	Varies	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	Steel Flashing & Trim	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Steel Angle	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.51 | Horizontal Insulated Metal Panel – Clear Wall with Horizontal Connection Joint and Steel Stud Backup Wall

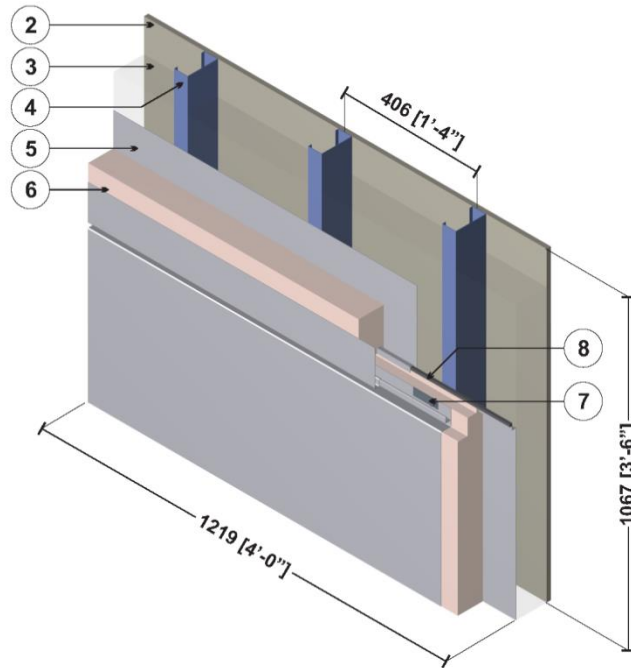


Horizontal Joint

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	Varies	2.4 (0.35)	-	-	-
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.52 | Horizontal Insulated Metal Panel – Vertical Gasket Joint with Steel Stud Backup Wall


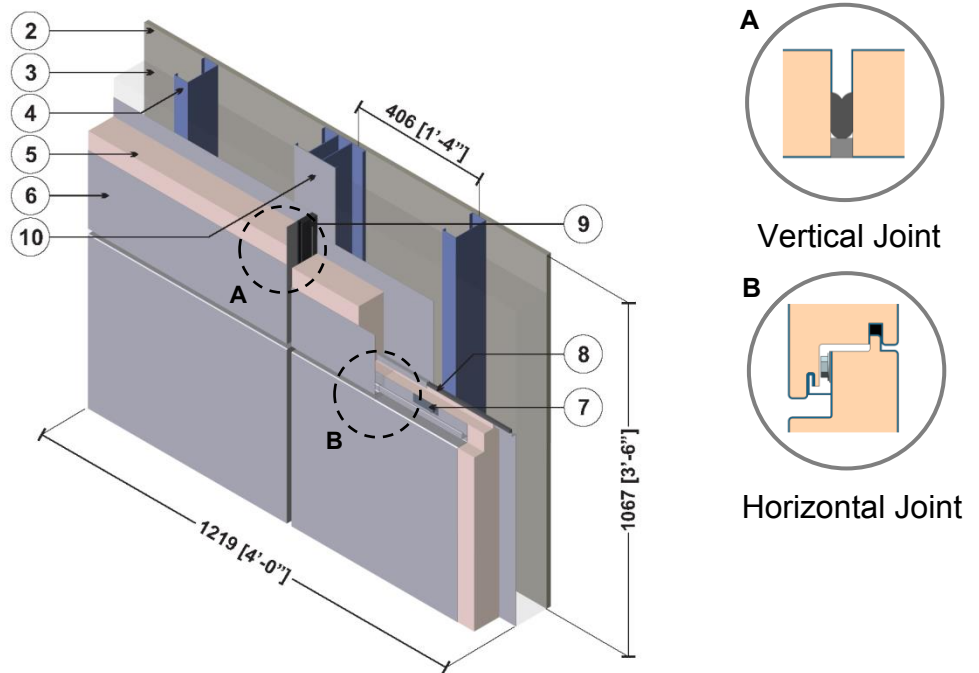


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	Varies	2.4 (0.35)	-	-	-
9	Gasket	1 1/3" (33)	0.966 (0.14)	-	-	-
10	Steel Plate	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.53

Structural Sheet Steel Wall with Cladding Supported by Notched Z-Bar for Baseline System – Clear Wall

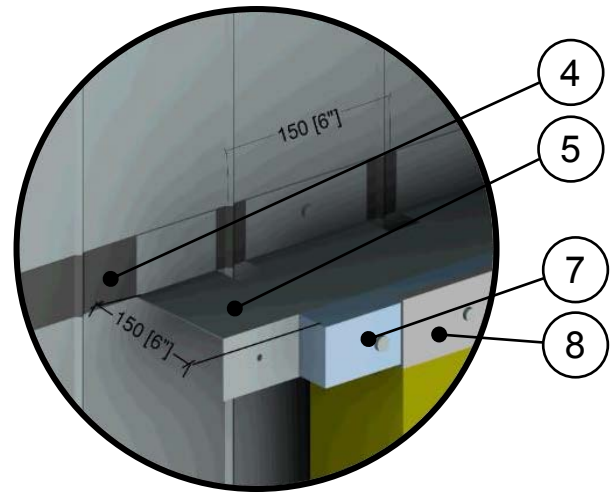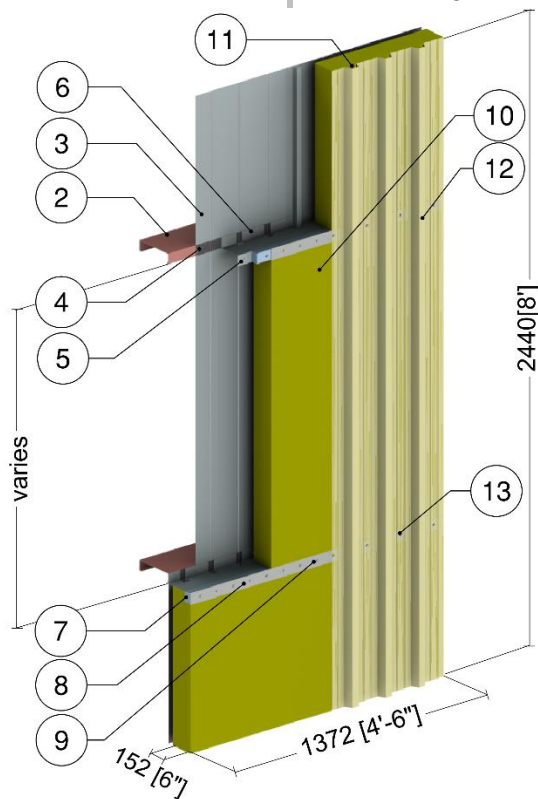



Notched Z-Bar with Thermal Block and U-Bar

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	8 x 2 Steel Girts @ 48" o.c.	0.10" (2.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner Panel	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.2)	0.097 (0.014)	-	-	-
5	Galvanized Steel Notched Z-Bar	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
7	Thermal Block Insulation	2" (50)	0.200 (0.029)	R-10 (1.76 RSI)	9.4 (150)	0.23 (1000)
8	Galvanized Steel U-Bar	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	#12 Galvanized Steel Fasteners (7.5" o.c.)	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
10	Exterior Mineral Wool Insulation	6" (152)	0.238 (0.034)	R-25 (4.4 RSI)	1.8 (28)	0.29 (1090)
11	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
12	Galvanized Steel Cladding	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
14	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 5.1.54 Structural Sheet Steel Wall with Cladding Supported by Intermittent Notched Z-Bar – Clear Wall

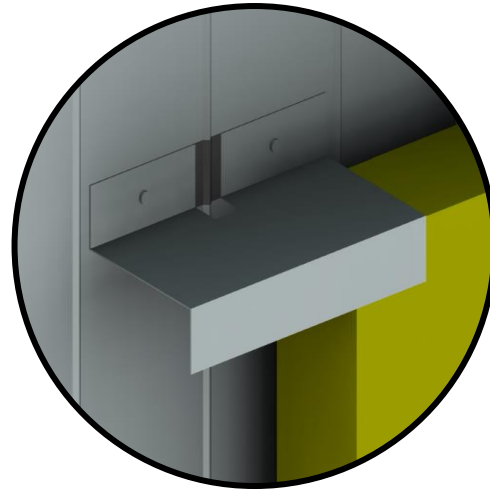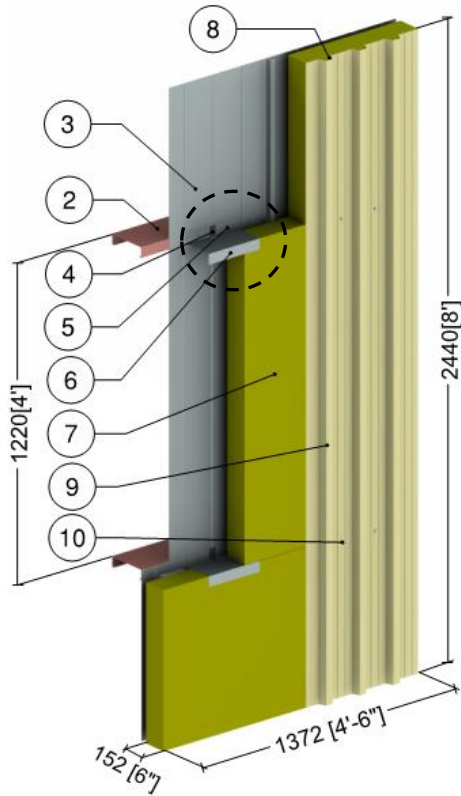



Intermittent Notched Z-Bar

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	8 x 2 Steel Girts @ 48" o.c.	0.10" (2.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner Panel	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.2)	0.097 (0.014)	-	-	-
5	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
6	Galvanized Steel Notched Z-Bar	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Mineral Wool Insulation	6" (152)	0.238 (0.034)	R-25 (4.4 RSI)	1.8 (28)	0.29 (1090)
8	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
9	Galvanized Steel Cladding	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	#12 Galvanized Steel Fasteners (7.5" o.c.)	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 5.1.55 | Structural Sheet Steel Wall with Cladding Supported by Thermal Chairs – Clear Wall

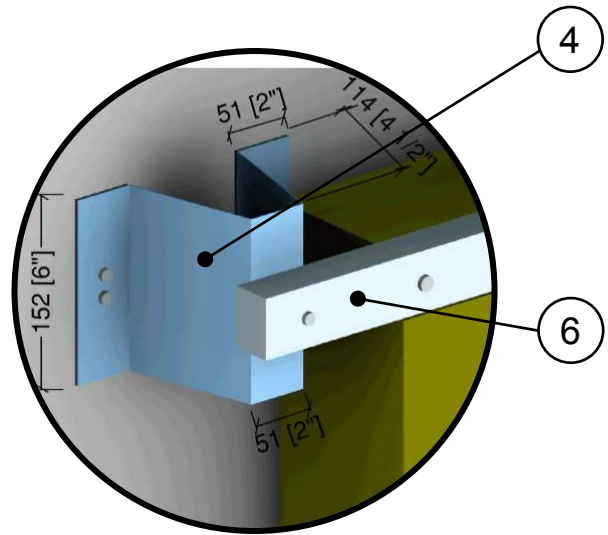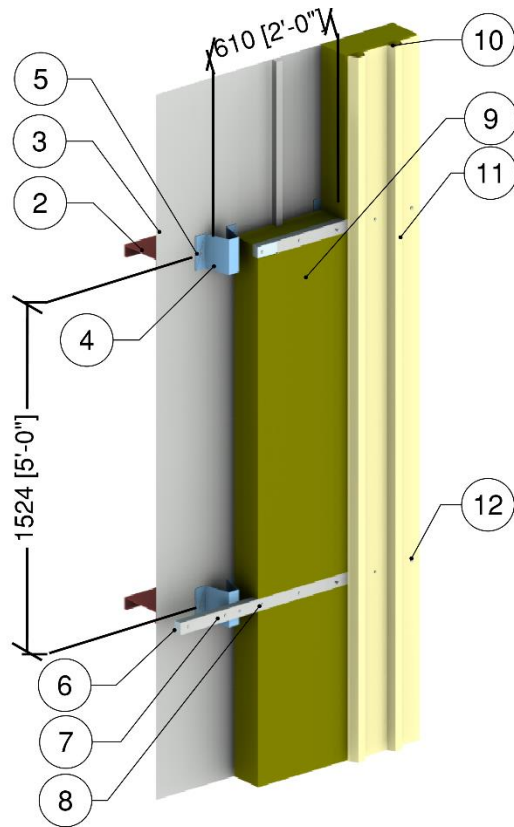



Thermal Chair with Thermal Block and U-Bar

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	8 x 2 Steel Girts @ 48" o.c.	0.10" (2.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner Panel	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal chairs	18 Gauge	430 (62)	-	-	-
5	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
6	Thermal Block Insulation	2" (50)	0.200 (0.029)	R-10 (1.76 RSI)	9.4 (150)	0.23 (1000)
7	Galvanized Steel U-Bar	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	#12 Galvanized Steel Fasteners (7.5" o.c.)	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
9	Exterior Mineral Wool Insulation	6" (152)	0.238 (0.034)	R-25 (4.4 RSI)	1.8 (28)	0.29 (1090)
10	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
11	Galvanized Steel Cladding	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	#12 Galvanized Steel Fasteners (7.5" o.c.)	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 5.1.56 | 2 Hour Fire Rated Structural Steel Sheet Wall with Cladding Supported by Notched Z-bar with Ceramic Blanket – Clear Wall

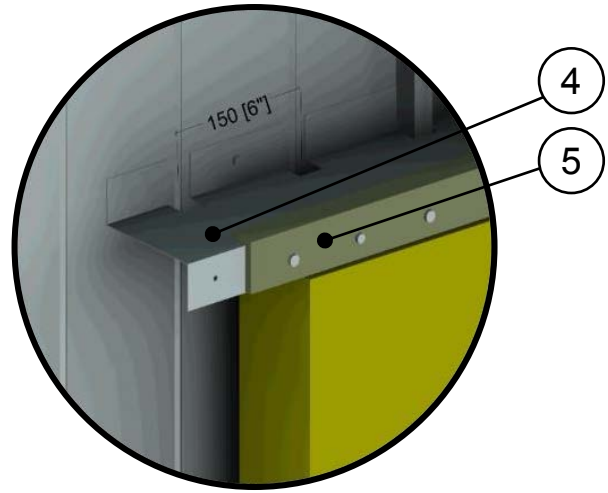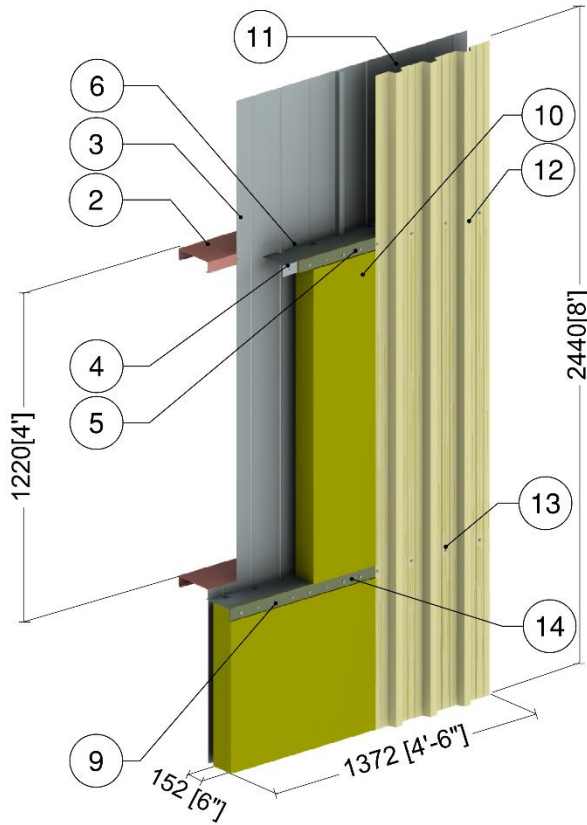

Notched Z-Bar with Ceramic Blanket



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	8 x 2 Steel Girts @ 48" o.c.	0.10" (2.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner Panel	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Galvanized Steel Notched Z-Bar	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Ceramic Fibre strip	-	-	-	-	-
6	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
7	#12 Galvanized Steel Fasteners	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Mineral Wool Insulation	6" (152)	0.238 (0.034)	R-25 (4.4 RSI)	1.8 (28)	0.29 (1090)
9	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
10	Galvanized Steel Cladding	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	#12 Galvanized Steel Fasteners (7.5" o.c.)	0.21" (5) Ø	430 (62)	-	489 (7830)	0.12 (500)
12	Ceramic Blanket	1/2" (13)	0.62 (0.09)	R-0.8 (0.14)	-	-
13	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 5.1.57

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System (16" o.c.) Supporting Horizontal and Vertical Sub-girts – Clear Wall

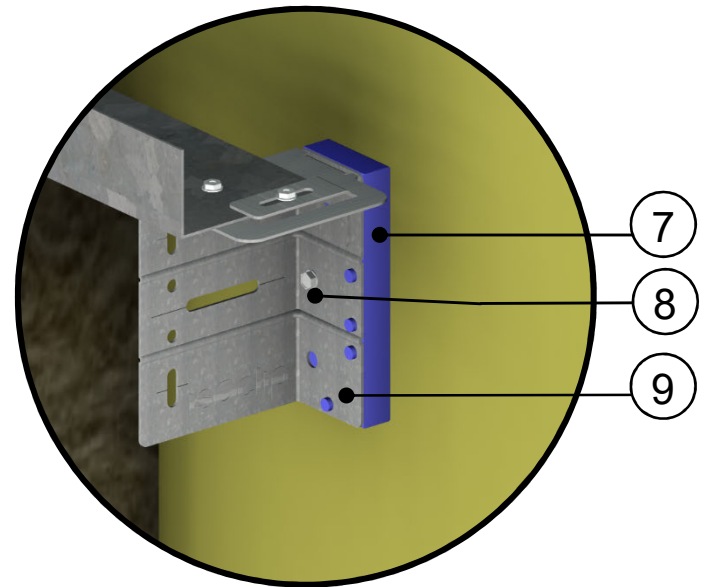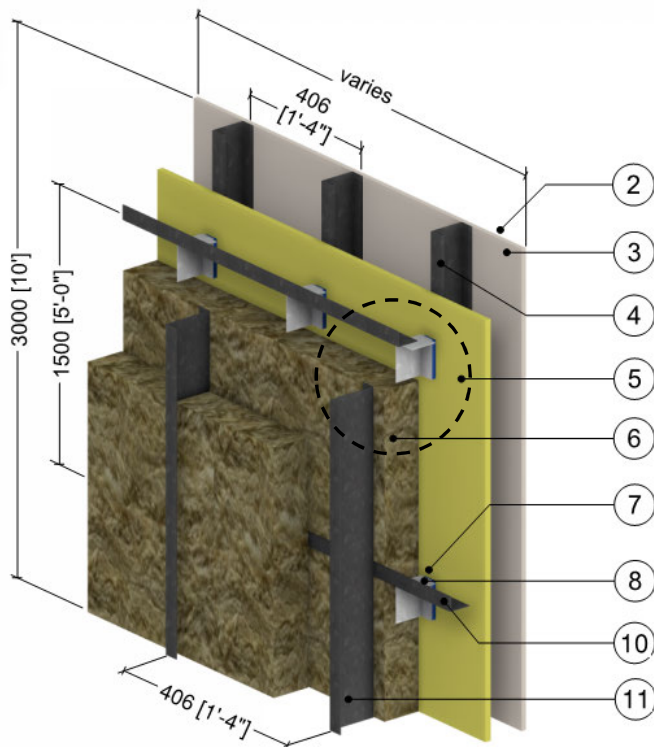



ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	Fasteners	1/4" (6) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Vertical Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.58

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System (32" o.c.) Supporting Horizontal and Vertical Sub-girts – Clear Wall

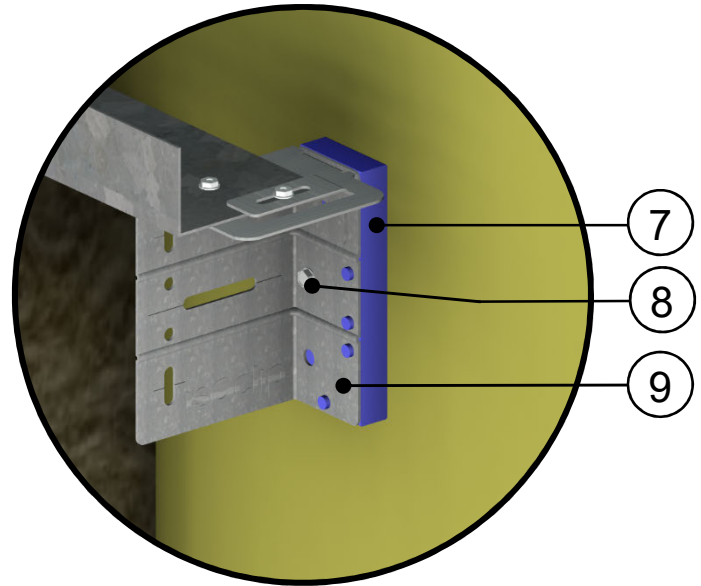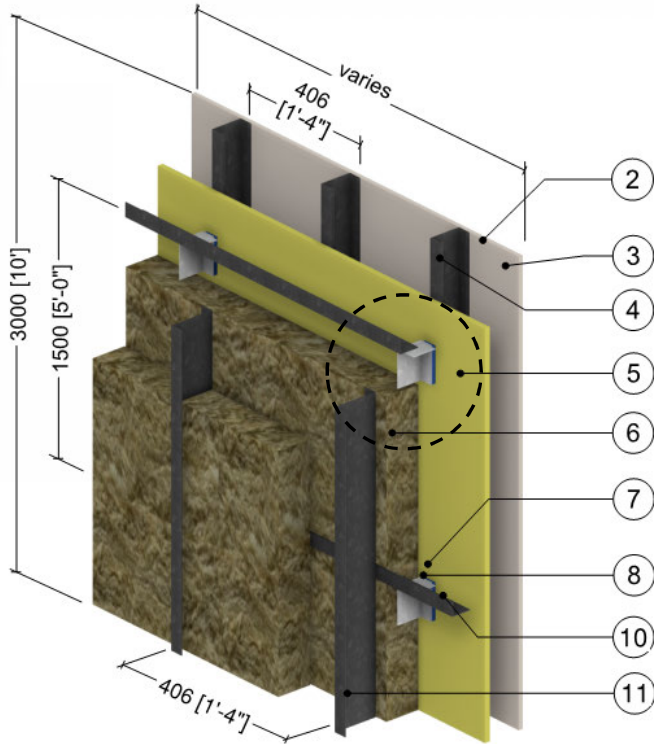



ISO Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	Fasteners	1/4" (6) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Vertical Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.59

Exterior and Interior Insulated 6" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall

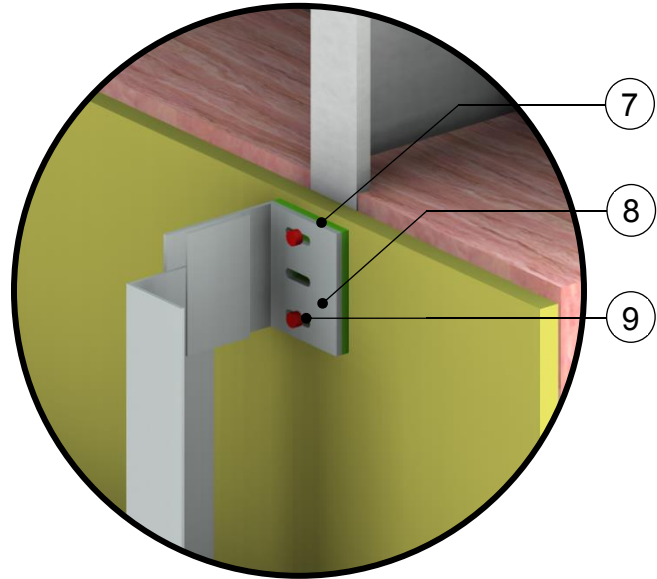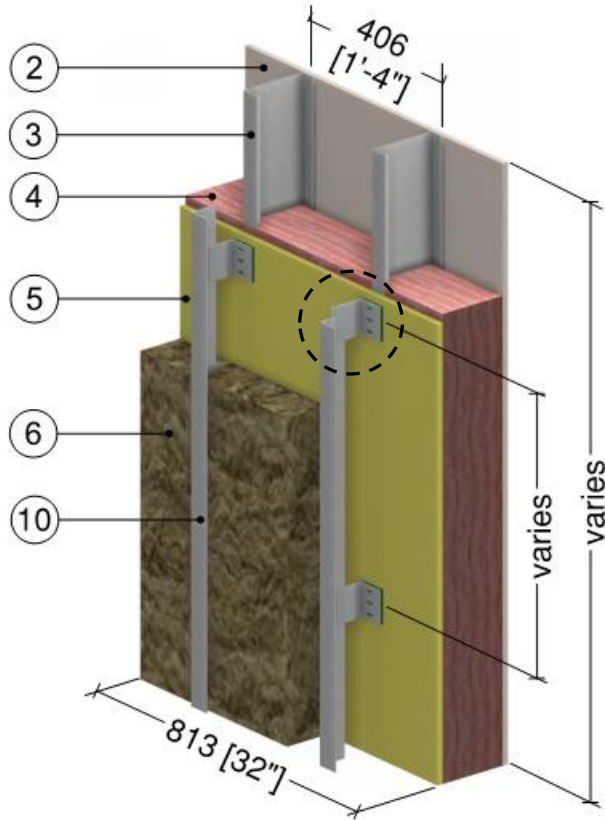



Nvelope NV1 Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	6" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	6" (152)	0.31 (0.045)	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1.5" to 4" (38 to 102)	0.24 (0.034)	R-6.3 to R-16.8 (1.11 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Nvelope Clip Isolator	0.2" (5)	0.82 (0.117)	-	-	-
8	Nvelope Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fastener	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Vertical Aluminum Sub-girt	0.09" (2.2)	1340 (193)	-	168 (2700)	0.22 (900)
11	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.60

Exterior and Interior Insulated 6" x 1 5/8" Slotted Steel R-Stud (16" o.c.) Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall

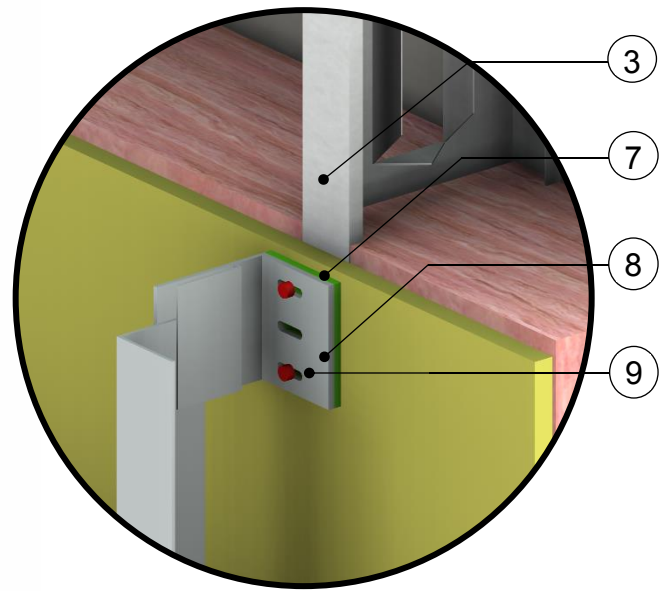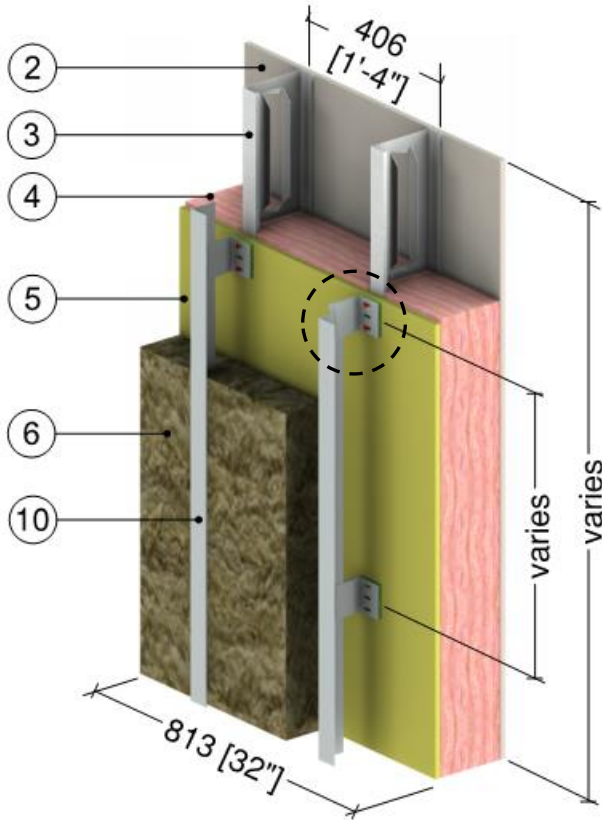



Nvelope NVI Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	6" x 1 5/8" Slotted Steel R-Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	6" (152)	0.31 (0.045)	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1.5" to 4" (38 to 102)	0.24 (0.034)	R-6.3 to R-16.8 (1.11 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Nvelope Clip Isolator	0.2" (5)	0.82 (0.117)	-	-	-
8	Nvelope Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fastener	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Vertical Aluminum Sub-girt	0.09" (2.2)	1340 (193)	-	168 (2700)	0.22 (900)
11	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.61

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobacket Clip System Supporting Cladding – Clear Wall

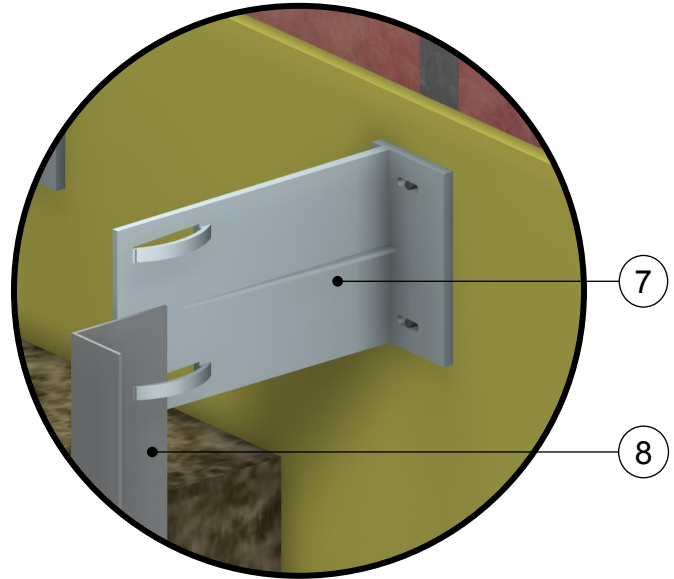
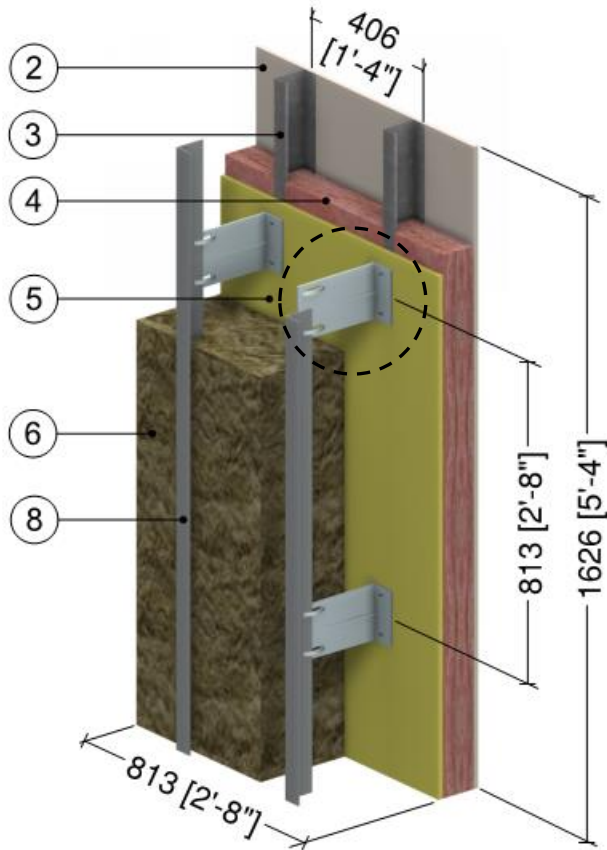


Nvelope Eko Clip Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.31 (0.045)	R-13 (2.29 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	10" (254)	0.24 (0.034)	R-42.0 (7.40 RSI)	4 (64)	0.20 (850)
7	Nvelope Eko Thermobacket (Polymer Composite)	-	4.86 (0.70)	-	-	-
8	Vertical Aluminum Sub-girt	0.09" (2.2)	1340 (193)	-	-	-
9	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.62 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobacket and NV1 Clip System Supporting Cladding – Clear Wall

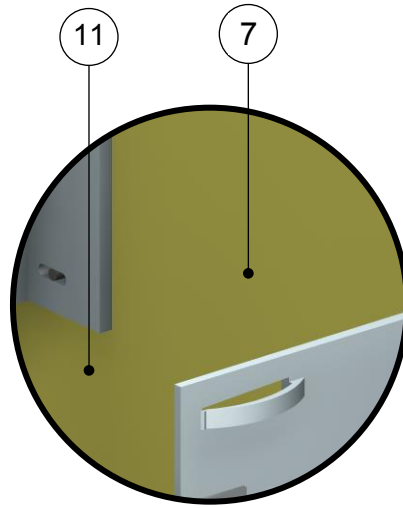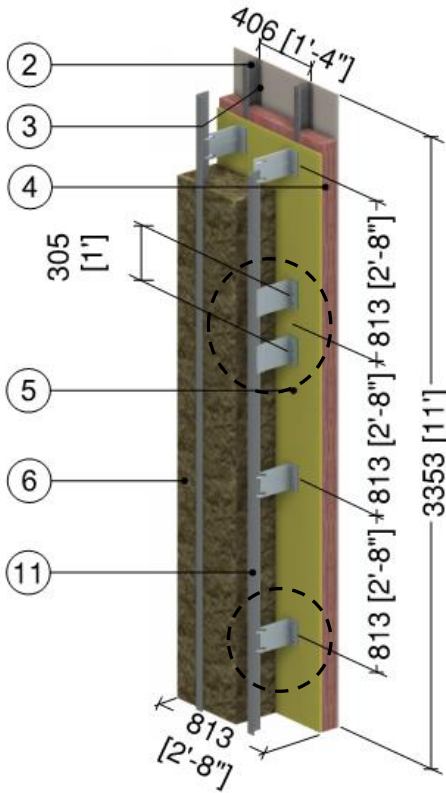

Nvelope Eko Thermobacket Clip Detail

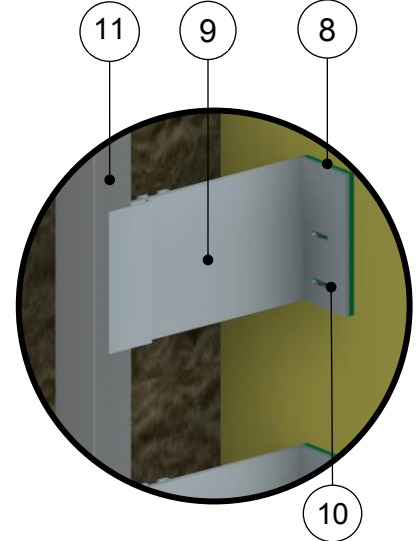


Nvelope NV1 Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.31 (0.045)	R-13 (2.29 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	10" (254)	0.24 (0.034)	R-42.0 (7.40 RSI)	4 (64)	0.20 (850)
7	Nvelope Eko Thermobacket (Polymer Composite)	-	4.86 (0.70)	-	-	-
8	Nvelope Clip Isolator	0.2" (5)	0.82 (0.117)	-	-	-
9	Nvelope Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	-	-
10	#14 Stainless Steel Fastener	1/4" (6) ∅	118 (17)	-	-	-
11	Vertical Aluminum Sub-girt	0.09" (2.2)	1340 (193)	-	-	-
12	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.63 Exterior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Vci Vertical System – Clear Wall

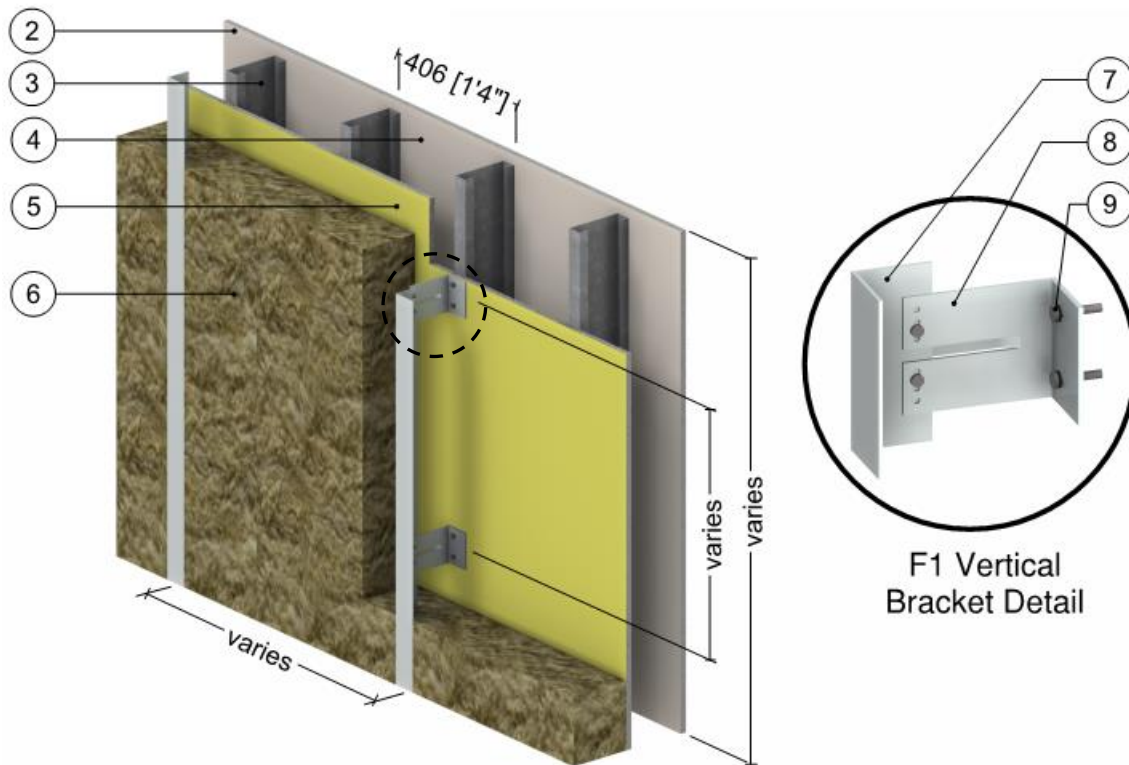


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 1/2" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	5/8" (15)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 6" (51 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	L Angle Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
8	ECO Cladding Alpha V Bracket Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.64


Exterior and Interior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Vci Vertical System – Clear Wall

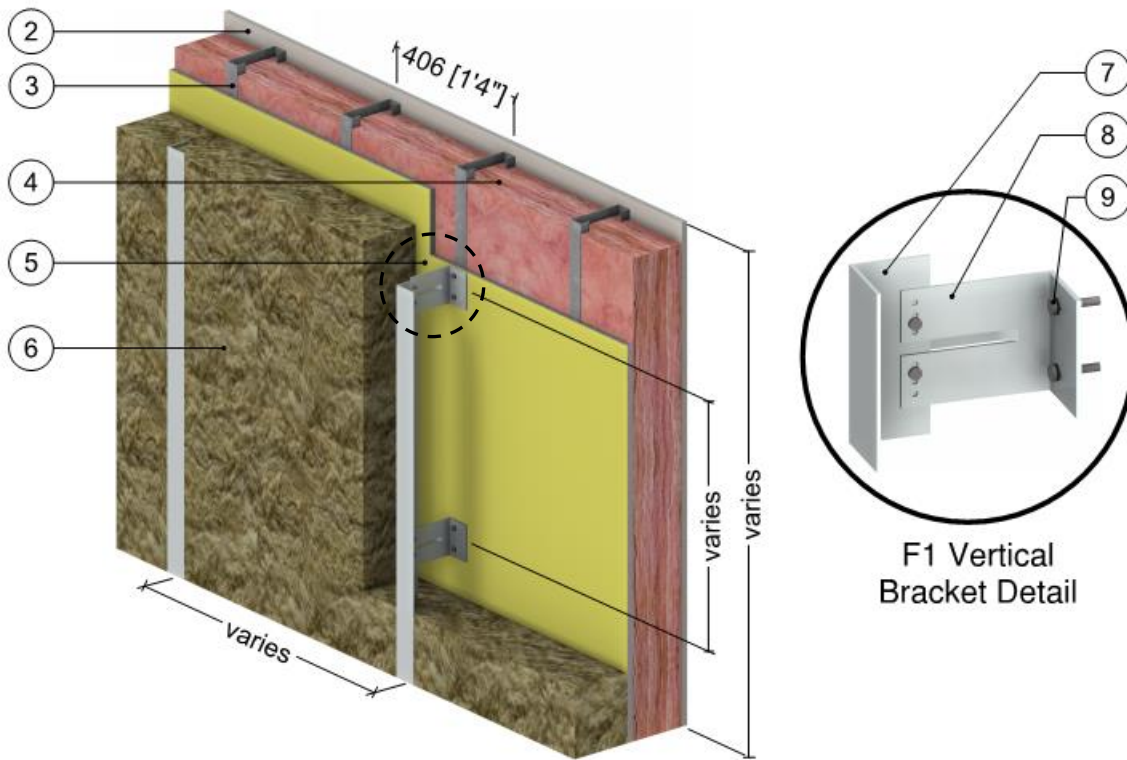

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	6" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	5 1/2" (140)	-	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	5/8" (15)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 6" (51 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	L Angle Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
8	ECO Cladding Alpha V Bracket Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.65 Exterior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Hci Horizontal System – Clear Wall

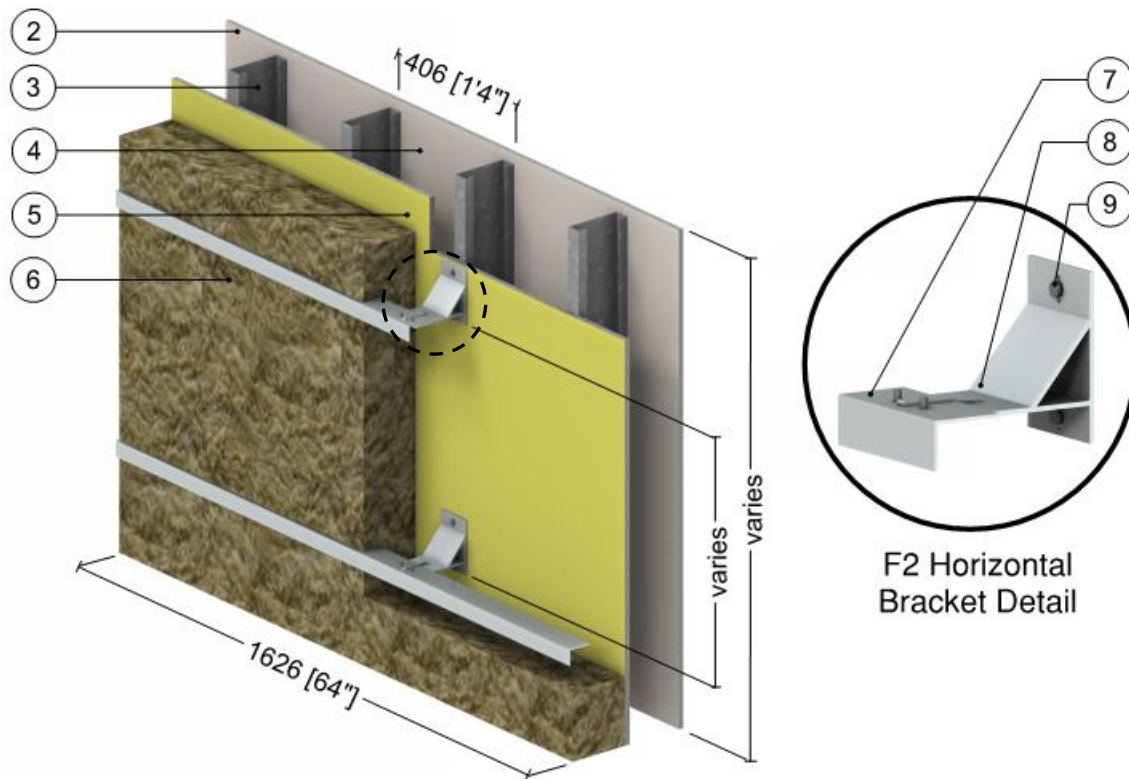


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 1/2" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	5/8" (15)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 6" (51 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	L Angle Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
8	ECO Cladding Alpha H Bracket Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.66



Exterior and Interior Insulated 5 1/2" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with ECO Cladding Alpha Hci Horizontal System – Clear Wall

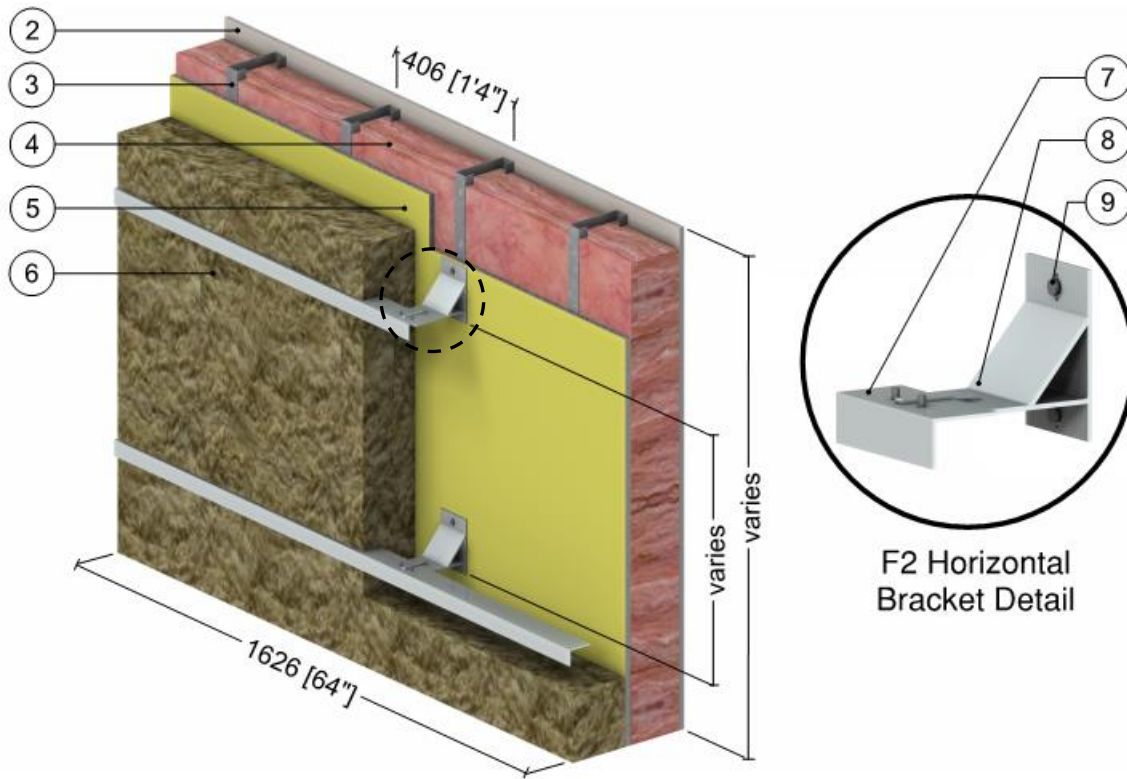

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	5 1/2" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	5 1/2" (140)	-	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	5/8" (15)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	2" to 6" (51 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	L Angle Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
8	ECO Cladding Alpha H Bracket Aluminum 6063	-	1450 (209)	-	168 (2700)	0.22 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.13 (530)
10	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.1.67 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Horizontal Z-Girts Supporting Cladding – Clear Wall

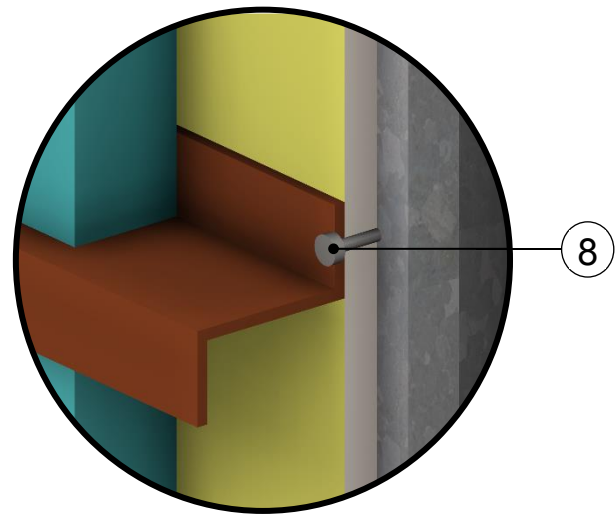
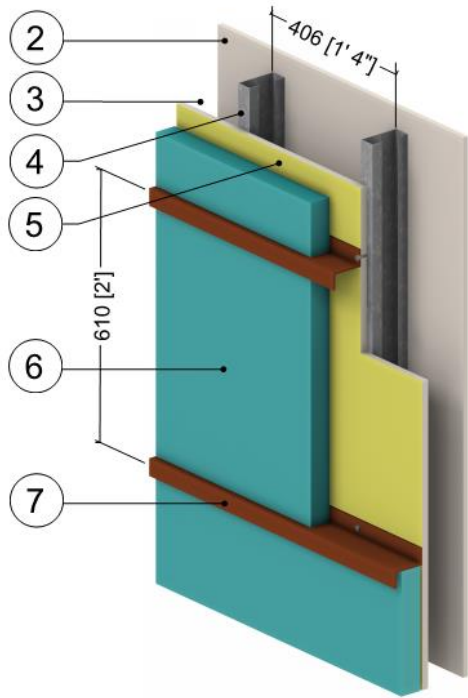


FRR Girt Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5.0 to R-35.0 (0.88 RSI to 6.16 RSI)	4 (64)	0.20 (850)
7	Armadillo FRR Girt	-	1.4 (0.2)	-	85 (5.3)	-
8	#12 Steel Fasteners (16" o.c.)	7/32" (5.5) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film	-	-	R-0.7 (0.12 RSI)	-	-

Detail 5.1.68

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Horizontal Z-Girts Supporting Cladding – Clear Wall

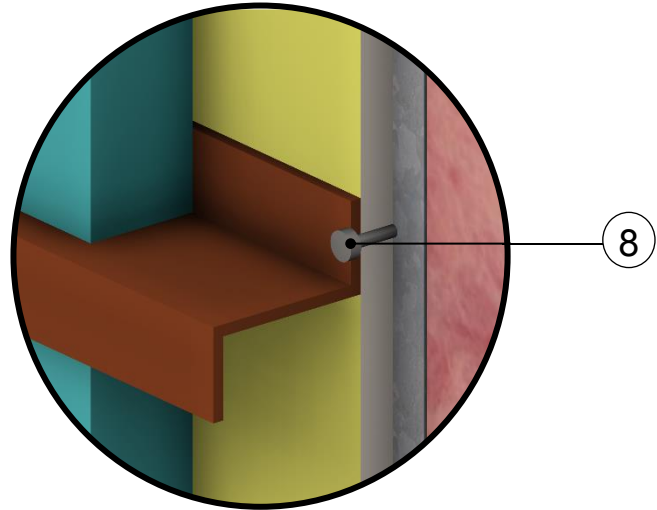
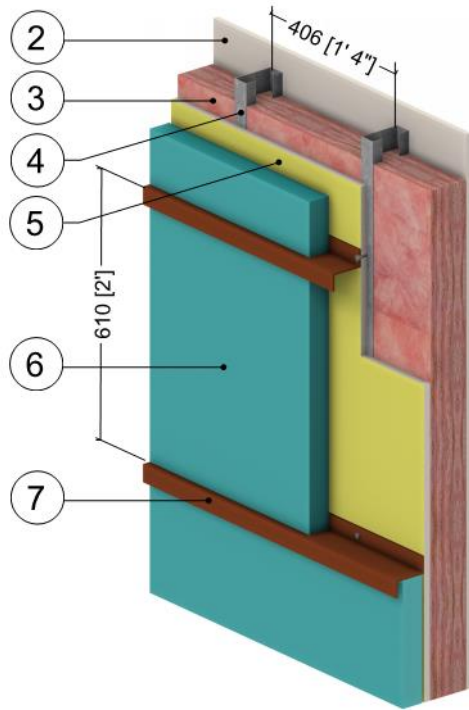


FRR Girt Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr-ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	-	R-13.0 (2.29 RSI)	4 (64)	0.20 (850)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5.0 to R-35.0 (0.88 RSI to 6.16 RSI)	4 (64)	0.20 (850)
7	Armadillo FRR Girt	-	1.4 (0.2)	-	85 (5.3)	-
8	#12 Steel Fasteners (16" o.c.)	7/32" (5.5) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film	-	-	R-0.7 (0.12 RSI)	-	-

Detail 5.1.69



Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Vertical Z-Girts Supporting Cladding – Clear Wall

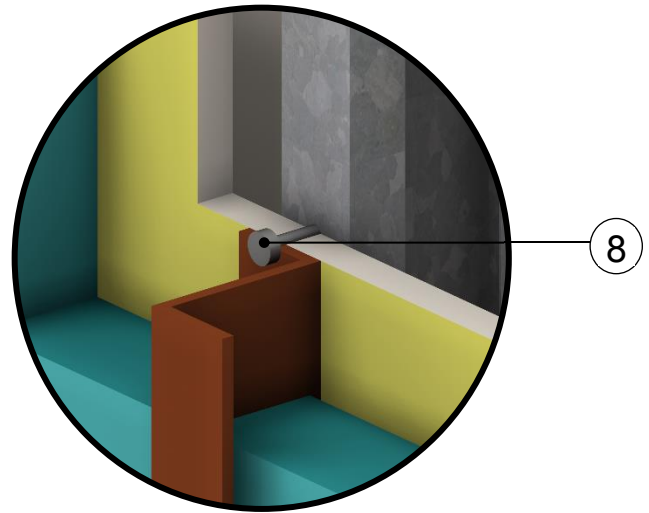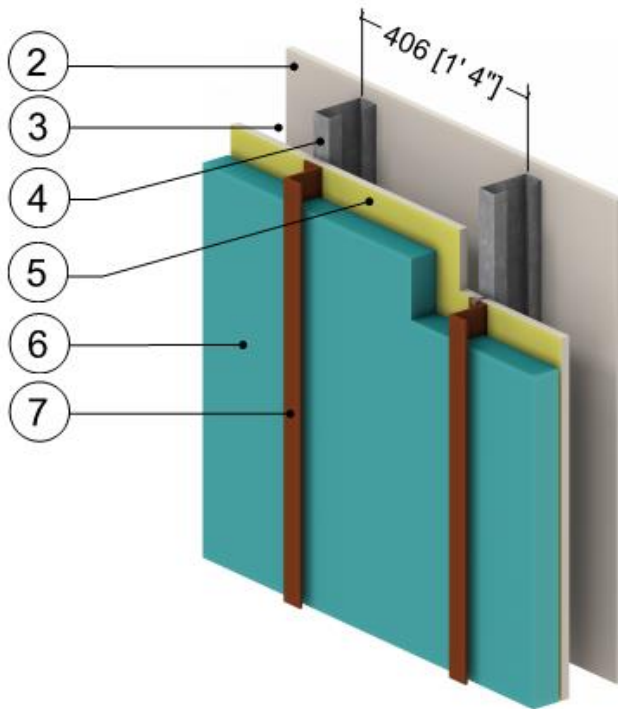

FRR Girt Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr-ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5.0 to R-35.0 (0.88 RSI to 6.16 RSI)	4 (64)	0.20 (850)
7	Armadillo FRR Girt	-	1.4 (0.2)	-	85 (5.3)	-
8	#12 Steel Fasteners (16" o.c.)	7/32" (5.5) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film	-	-	R-0.7 (0.12 RSI)	-	-

Detail 5.1.70 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" O.C.) Wall Assembly with Armadillo FRR Vertical Z-Girts Supporting Cladding – Clear Wall

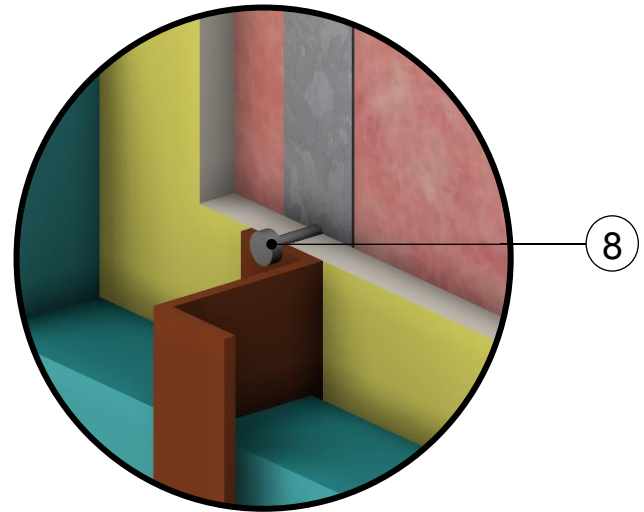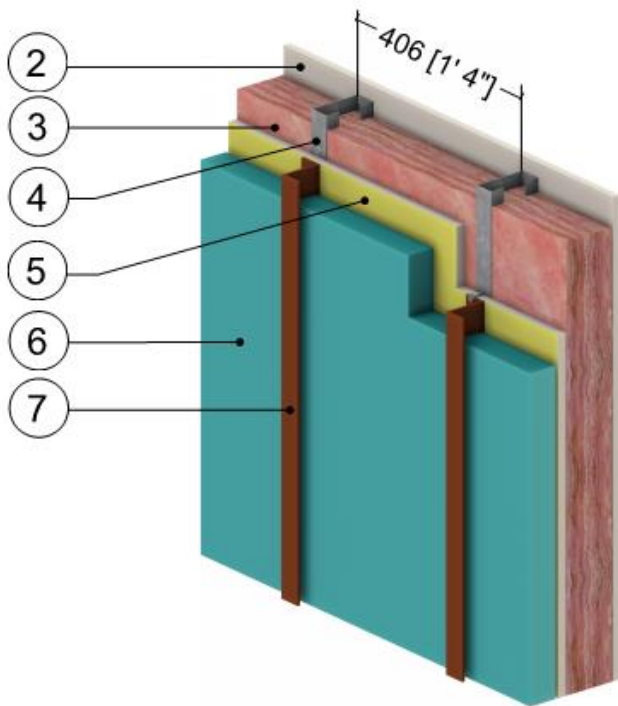


FRR Girt Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	-	R-13.0 (2.29 RSI)	4 (64)	0.20 (850)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5.0 to R-35.0 (0.88 RSI to 6.16 RSI)	4 (64)	0.20 (850)
7	Armadillo FRR Girt	-	1.4 (0.2)	-	85 (5.3)	-
8	#12 Steel Fasteners (16" o.c.)	7/32" (5.5) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film	-	-	R-0.7 (0.12 RSI)	-	-

Detail 5.2.1

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection

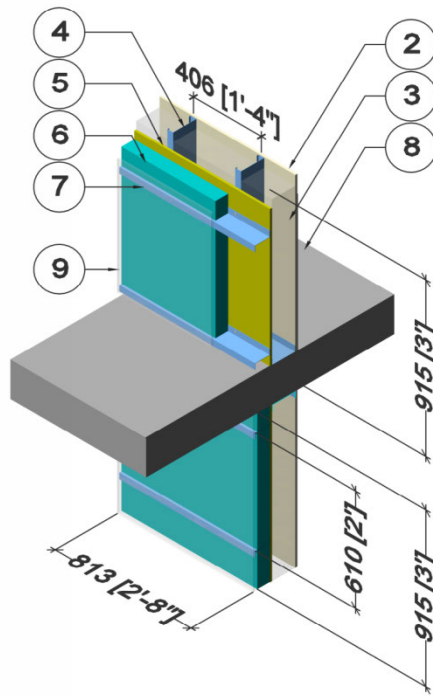


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.2

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection with Top Side Insulation

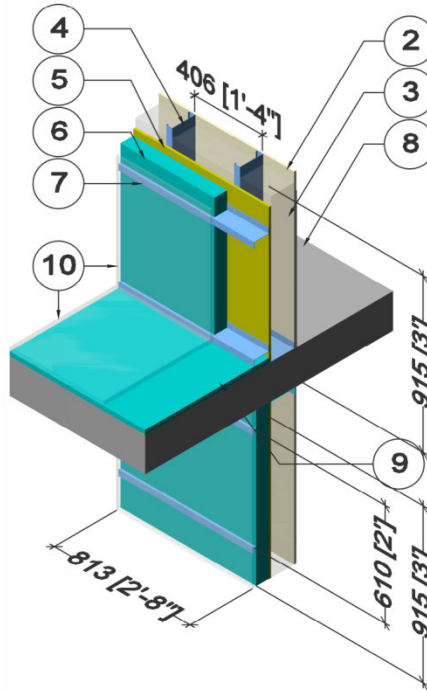


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
9	Exterior Balcony Insulation ²	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
10	Metal cladding/flashing/ finished soffit/pavers with vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² Exterior Balcony Insulation Length varies at 0" (0mm), 7 7/8" (200mm), 15 3/4" (400mm), 31 1/2" (800mm) from wall

Detail 5.2.3

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Intermediate Floor Intersection with Top & Under Side Insulation

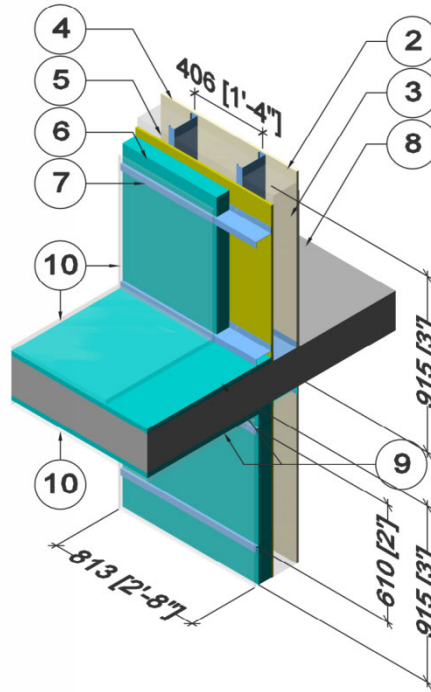



ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Exterior Balcony & Soffit Insulation ²	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
10	Metal cladding/flashing/ finished soffit/pavers with vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² Exterior Balcony Insulation Length varies at 0" (0mm), 7 7/8" (200mm), 15 3/4" (400mm), 31 1/2" (800mm) from wall

Detail 5.2.4

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Uninsulated Curb

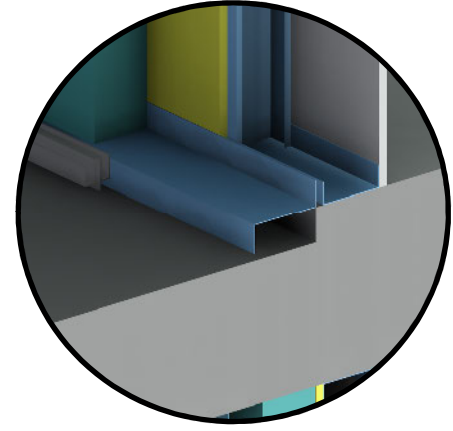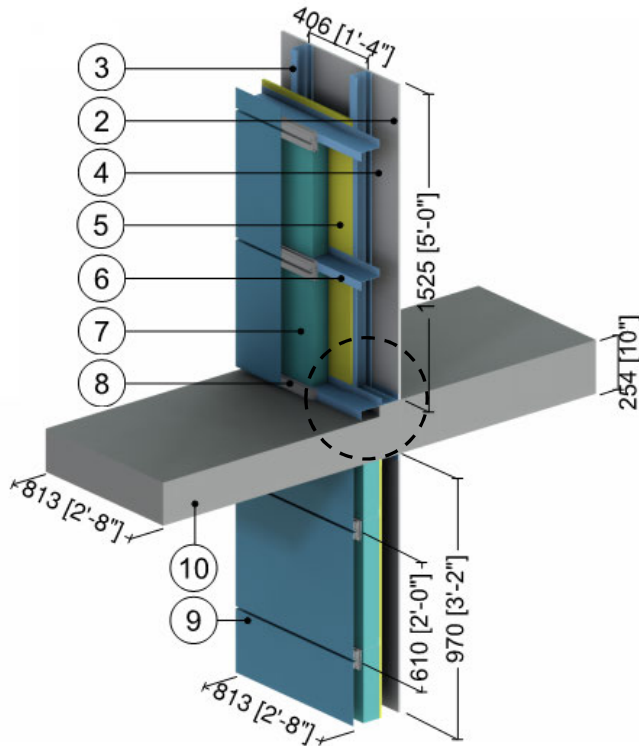

Balcony Stepdown Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Concrete Slab	8" (204)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.2.5

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Uninsulated Curb

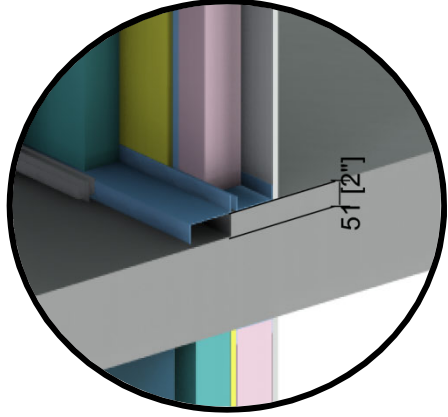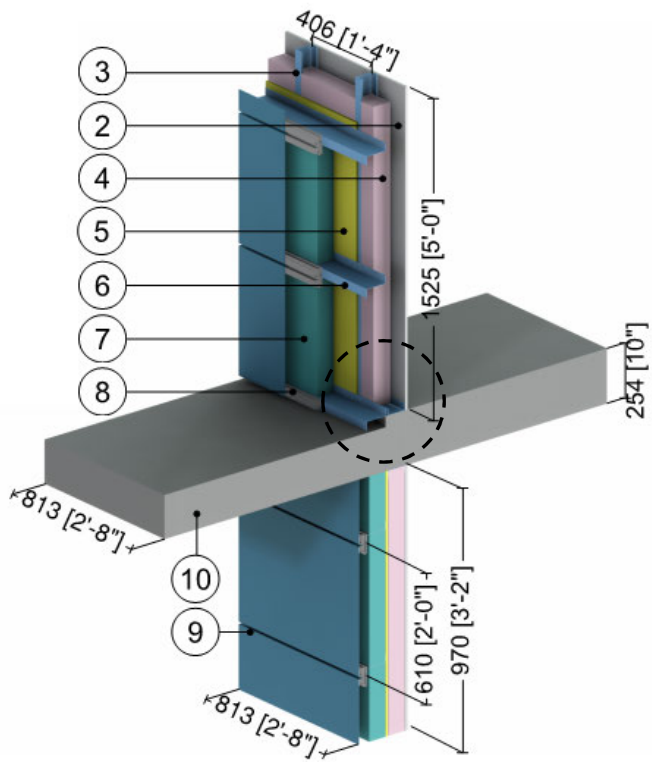



Balcony Stepdown Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Concrete Slab	8" (204)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.6

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Insulated Curb

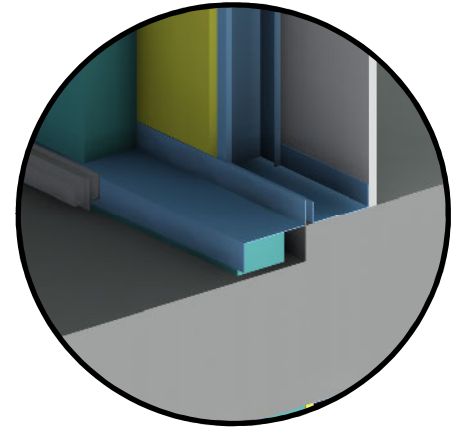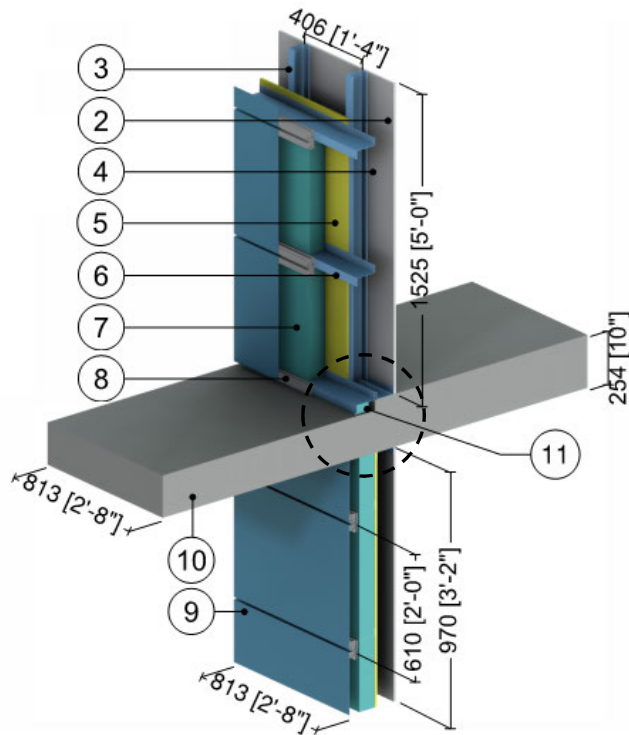



Balcony Stepdown Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Concrete Slab	8" (204)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Curb Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.7

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Uninsulated Intermediate Floor Intersection with Insulated Curb

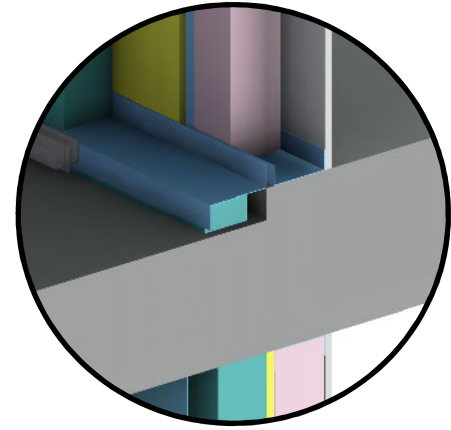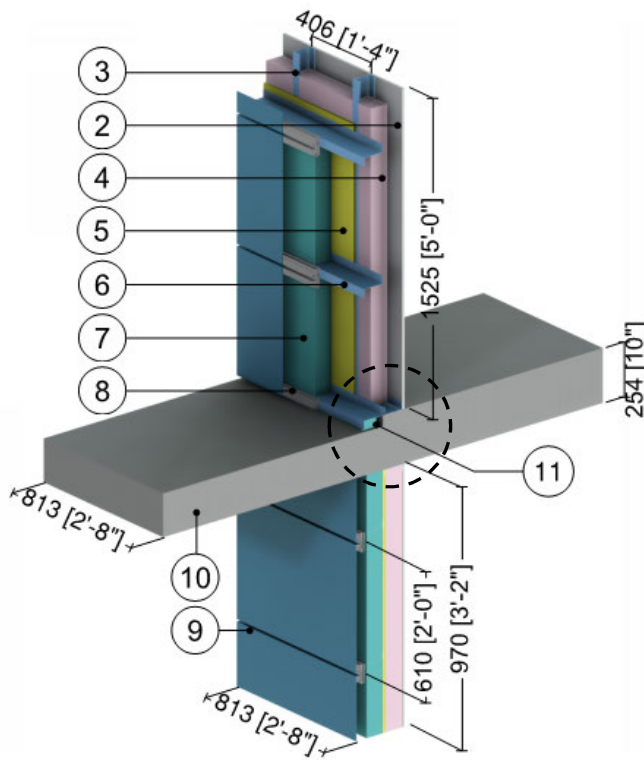



Balcony Stepdown Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Concrete Slab	8" (204)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Curb Insulation	-	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.8

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Uninsulated Intermediate Floor Intersection

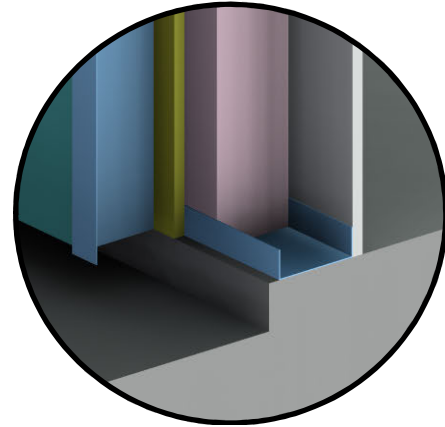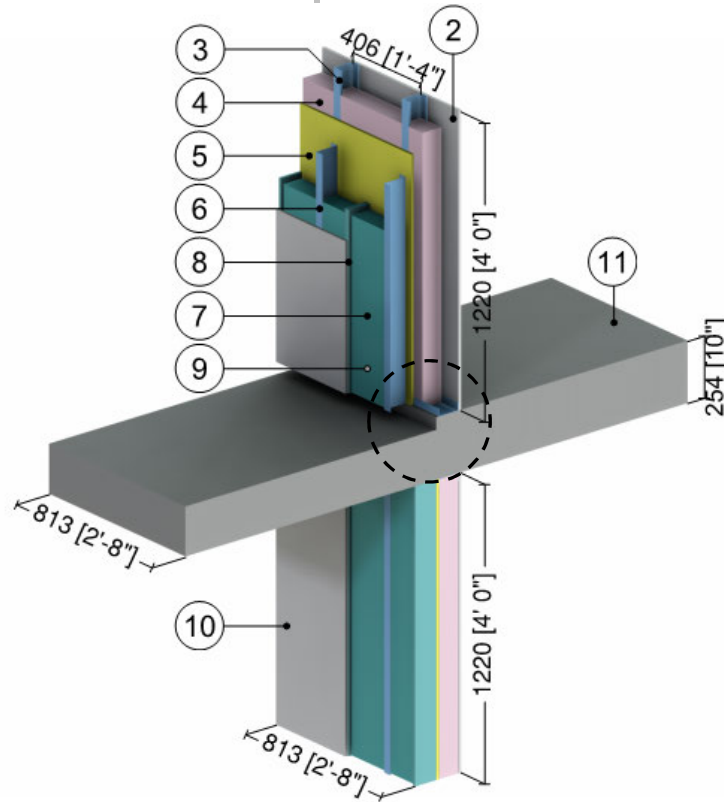



Balcony Stepdown Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Rigid Insulation Bracing	Varies	0.2 (0.29)	-	1.8 (28)	0.29 (1220)
9	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
10	Stucco Cement with Breather Board	1/2" (13)	6 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.9

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Isokorb CM20 Thermally Broken Slab Projection without Concrete Curb

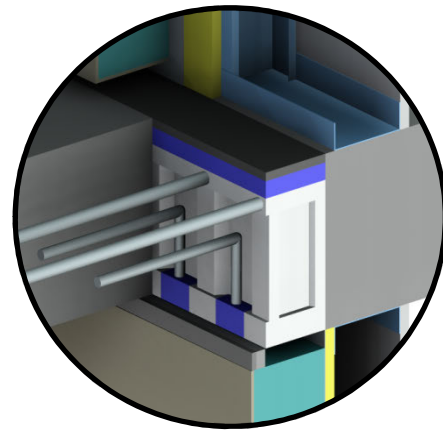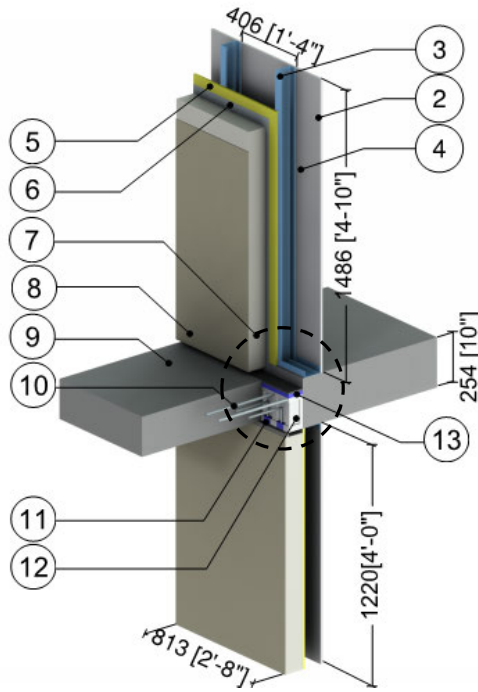



Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistant Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-14.6 (2.56 RSI)	1.0 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.10

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Isokorb CM20 Thermally Broken Slab Projection without Concrete Curb

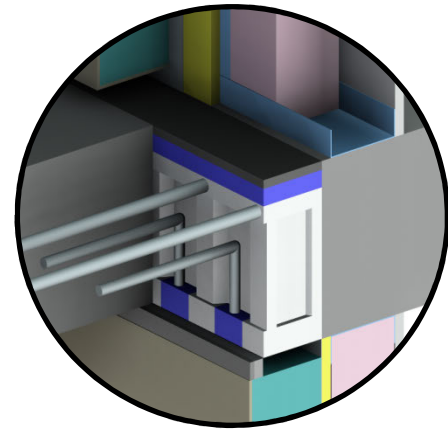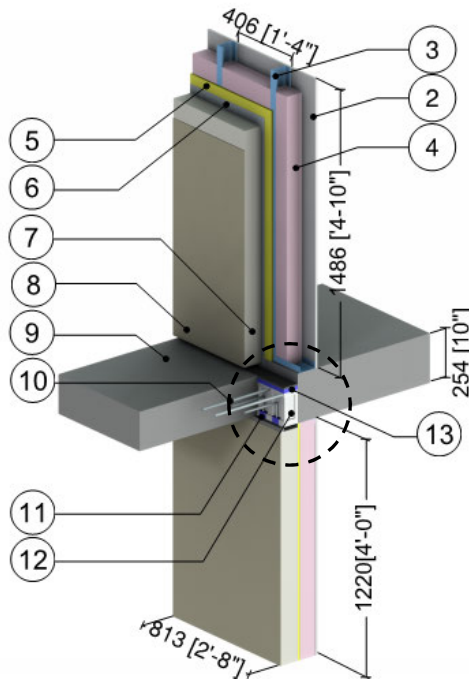



Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.10 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-14.6 (2.56 RSI)	1.0 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.11

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Uninsulated Curb

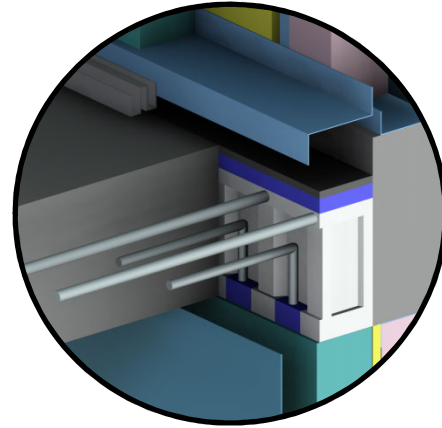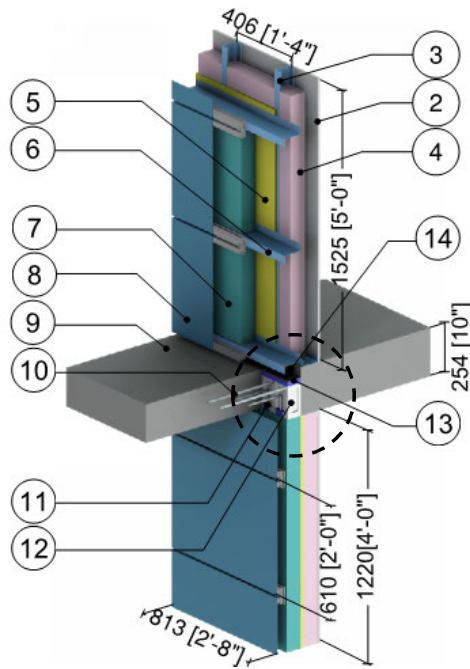



Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.2 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.12

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Uninsulated Curb

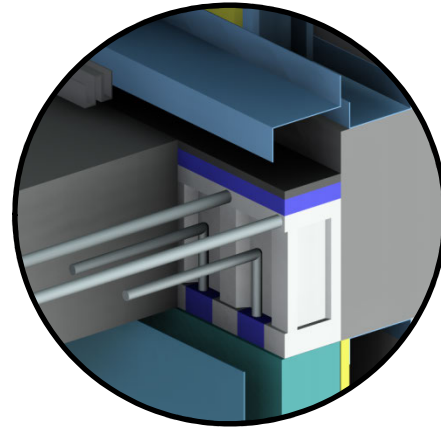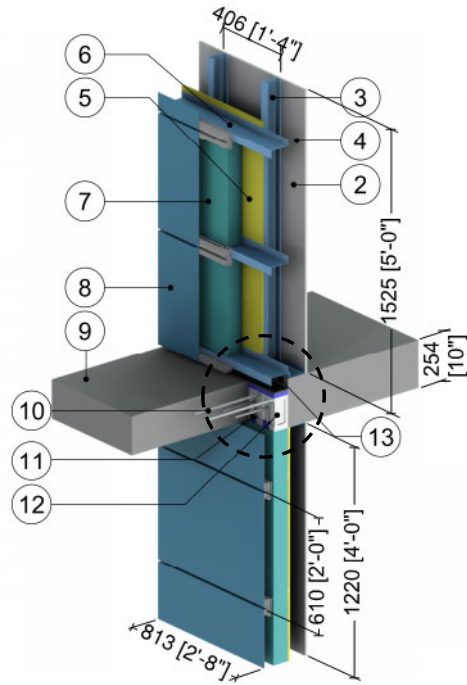



Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3" (76)	0.217 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.13

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Insulated Curb

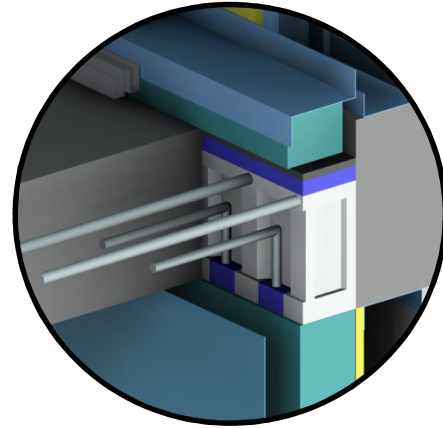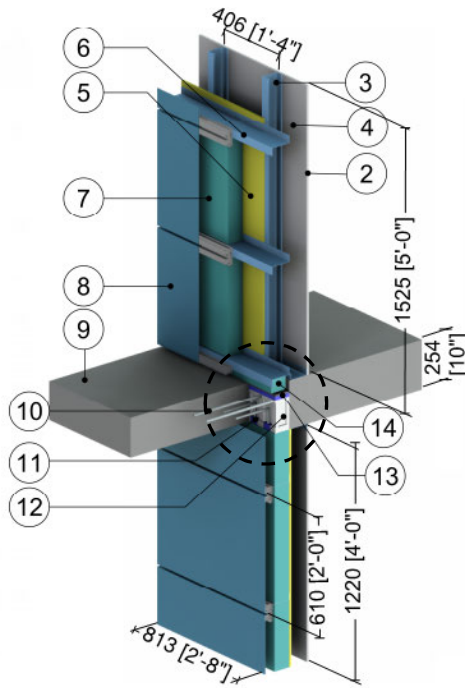



Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Curb Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
15	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.14

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Isokorb CM20 Thermally Broken Slab Projection with Insulated Curb

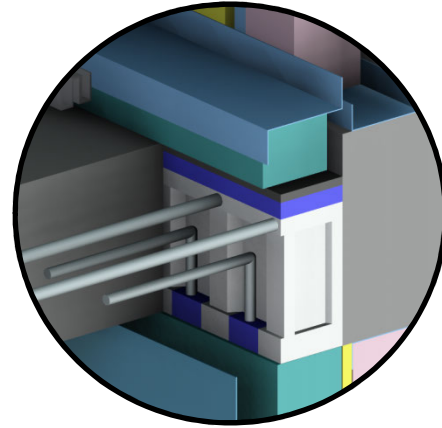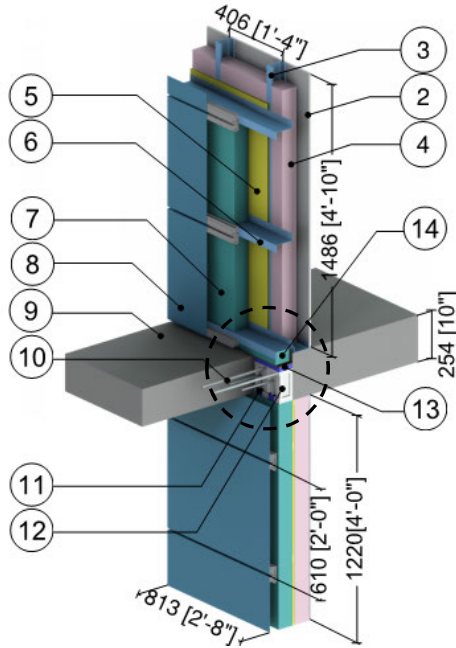


Thermally Broken Slab Detail (Isokorb CM20)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	HDPE Plastic Sleeve	-	1.7 (0.25)	-	59 (950)	0.48 (2000)
	UHPC Concrete Mix	-	5.5 (0.80)	-	140 (2250)	0.20 (850)
12	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.7 (2.58 RSI)	66 (1060)	0.35 (1500)
13	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
14	Curb Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
15	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.15 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Intermediate Floor Intersection


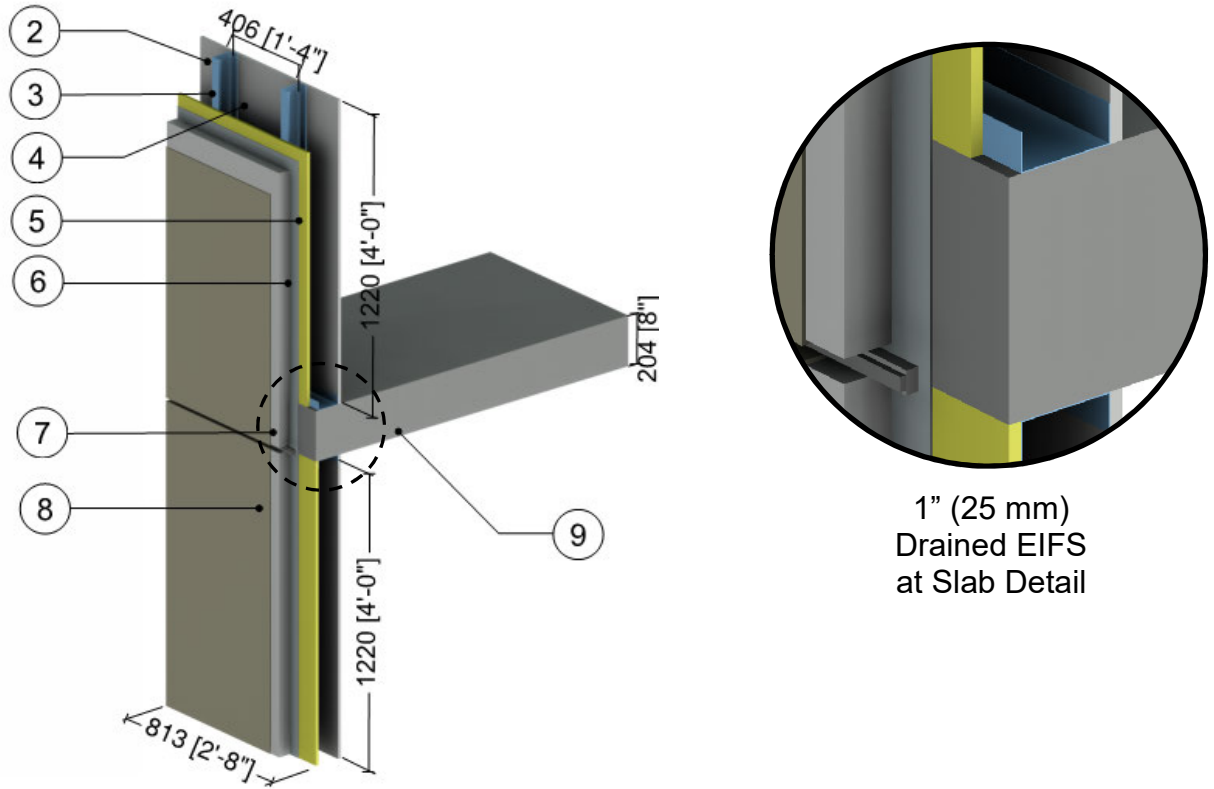


1" (25 mm)
Drained EIFS
at Slab Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 3 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	2" to 4" (50 to 100)	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.16 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Intermediate Floor Intersection

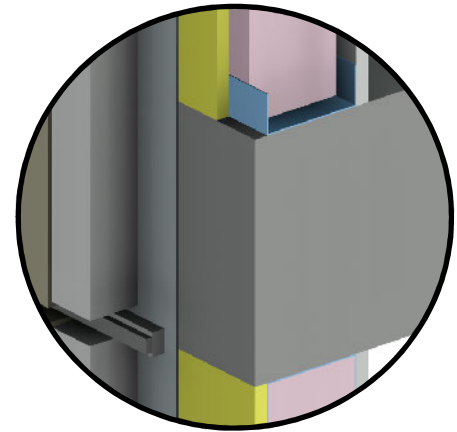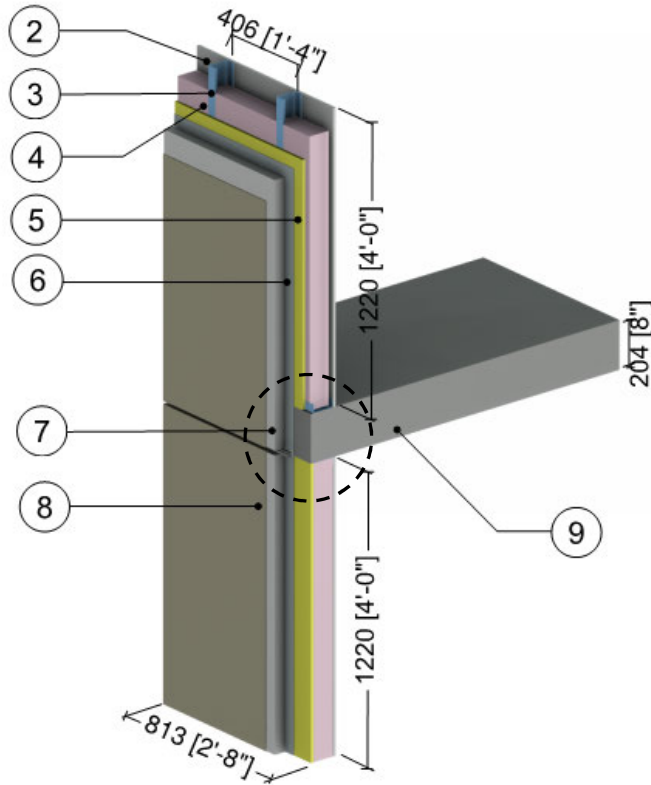



1" (25 mm)
Drained EIFS
at Slab Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 3 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	2" to 4" (50 to 100)	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.17

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Vertical Sub-girts - Intermediate Concrete Floor Intersection

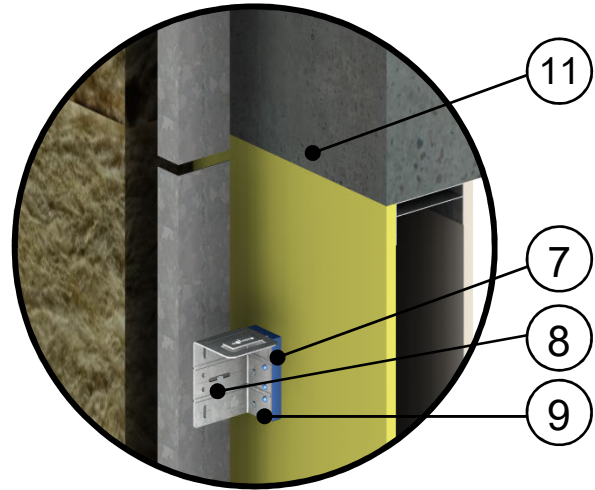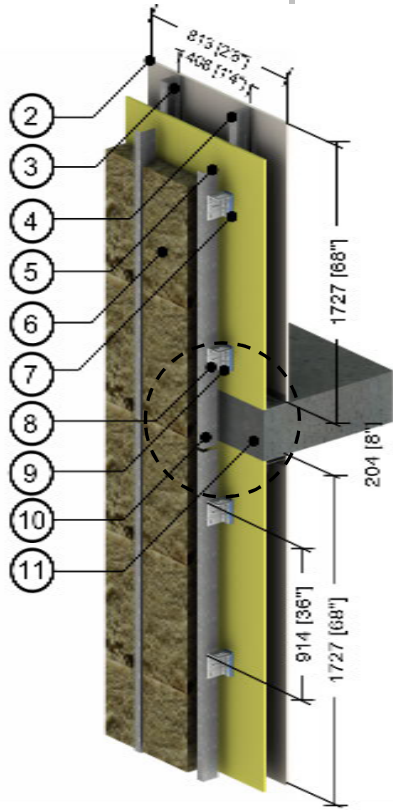



Concrete Floor Intersection

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	ISO Clip - Galvanized Metal	14 gauge	430 (62)	-	489 (7830)	0.12 (500)
9	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Vertical Sub-girt	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.18

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken ISO Clip System Supporting Horizontal Sub-girts – Intermediate Concrete Floor Intersection

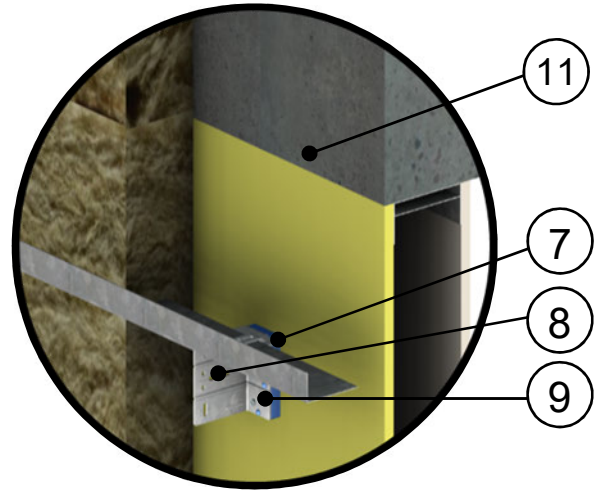
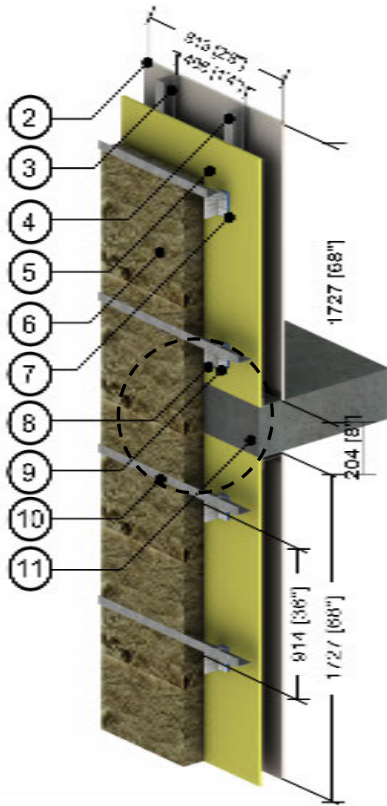


Concrete Floor Intersection

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	ISO Clip - Galvanized Metal	14 gauge	430 (62)	-	489 (7830)	0.12 (500)
9	#14 Steel Fasteners	1/4" (6) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.19 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z-girts (16" o.c.) Supporting Stucco Cladding – Steel Framed Floor with Cross Cavity Flashing

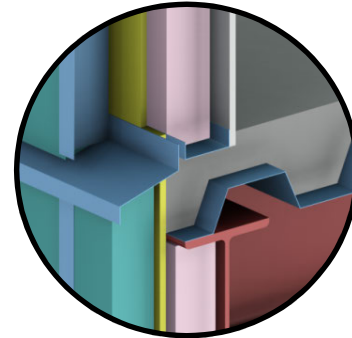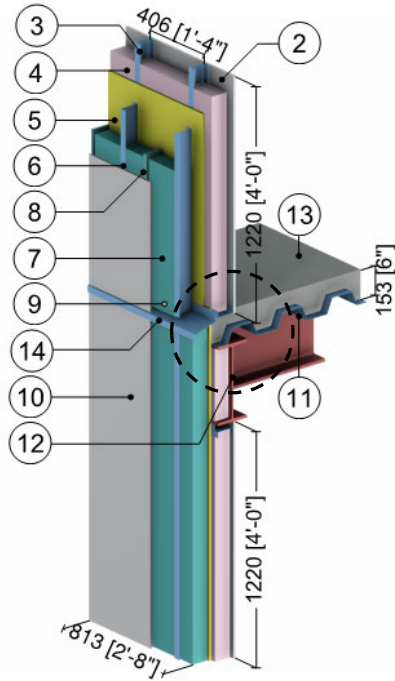

Slab Edge Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-girts with 11/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Rigid Insulation Bracing	Varies	0.2 (0.029)	-	1.8 (28)	0.29 (1220)
9	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
10	Stucco Cement with Breather Board	1/2" (13)	6.3 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
11	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
12	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
13	Concrete Topping	6" (203)	6.3 (0.9)	-	120 (1920)	0.20 (850)
14	Cross Cavity Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.2.20

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Fiberglass Spacer and Through Insulation Fasteners Supporting Cladding – Insulated Intermediate Floor Intersection

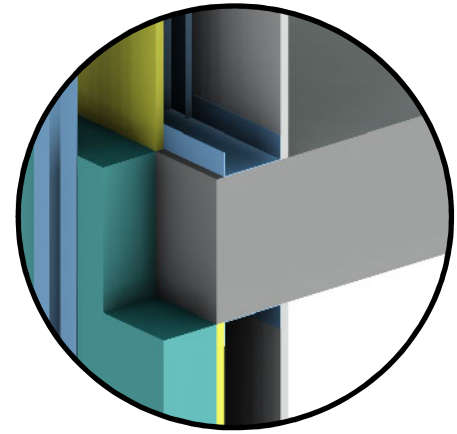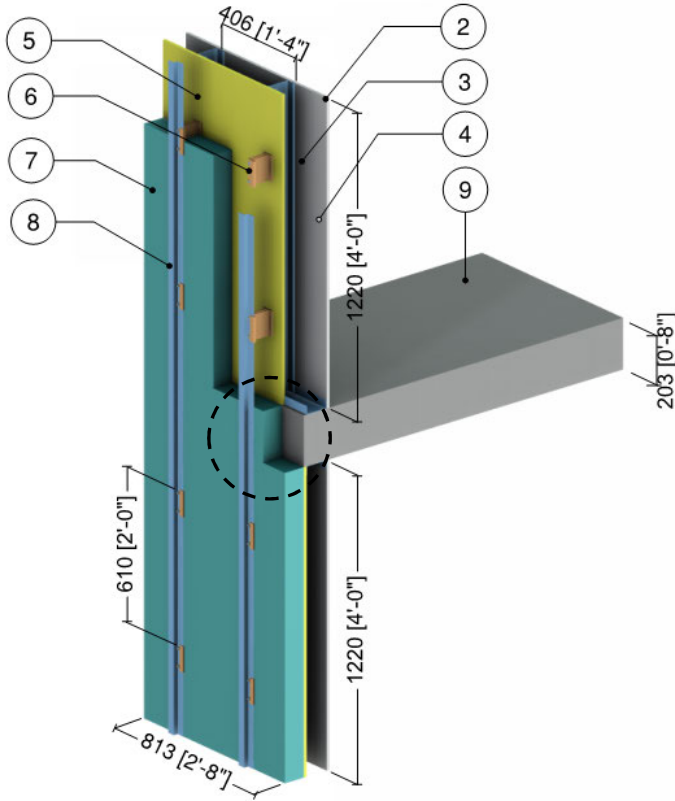



Slab Edge Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Fiberglass Spacer	3 1/2" (89)	1.7 (0.299)			
6	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
7	Exterior Insulation	3 1/2" (89)	-	R-15 (2.59 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Steel Z-girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.21

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Aluminum Clip Horizontal Sub-girt System Supporting Cladding – Intermediate Floor Intersection

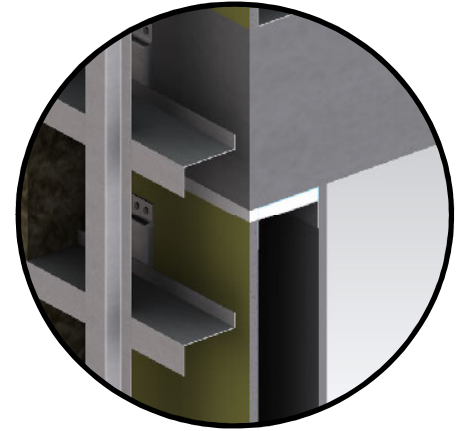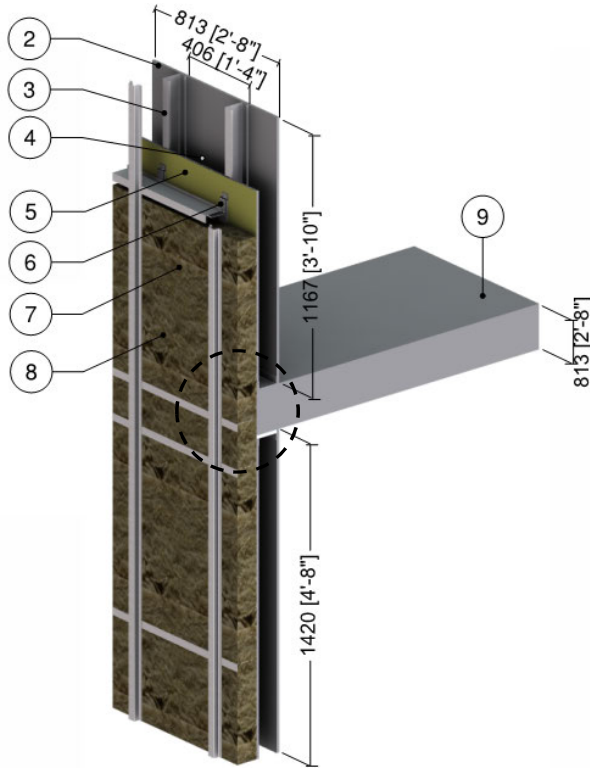



Slab Edge Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Engineered Assemblies Aluminum Panel Clip (models T100 T125 150)	1/5" to 3/8" (5 to 10)	1109 (160)			
7	Exterior Insulation	Varies	-	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	1.8 (28)	0.29 (1220)
8	Vertical/Horizontal Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Cork/Neoprene pad	1/16" (1.5)	0.329 (0.058)	R-0.15 (0.03 RSI)	-	-
11	Aerogel	3/8" (10)	0.086 (0.015)	R-3.9 (0.68 RSI)		
12	Steel Fasteners	5/16" (8) Ø	347 (50)	-	489 (7830)	0.12 (500)
13	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.22

Exterior Insulated 3 5/8" x 1/58" Steel Stud (16"o.c.) Wall Assembly with TAC Fiber Reinforced Plastic Girts Supporting Cladding – Intermediate Floor Intersection

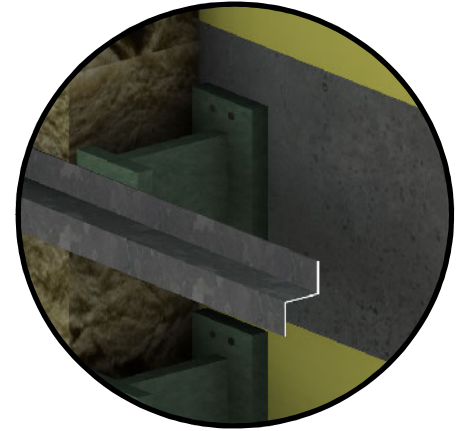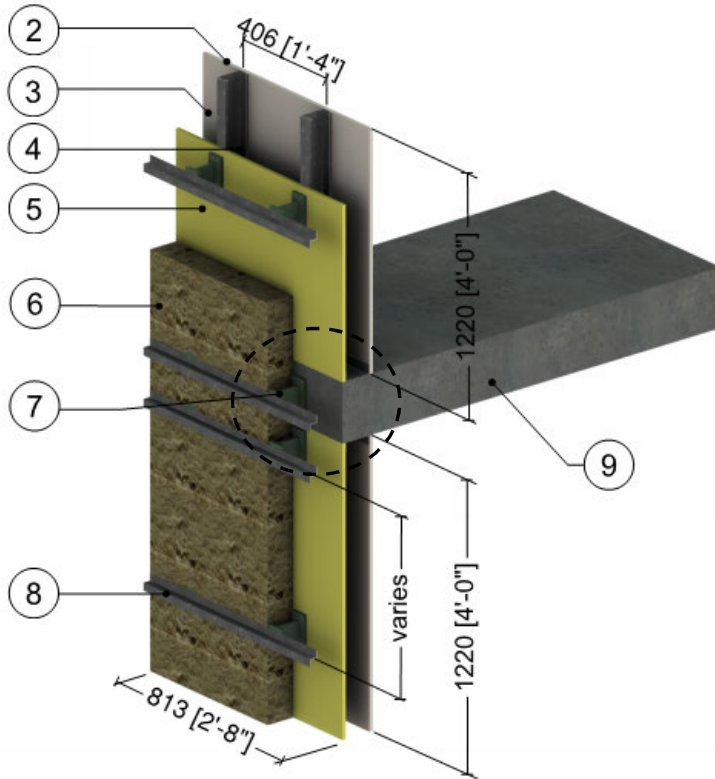



Slab Edge Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.034)	R-12.6 to R-25.2 (2.22 RSI to 4.40 RSI)	489 (7830)	0.12 (500)
7	Fiber Reinforced Plastic (FRP) Girts	-	2.4 (0.35)	-	-	-
8	Horizontal Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
10	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.23

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Intermediate Floor Intersection

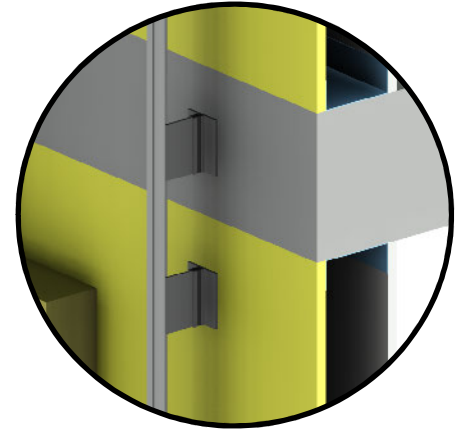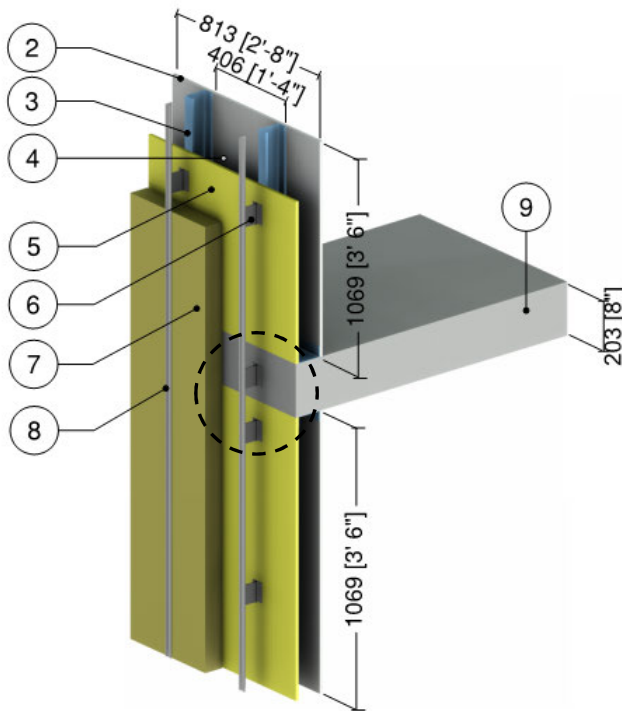


Slab Edge Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Longboard Aluminum Panel Clip	1/5" to 3/8" (5 to 10)	1109 (160)	-	-	-
7	Exterior Insulation	Varies	0.24 (0.034)	R-12.6 to R-25.2 (2.22 RSI to 4.44 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.24

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Framed Floor Intersection

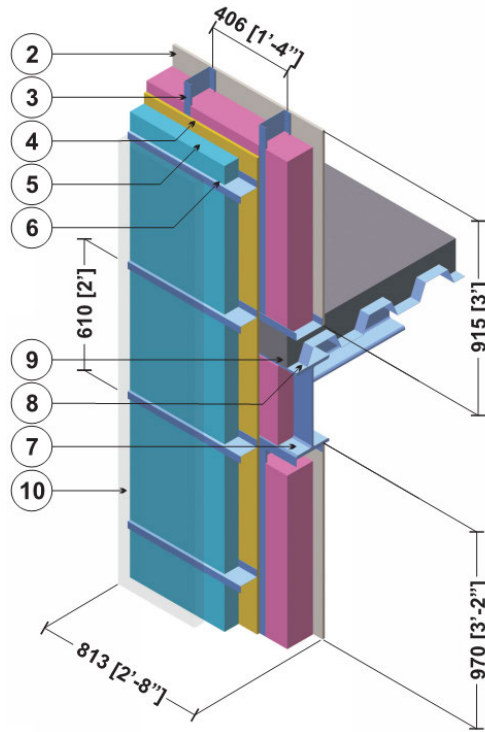


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
9	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
10	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.25

Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Framed Floor Intersection


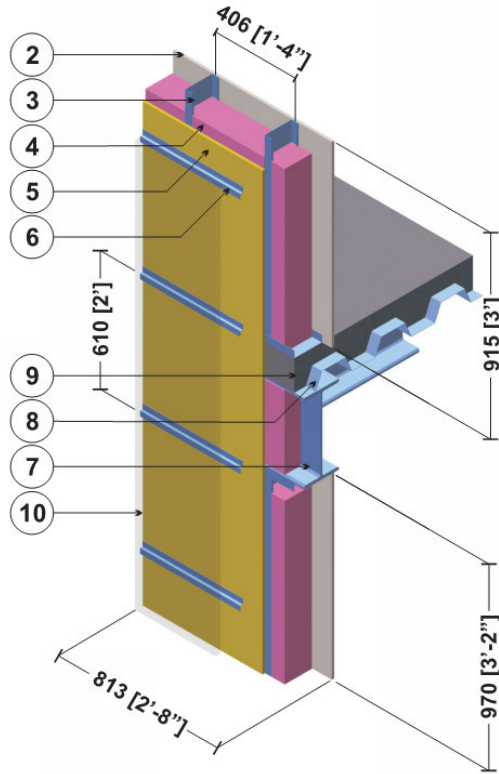


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Metal Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
9	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
10	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.26

Vertical Insulated Metal Panel - Corrugated Slab Intersection with I-beam – Open Web Steel Joist and Support Girt/Hat Track Backup Wall

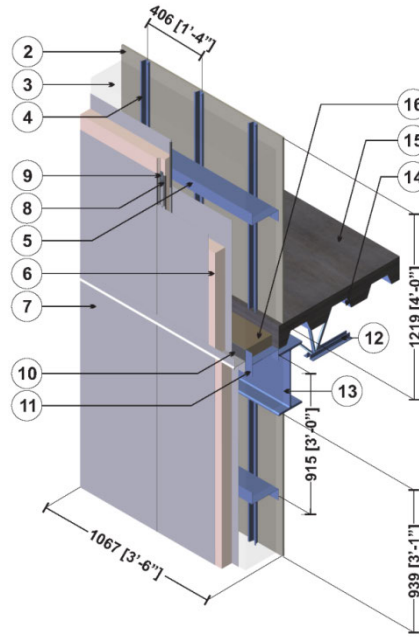

Vertical Joint





Horizontal Joint


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	Steel Flashing & Trim	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Steel Angle	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Open Web Steel Joist	-	314 (45)	-	489 (7830)	0.12 (500)
13	Steel Beam (W410)	-	314 (45)	-	489 (7830)	0.12 (500)
14	Steel Deck	1/16" (1.6)	314 (45)	-	489 (7830)	0.12 (500)
15	Concrete Topping	6" (152)	6 (0.9)	-	120 (1920)	0.20 (850)
16	Semi-Rigid Insulation	-	0.28 (0.04)	-	4.5 (72)	0.17 (710)
17	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.27 Horizontal Insulated Metal Panel – Corrugated Slab Intersection with I-beam – Open Web Steel Joist and Steel Stud Backup Wall

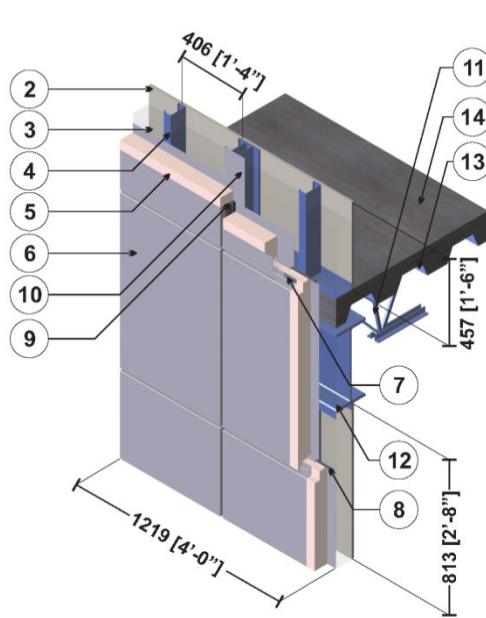

Vertical Joint





Horizontal Joint

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76.2)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	Gasket	1 1/3" (33)	0.966 (0.14)	-	-	-
10	Steel Plate	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Open Web Steel Joist	-	314 (45)	-	489 (7830)	0.12 (500)
12	Steel Beam (W410)	-	314 (45)	-	489 (7830)	0.12 (500)
13	Steel Deck	1/16" (1.6)	314 (45)	-	489 (7830)	0.12 (500)
14	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.28

Exterior and Interior Insulated Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection

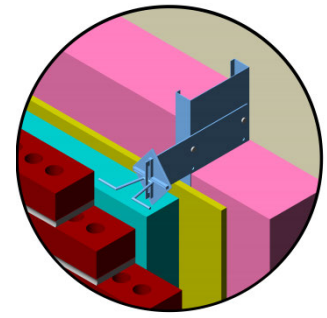
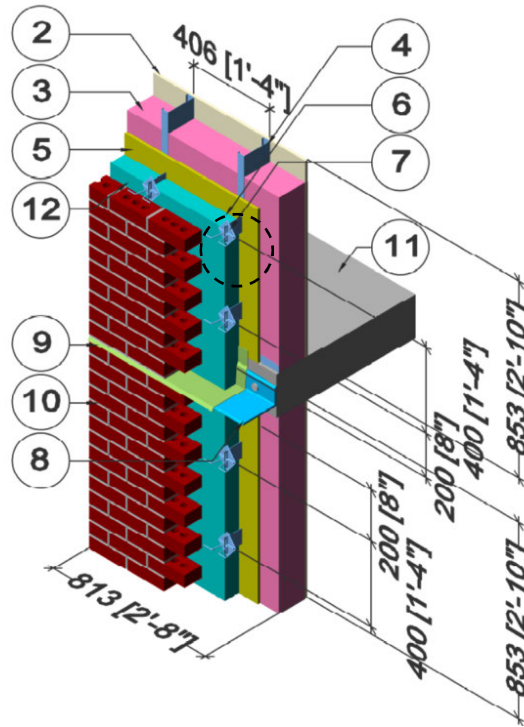


Brick Tie Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Brick Ties	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
9	Flashing	20 Gauge	347 (50)	-	489 (7830)	0.12 (500)
10	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.29 Exterior and Interior Insulated Wall Assembly with Spaced Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection

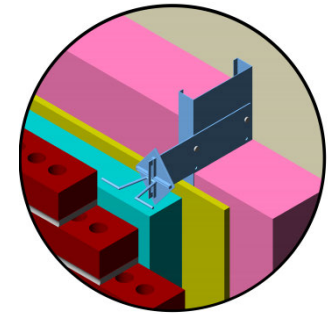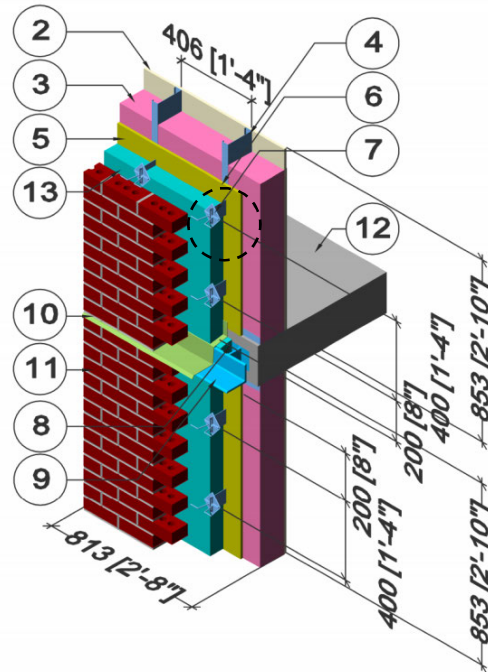



Brick Tie Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Brick Ties	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Insulation Behind Shelf Angle	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
9	Spaced Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Flashing	20 Gauge	347 (50)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.30

Exterior and Interior Insulated Wall Assembly with Thermally Broken Steel Shelf Angle & Brick Ties Supporting Brick Veneer – Slab Intersection

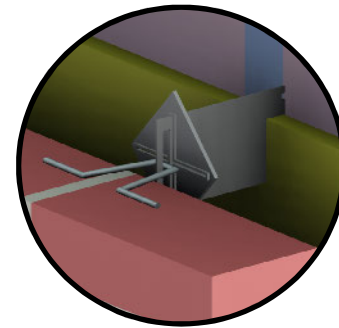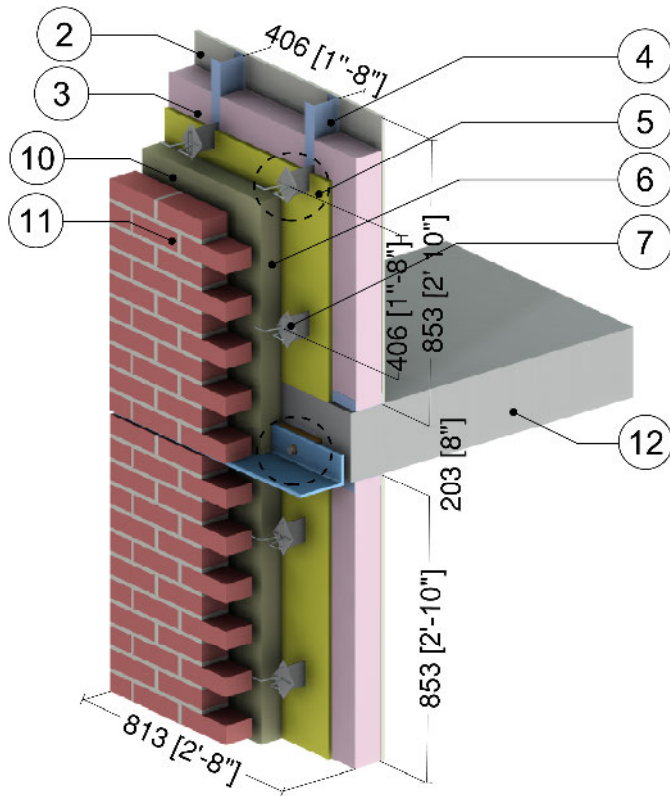

Brick Tie Detail

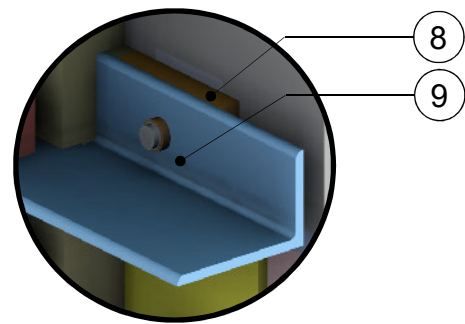

Shelf Angle Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	-	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Brick Ties	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Armatherm FRR Thermal Break	1" (25)	1.4 (0.20)	-	85 (5.3)	-
9	Steel Shelf Angle and Bolts	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Air Gap ²	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 5.2.31

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud Wall Assembly with Horizontal Z-girts Supporting Metal Cladding – Armatherm 500 Thermally Broken Slab Projection with Insulated Curb

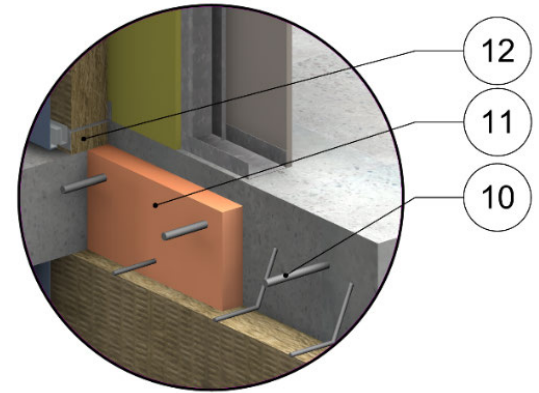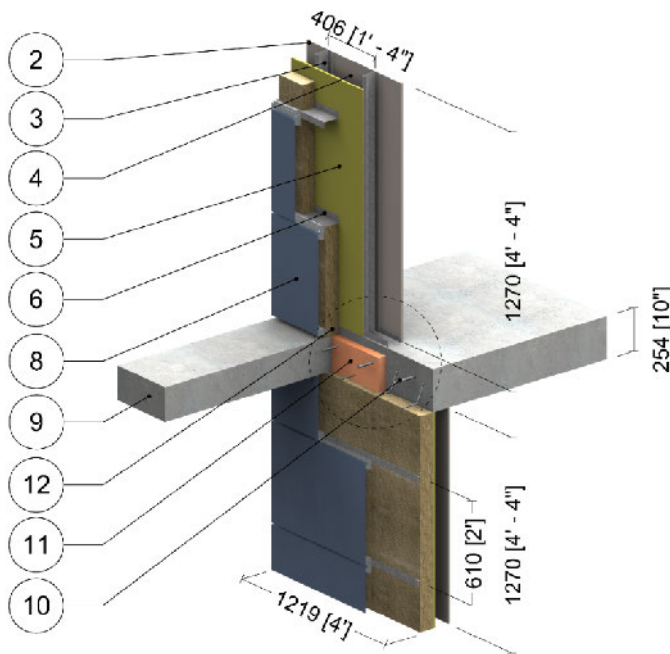



Thermally Broken Slab Detail (Armatherm 500)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air Cavity	3 5/8" (92)	-	R-0.9 (2.11 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Mineral Wool Insulation	3 1/2" (89)	-	R-14.7 (2.59 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	10" (254)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Carbon Steel Rebar	-	430 (62)	-	489 (7830)	0.12 (500)
	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	Armatherm 500-280 Thermal Break	2" (51)	0.53 (0.08)	-	-	-
	Armatherm 500-080 Thermal Break	2" (51)	0.26 (0.04)	-	-	-
12	Curb Insulation	3 1/2" (89)	-	R-14.7 (2.59 RSI)	1.8 (28)	0.29 (1220)
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.32

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud Wall Assembly with Armatherm Z-girts Supporting Metal Cladding – Armatherm 500-080 Thermally Broken Slab Projection with Insulated Curb

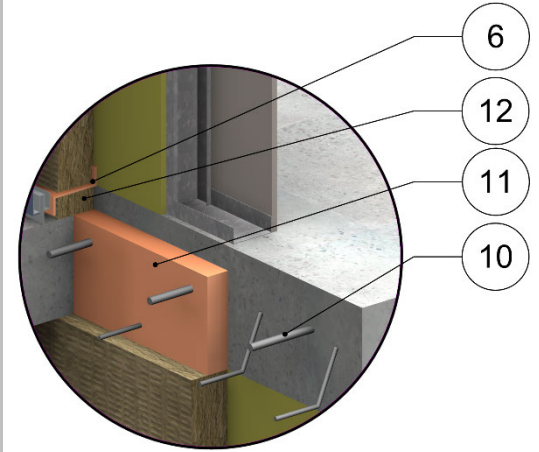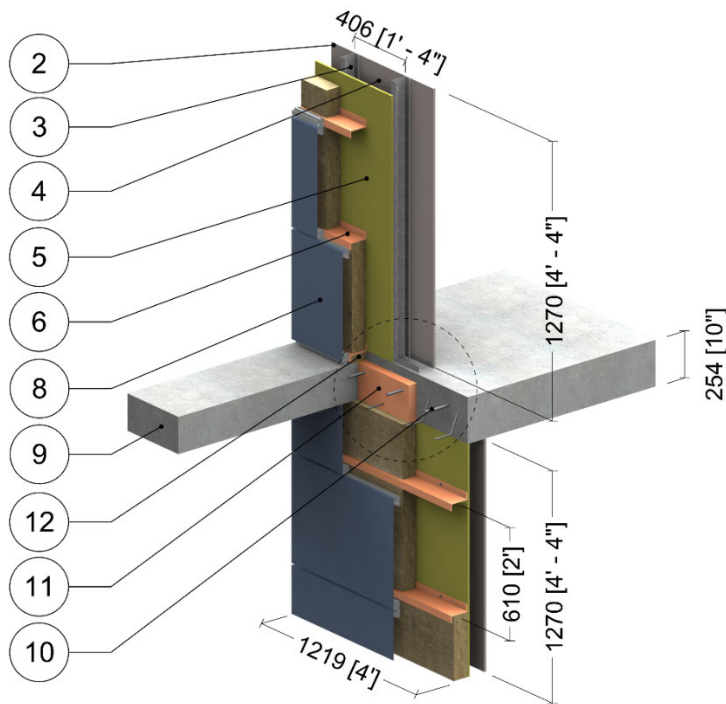



Thermally Broken Slab Detail (Armatherm 500-080)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air Cavity	3 5/8" (92)	-	R-0.9 (2.11 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Armatherm Z-girts (24" o.c.)	0.2 (5)	1.4 (0.2)	-	-	-
7	Exterior Mineral Wool Insulation	3 1/2" (89)	-	R-14.7 (2.59 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	10" (254)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	Armatherm 500-080 Thermal Break	2" (51)	0.26 (0.04)	-	-	-
12	Curb Insulation	3 1/2" (89)	-	R-14.7 (2.59 RSI)	1.8 (28)	0.29 (1220)
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.2.33


Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Nvelope – Eko Thermobacket and NV1 Clip System Supporting Cladding – Intermediate Floor Intersection

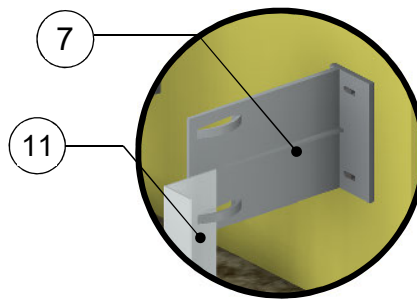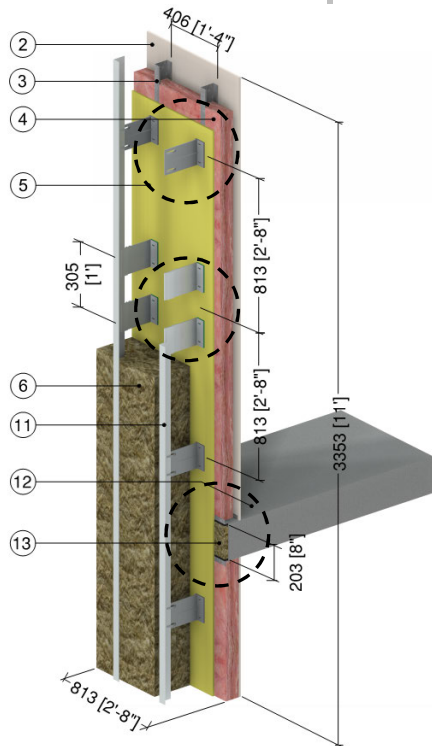


Eko Thermobacket Clip

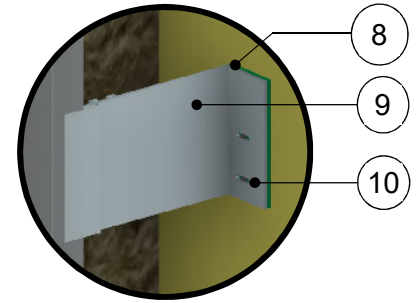

NV1 Clip

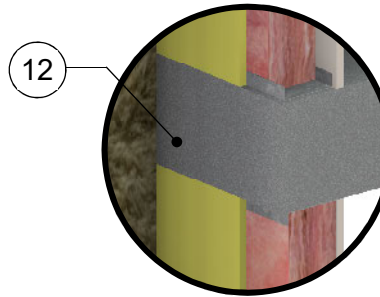

Uninsulated Floor Intersection


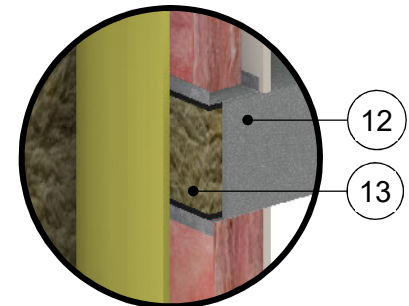


Insulated Floor Intersection


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.31 (0.045)	R-13 (2.29 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Mineral Wool Insulation	1.5" to 4" (38 to 102)	0.24 (0.034)	R-6.3 to R-16.8 (1.11 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Nvelope Eko Thermobacket (Polymer Composite)	-	4.86 (0.70)	-	-	-
8	Nvelope Clip Isolator	0.2" (5)	0.82 (0.117)	-	-	-
9	Nvelope Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	-	-
10	#14 Stainless Steel Fastener	1/4" (6) ∅	118 (17)	-	-	-
11	Vertical Aluminum Sub-girt	0.09" (2.2)	1340 (193)	-	-	-
12	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Insulation at Floor Slab	1" (25)	0.24 (0.034)	-	4 (64)	0.20 (850)
14	Generic Cladding with 1" (25mm) vented air space is incorporated into exterior heat transfer coefficient					
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.3.1 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection

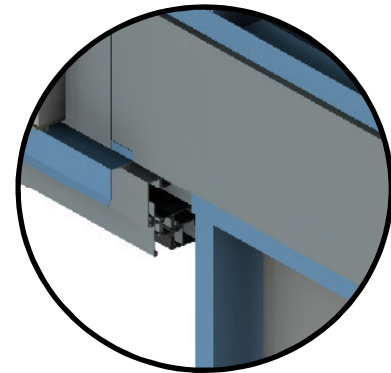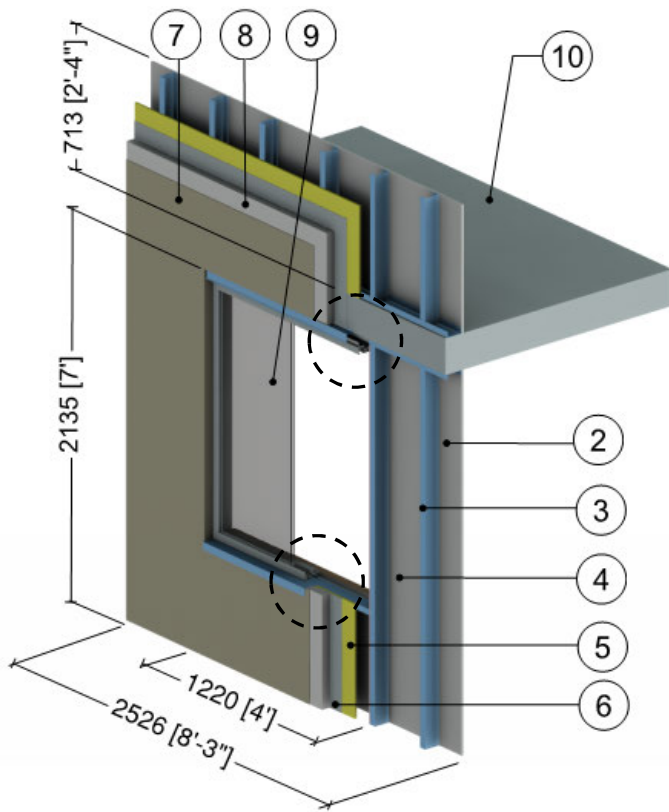

Window Head Detail

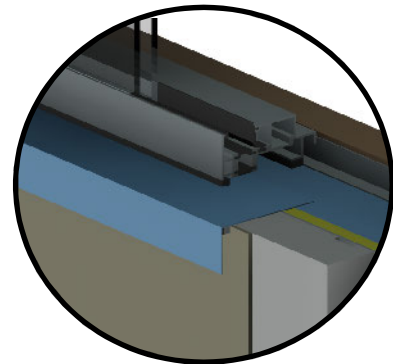



Window Sill Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² -°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.3.2 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection

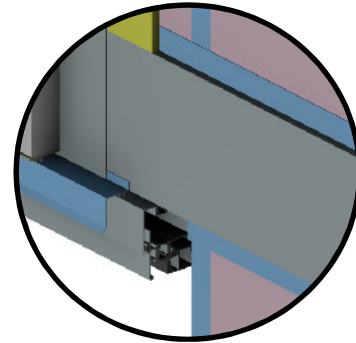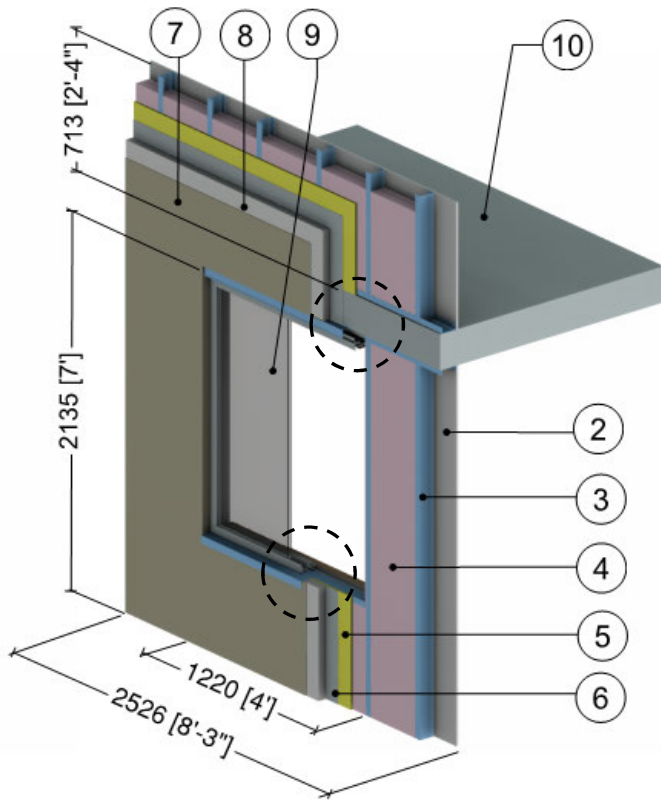

Window Head Detail

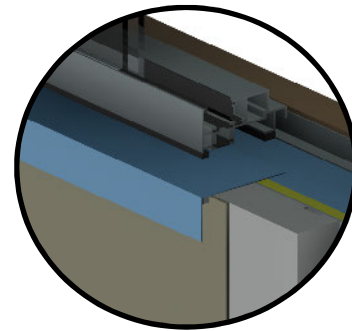

Window Sill Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² .°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.3.3

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Window & Intermediate Floor Intersection

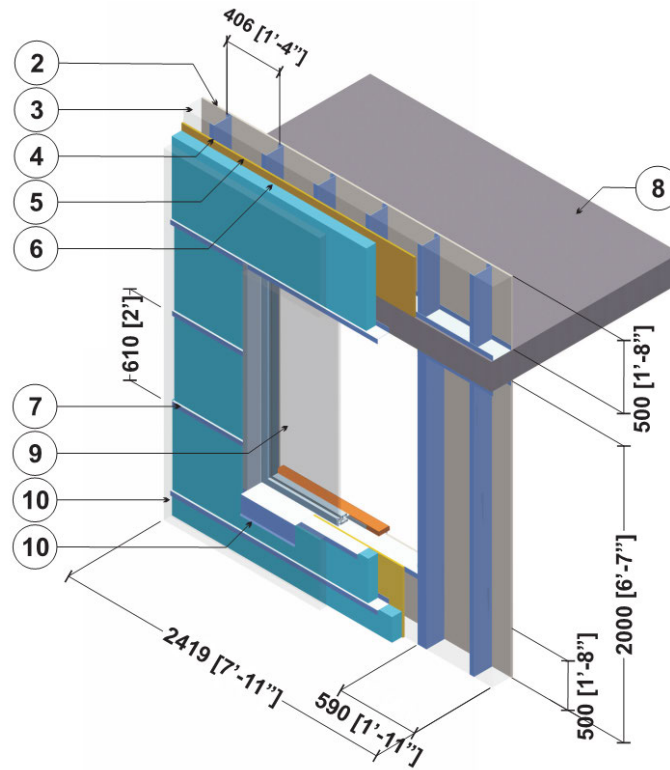



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient, sill flashing & interior finish materials					
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity for air spaces within window framing was found using ISO 10077-2

Detail 5.3.4

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Window and Intermediate Floor Intersection

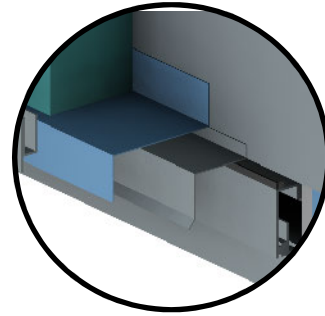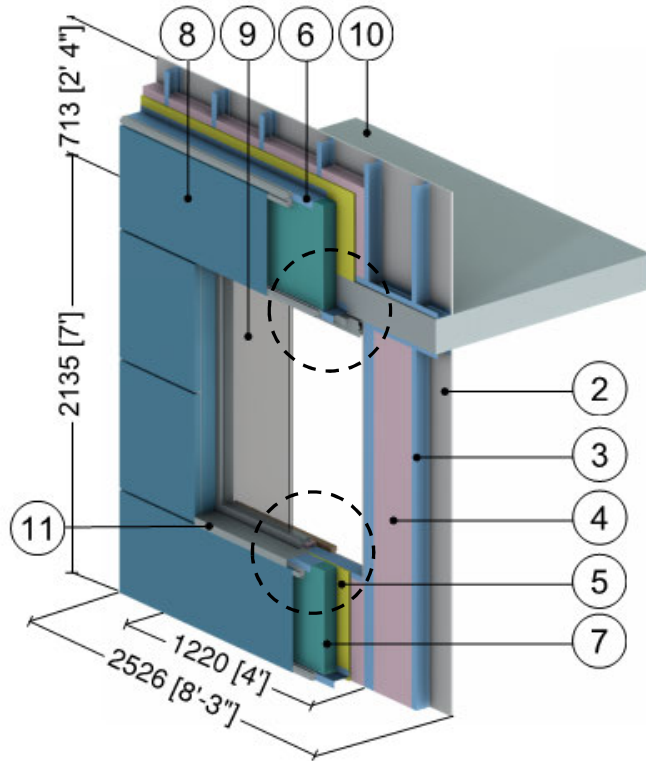

Window Head Detail

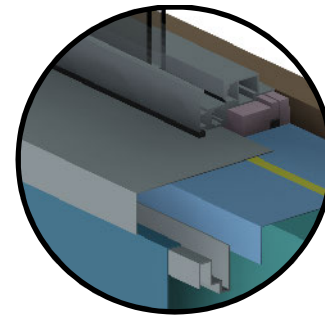



Window Sill Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Aluminum Flashing	18 Gauge	1109 (160)	-	171(2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity for air spaces within window framing was found using ISO 10077-2

Detail 5.3.5 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Window and Intermediate Floor Intersection

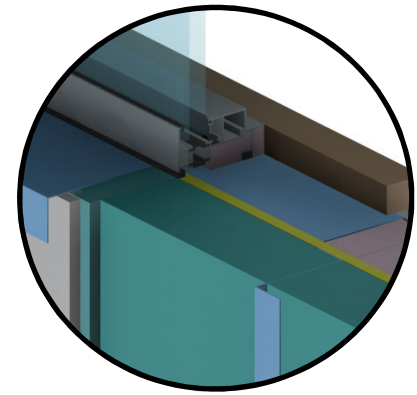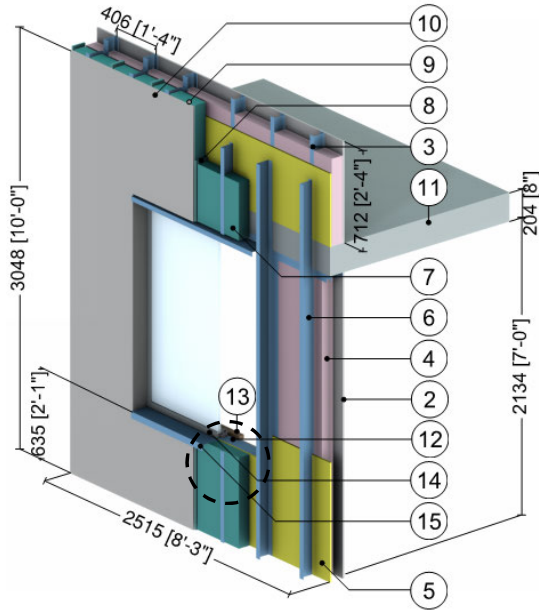

Window Sill Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Rigid Insulation Bracing	Varies	0.2 (0.29)	-	1.8 (28)	0.29 (1220)
9	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
10	Stucco Cement with Breather Board	1/2" (13)	6 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Metal sheet connected to studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Wood Sill	1.5" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
14	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² .°F (1.82 W/m ² K)					
15	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 5.3.6 Vertical Insulated Metal Panel – Window Glazing Transition with Steel Support Framing

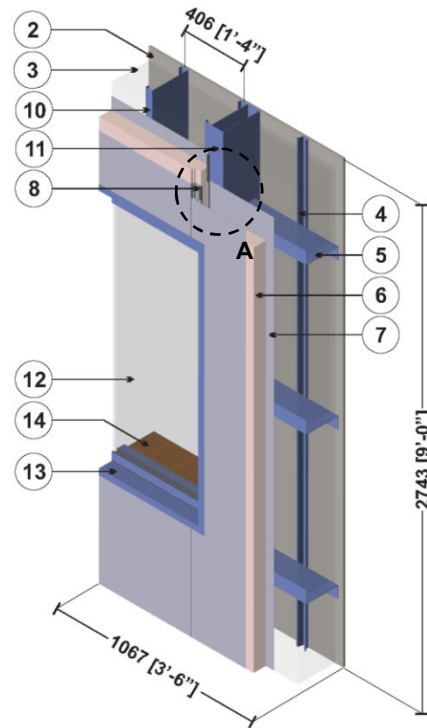



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76.2)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	Steel Studs @ 16" o.c. with Track	18 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Steel Support Post	1/8" (3.2)	314 (45)	-	489 (7830)	0.12 (500)
12	5' (1.5m) High aluminum window: double glazed & thermally broken ²					
13	Window Trim and Sill Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
14	Wood Sill	5/8" (16)	0.6 (0.09)	-	27.8 (445)	0.45 (1880)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces within window framing was found using ISO 10077-2



Detail 5.3.7 | Horizontal Insulated Metal Panel – Window Glazing Transition with Steel Support Framing

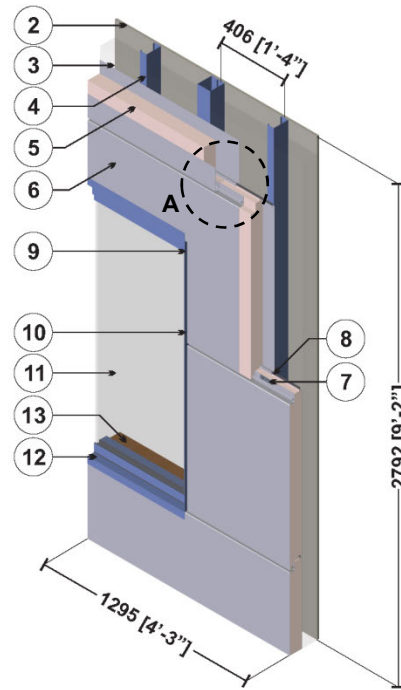



Horizontal Joint

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Track	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	Gasket	-	0.966 (0.14)	-	-	-
10	Steel Plate	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	5' (1.5m) High aluminum window: double glazed & thermally broken ²					
12	Steel Window Trim and Sill Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Wood Sill	5/8" (16)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation & surface emissivity. Window values supplemented by ISO 1007-2, Annex B.

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2

Detail 5.3.8 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window with Aerogel and Intermediate Floor Intersection

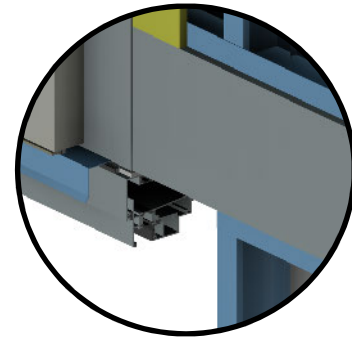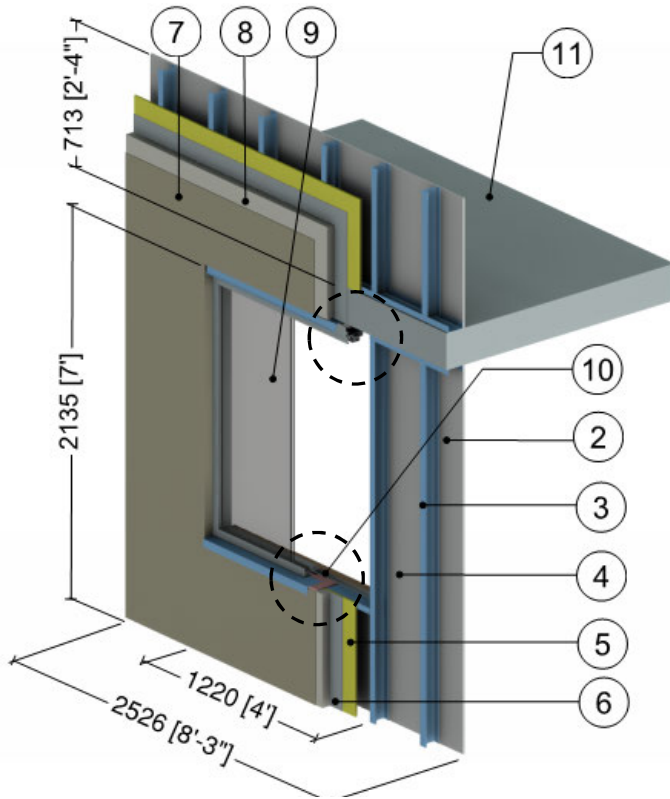

Window Head Detail

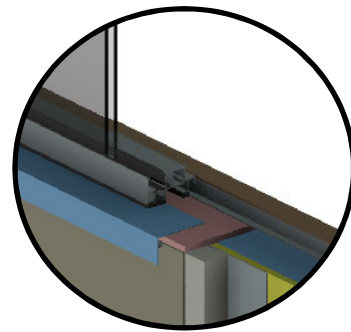

Window Sill Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Aerogel Blanket	3/8" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 5.3.9 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Window with Aerogel and Floor Slab Intersection

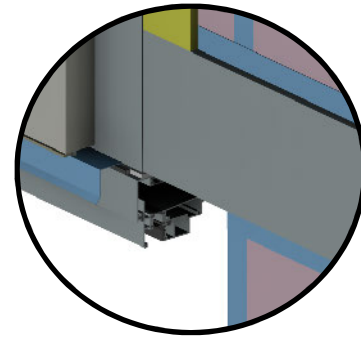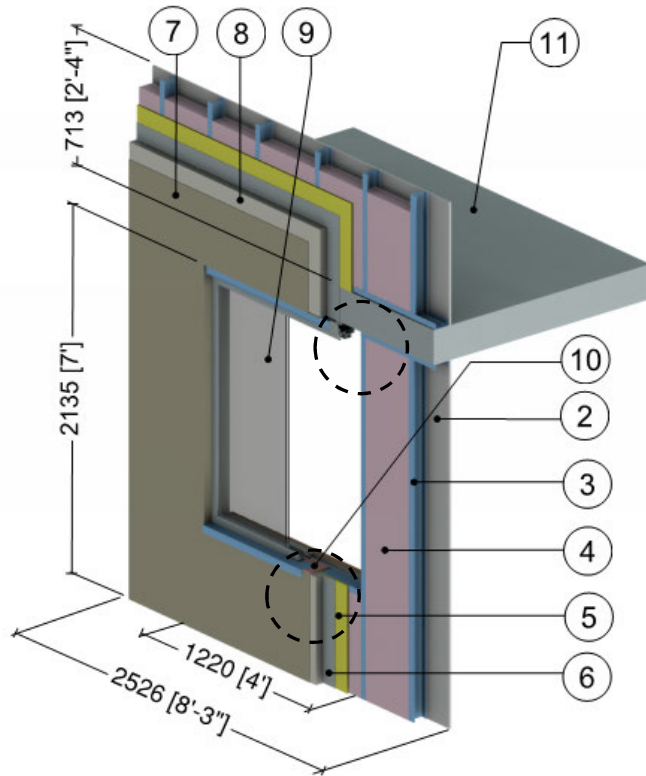

Window Head Detail

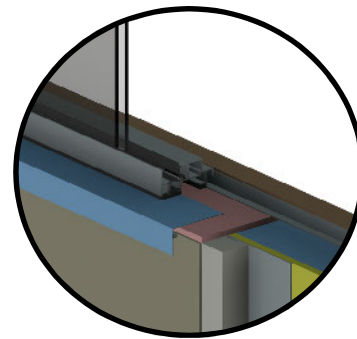

Window Sill Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	Varies	0.27 (0.039)	R-7.5 (1.32 RSI) to R-15 (2.64 RSI)	1 (16)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Aerogel Blanket	3/8" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 5.3.10

Interior Insulated Steel Frame Wall Assembly with Brick Cladding – Window Intersection

Detail referenced from work done by Passive House Academy

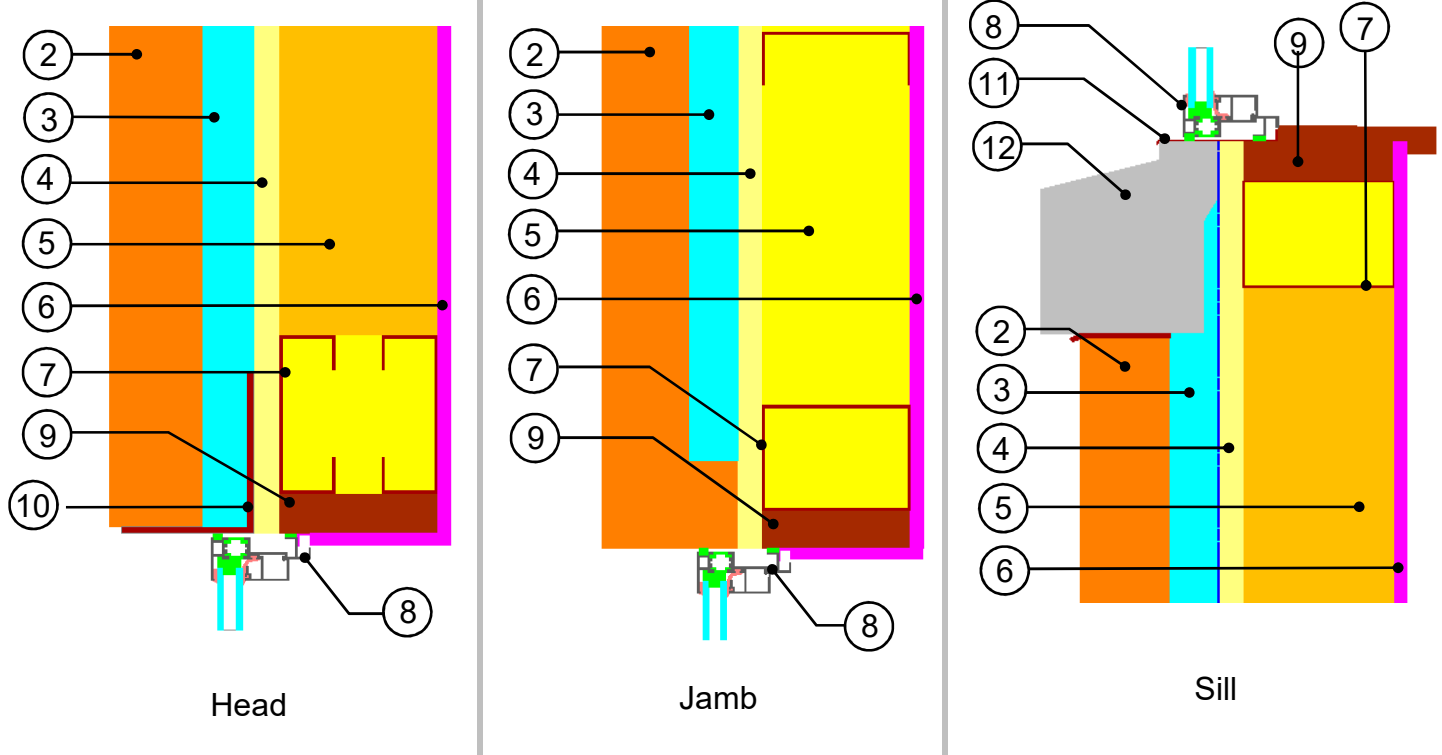




ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.74 (0.13 RSI)	-	-
2	Brick	3 5/8" (92)	0.578 (1.0)	R-0.523 (0.092 RSI)	110 (1800)	-
3	Air Cavity	2" (51)	0.132 (0.23)	R-1.261 (0.222 RSI)	-	-
4	Insulation	1" (25)	0.0139 (0.024)	R-6 (1.055 RSI)	-	-
5	Mineral Wool Insulation with Steel Studs	6 3/8" (162)	0.0370 (0.064)	R-14.36 (2.53 RSI)	-	-
6	Gypsum Board	1/2" (13)	0.092 (0.16)	R-0.5 (0.08 RSI)	50 (800)	-
7	Steel Studs	-	27.7 (48)	-	-	-
8	5500 ISOWEB Window	-	-	-	-	-
9	Timber Buck	-	0.006 (0.10)	-	-	-
10	Steel Lintel	-	27.7 (48)	-	-	-
11	Aluminum Sill Pan	-	92.45 (160)	-	-	-
12	Concrete Sill	-	1.4 (2.4)	-	-	-
13	Exterior Film ¹	-	-	R-0.23 (0.04 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.3.11

Interior Insulated Steel Frame Wall Assembly with Brick Cladding – Window Intersection Aligned with Insulation

Detail referenced from work done by Passive House Academy

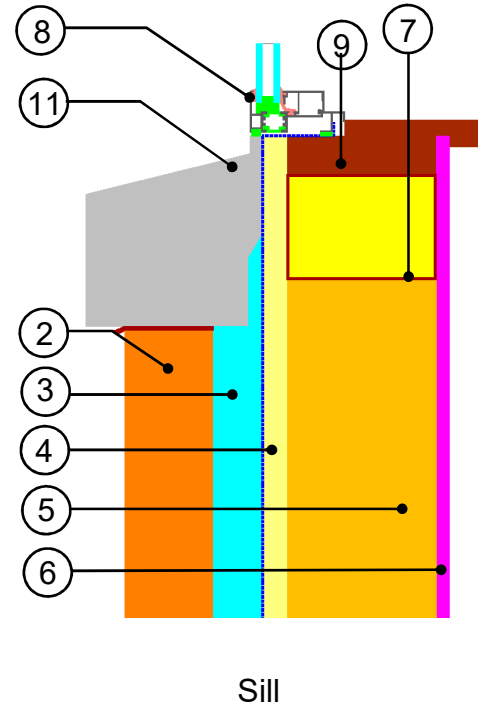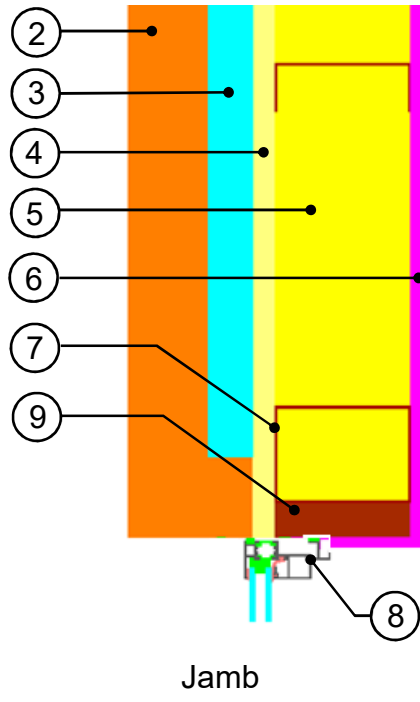
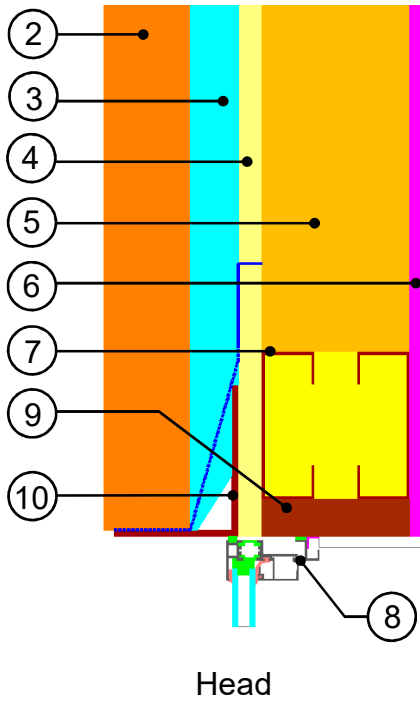


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.74 (0.13 RSI)	-	-
2	Brick	3 5/8" (92)	0.578 (1.0)	R-0.523 (0.092 RSI)	110 (1800)	-
3	Air Cavity	2" (51)	0.132 (0.23)	R-1.261 (0.222 RSI)	-	-
4	Insulation	1" (25)	0.0139 (0.024)	R-6 (1.055 RSI)	-	-
5	Mineral Wool Insulation with Steel Studs	6 3/8" (162)	0.0370 (0.064)	R-14.36 (2.53 RSI)	-	-
6	Gypsum Board	1/2" (13)	0.092 (0.16)	R-0.5 (0.08 RSI)	50 (800)	-
7	Steel Studs	-	27.7 (48)	-	-	-
8	5500 ISOWEB Window	-	-	-	-	-
9	Timber Buck	-	0.006 (0.10)	-	-	-
10	Steel Lintel	-	27.7 (48)	-	-	-
11	Concrete Sill	-	1.4 (2.4)	-	-	-
12	Exterior Film ¹	-	-	R-0.23 (0.04 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.3.12


Exterior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Steel Framing

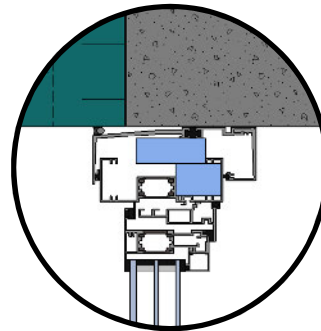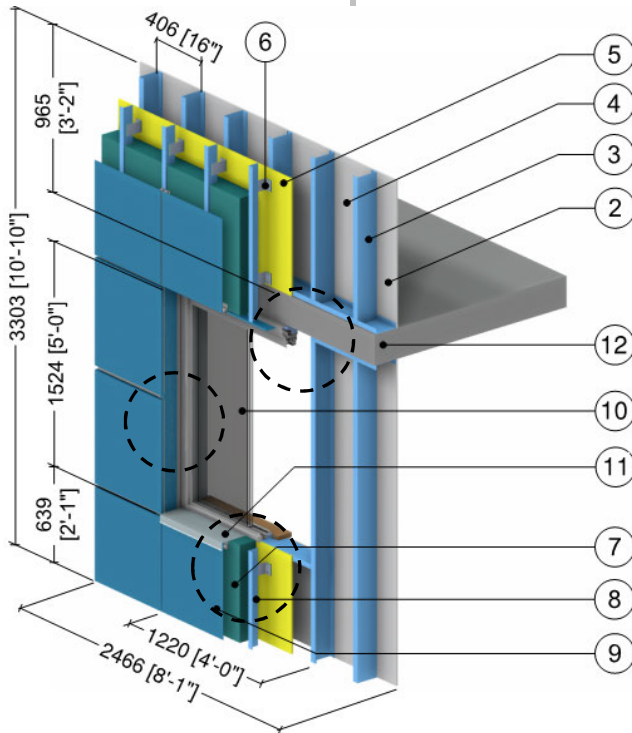

Head Detail

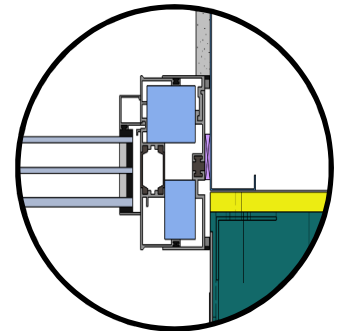

Jamb Detail

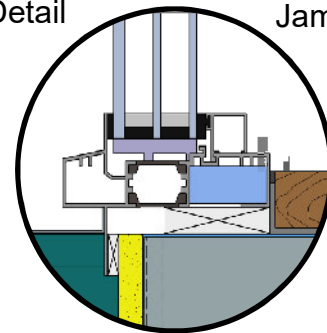

Sill Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2" x 6" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	6" (152)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum window: triple glazed & thermally broken ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.3.13

Exterior and Interior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Steel Framing

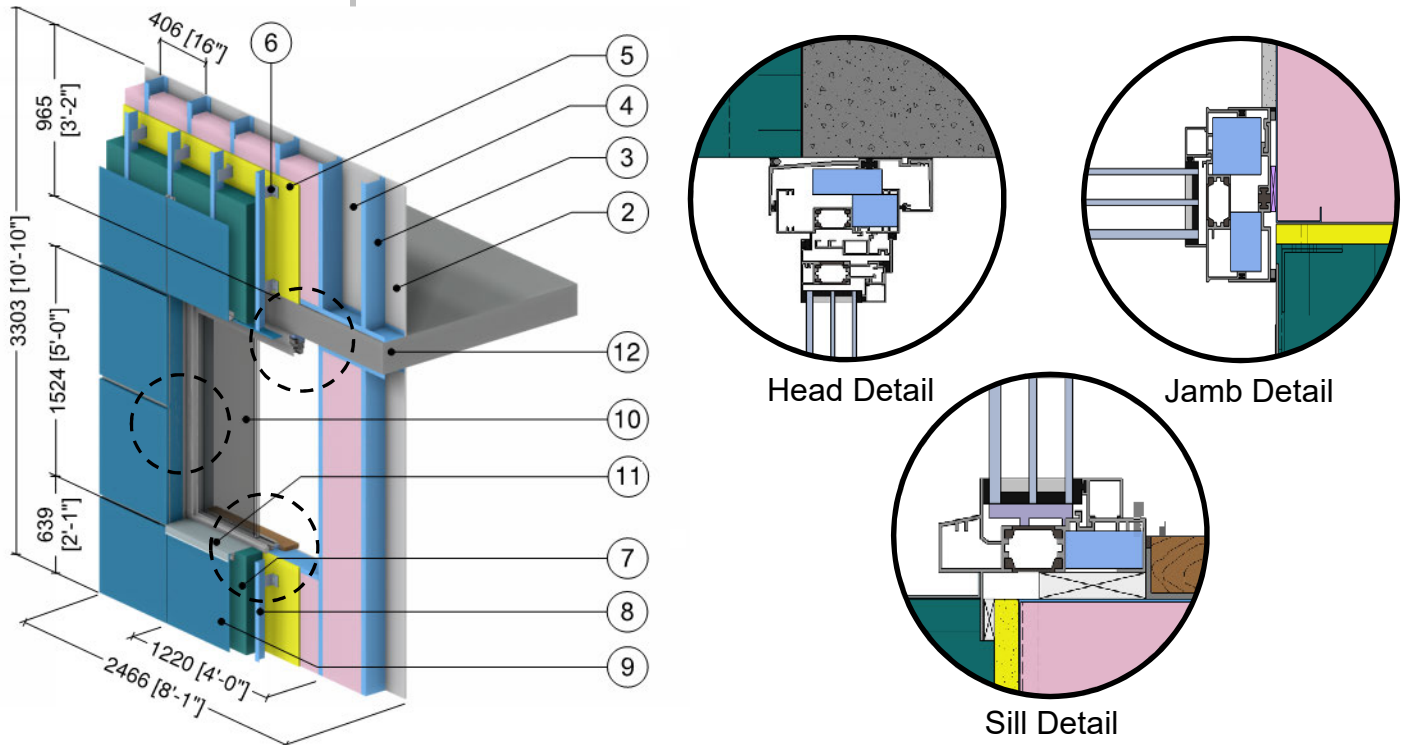

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2" x 6" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglas Batt Insulation	6" (152)	0.29 (0.042)	R-19 (3.35 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum window: triple glazed & thermally broken, IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K) ²					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2




Detail 5.3.14


Exterior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation

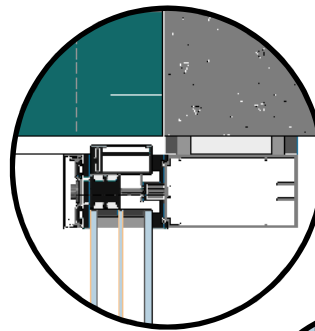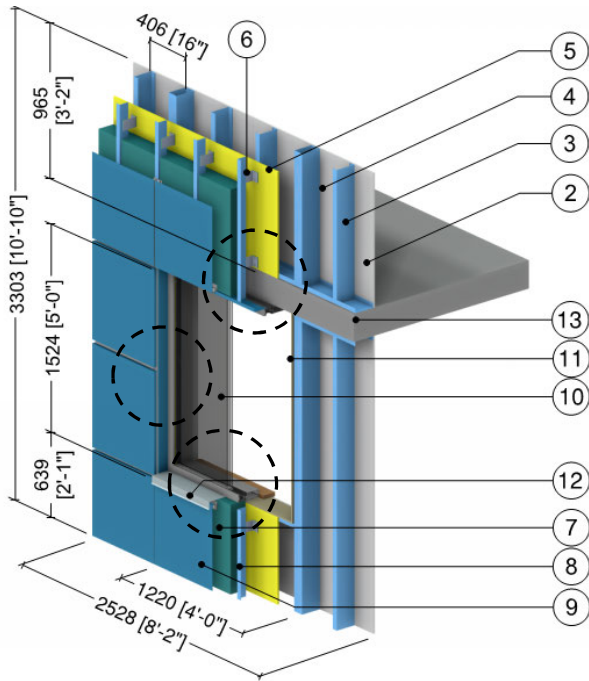

Head Detail

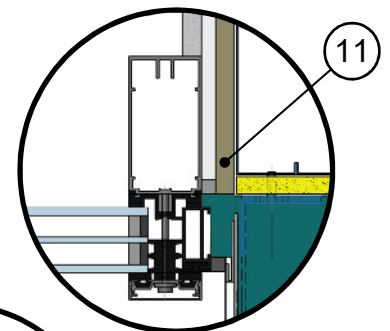

Jamb Detail

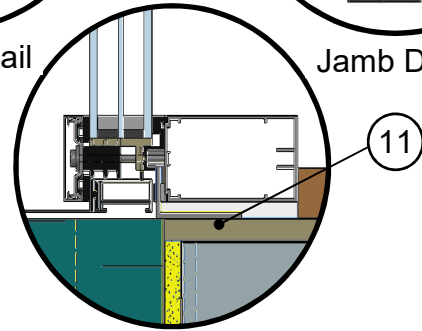

Sill Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2" x 6" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	6" (152)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum curtain wall (Passive House certified): triple glazed & thermally broken ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² .°F (0.81 W/m ² K)					
11	Wood Liner	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.3.15

Exterior and Interior Insulated 2"x6" Steel Stud (16" o.c.) Wall Assembly with Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation


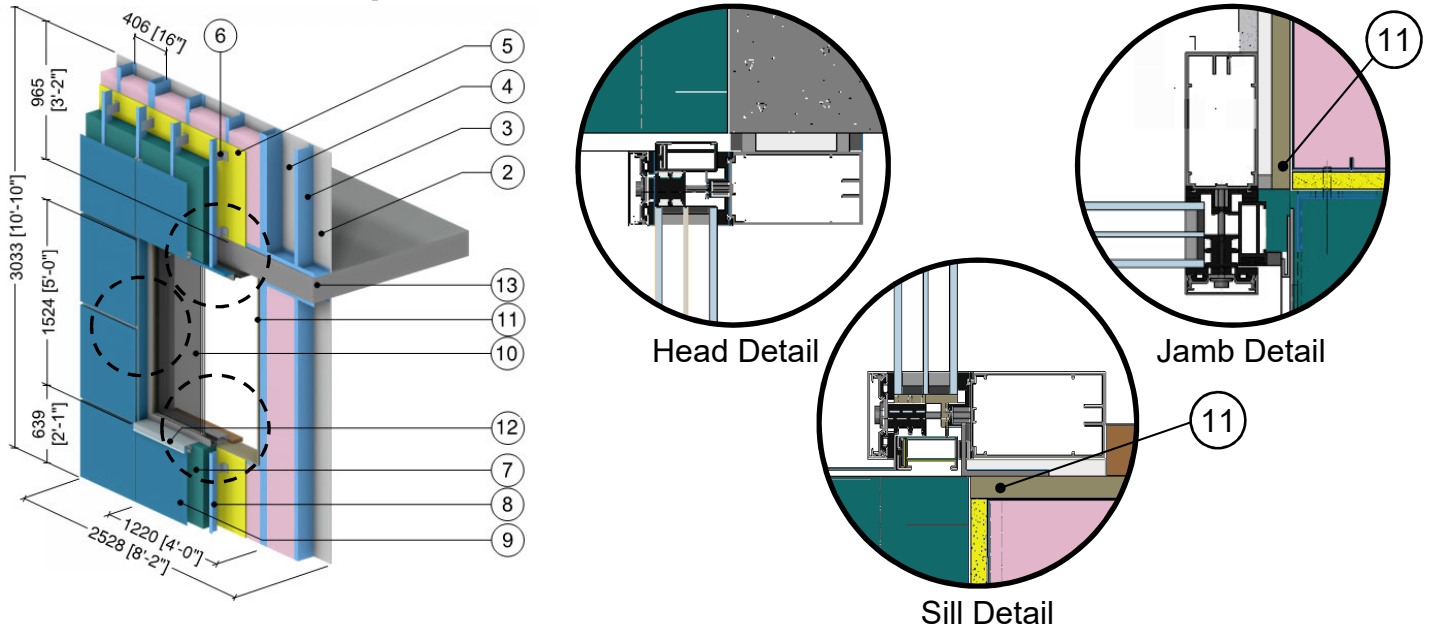


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2" x 6" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglas Batt Insulation	6" (152)	0.29 (0.042)	R-19 (3.35 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum curtain wall (Passive House certified): triple glazed & thermally broken ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² .°F (0.81 W/m ² K)					
11	Wood Liner	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.4.1 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Conventional Curtain Wall Transition

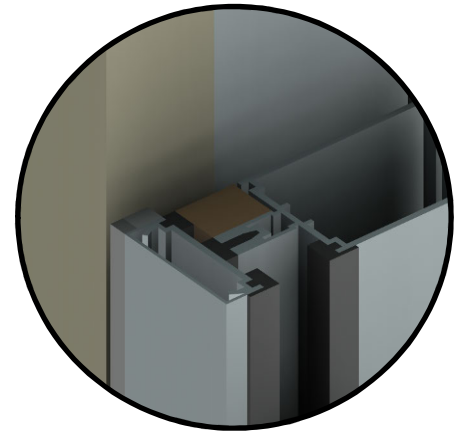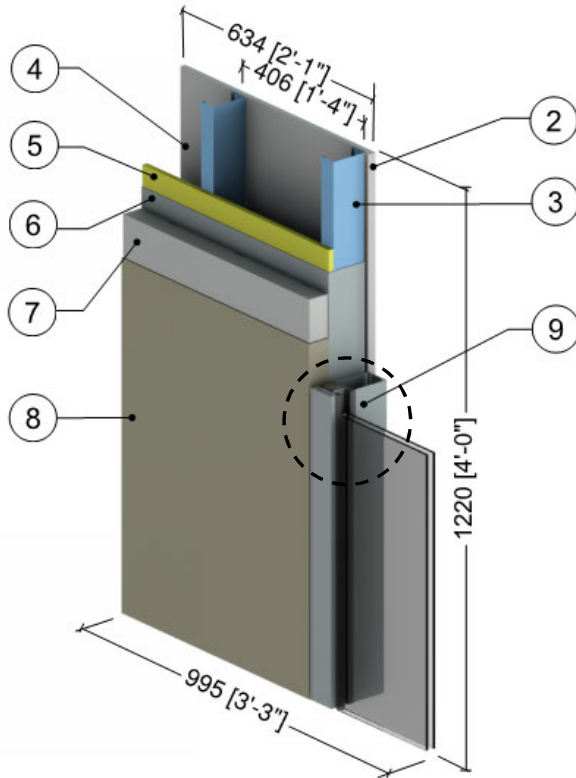



Curtain Wall Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·oF (1.82 W/m ² K)					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.4.2 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Conventional Curtain Wall Transition

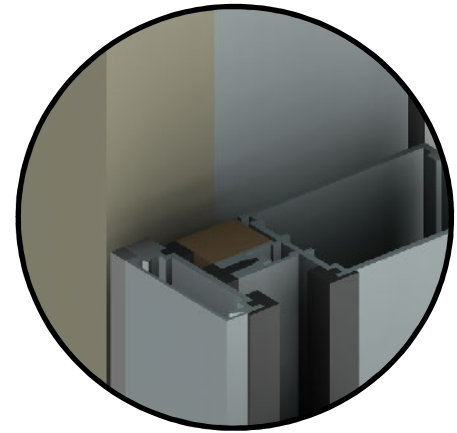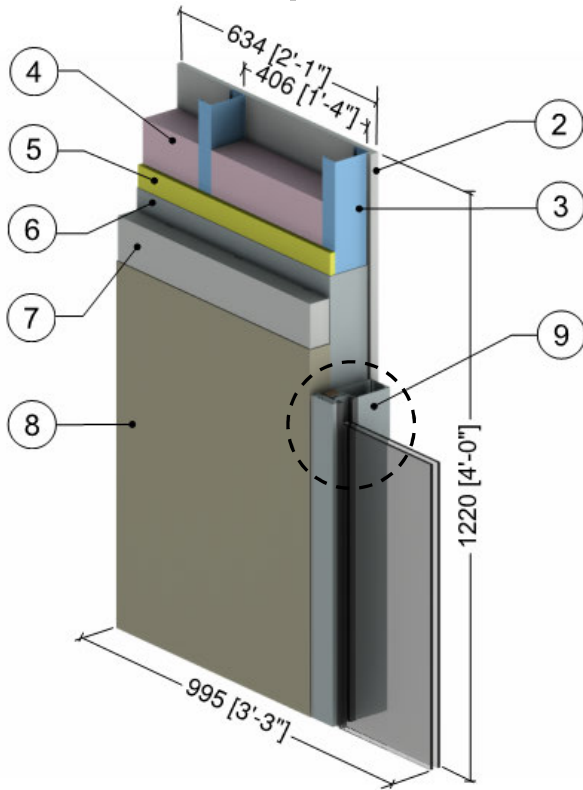



Curtain Wall Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·oF (1.82 W/m ² K)					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.4.3 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly – Curtain Wall Transition

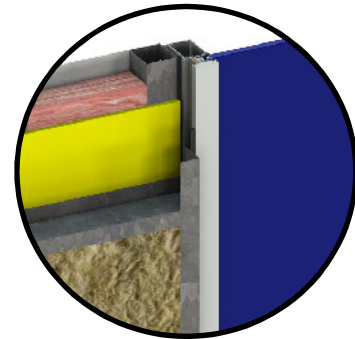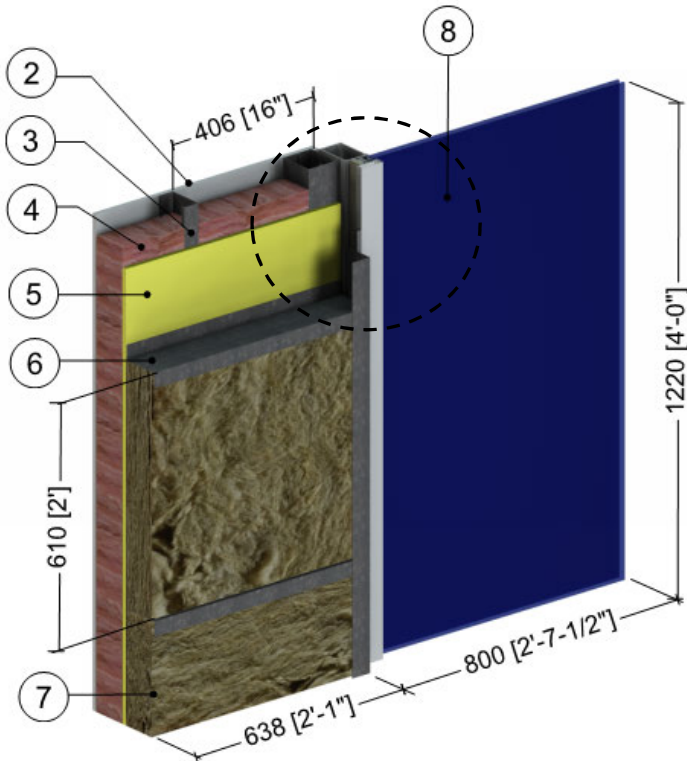

Without Aerogel Detail

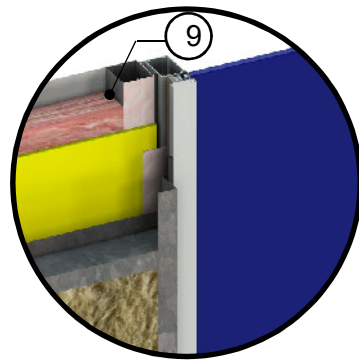

With Aerogel Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3 1/2" (89)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -oF (1.82 W/m ² K)					
9	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
10	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.4.4

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Conventional Curtain Wall Intersection


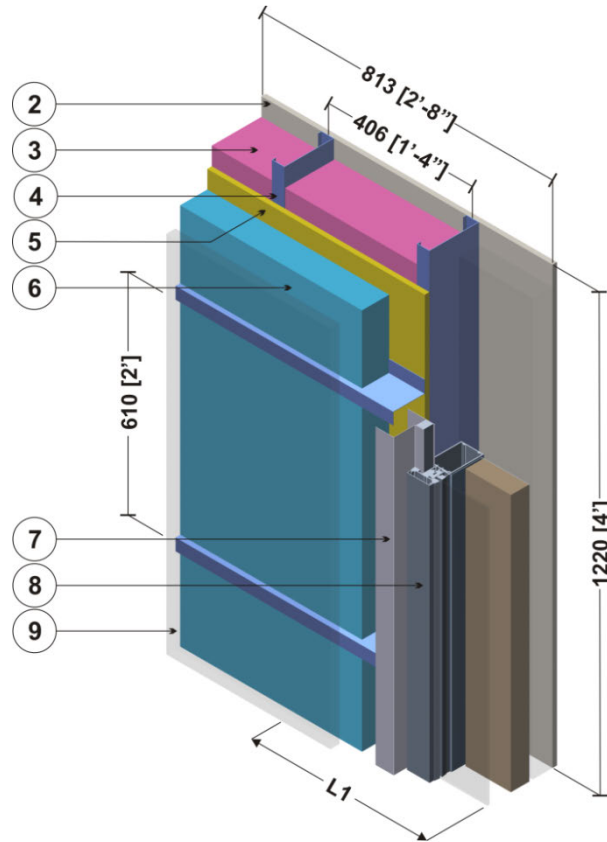


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (90)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange with Closure Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
9	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI) to R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2

Detail 5.4.5 Exterior Insulated Concrete Wall and Steel Stud Assembly Supporting Metal Cladding – Curtain Wall Transition Intersection

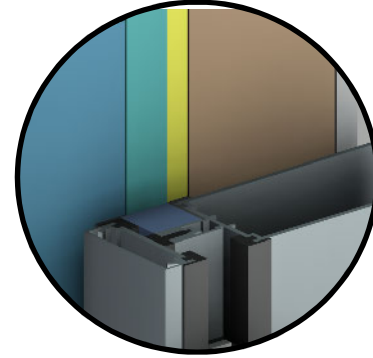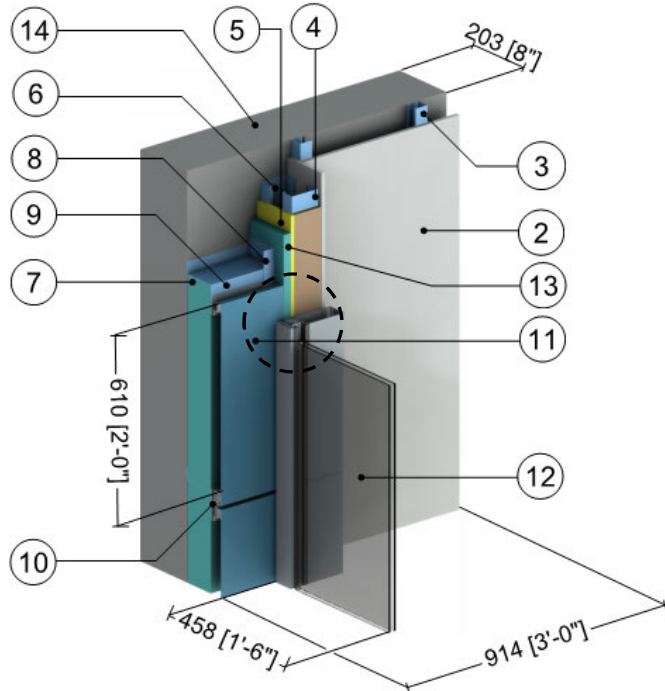



Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
7	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Z-Girt	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Horizontal Z-Girt (24" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Metal Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
12	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Rigid Insulation	1" (25)	-	R-5.0 (0.88 RSI)	1.8 (28)	0.29 (1220)
14	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
15	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.4.6 Exterior Insulated Concrete Wall and Steel Stud Assembly Supporting Metal Cladding with Cavity Insulation – Curtain Wall Transition Intersection

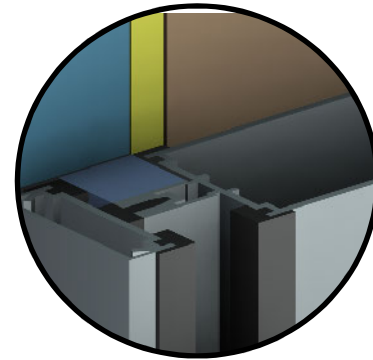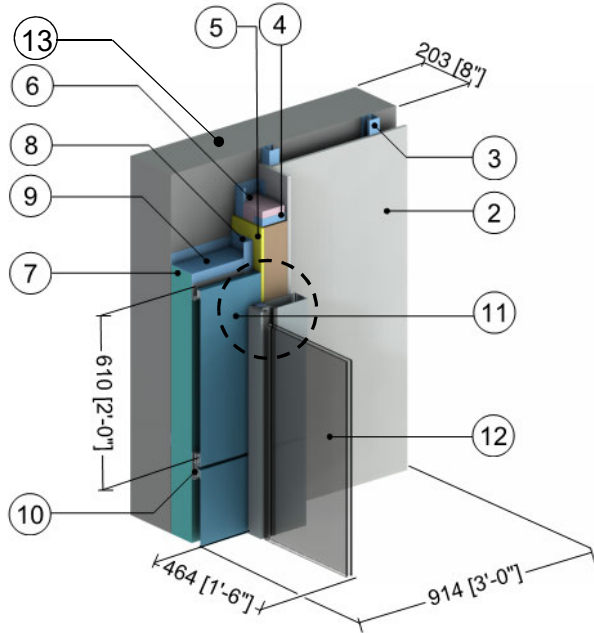


Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.1 RSI)	0.9 (14)	0.17 (710)
7	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Z-Girt	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Horizontal Z-Girt (24" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Metal Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
12	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·oF (1.82 W/m ² K)					
13	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


Detail 5.5.1 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection

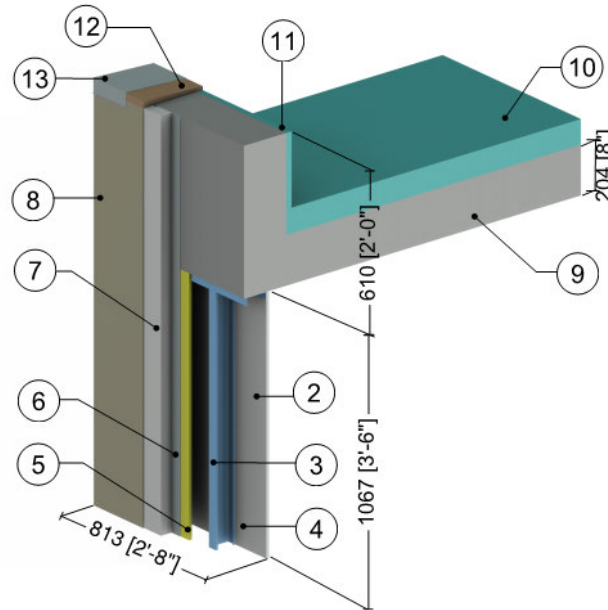

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.5.2 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection

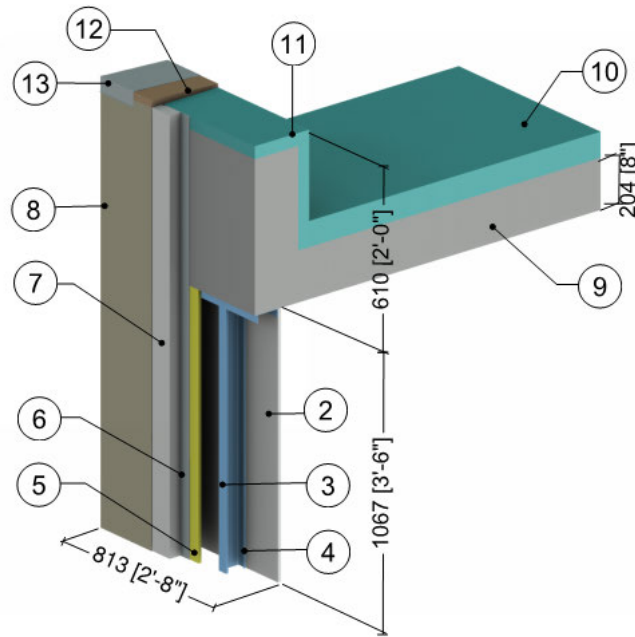

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	Varies	-	R-10 to R-20 (1.76 RSI to 3.52 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.5.3 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection

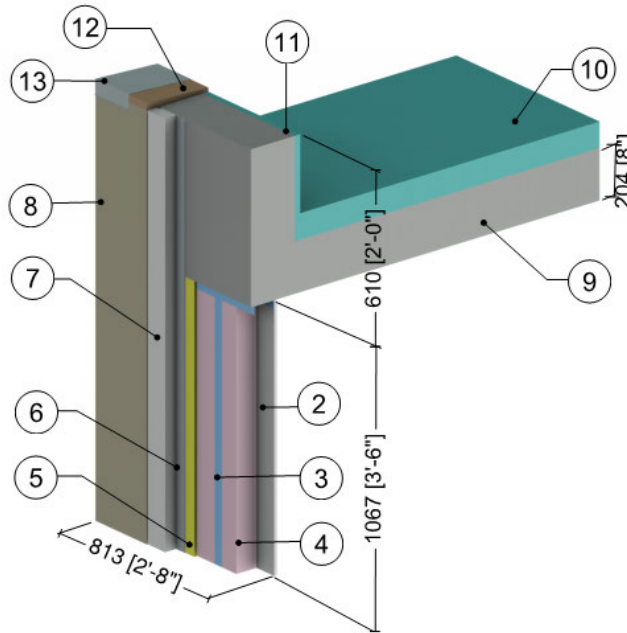

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 5.5.4 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection

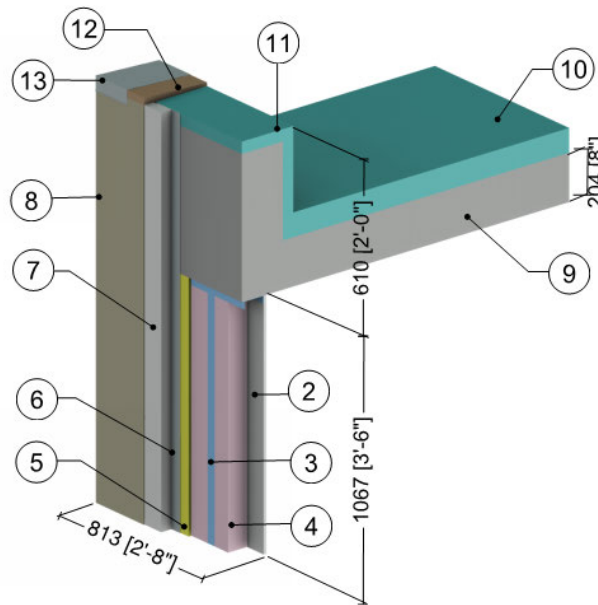

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	Varies	-	R-10 to R-20 (1.76 RSI to 3.52 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	R-1 (0.18 RSI)	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.5 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Concrete Parapet & Slab Intersection


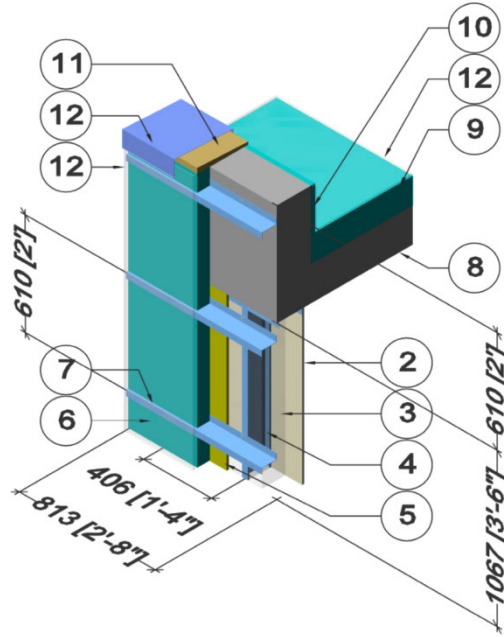


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Stud With Top and Bottom Track	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R5 to R25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
10	Parapet Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
11	Wood Blocking	5/8" (16)	0.63 (0.09)	R-1 (0.18 RSI)	27.8 (445)	0.45 (1880)
12	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient, metal cap flashing & finish roof materials					
13	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.6

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Concrete Parapet and Slab Intersection

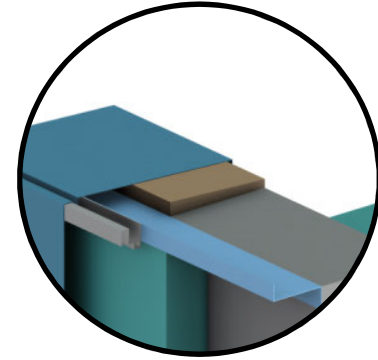
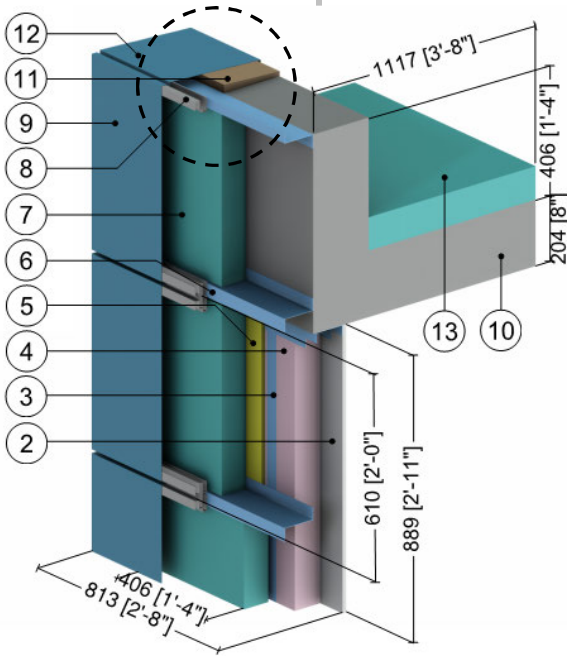


Parapet Cap Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
10	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Wood Blocking	5/8" (16)	0.69 (0.10)	R-1 (RSI-0.18)	31 (500)	0.45 (1880)
12	Steel Cap Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Roof Insulation	4" (102)	0.20 (0.029)	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.7 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Vertical Z Girts (16" o.c.) Supporting Stucco Cladding – Concrete Parapet & Slab Intersection

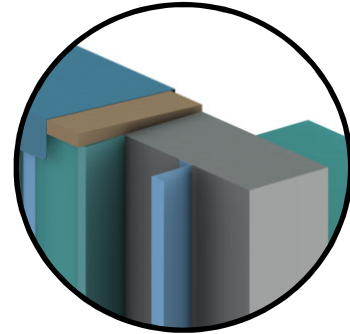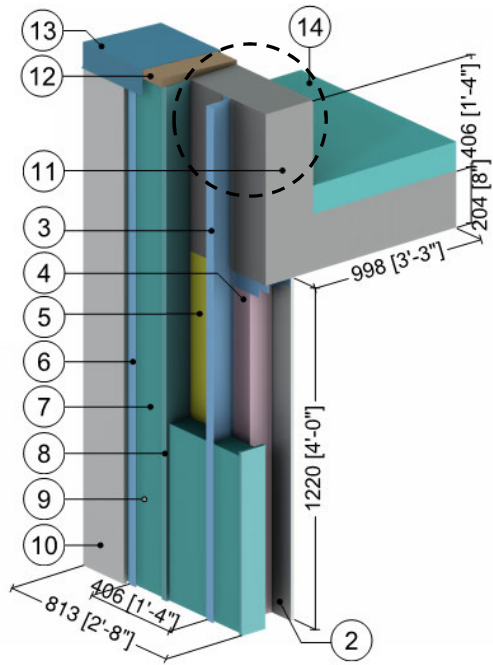



Parapet Cap Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Rigid Insulation Bracing	Varies	0.2 (0.029)	-	1.8 (28)	0.29 (1220)
9	Rainscreen Cavity	1/2" (13)	-	R-0.5 (0.09 RSI)	0.075 (1.2)	0.24 (1000)
10	Stucco Cement with Breather Board	1/2" (13)	6 (0.9)	R-0.1 (0.01 RSI)	120 (1922)	0.20 (850)
11	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Wood Blocking	5/8" (16)	0.69 (0.10)	-	31 (500)	0.45 (1880)
13	Steel Cap Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
14	Roof Insulation	4 (102)	0.20 (0.029)	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.8

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z Girts (16" o.c.) Supporting Metal Cladding – Concrete Roof Deck at Continuous Concrete Parapet

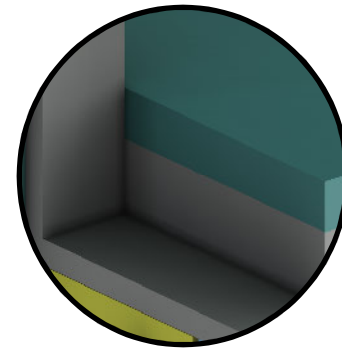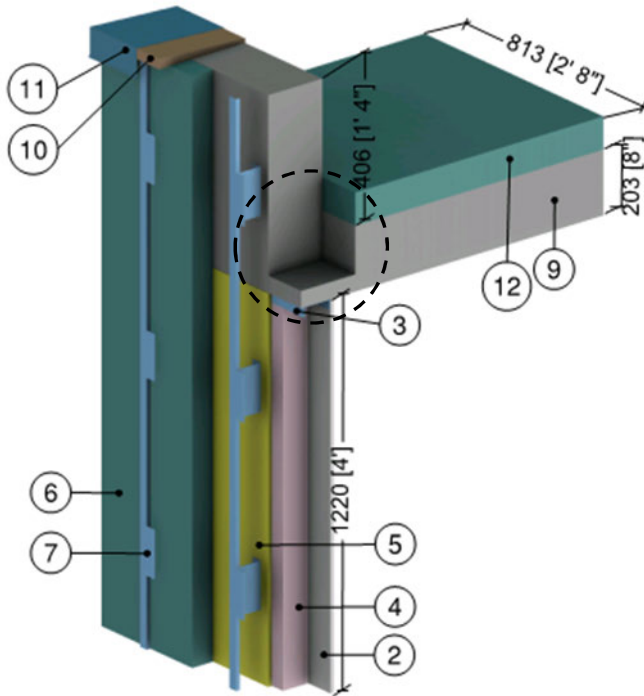

Continuous Concrete Parapet Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Intermittent Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Wood Blocking	5/8" (16)	0.69 (0.10)	R-1.0 (0.18 RSI)	31 (500)	0.45 (1880)
11	Steel Cap Flashing	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
12	Roof Insulation	4 (102)	0.20 (0.029)	R-20 (3.50 RSI)	1.8 (28)	0.29 (1220)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.5.9

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z Girts (16" o.c.) Supporting Metal Cladding – Concrete Roof Deck at Isokorb AXT1 Thermally Broken Concrete Parapet

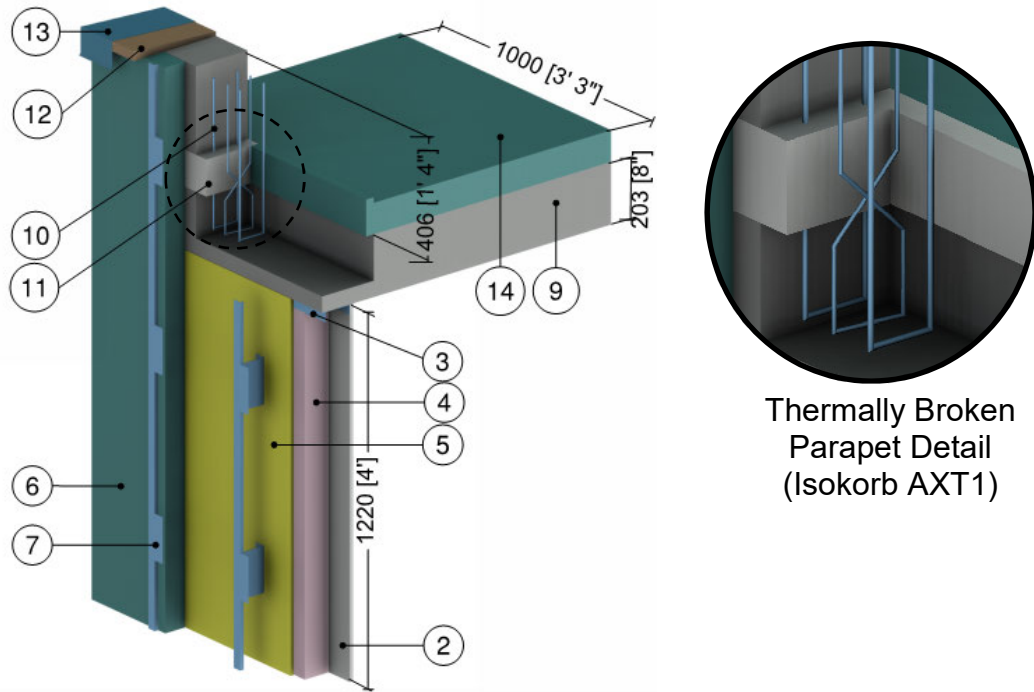


Thermally Broken Parapet Detail (Isokorb AXT1)

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI) to R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Intermittent Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab and Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
11	Polystyrene Hard Foam Insulation	4 3/4" (120)	0.217 (0.031)	R-22.0 (3.87 RSI)	66 (1060)	0.35 (1500)
12	Wood Blocking	5/8" (16)	0.69 (0.10)	R-1.0 (0.18 RSI)	31 (500)	0.45 (1880)
13	Steel Cap Flashing	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
14	Roof Insulation	4 (102)	0.20 (0.029)	R-20 (3.50 RSI)	1.8 (28)	0.29 (1220)
15	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI) to R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.10

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection


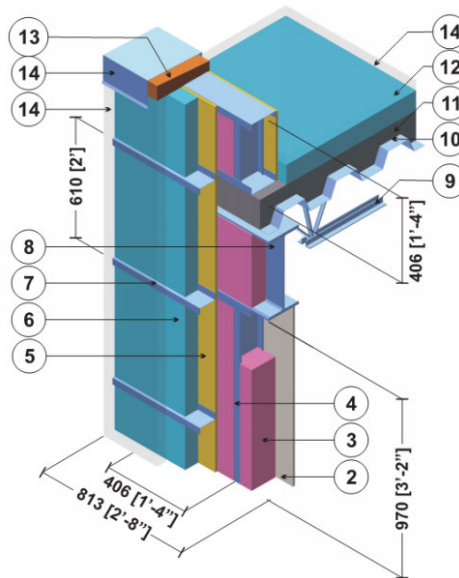


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	varies	-	R5 to R25 (0.88 to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Open Web Steel Joist	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
11	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
12	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
13	Wood Blocking	5/8" (16)	0.63 (0.09)	R-1 (0.18 RSI)	27.8 (445)	0.45 (1880)
14	Metal cladding with 1/2" (13mm) vented air space/ metal cap flashing/ finish roof materials is incorporated into exterior heat transfer coefficient					
15	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.11

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection with Thermal Break under Parapet Stud Cavity

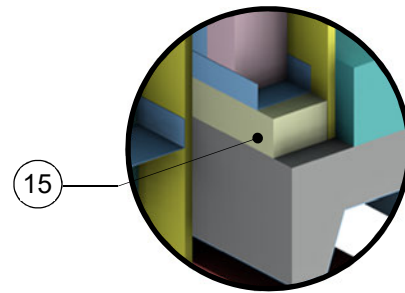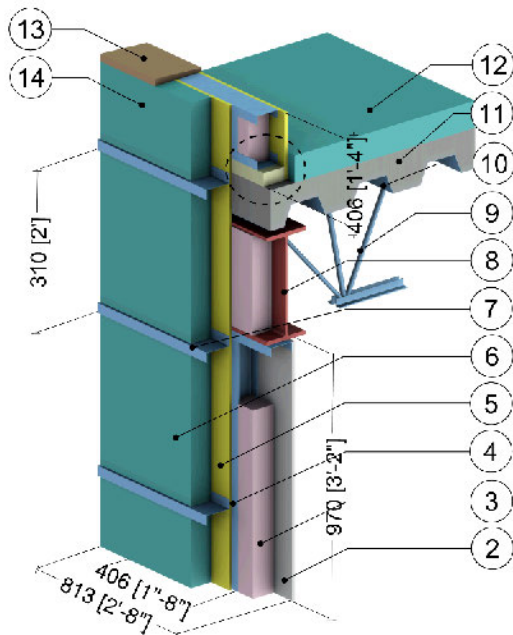


Parapet Thermal Break

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	varies	-	R15 (2.64 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Open Web Steel Joist	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
11	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
12	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
13	Wood Blocking	5/8" (16)	0.63 (0.09)	R-1 (0.18 RSI)	27.8 (445)	0.45 (1880)
14	Metal cladding with vented air space/ cap flashing/ finish roof materials	is incorporated into exterior heat transfer coefficient				
15	Armatherm 500	2" (50)	0.32 (0.05)	R-6.2 (1.09 RSI)	-	-
16	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.12 Vertical Insulated Metal Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection

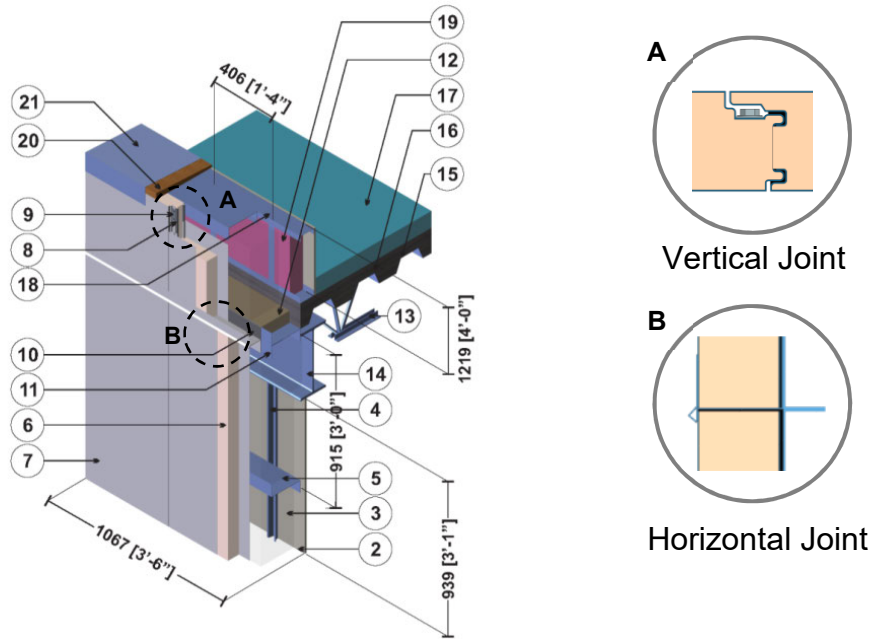


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	Steel Flashing & Trim	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Steel Angle	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Semi-Rigid Insulation	-	0.28 (0.04)	-	4.5 (72)	0.17 (710)
13	Open Web Steel Joist	-	314 (45)	-	489 (7830)	0.12 (500)
14	Steel Beam (W410)	-	314 (45)	-	489 (7830)	0.12 (500)
15	Steel Deck	1/16" (2)	314 (45)	-	489 (7830)	0.12 (500)
16	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
17	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
18	3 5/8" x 1 5/8" Steel Studs with Track	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
19	Parapet Insulation	-	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)



20	Wood Block	5/8" (16)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
21	Flashing & roof finish materials are incorporated into exterior heat transfer coefficient.					
22	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.5.13 Horizontal Insulated Metal Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection

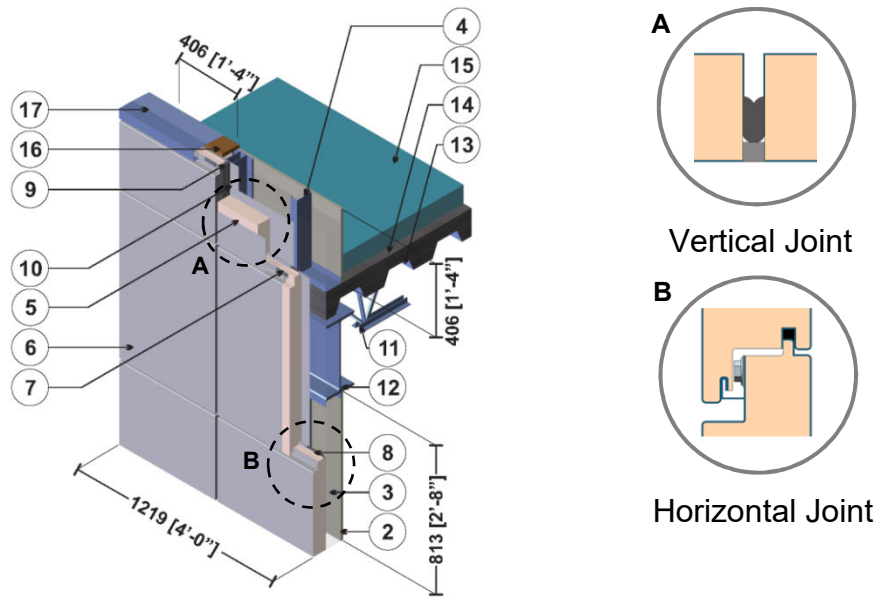


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Track	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	Gasket	-	0.966 (0.14)	-	-	-
10	Steel Plate	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Open Web Steel Joist	-	314 (45)	-	489 (7830)	0.12 (500)
12	Steel Beam (W410)	-	314 (45)	-	489 (7830)	0.12 (500)
13	Steel Deck	1/16" (1.6)	314 (45)	-	489 (7830)	0.12 (500)
14	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
15	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
16	Wood Block	5/8" (16)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
17	Flashing & roof finish materials are incorporated into exterior heat transfer coefficient.					
18	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.6.1 Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Corner Intersection

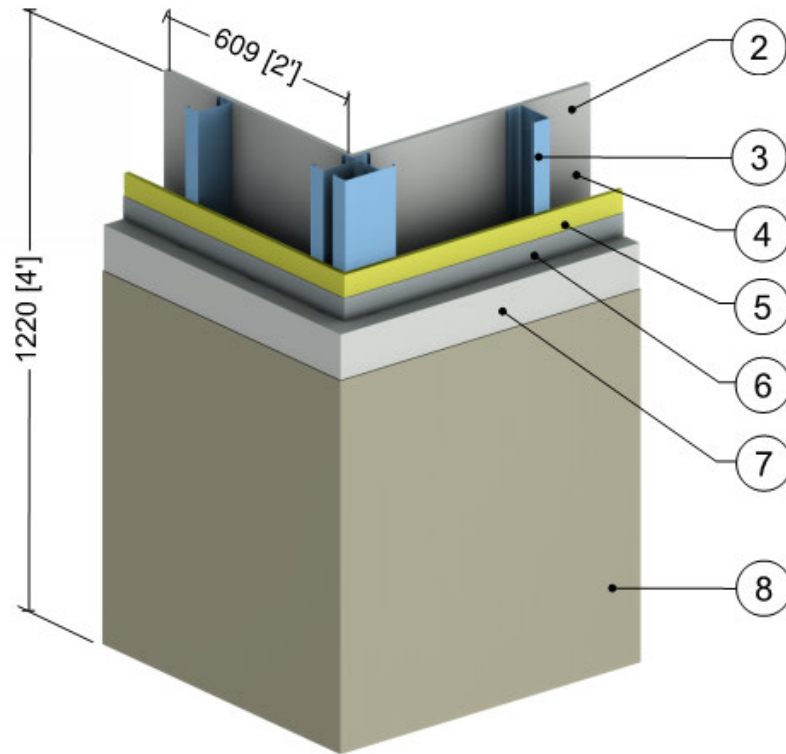


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.2

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Drained EIFS Wall Assembly – Corner Intersection

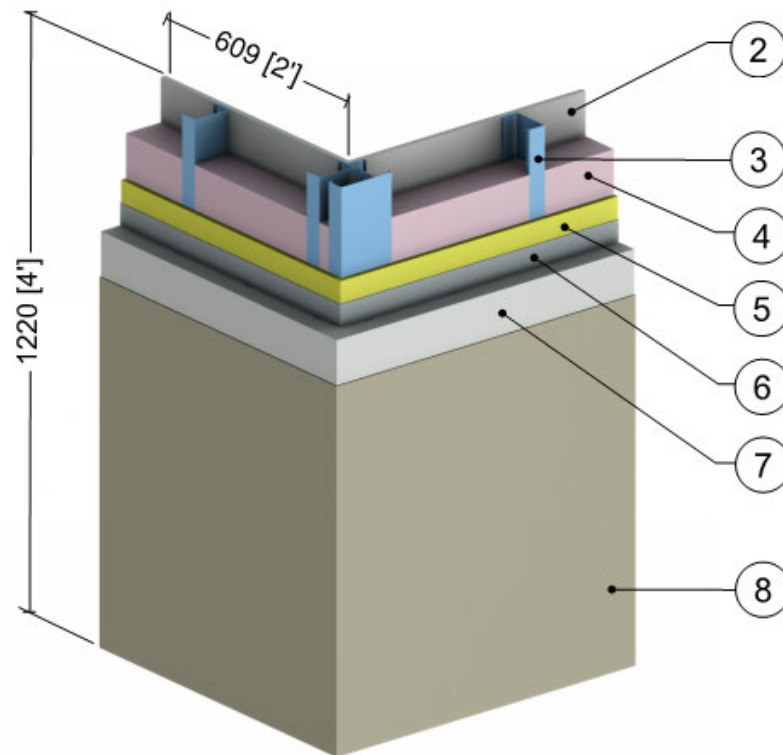


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (1.1)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	Varies	0.27 (0.039)	R-7.5 to R-15 (1.32 RSI to 2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.3

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Corner Intersection

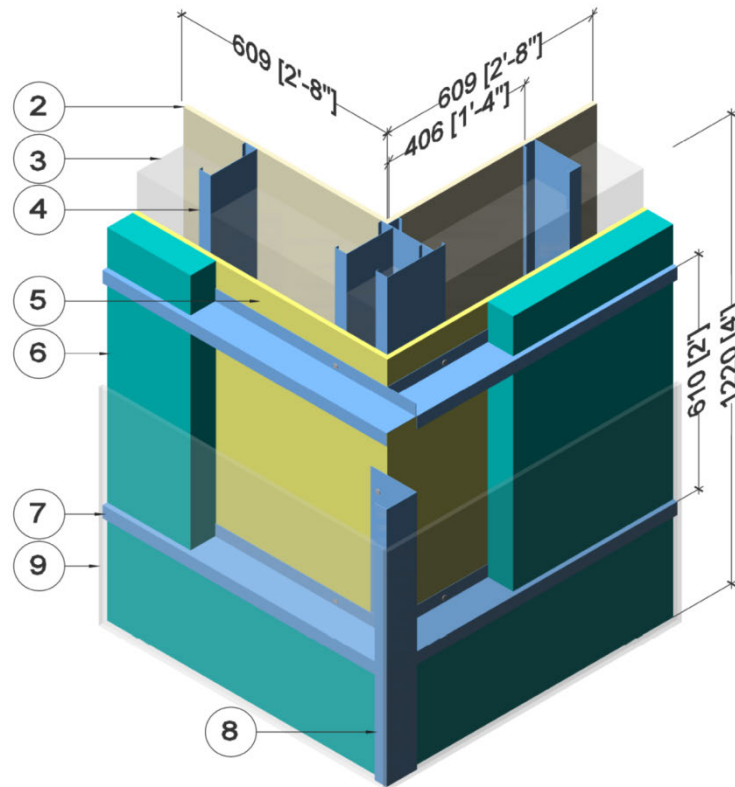


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Corner Break Shape w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.4

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Corner Intersection with Alternative Framing

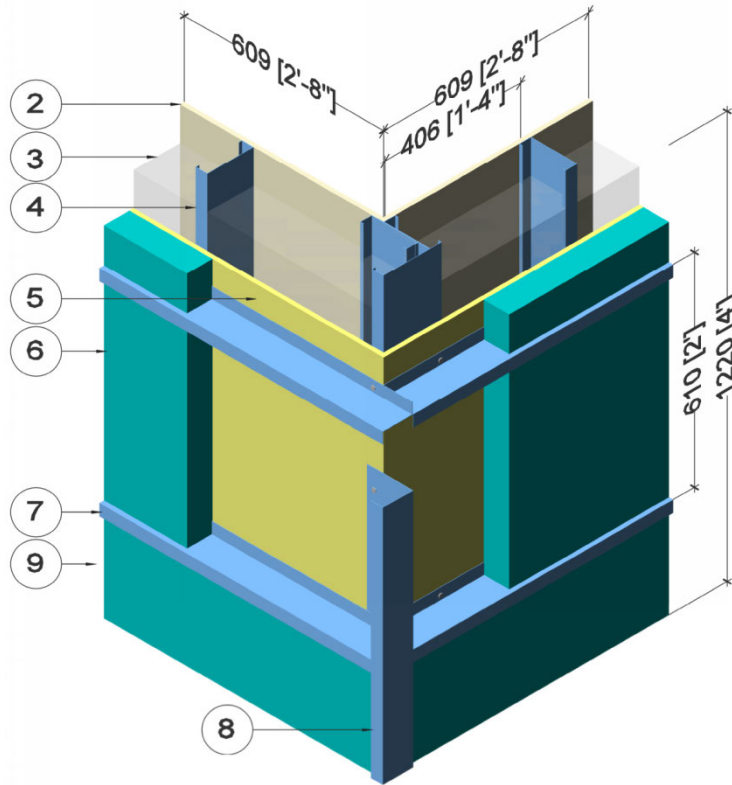


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Corner Break Shape w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.5

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Corner Intersection


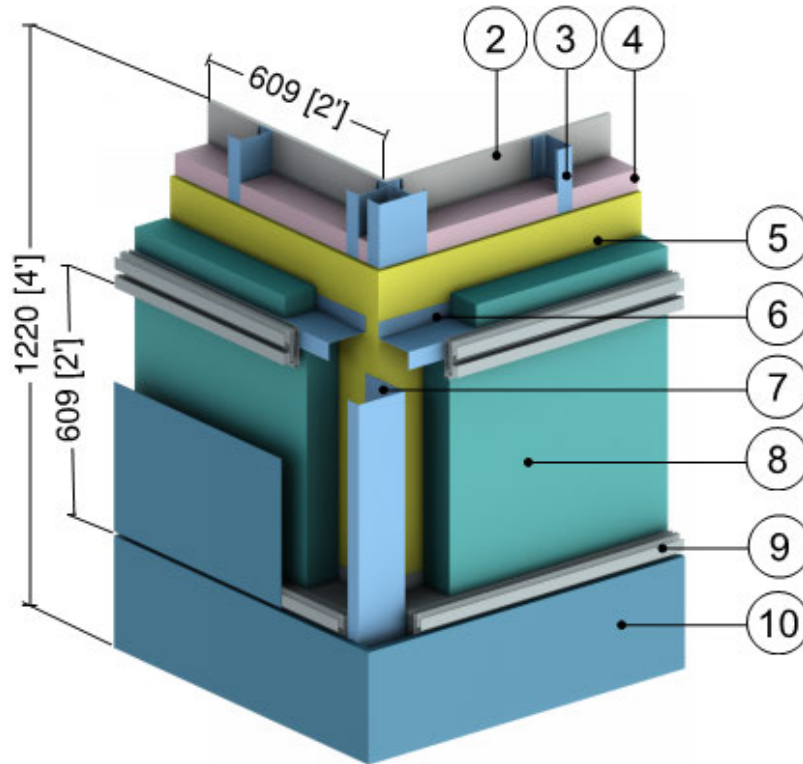


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Corner Break Shape w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
9	Panel Clip	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Metal Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.6

Window Wall System – Transition to Exterior Insulated Steel Stud Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding & No Interior Stud Cavity Insulation

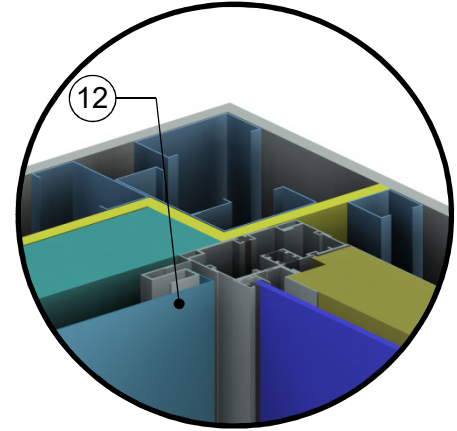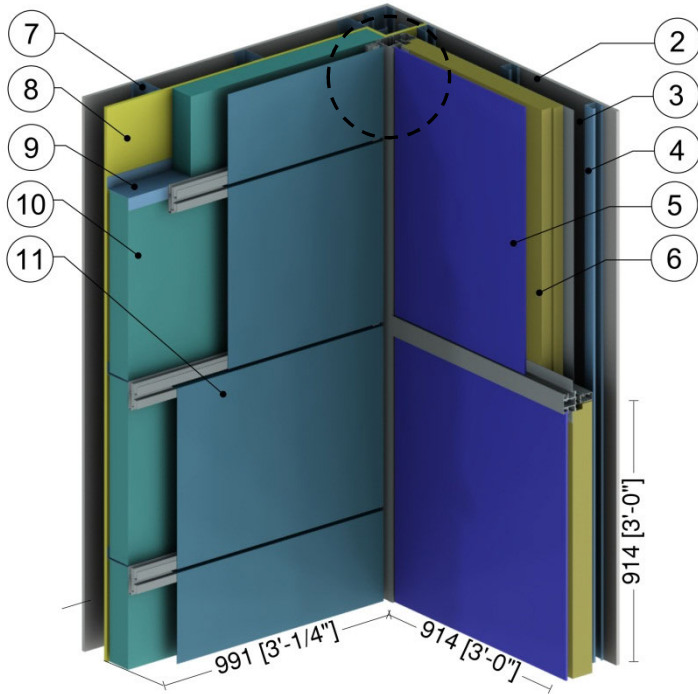



Corner Post Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
6	Backpan Insulation	-	-	R-16.8 (2.96 RSI)	4 (64)	0.20 (850)
7	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
9	Horizontal Z-girts (24" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 RSI) to 4.40 RSI)	1.8 (28)	0.29 (1220)
11	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
12	Aluminum Flashing	14 Gauge	1109 (16)	-	171 (2739)	0.21 (900)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.6.7 Window Wall System – Transition to Exterior Insulated Steel Stud Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding & Interior Sprayfoam and Fibreglass Batt Insulation

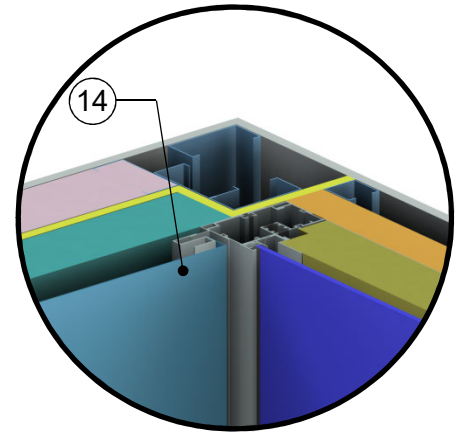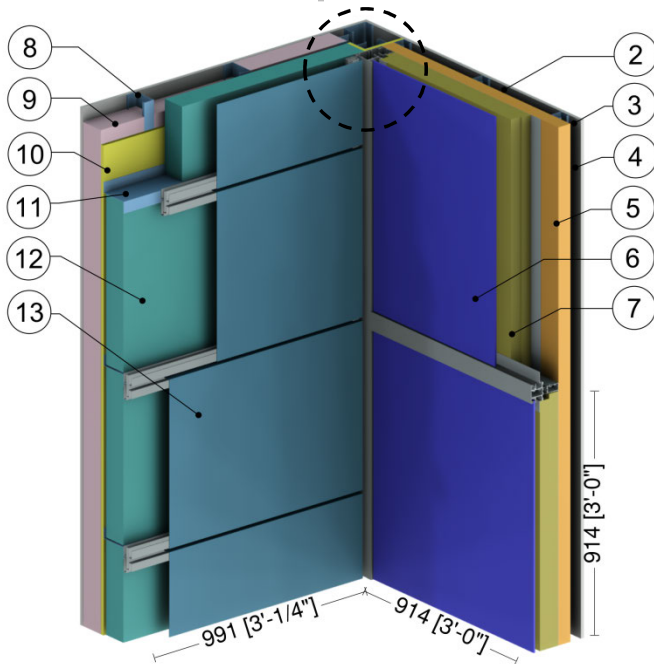



Corner Post Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Continuous Sprayfoam Insulation	2" (51)	0.17 (0.024)	R-12 (2.11 RSI)	2.8 (39)	0.35 (1470)
6	Aluminum Window Wall Spandrel System with Insulated Backpan: thermally broken frame ²					
7	Backpan Insulation	Varies	-	R-8.4 to R-16.8 (1.48 RSI to 2.96 RSI)	4 (64)	0.20 (850)
8	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
10	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
11	Horizontal Z-girts (24" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
13	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
14	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 5.6.8 Vertical Insulated Metal Panel – Corner Intersection with Post and Support Girt/Hat Track Backup Wall

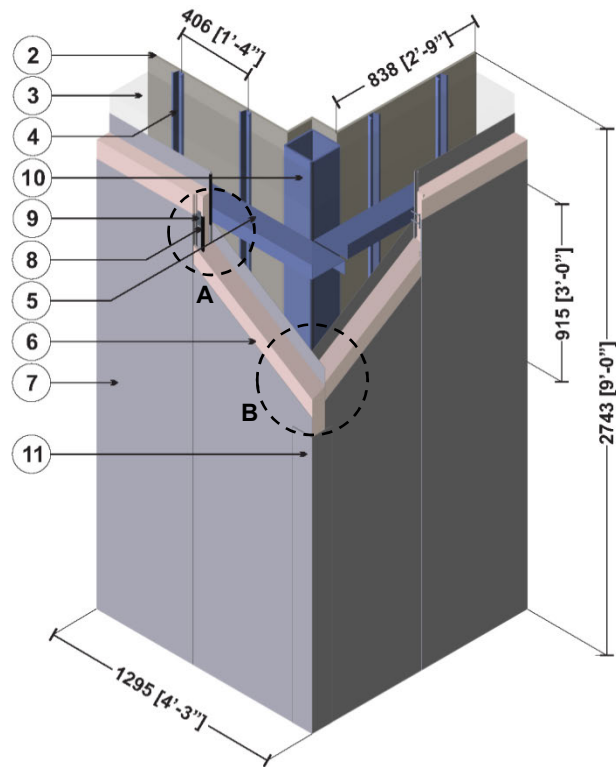

Vertical Joint




Corner Plan Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	Hat Tracks @ 16" o.c.	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Z-Girts with 1 1/2" Flange	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
7	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
10	HSS Steel Post	1/8" (3)	314 (45)	-	489 (7830)	0.12 (500)
11	Steel Corner Trim	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.6.9 Horizontal Insulated Metal Panel – Corner Intersection with Post and Steel Stud Backup Wall

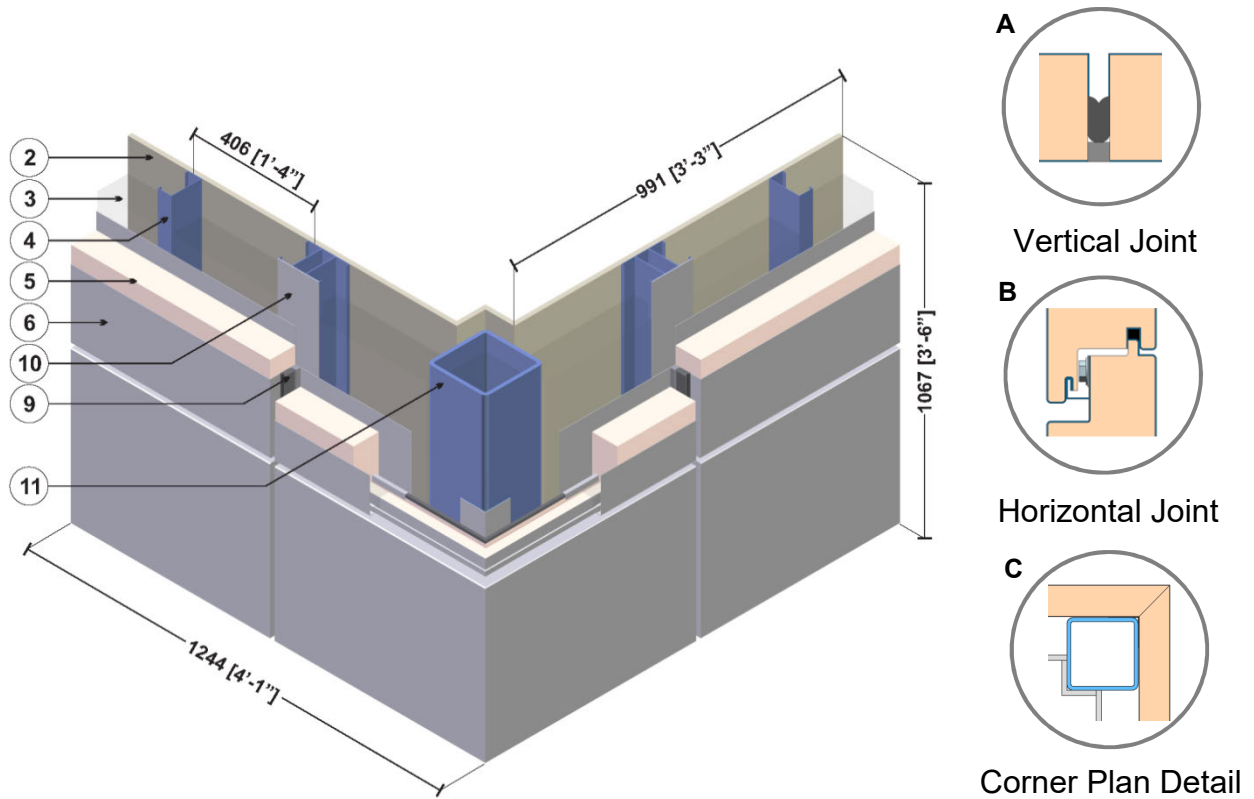


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Cavity	-	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Polyisocyanurate Insulation	3" (76)	0.143 (0.02)	R-21.0 (3.70)	1.8 (28)	0.29 (1220)
6	Steel Facer Skin	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	#14 Steel Fasteners	1/4" (6) Ø	314 (45)	-	489 (7830)	0.12 (500)
8	Sealant	-	2.4 (0.35)	-	-	-
9	Gasket	-	0.966 (0.14)	-	-	-
10	Steel Plate	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	HSS Steel Post	1/8" (3)	314 (45)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.1

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Structural Steel Column & Cantilever Beam Intersection (Canopy Support)

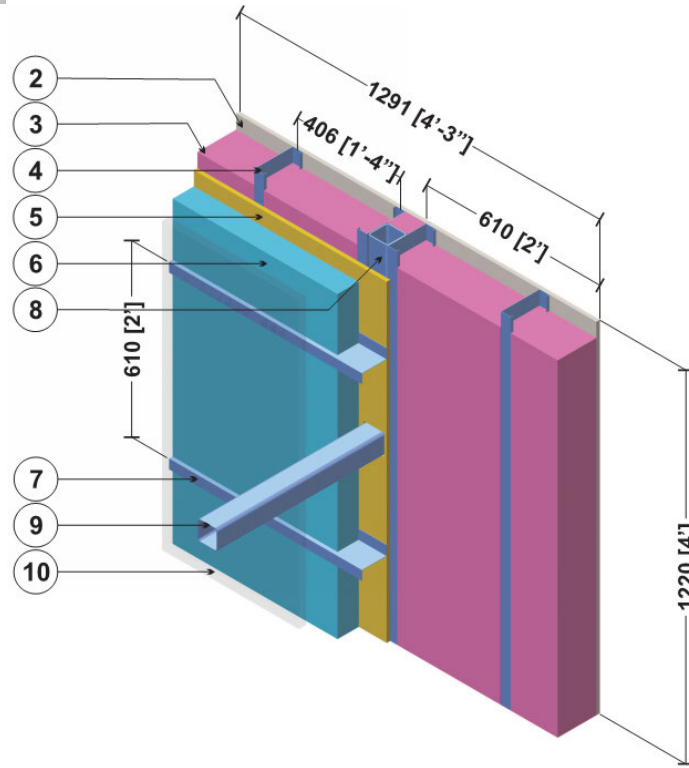


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Steel Post (HSS 76x76x3.2)	1/8" (3)	347 (50)	-	489 (7830)	0.12 (500)
9	Steel Beam (HSS 76x76x3.2)	1/8" (3)	347 (50)	-	489 (7830)	0.12 (500)
10	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.2

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Uninterrupted Beam

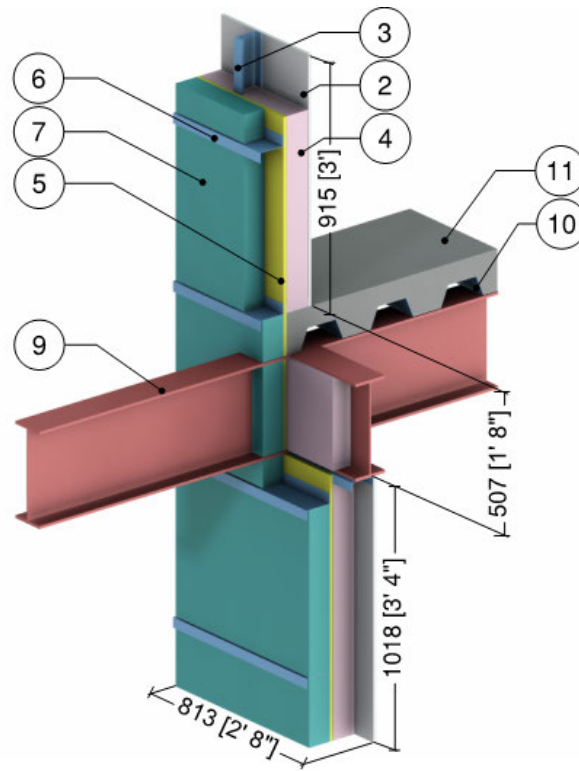


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Steel Through Beam W14x26 (W360x39)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
11	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.3

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Isolator Pad

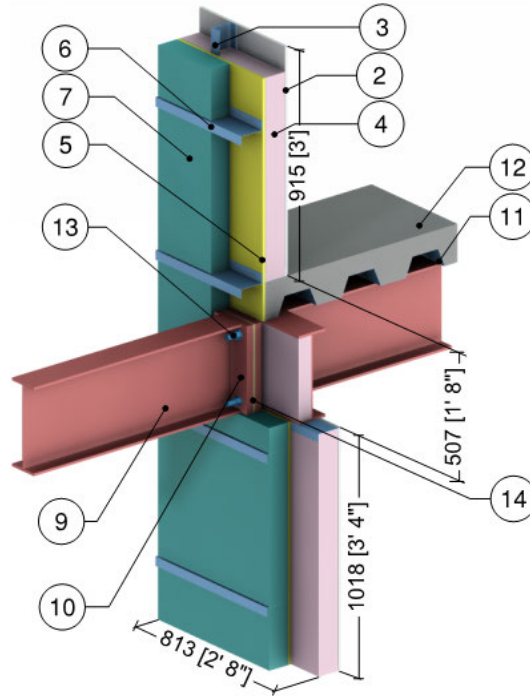


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.10 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	0.2 (0.029)	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Steel Beam W14x26 (W360x39)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Bearing Plates	1 3/16" (30)	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
12	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
13	Steel or Stainless Steel Bolts	-	347 to 118 (50 to 17)	-	500 (8000)	0.12 (500)
14	Polymer Thermal Isolator Pad	3/16" to 3/8" (5 to 10)	1.7 (0.25)	-	137 (2200)	0.31 (1300)
15	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 5.7.4

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Isokorb S22 Thermally Broken Beam

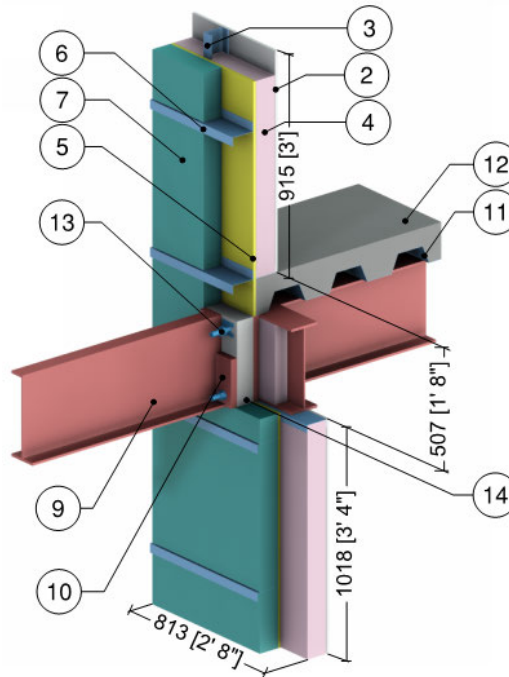


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.044)	R-12.0 (2.11 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Steel Beam W14x26 (W360x39)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Bearing Plates	1 3/16" (30)	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
12	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
Isokorb S22 Thermal Break						
13	Stainless Steel Bolts, Plates and HSS	-	118 (17)	-	500 (8000)	0.12 (500)
14	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.5 (2.6 RSI)	66 (1060)	0.35 (1500)
15	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.5

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam Connection

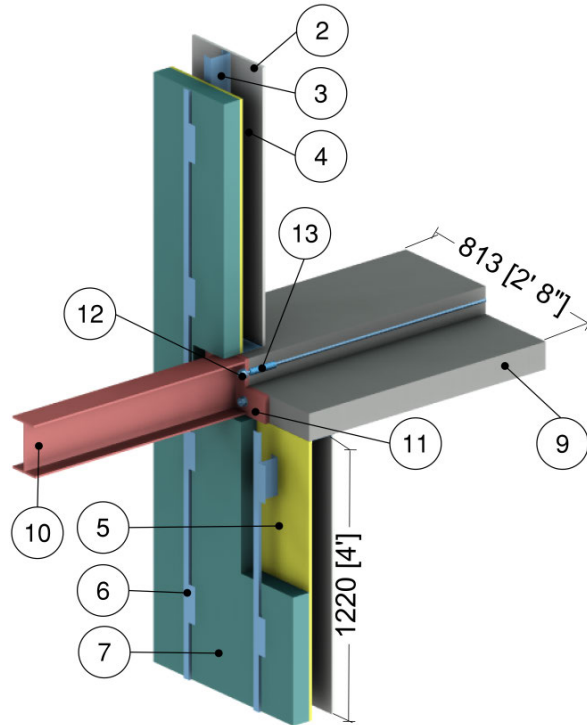


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Intermittent Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8 5/8" (220)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Steel Beam W8x18 (W200x27)	-	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Bearing Plates	3/4" (20)	347 (50)	-	489 (7830)	0.12 (500)
12	Steel Bolts and Rebar	-	347 (50)	-	489 (7830)	0.12 (500)
13	Stainless Steel Anchors	-	118 (17)	-	500 (8000)	0.12 (500)
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.6

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam with a Thermal Isolator Pad Connection

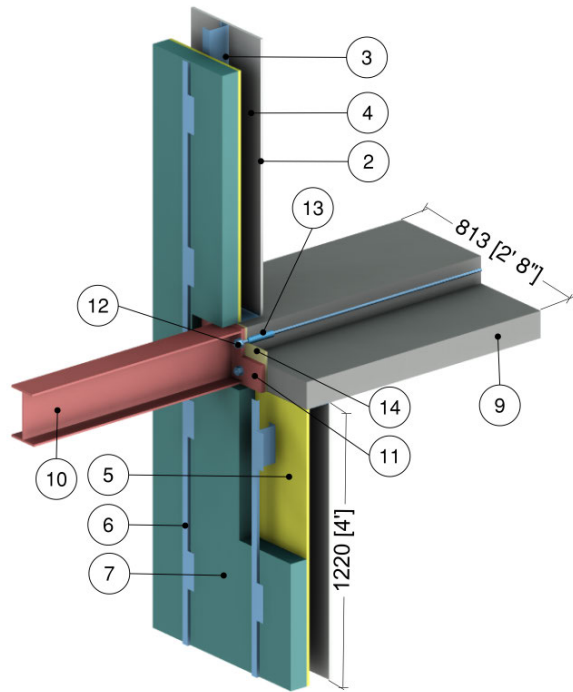


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Intermittent Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8 5/8" (220)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Steel Beam W8x18 (W200x27)	-	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Bearing Plates	3/4" (20)	347 (50)	-	489 (7830)	0.12 (500)
12	Steel Bolts and Rebar	-	347 (50)	-	489 (7830)	0.12 (500)
13	Stainless Steel Anchors	-	118 (17)	-	500 (8000)	0.12 (500)
14	Polymer Thermal Isolator Pad	3/8" (10)	1.7 (0.25)	-	137 (2200)	0.31 (1300)
15	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.7

Exterior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Intermittent Vertical Z-girts (16" o.c.) Supporting Metal Cladding – Concrete Floor to Steel Beam with Isokorb KS14 Connection


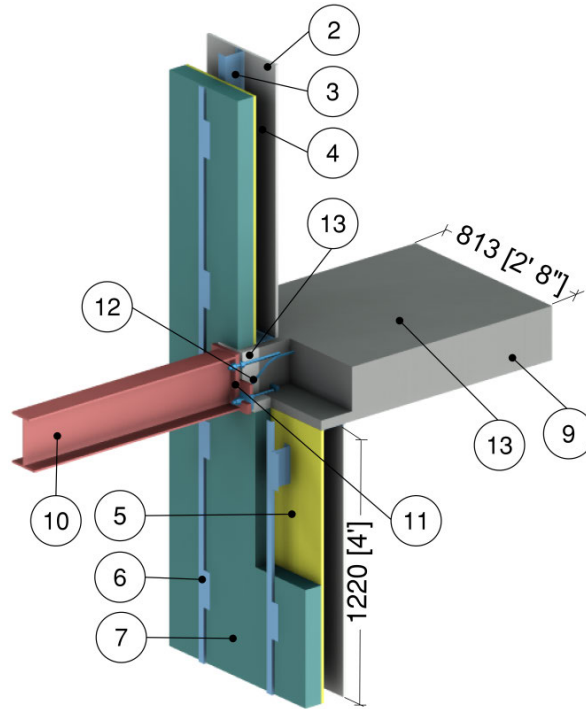


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Intermittent Vertical Z-Girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Concrete Slab	8 5/8" (220)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Steel Beam W8x18 (W200x27)	-	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Bearing Plate with Butt Stop	3/4" (20)	347 (50)	-	489 (7830)	0.12 (500)
Isokorb KS14 Thermal Break						
12	Stainless Steel Reinforcement	-	118 (17)	-	500 (8000)	0.12 (500)
13	Polystyrene Hard Foam Insulation	3 1/8" (80)	0.217 (0.031)	R-14.5 (2.6 RSI)	66 (1060)	0.35 (1500)
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.8

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Beam Thermal Break

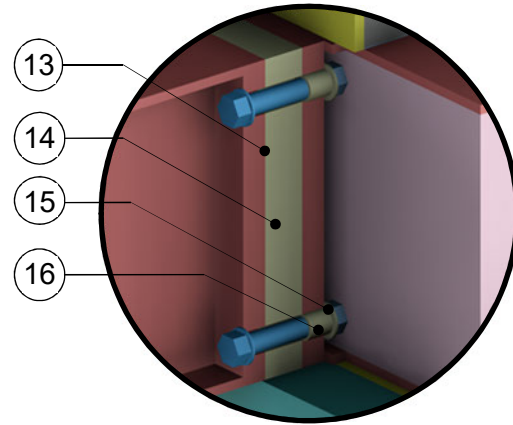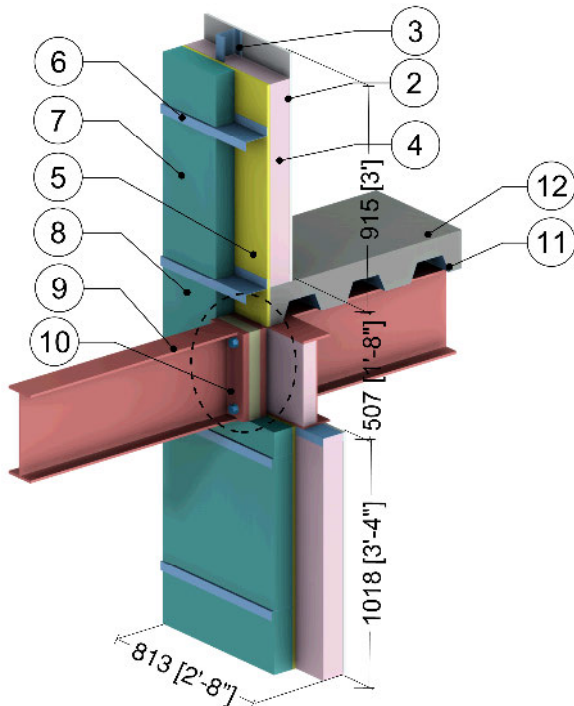


Beam Thermal Break

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI) to R-0.9 (0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.10 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	0.2 (0.029)	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Steel Beam W14x26 (W360x39)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Steel Bearing Plates	1 3/16" (30)	347 (50)	-	489 (7830)	0.12 (500)
11	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
12	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
13	Steel or Stainless Steel Bolts	-	347 (50) to 118 (17)	-	500 (8000)	0.12 (500)
14	Armatherm FRR Break	1" to 2" (25 to 50)	1.4 (0.20)	-	85 (5.3)	-
15	Armatherm FRR Washer	3/8" (10)	1.4 (0.20)	-	85 (5.3)	-
16	Armatherm FRR Bushing	1.2" (30)	1.4 (0.20)	-	85 (5.3)	-
17	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.7.9

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-girts (24" o.c.) Supporting Metal Cladding – Structural Steel Floor Intersection with Aerolon Coating

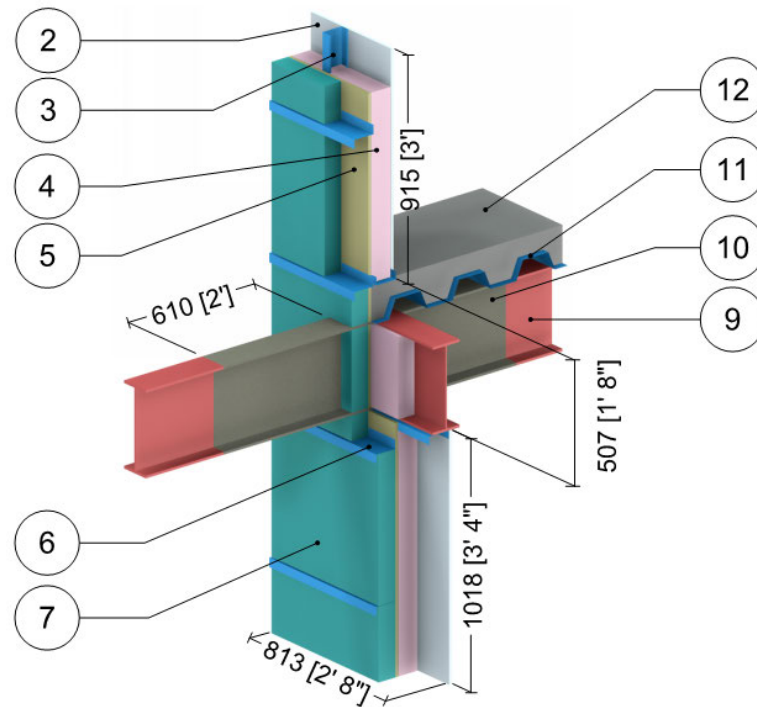


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fibreglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.0 (2.10 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Horizontal Z-girts with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Exterior Insulation	3" (76)	0.2 (0.029)	R-15.0 (2.64 RSI)	1.8 (28)	0.29 (1220)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Steel Beam W14x26 (W360x39)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Aerolon Coating	0.098" (2.5)	-	R-0.4 (0.07 RSI)	-	-
11	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
12	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 5.8.1

Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly with Horizontal Z-Girts (24" o.c.) Supporting Metal Cladding – Interior Wall Intersection

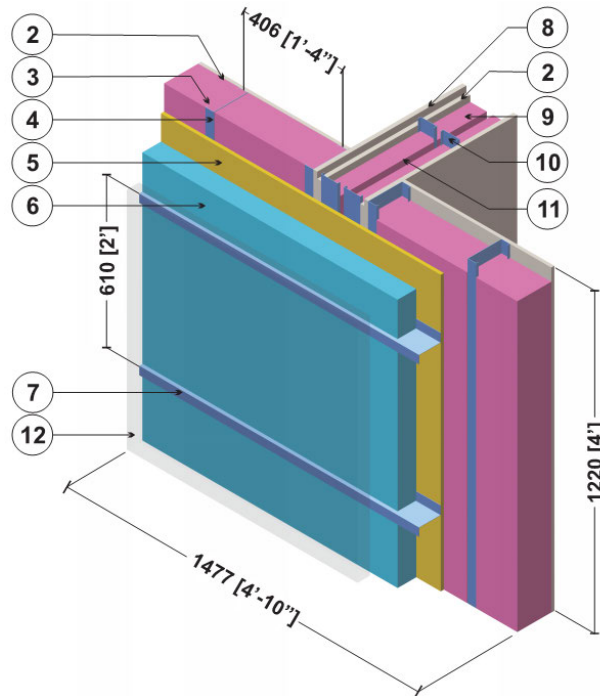

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-girts w/ 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Gypsum Board	5/8" (16)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
9	Acoustic Batt Insulation	2 5/8" (67)	0.29 (0.042)	-	0.9 (14)	0.17 (710)
10	2 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Metal cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
13	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

6.0 Concrete Construction

Detail 6.1.1	A.6.1
Exterior Insulated Concrete Drained EIFS Wall Assembly – Clear Wall	
Detail 6.1.2	A.6.2
Exterior Insulated Concrete Block Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 6.1.3	A.6.3
Exterior Insulated Concrete Block Wall with Thermally Broken ISO Clip System with Horizontal Sub-Girt Supporting Cladding – Clear Wall	
Detail 6.1.4	A.6.4
Exterior Insulated Concrete Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 6.1.5	A.6.5
Exterior Insulated Concrete Block Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall	
Detail 6.1.6	A.6.6
Exterior Insulated Concrete Mass Wall Assembly with Hohmann & Barnard Masonry Zinc 2-Seal Anchor Supporting Brick Veneer – Clear Wall	
Detail 6.1.7	A.6.7
Exterior Insulated Concrete Mass Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Wing Nut Anchor Supporting Brick Veneer – Clear Wall	
Detail 6.1.8	A.6.8
Precast Sandwich Panel Wall Assembly with Concrete Panel Joints – Clear Wall	
Detail 6.1.9	A.6.9
Precast Sandwich Panel Wall Assembly with Tigerloc Thermally Broken Panel Joints – Clear Wall	
Detail 6.2.1	A.6.10
Exterior Insulated Concrete Drained EIFS Wall Assembly – Intermediate Floor Intersection	
Detail 6.2.2	A.6.11
Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16"o.c.) Supporting Interior Finish – Non-Insulated Interior Wall and Non-insulated Intermediate Floor Intersection	
Detail 6.2.3	A.6.12
Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16" o.c.) Supporting Interior Finish – Insulated Interior Wall and Non-insulated Intermediate Floor Intersection	
Detail 6.2.4	A.6.13

Interior Insulated Concrete Mass Wall with 3 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Interior Insulated Wall and Non-Insulated Partition Wall Intersection	
Detail 6.2.5	A.6.14
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Continuous Concrete Intermediate Floor Intersection	
Detail 6.2.6	A.6.15
Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Insulation in Stud Cavity – Intermediate Floor Intersection	
Detail 6.2.7	A.6.16
Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Intermediate Floor Intersection	
Detail 6.2.8	A.6.17
Precast Sandwich Panel Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection	
Detail 6.2.9	A.6.18
Precast Sandwich Panel Wall Assembly with Concrete at Panel Perimeter and Steel Connectors at 24" o.c. – Intermediate Floor Intersection	
Detail 6.2.10	A.6.19
Precast Sandwich Panel Wall Assembly with Steel Connectors at 16" o.c. – Intermediate Floor Intersection	
Detail 6.2.11	A.6.20
Precast Sandwich Panel Wall Assembly with Steel Connectors at 36" o.c. – Intermediate Floor Intersection	
Detail 6.2.12	A.6.21
Precast Sandwich Panel Wall Assembly with Steel Connectors at 48" o.c. – Intermediate Floor Intersection	
Detail 6.2.13	A.6.22
Precast Sandwich Panel Wall Assembly with Fiber-Reinforced Composite Connections at 16" o.c. – Intermediate Floor Intersection	
Detail 6.2.14	A.6.23
Exterior Insulated Concrete Block Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection	
Detail 6.2.15	A.6.24
Exterior Insulated Concrete Block Wall Assembly with Stand-Off Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection	
Detail 6.2.16	A.6.25
Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Intermediate Floor Intersection at Balcony	

Detail 6.2.17	A.6.26
Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Angle Supported Slab & Intermediate Floor Intersection	
Detail 6.2.18	A.6.27
Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Intermediate Floor Intersection at Balcony	
Detail 6.2.19	A.6.28
Exterior Insulated Concrete Block Wall Assembly with Thermally Broken Shelf Angle & Brick Ties Supporting Brick Veneer – Slab Intersection	
Detail 6.2.20	A.6.29
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Isokorb Rutherma DF Thermally Broken Concrete Intermediate Floor Intersection	
Detail 6.3.1	A.6.30
Exterior Insulated Concrete Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection	
Detail 6.3.2	A.6.31
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Intermediate Floor Intersection	
Detail 6.3.3	A.6.32
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Intermediate Floor Intersection with Project Slab	
Detail 6.3.4	A.6.33
Precast Sandwich Panel Wall Assembly with Concrete at Panel Perimeter and Steel Connectors at 24" (o.c.) – Window Intersection	
Detail 6.3.5	A.6.34
Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Window Intersection	
Detail 6.3.6	A.6.35
Exterior Insulated Concrete Drained EIFS Wall Assembly – Window with Aerogel and Intermediate Floor Intersection	
Detail 6.3.7	A.6.36
Interior Insulated Concrete Block or Concrete Wall Assembly with Brick Cladding – Window Intersection	
<i>Detail referenced from work done by Passive House Academy</i>	
Detail 6.3.8	A.6.37
Interior Insulated Concrete Block or Concrete Wall Assembly with Brick Cladding – Window Intersection Aligned with Insulation	

Detail referenced from work done by Passive House Academy

Detail 6.3.9	A.6.38
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection with Plywood and Insulation Liner	
Detail 6.3.10	A.6.39
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection with Wall Insulation Wrapped into Opening	
Detail 6.3.11	A.6.40
Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection – Plywood Liner and Glazing Aligned with Wall Insulation	
Detail 6.3.12	A.6.41
Exterior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Stud (16" o.c.) and Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Concrete Opening	
Detail 6.3.13	A.6.42
Exterior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Stud (16" o.c.) and Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation	
Detail 6.4.1	A.6.43
Exterior Insulated Concrete Drained EIFS Wall Assembly – Conventional Curtain Wall Transition	
Detail 6.4.2	A.6.44
Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Curtain Wall Transition	
Detail 6.4.3	A.6.45
Interior Insulated Concrete Mass Wall – Conventional Curtain Wall Transition	
Detail 6.4.4	A.6.46
Interior Insulated Concrete Mass Wall – Thermally Broken Curtain Wall Transition	
Detail 6.4.5	A.6.47
Precast Sandwich Panel Wall Assembly – Tigerloc Thermally Broken Curtain Wall Transition	
Detail 6.5.1	A.6.48
Exterior Insulated Concrete Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection	

Detail 6.5.2	A.6.49
Exterior Insulated Concrete Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection	
Detail 6.5.3	A.6.50
Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16" o.c.) Supporting Interior Finish – Concrete Parapet & Roof Intersection	
Detail 6.5.4	A.6.51
Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection	
Detail 6.5.5	A.6.52
Precast Sandwich Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection	
Detail 6.5.6	A.6.53
Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Parapet & Roof Intersection	
Detail 6.5.7	A.6.54
Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Parapet & Roof Intersection with Thermal Break under Parapet Stud Cavity and At Anchors	
Detail 6.5.8	A.6.55
Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Parapet & Roof Intersection	
Detail 6.5.9	A.6.56
Precast Sandwich Panel – Steel Roof Deck with Open Web Steel Joist & Paraloc Thermally Broken Parapet Intersection	
Detail 6.6.1	A.6.57
Exterior Insulated Concrete Drained EIFS Wall Assembly – Corner Intersection	
Detail 6.7.1	A.6.58
Interior Insulated Concrete Mass Wall with 3 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Intermediate Floor Intersection above Parking Garage	
Detail 6.7.2	A.6.59
Insulated Concrete Floor Slab – Concrete Column Intersection	
Detail 6.7.3	A.6.60
Precast Sandwich Wall Assembly Slab and Foundation Intersection	
Detail 6.7.4	A.6.61
Precast Sandwich Panel with 3 5/8" Steel Stud (16" o.c.) – Concrete Slab and Foundation Wall	
Detail 6.7.5	A.6.62

Precast Sandwich Panel with 3 5/8" Steel Stud (16" o.c.) – Thermally Broken
Concrete Slab and Foundation Intersection

Detail 6.7.6 **A.6.63**

Insulated Slab on Grade – Steel Column



Detail 6.7.7 **A.6.64**

Insulated Slab on Grade – Armatherm 500 Thermal Break under Column

Detail 6.8.1 **A.6.65**

Precast Sandwich Panel Wall Assembly – Emloc Thermally Broken Embedment
Detail

Detail 6.1.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Clear Wall

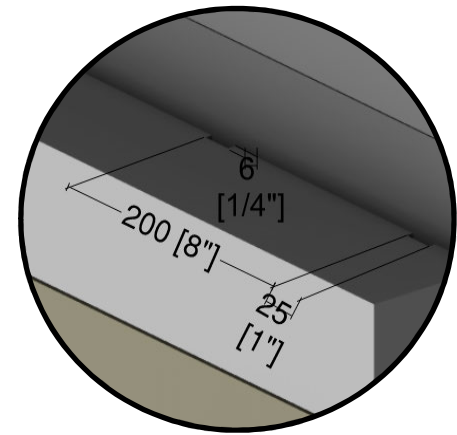
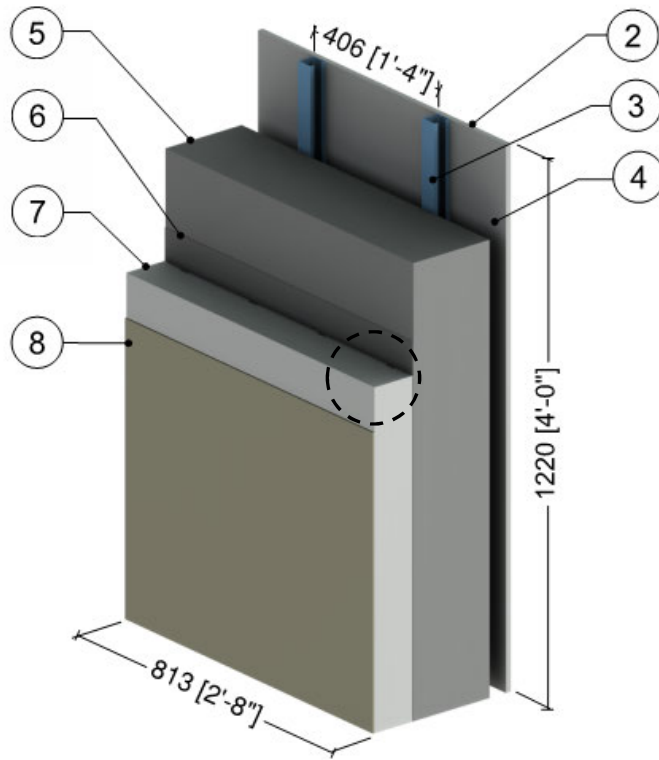


1" (25 mm)
Drained EIFS
Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.2 Exterior Insulated Concrete Block Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall

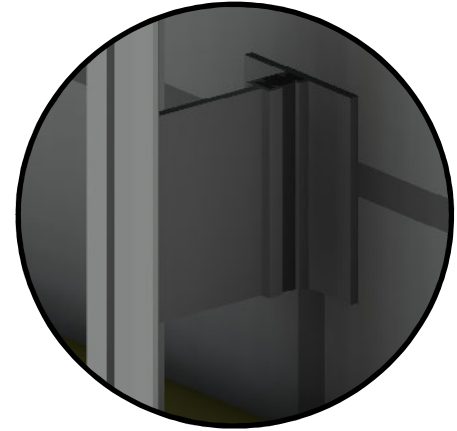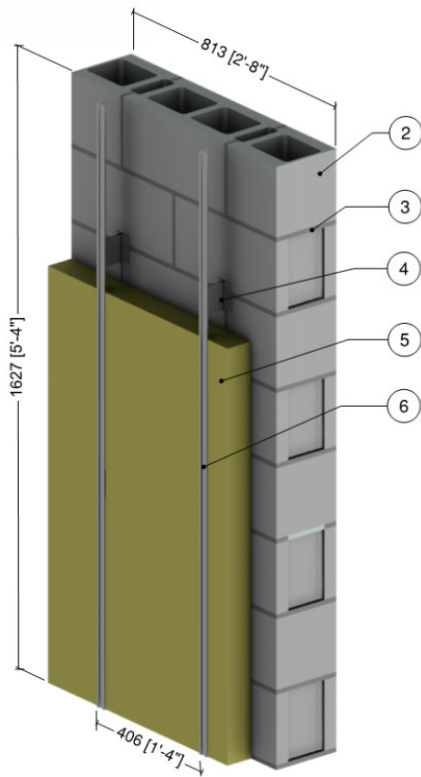


Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
3	Cement Mortar	-	3.5 (0.5)	-	119 (1900)	0.19 (800)
4	Longboard Aluminum Panel Clip	1/5" to 3/8" (5 to 10)	1109 (160)	-	-	-
5	Exterior Insulation	3" (76)	-	R-12.6 (2.22 RSI)	1.8 (28)	0.29 (1220)
6	Vertical Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
8	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.3

Exterior Insulated Concrete Block Wall with Thermally Broken ISO Clip System with Horizontal Sub-Girt Supporting Cladding – Clear Wall

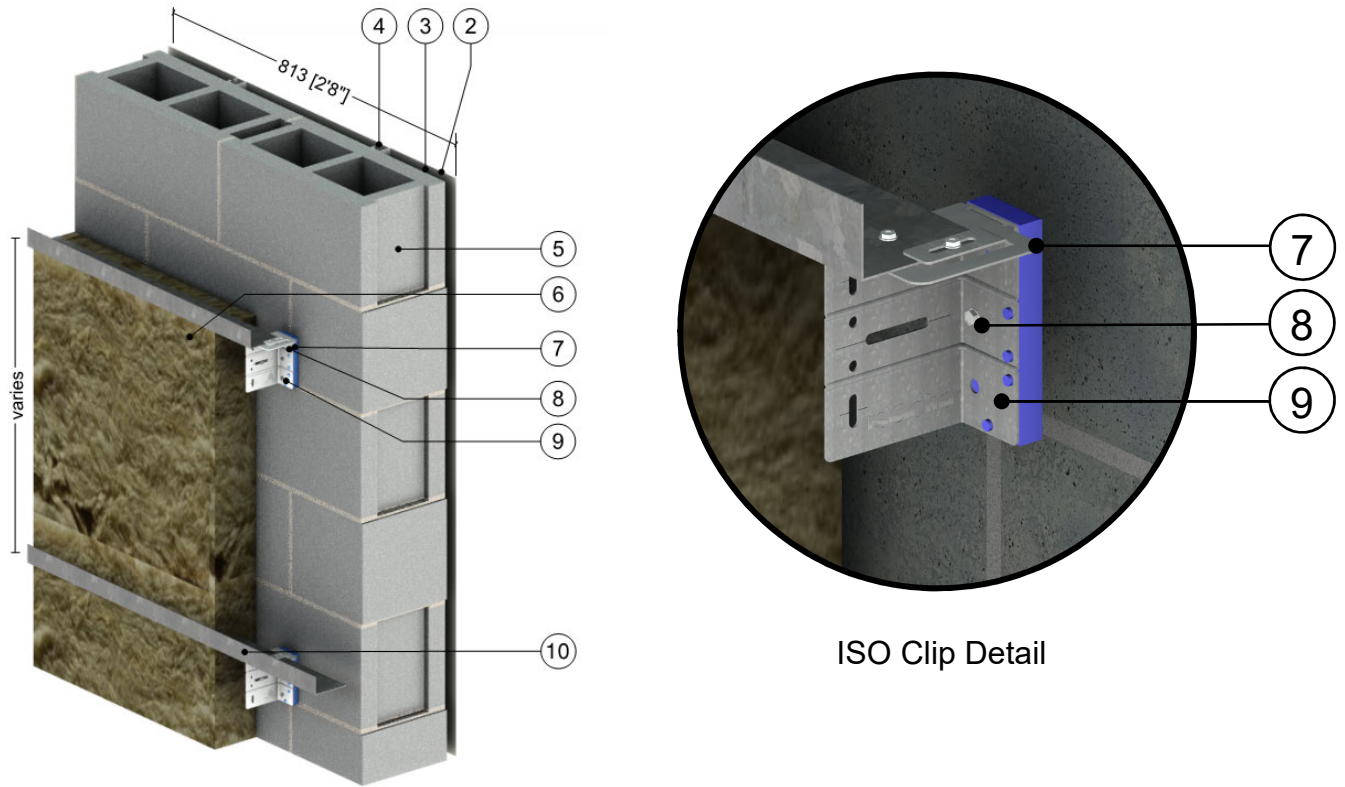


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Blocks	8" (203)	10.3 (1.5)	-	119 (1900)	0.19 (800)
6	Exterior Mineral Wool Insulation	4" to 6" (102 to 152)	0.24 (0.034)	R-16.8 to R-25.2 (2.96 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	ISO Clip - HDPE Isolator	1/2" (12.7)	3.1 (0.45)	-	-	-
8	#14 Steel Fasteners	1/4" (6) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	ISO Clip - Galvanized Metal	14 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Horizontal Sub-girt	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.4

Exterior Insulated Concrete Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall


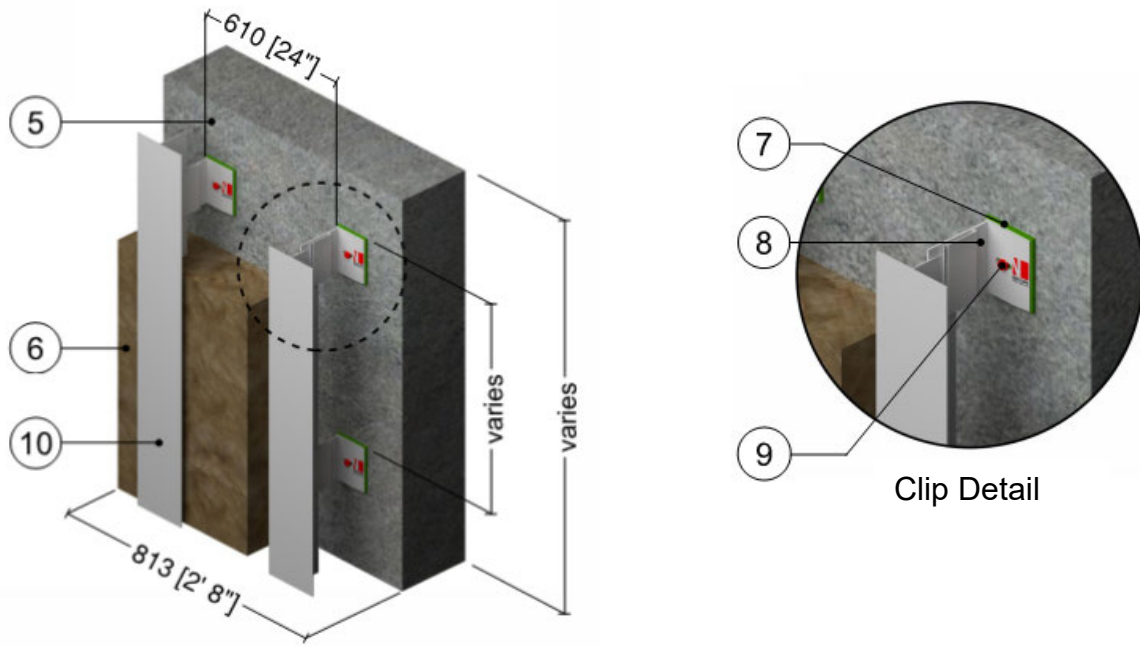


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Exterior Mineral Wool Insulation	2" to 6" (50 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	NV1 Clip Isolator	0.2" (5)	0.82 (0.117)	-	87 (1400)	0.20 (840)
8	NV1 Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	171 (2739)	0.21 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) ∅	118 (17)	-	500 (8000)	0.12 (500)
10	Vertical Sub-girt	0.09" (2.2)	1340 (193)	-	171 (2739)	0.21 (900)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.5

Exterior Insulated Concrete Block Wall Assembly with Nvelope – NV1 Clip System Supporting Cladding – Clear Wall

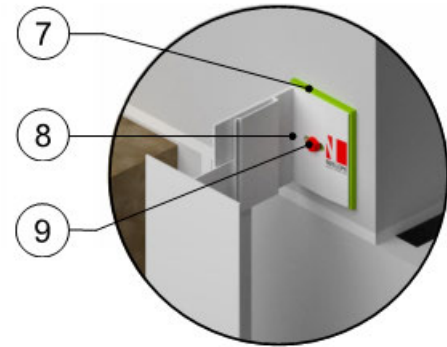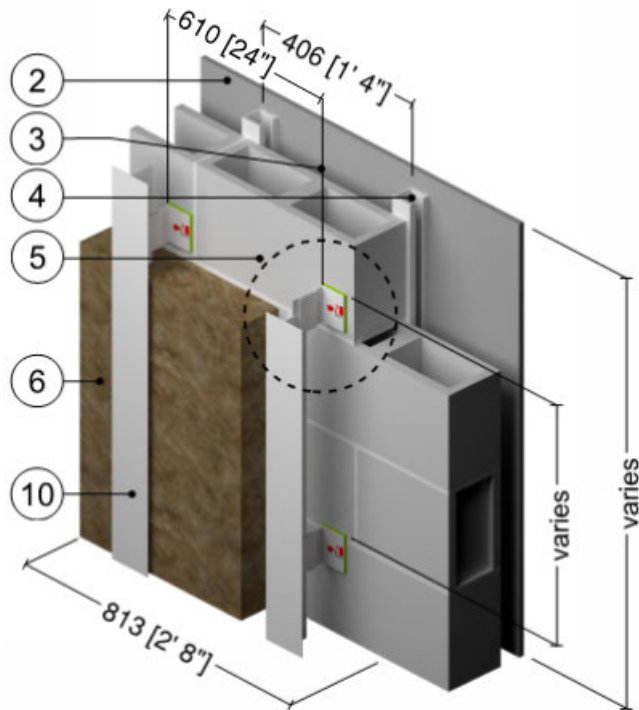


Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Block	7-5/8" (190)	-	R-1.2 (0.22 RSI)	119 (1900)	0.19 (800)
6	Exterior Mineral Wool Insulation	2" to 6" (50 to 152)	0.24 (0.034)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	4 (64)	0.20 (850)
7	NV1 Clip Isolator	0.2" (5)	0.82 (0.117)	-	87 (1400)	0.20 (840)
8	NV1 Clip Extrusion – Aluminum 6005A alloy	Varies	1340 (193)	-	171 (2739)	0.21 (900)
9	#14 Stainless Steel Fasteners	1/4" (6) Ø	118 (17)	-	500 (8000)	0.12 (500)
10	Vertical Sub-girt	0.09" (2.2)	1340 (193)	-	171 (2739)	0.21 (900)
11	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
12	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.6

Exterior Insulated Concrete Mass Wall Assembly with Hohmann & Barnard Masonry Zinc 2-Seal Anchor Supporting Brick Veneer – Clear Wall

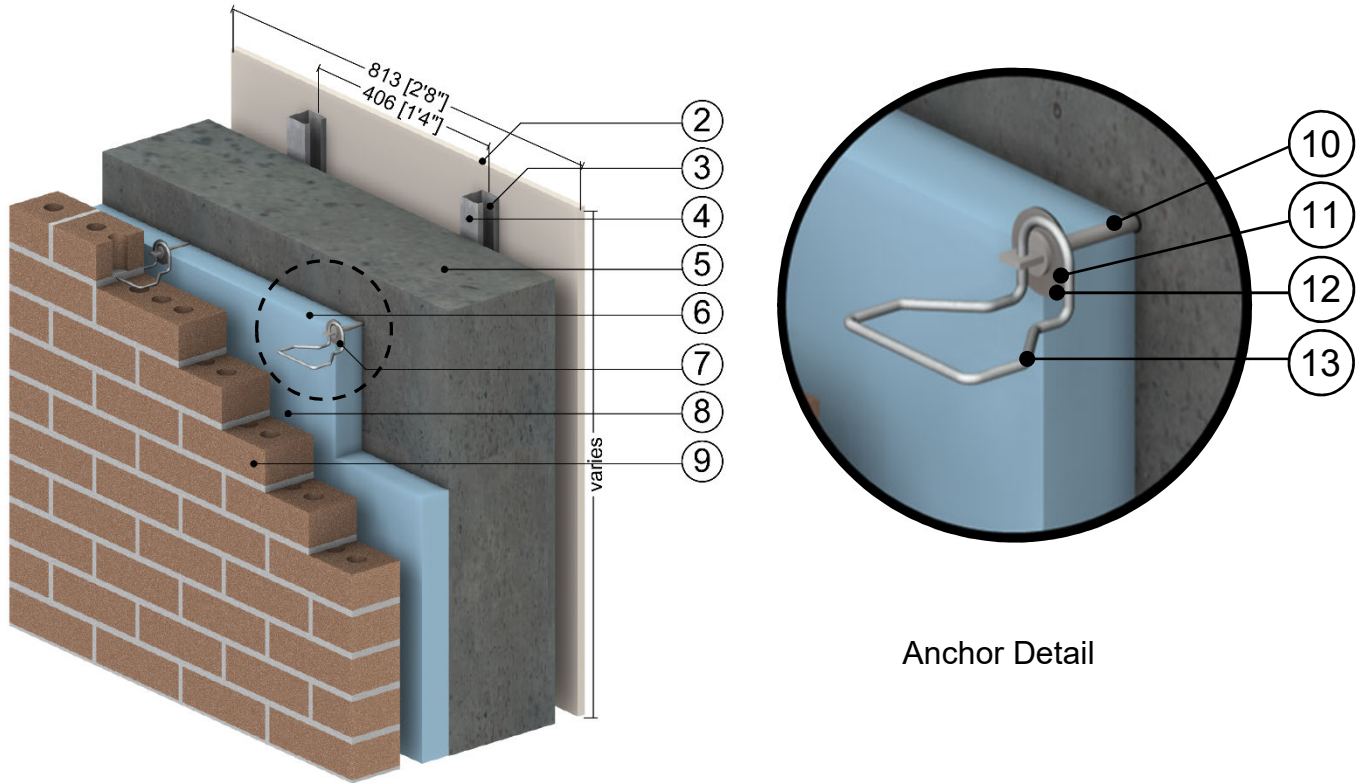


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Mass Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Zinc Barrel	-	784 (113)	-	-	-
11	Steel Washer	1.5" (38) ∅	347 (50)	-	489 (7830)	0.12 (500)
12	Rubber Washer (EPDM)	-	1.7 (0.25)	-	-	-
13	Galvanized Steel Wire Pintle	3/16" (5) ∅	430 (62)	-	489 (7830)	0.12 (500)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.7

Exterior Insulated Concrete Mass Wall Assembly with Hohmann & Barnard Masonry Stainless Steel 2-Seal Thermal Wing Nut Anchor Supporting Brick Veneer – Clear Wall

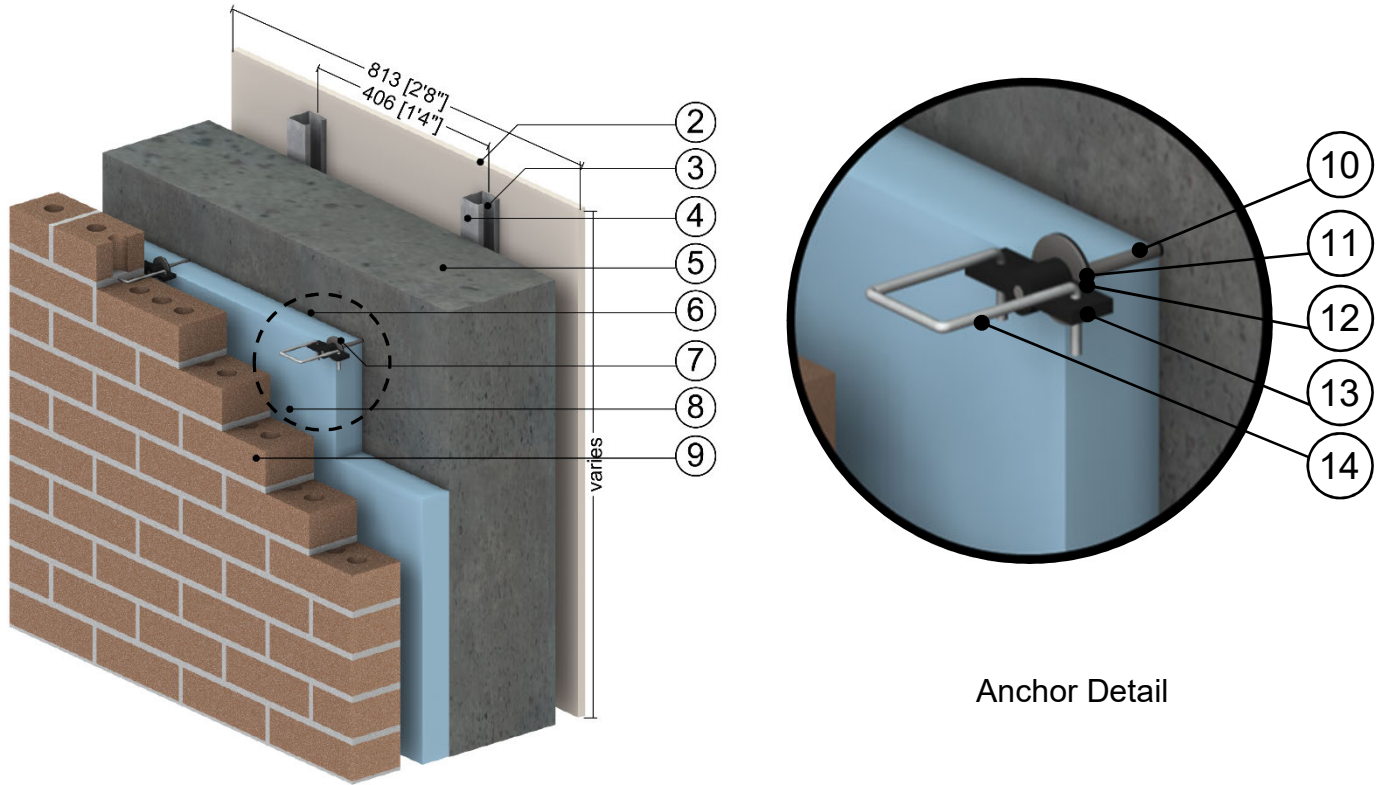


Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Mass Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Exterior Mineral Wool Insulation	1" to 4" (25 to 102)	0.24 (0.034)	R-4.2 to R-16.8 (0.74 RSI to 2.96 RSI)	4 (64)	0.20 (850)
7	Brick Tie	1" to 4" (25 to 102)	784 (113)	-	445 (7130)	0.09 (390)
8	Vented Air Cavity	1.5" (38)	-	R-0.4 (0.70 RSI)	0.075 (1.2)	0.24 (1000)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Stainless Steel Barrel	-	118 (17)	-	489 (7830)	0.12 (500)
11	Steel Washer	1.5" (38) ∅	347 (50)	-	489 (7830)	0.12 (500)
12	Rubber Washer (EPDM)	-	1.7 (0.25)	-	-	-
13	Steel Wing Nut with Plastic Coating	Varies	347 (50)	-	489 (7830)	0.12 (500)
14	Galvanized Steel Wire Pintle	3/16" (5) ∅	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.8

Precast Sandwich Panel Wall Assembly with Concrete Panel Joints – Clear Wall

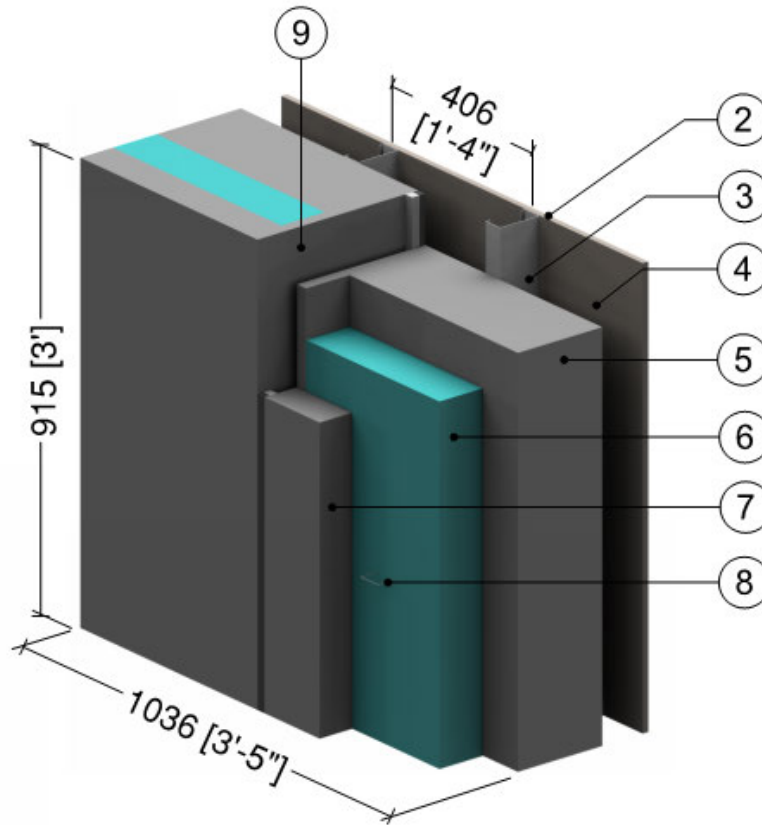


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (130)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Precast Sandwich Panel, Interior Concrete Panel	7 3/4" (197)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 to 3.5 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete Panel	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Panel Joint	1" (25)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.1.9



Precast Sandwich Panel Wall Assembly with Tigerloc Thermally Broken Panel Joints – Clear Wall

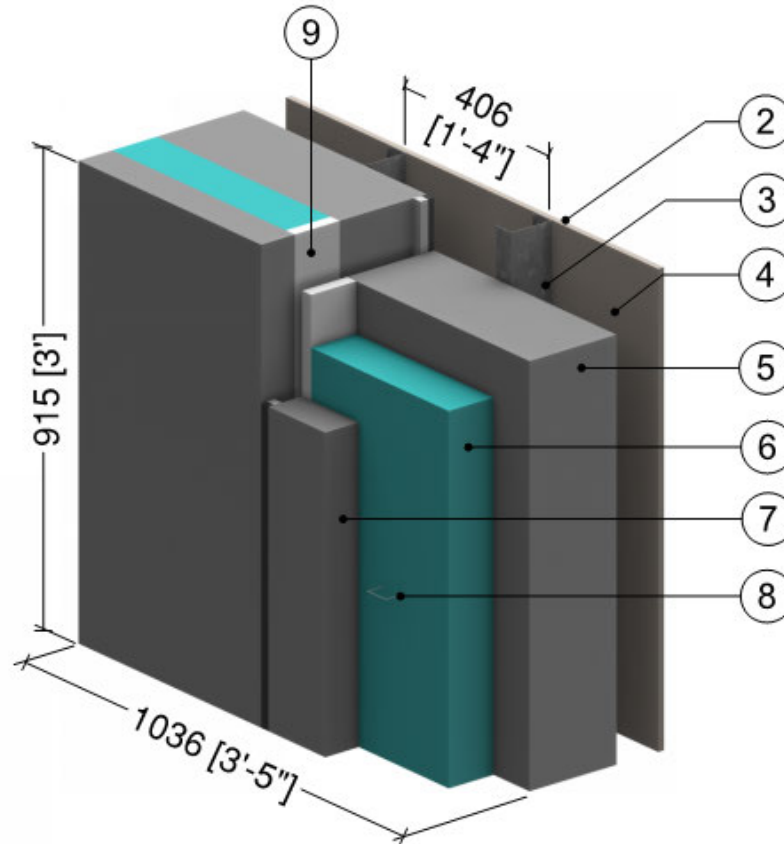

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (130)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Precast Sandwich Panel, Interior Concrete Panel	7 3/4" (197)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 to 3.5 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete Panel	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Tigerloc, PVC Foam	1" (25)	0.42 (0.06)	-	-	-
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Intermediate Floor Intersection

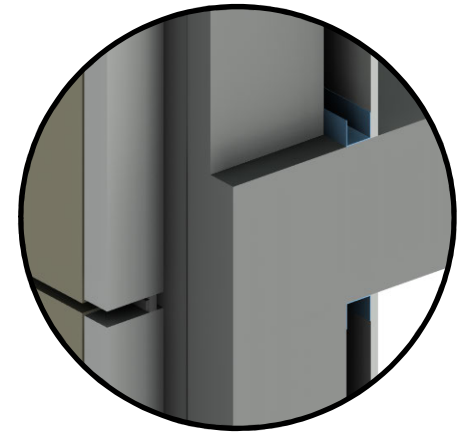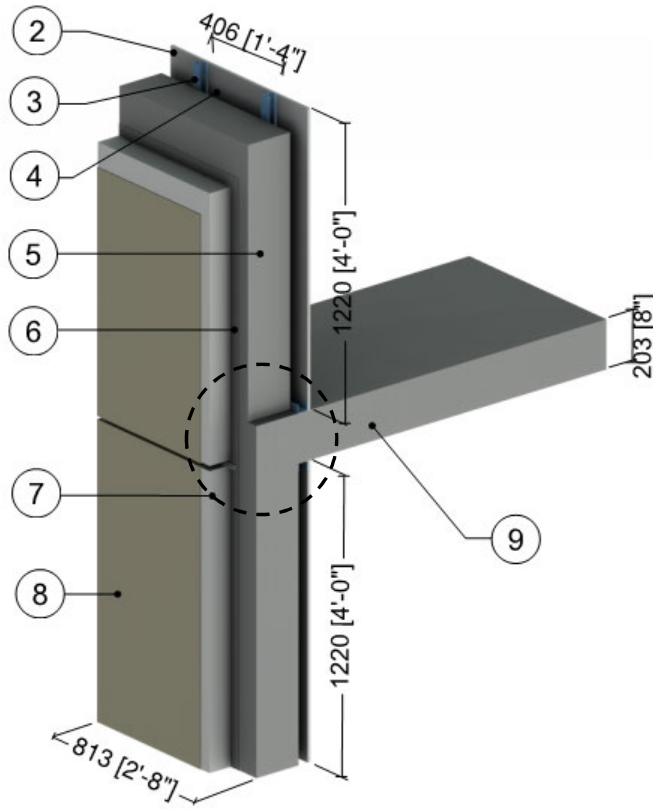


1" (25 mm)
Drained EIFS
at Slab Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.2

Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16"o.c.) Supporting Interior Finish – Non-Insulated Interior Wall and Non-insulated Intermediate Floor Intersection

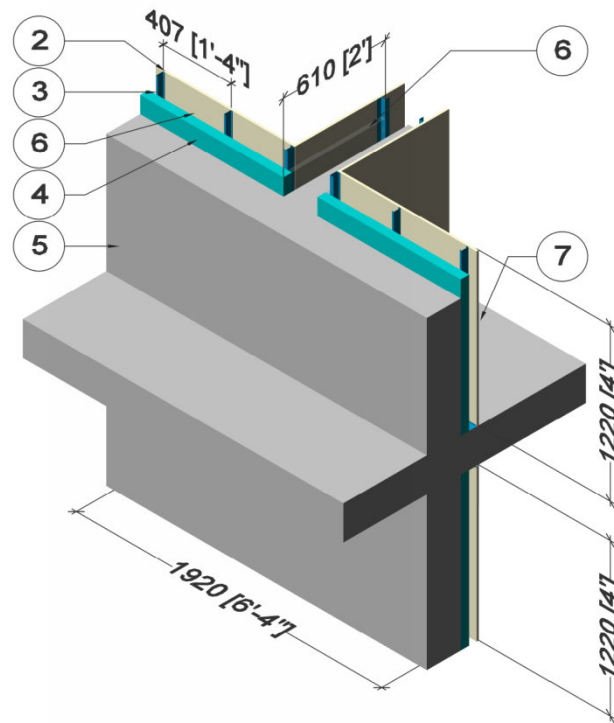


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Interior Insulation	2" (51)	0.2 (0.03)	R-11 (1.9 RSI)	1.8 (28)	0.29 (1220)
5	Exterior Concrete Mass Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Air in Stud Cavity and Interior Partition	Varies	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
7	Concrete Slab, Floor & Balcony	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.3

Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16" o.c.) Supporting Interior Finish – Insulated Interior Wall and Non-insulated Intermediate Floor Intersection


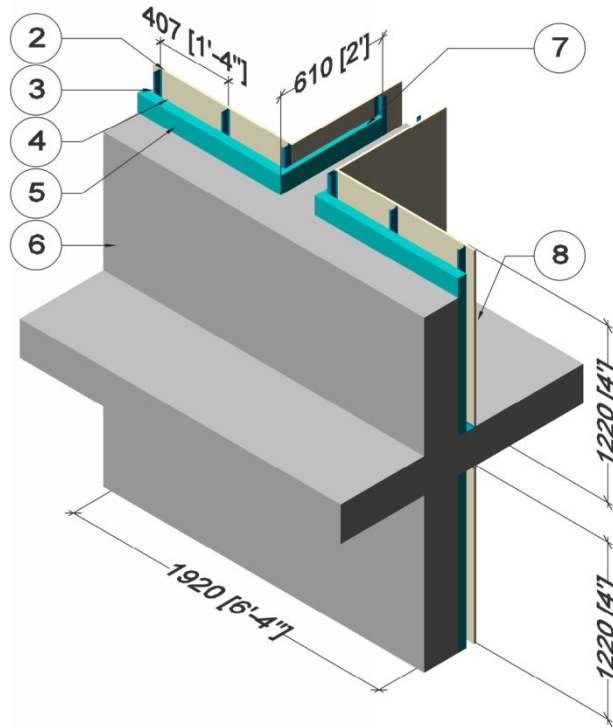


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Top and Bottom Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Interior Insulation	2" (51)	0.2 (0.03)	R-11 (1.9 RSI)	1.8 (28)	0.29 (1220)
6	Exterior Concrete Mass Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Interior Partition Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
8	Concrete Slab, Floor & Balcony	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.4

Interior Insulated Concrete Mass Wall with 3 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Interior Insulated Wall and Non-Insulated Partition Wall Intersection

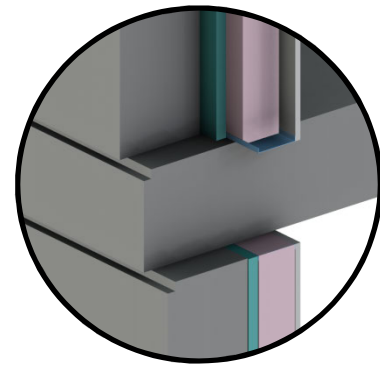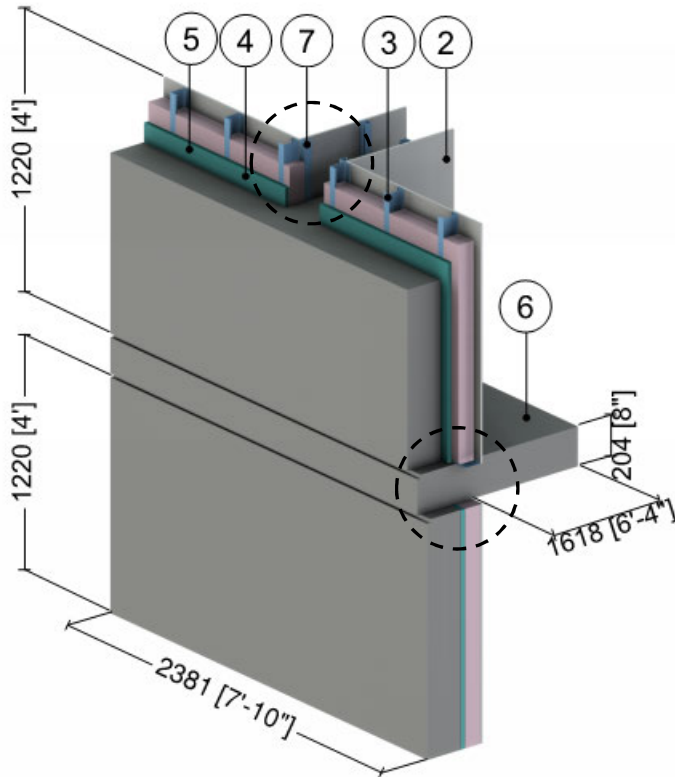

Slab Edge Detail

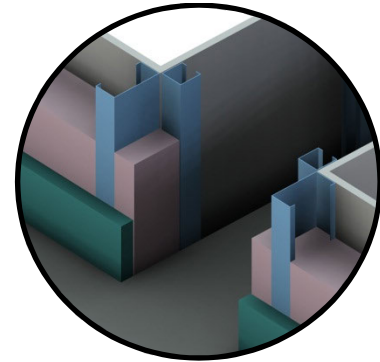



Partition Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Continuous Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.5

Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Continuous Concrete Intermediate Floor Intersection

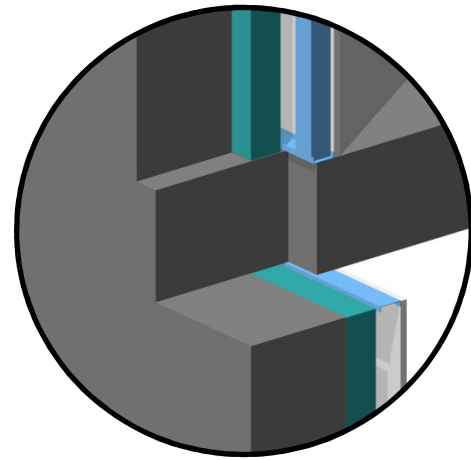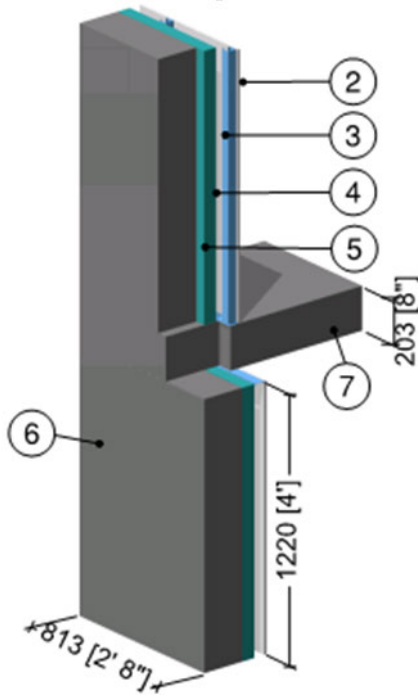


Continuous Concrete Slab Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Continuous Insulation	2 1/2" (64)	0.25 (0.04)	R-10.0 (1.76 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.6 | Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Insulation in Stud Cavity – Intermediate Floor Intersection

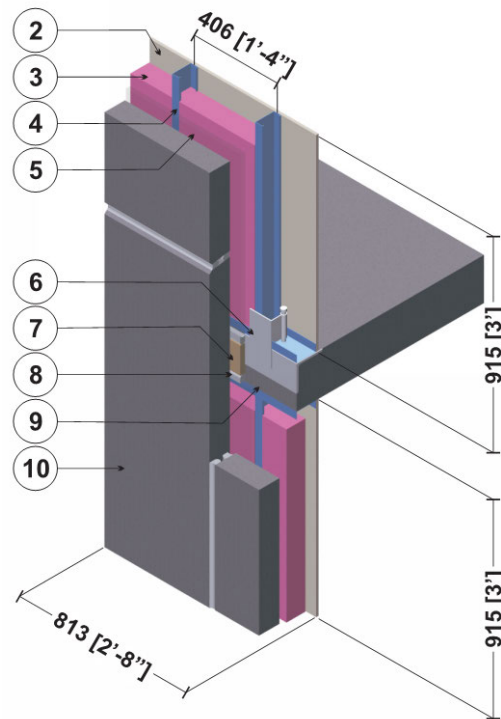


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Air in Stud Cavity	2" (51)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
7	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
8	Silicone Sealant	-	2.4 (0.35)	-	-	-
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Precast Wall Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.7


Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Intermediate Floor Intersection

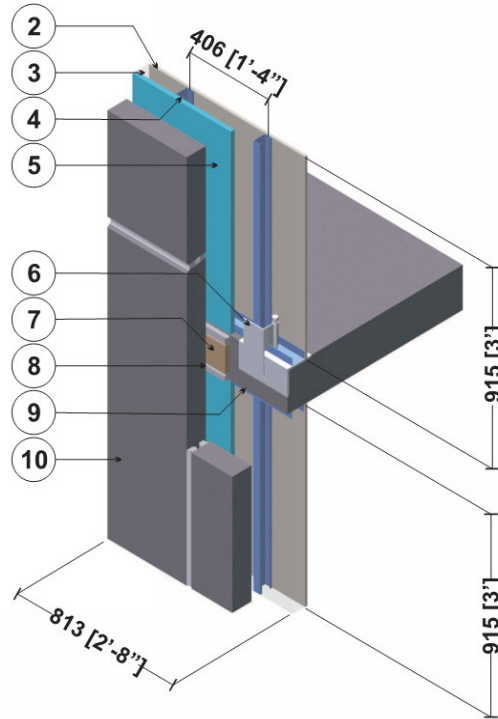

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Rigid Insulation	2" (51)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
6	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
7	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
8	Silicone Sealant	-	2.4 (0.35)	-	-	-
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Precast Wall Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.8 | Precast Sandwich Panel Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) – Intermediate Floor Intersection


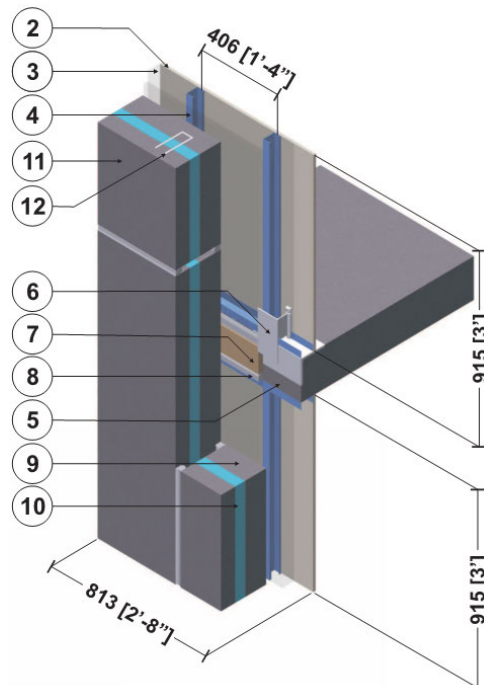


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
7	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
8	Silicone Sealant	-	2.4 (0.35)	-	-	-
9	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
11	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.9


Precast Sandwich Panel Wall Assembly with Concrete at Panel Perimeter and Steel Connectors at 24" o.c. – Intermediate Floor Intersection

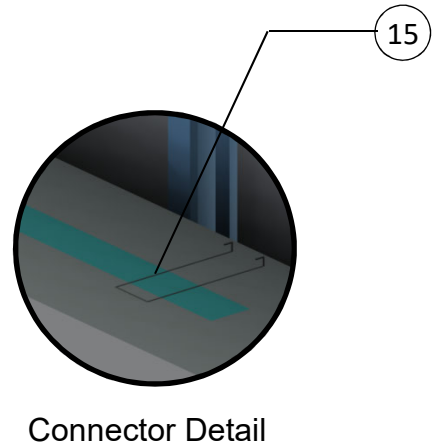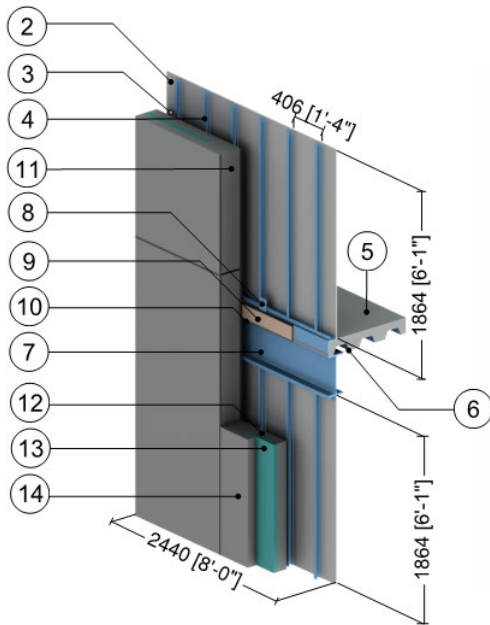

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film (bottom) ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
6	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
9	Semi Rigid Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.75 RSI)	4 (64)	0.20 (850)
10	Silicone Sealant	-	2.4 (0.35)	-	174 (2800)	0.17 (700)
11	Concrete at Panel Edges	12" (305)	12.5 (1.8)	-	140 (2250)	.20 (850)
12	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
14	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
15	Precast Sandwich Panel, Steel Connectors @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.10 Precast Sandwich Panel Wall Assembly with Steel Connectors at 16" o.c. – Intermediate Floor Intersection

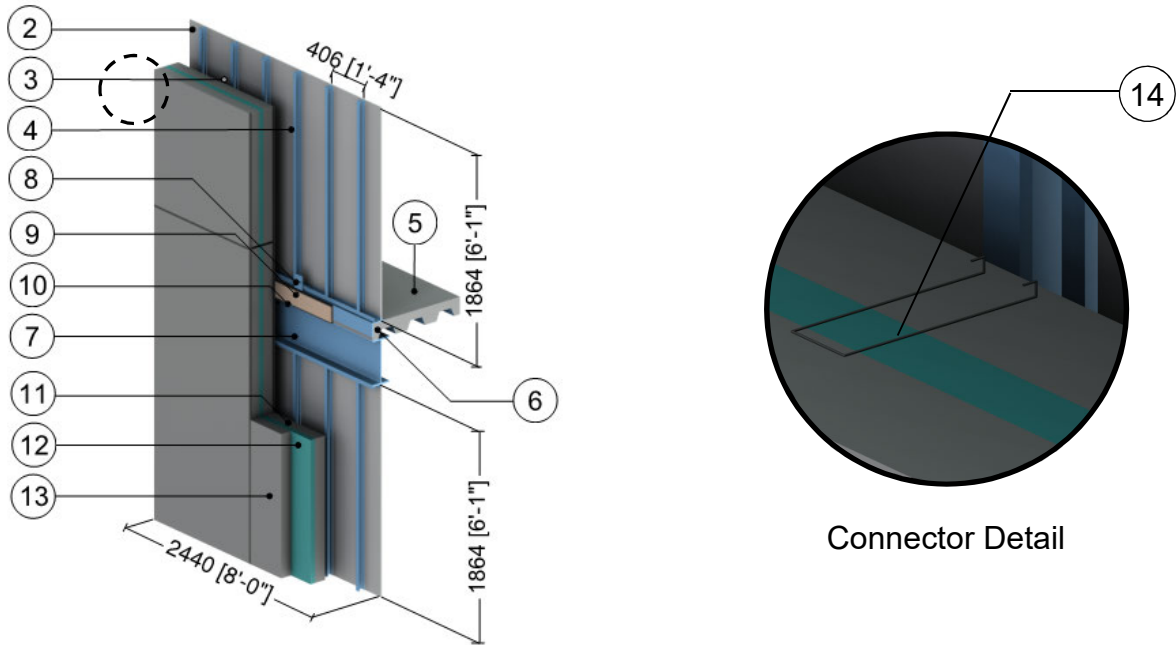


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film (bottom) ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
6	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
9	Semi Rigid Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.75 RSI)	4 (64)	0.20 (850)
10	Silicone Sealant	-	2.4 (0.35)	-	174 (2800)	0.17 (700)
11	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Steel Connectors @ 16" (406) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation





Detail 6.2.11 Precast Sandwich Panel Wall Assembly with Steel Connectors at 36" o.c. – Intermediate Floor Intersection

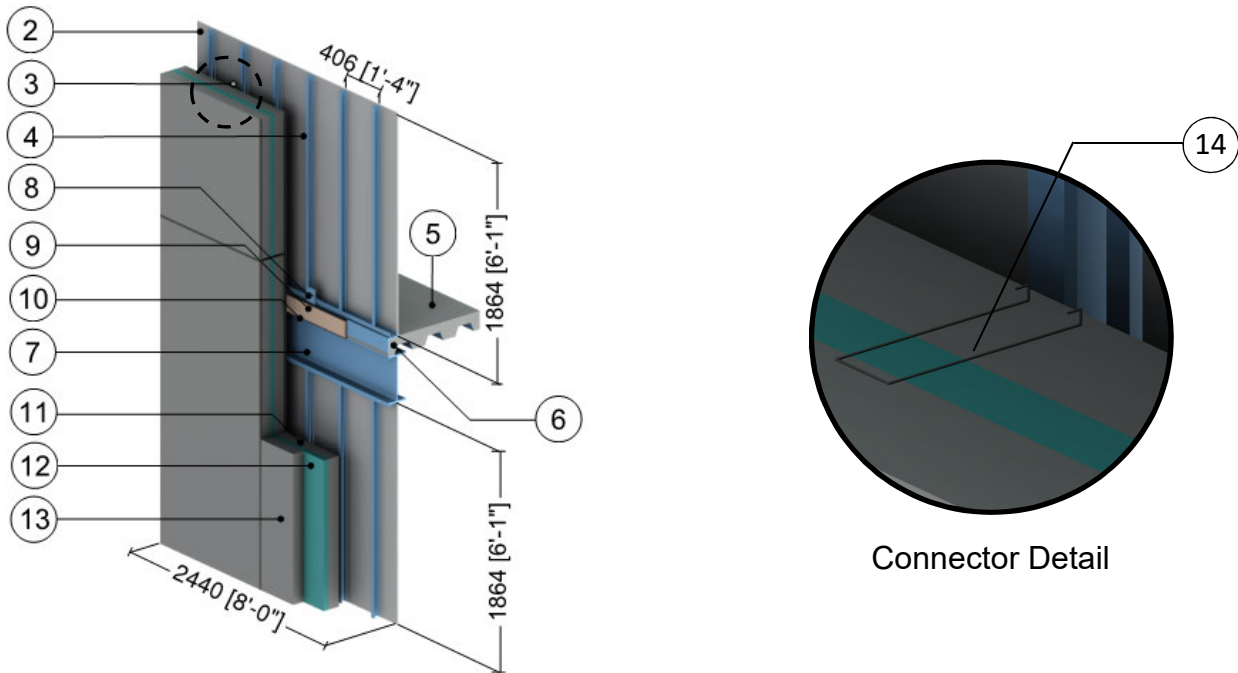

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film (bottom) ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
6	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
9	Semi Rigid Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.75 RSI)	4 (64)	0.20 (850)
10	Silicone Sealant	-	2.4 (0.35)	-	-	-
11	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Steel Connectors @ 36" (914) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.12 Precast Sandwich Panel Wall Assembly with Steel Connectors at 48" o.c. – Intermediate Floor Intersection

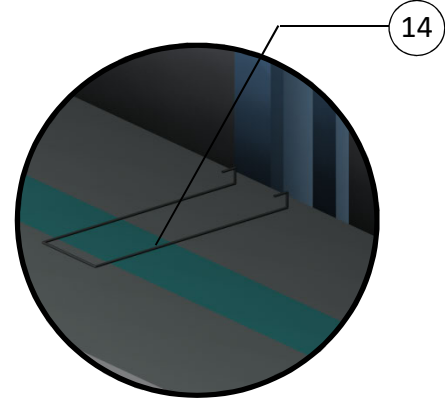
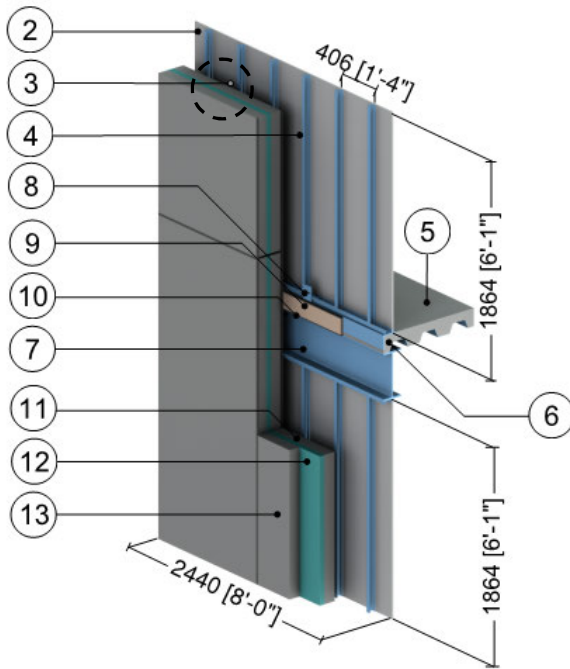


Connector Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film (bottom) ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
6	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
9	Semi Rigid Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.75 RSI)	4 (64)	0.20 (850)
10	Silicone Sealant	-	2.4 (0.35)	-	-	-
11	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Steel Connectors @ 48" (1220) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 6.2.13 Precast Sandwich Panel Wall Assembly with Fiber-Reinforced Composite Connections at 16" o.c. – Intermediate Floor Intersection

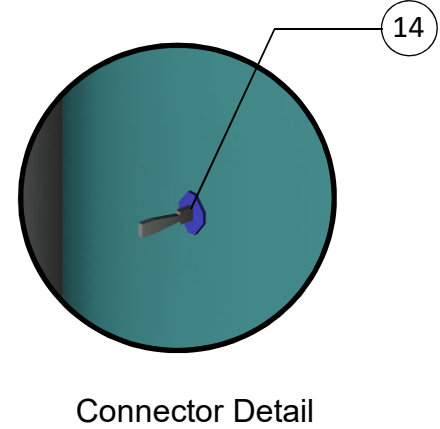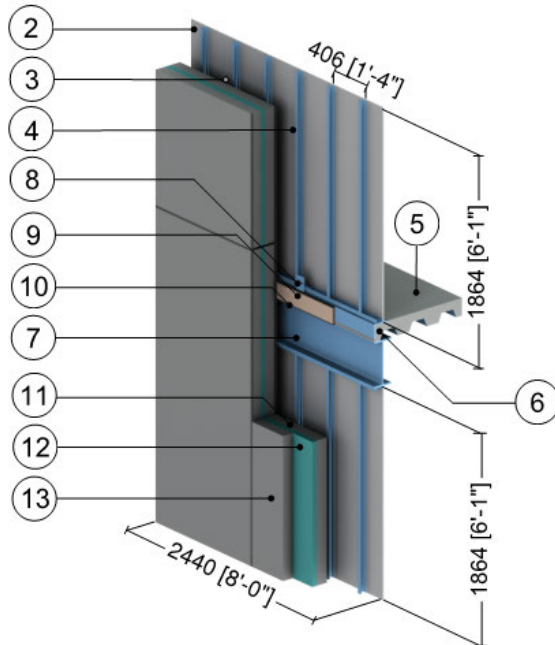

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film (bottom) ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
6	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
8	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
9	Semi Rigid Insulation	1" (25)	0.24 (0.034)	R-4.2 (0.75 RSI)	4 (64)	0.20 (850)
10	Silicone Sealant	-	2.4 (0.35)	-	-	-
11	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Fiber-Reinforced Composite Connectors @ 16" (406) o.c.	-	6.9 (1.0)	-	-	-
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 6.2.14 Exterior Insulated Concrete Block Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection

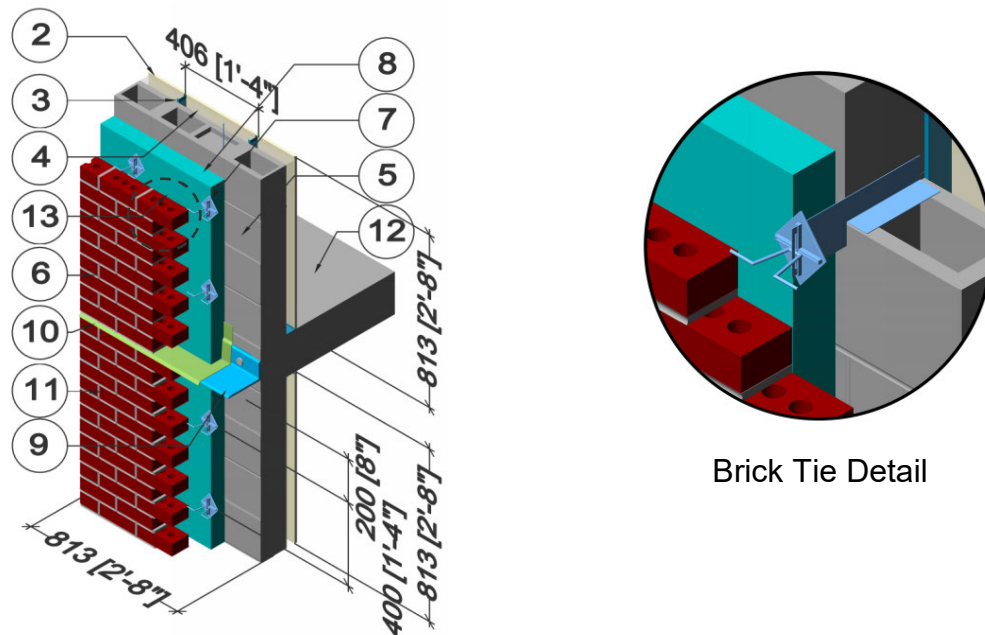

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
9	Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Flashing	20 Gauge	347 (50)	-	489 (7830)	0.12 (500)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
12	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.15 Exterior Insulated Concrete Block Wall Assembly with Stand-Off Shelf Angle & Brick Ties Supporting Brick Veneer – Intermediate Floor Intersection

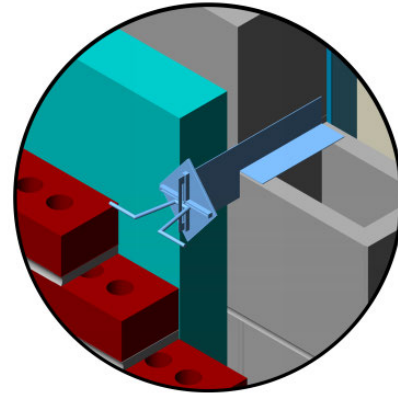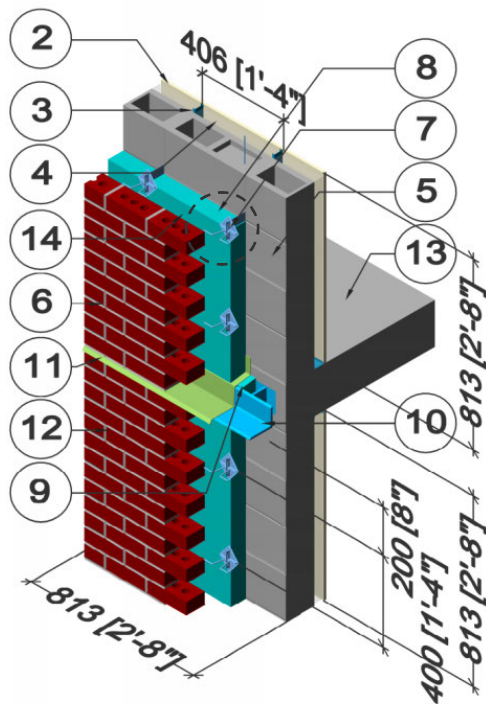



Brick Tie Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RS) to 4.4 RSI)	1.8 (28)	0.29 (1220)
9	Insulation Behind Shelf Angle	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
10	Stand-Off Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
11	Flashing	20 Gauge	347 (50)	-	489 (7830)	0.12 (500)
12	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
13	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.16

Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Intermediate Floor Intersection at Balcony

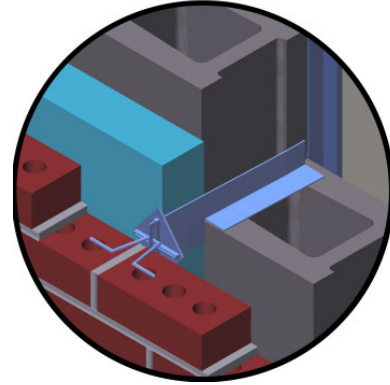
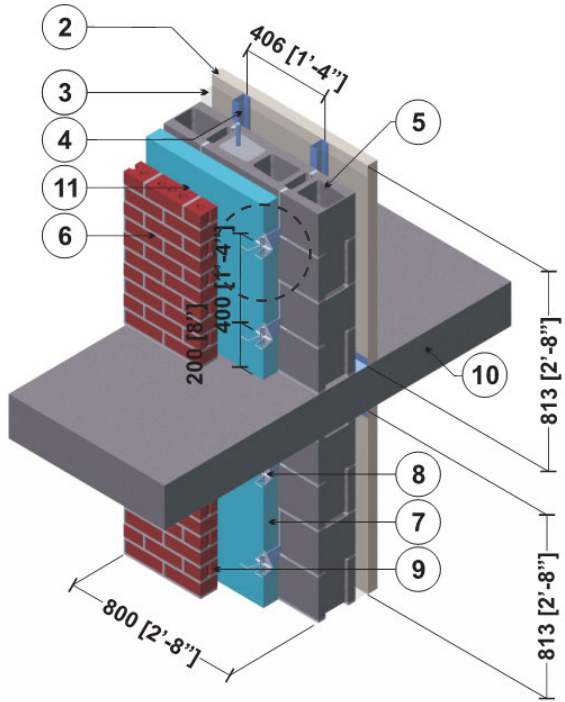


Brick Tie Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
9	Brick Veneer	3 5/8" (90)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.17 Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Angle Supported Slab & Intermediate Floor Intersection

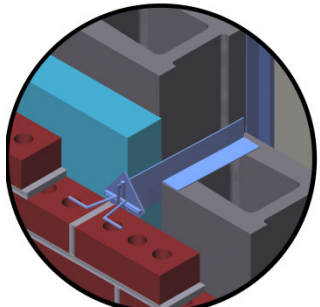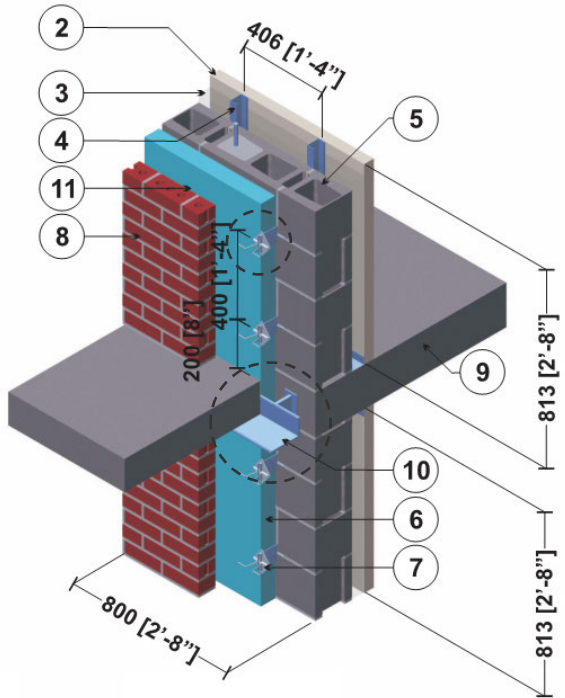

Brick Tie Detail

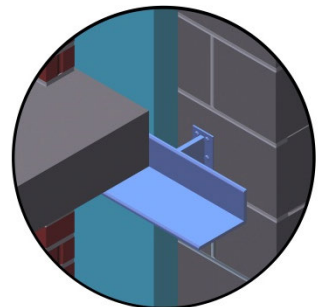



Shelf Angle Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
7	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
9	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Slab & Brick (Anchored to Slab at 16" o.c.) Support Angle	-	347 (50)	-	489 (7830)	0.12 (500)
11	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 6.2.18 Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Intermediate Floor Intersection at Balcony

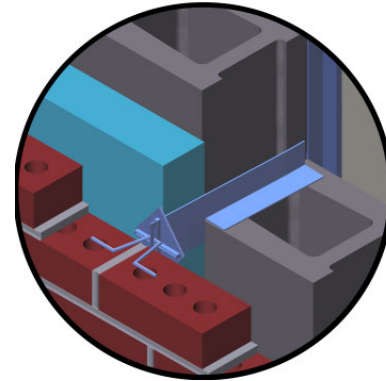
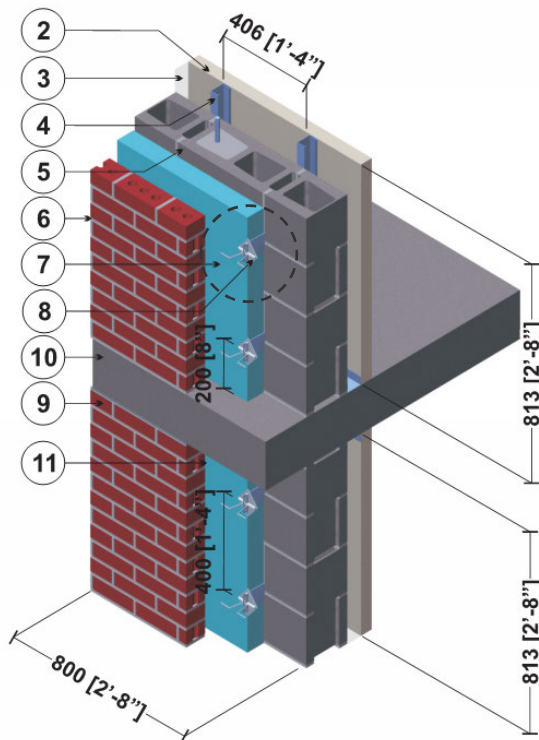


Brick Tie Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Exterior Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
9	Brick Veneer	3 5/8" (90)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.2.19 Exterior Insulated Concrete Block Wall Assembly with Thermally Broken Shelf Angle & Brick Ties Supporting Brick Veneer – Slab Intersection

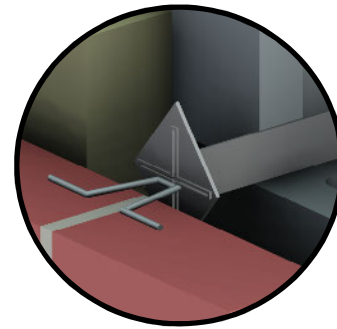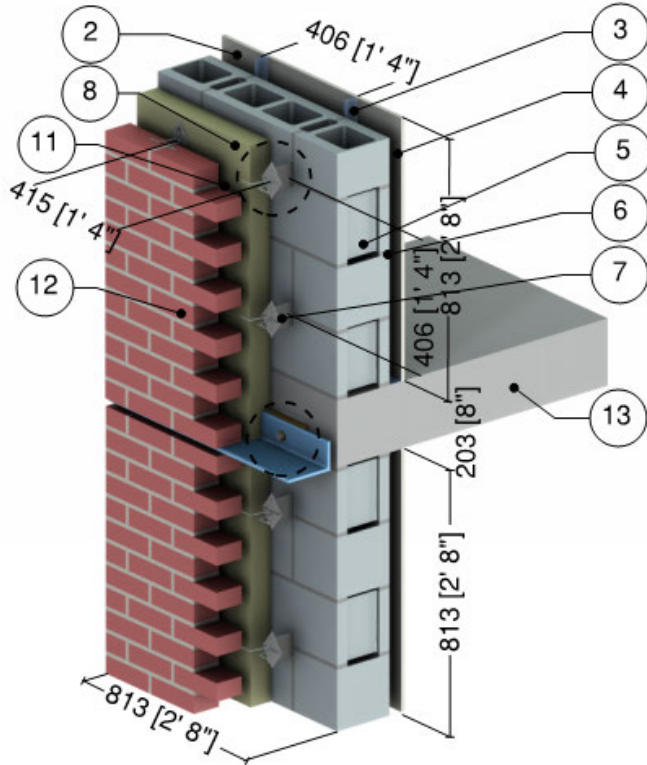

Brick Tie Detail

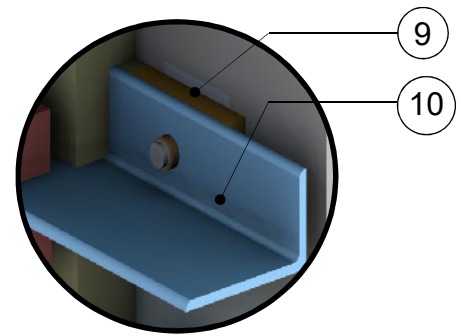

Shelf Angle Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Insulation	-	-	R-15 (2.64 RSI)	1.8 (28)	0.29 (1220)
9	Armatherm FRR Thermal Break	1" (25)	1.4 (0.20)	-	85 (5.3)	-
10	Steel Shelf Angle and Bolts	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Stainless Steel Shelf Angle and Bolts	3/8" (10)	118 (17)	-	500 (8000)	0.12 (500)
11	Air Gap ²	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
13	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 6.2.20

Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Isokorb Rutherma DF Thermally Broken Concrete Intermediate Floor Intersection

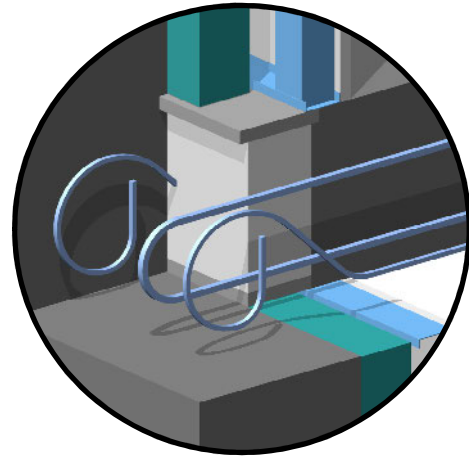
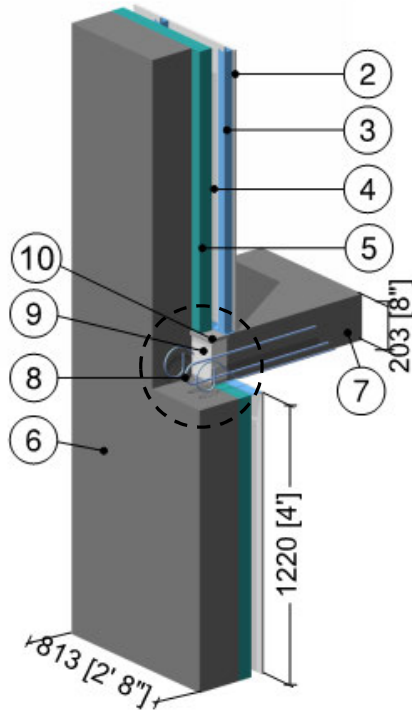


Thermally Broken Slab Detail (Rutherma Type DF)


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Continuous Insulation	2 1/2" (64)	0.03 (0.2)	R-12.5 (2.20 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall	8" (203)	12.5 (1.8)	R-0.64 (0.11 RSI)	140 (2250)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Stainless Steel Reinforcement	-	118 (17)	-	500 (8000)	0.12 (500)
9	Polystyrene Hard Foam Insulation	2 3/8" (60)	0.217 (0.031)	R-10.9 (1.93 RSI)	66 (1060)	0.35 (1500)
10	Cement Board	1/2" (13)	1.7 (0.25)	-	72 (1150)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.3.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Window and Intermediate Floor Intersection

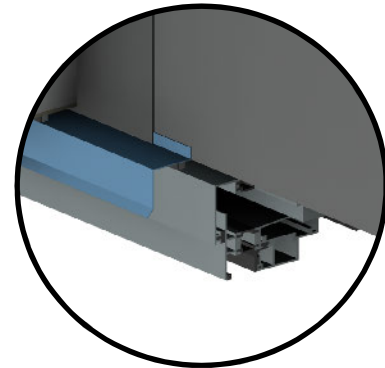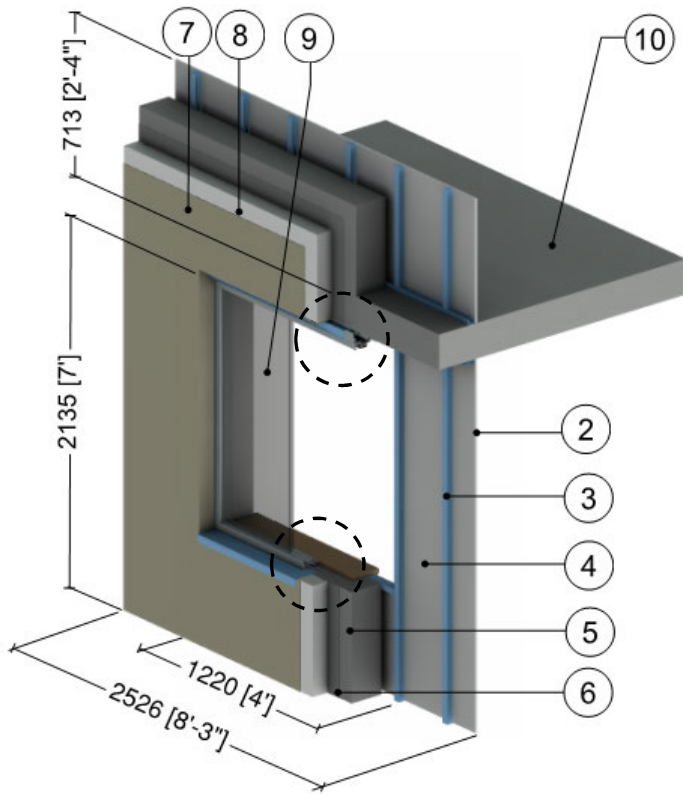

Window Head Detail

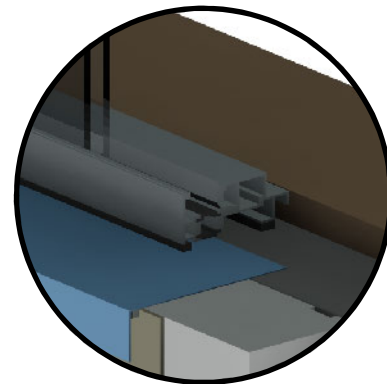



Window Sill Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1.2 (20)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.3.2 Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Intermediate Floor Intersection

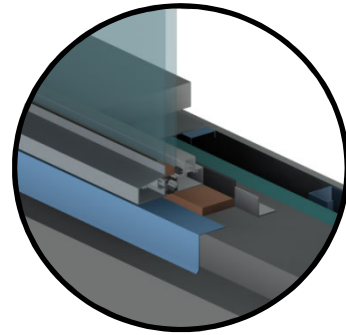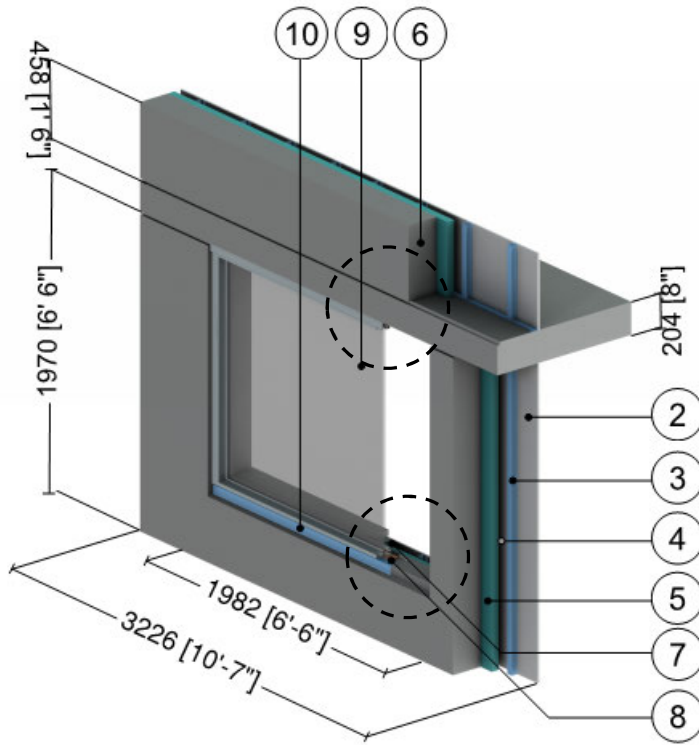

Window Sill Detail

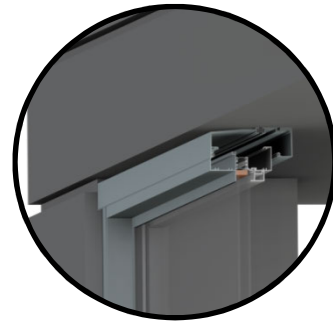



Window Head Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Continuous Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Wood Sill	1 1/4" (30)	0.69 (0.10)	-	27.8 (445)	0.45 (1880)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Aluminum Flashing	16 Gauge	1109 (160)	-	171(2739)	0.21 (900)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2.

Detail 6.3.3 Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Intermediate Floor Intersection with Project Slab

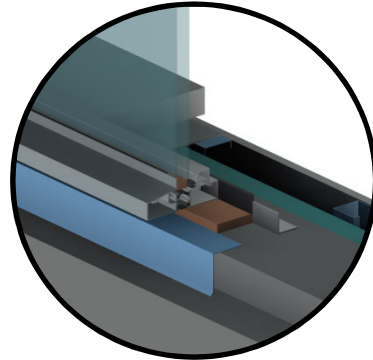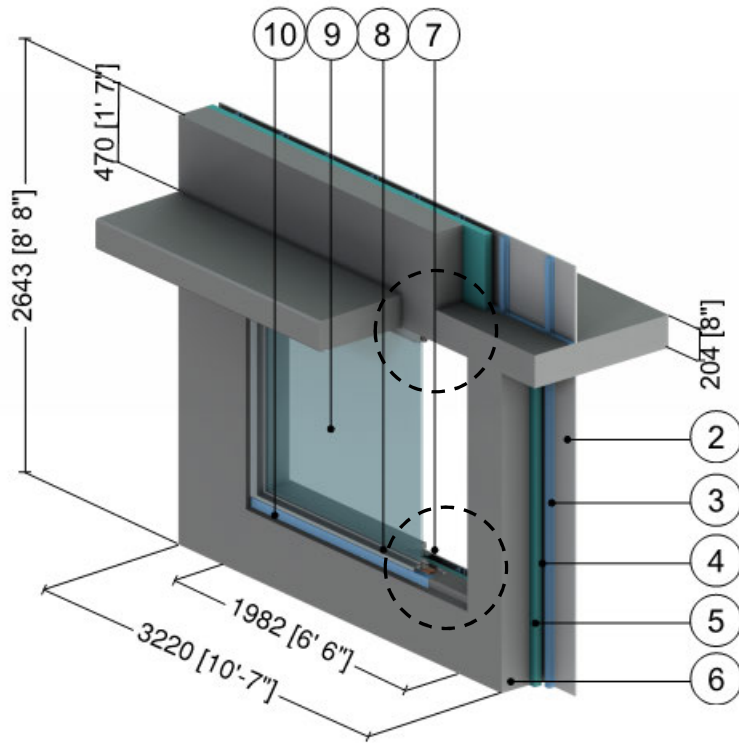

Window Sill Detail

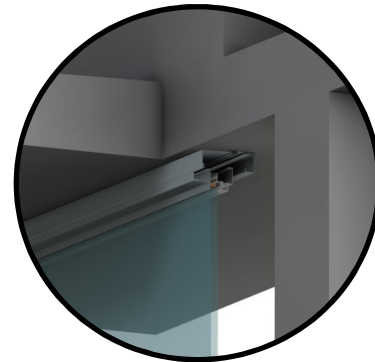

Window Head Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Continuous Rigid Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/ Projected Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Steel Sheet Connected to Studs ³	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Wood Sill	1 1/4" (30)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

³ Scenarios C and D include sheet steel, Scenarios A and B do not.

Detail 6.3.4 | Precast Sandwich Panel Wall Assembly with Concrete at Panel Perimeter and Steel Connectors at 24" (o.c.) – Window Intersection

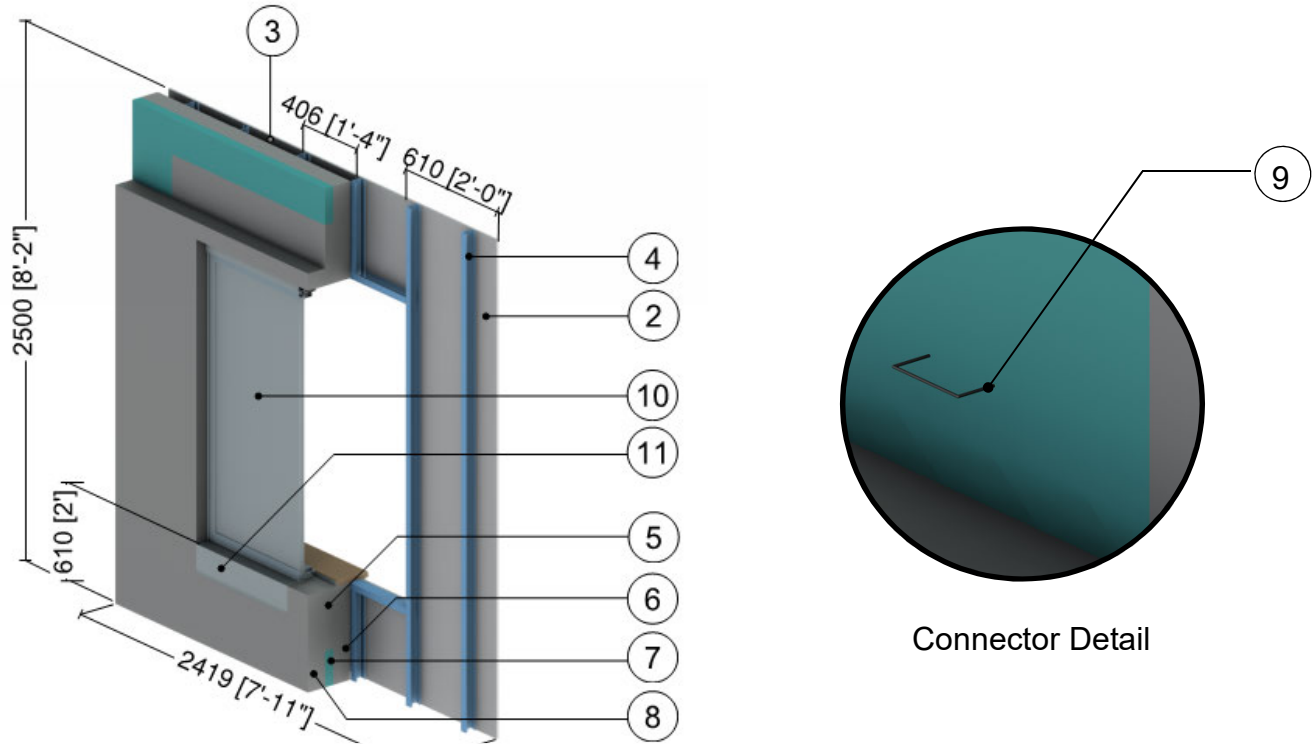


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete at Window Perimeter	12" (304)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
8	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Precast Sandwich Panel, Steel Structural Ties @ 24" (914) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
11	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.3.5 Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Window Intersection

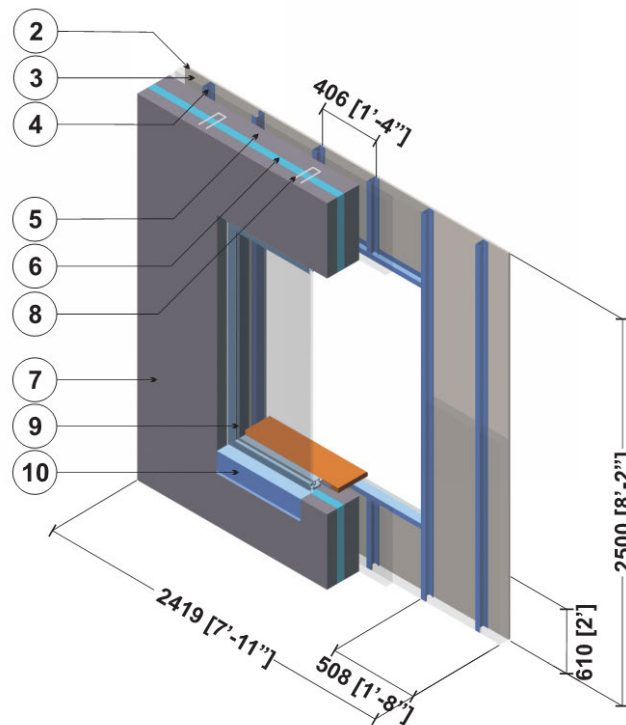


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	6 5/8" (168)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Metal Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel, Insulation	2" (50)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Steel Connectors @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	1.5m (H) x 1.2m (W) Aluminum window: double glazed & thermally broken ²					
10	Flashing/ finish material is incorporated into exterior heat transfer coefficient					
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity for air spaces within window framing was found using ISO 10077-2.

Detail 6.3.6 Exterior Insulated Concrete Drained EIFS Wall Assembly – Window with Aerogel and Intermediate Floor Intersection

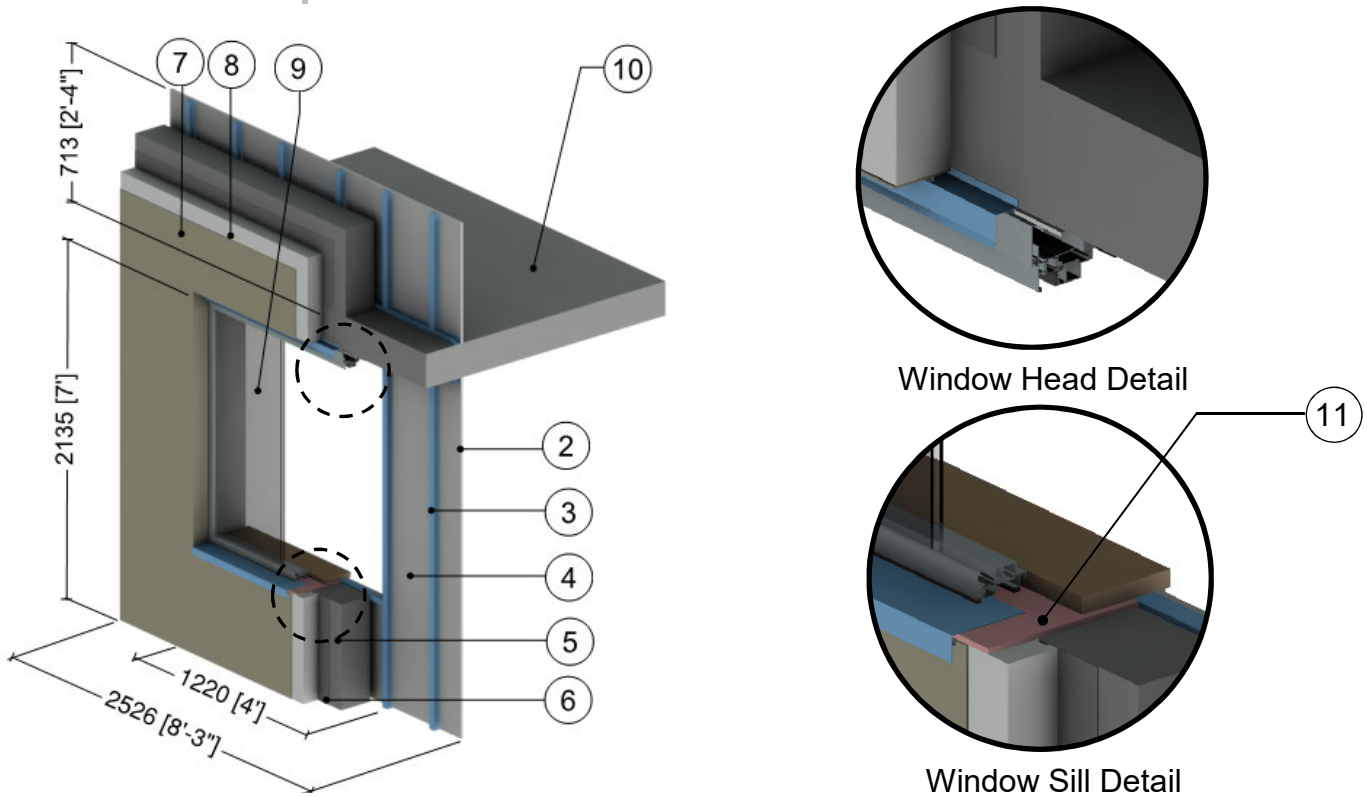


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
8	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1.2 (20)	0.35 (1470)
9	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
10	Concrete Slab	8" (203)	12 (1.8)	-	140 (2250)	0.20 (850)
11	Aerogel Blanket	3/8" (10)	0.1 (0.015)	R-3.8 (0.67 RSI)	-	-
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.3.7 Interior Insulated Concrete Block or Concrete Wall Assembly with Brick Cladding – Window Intersection

Detail referenced from work done by Passive House Academy

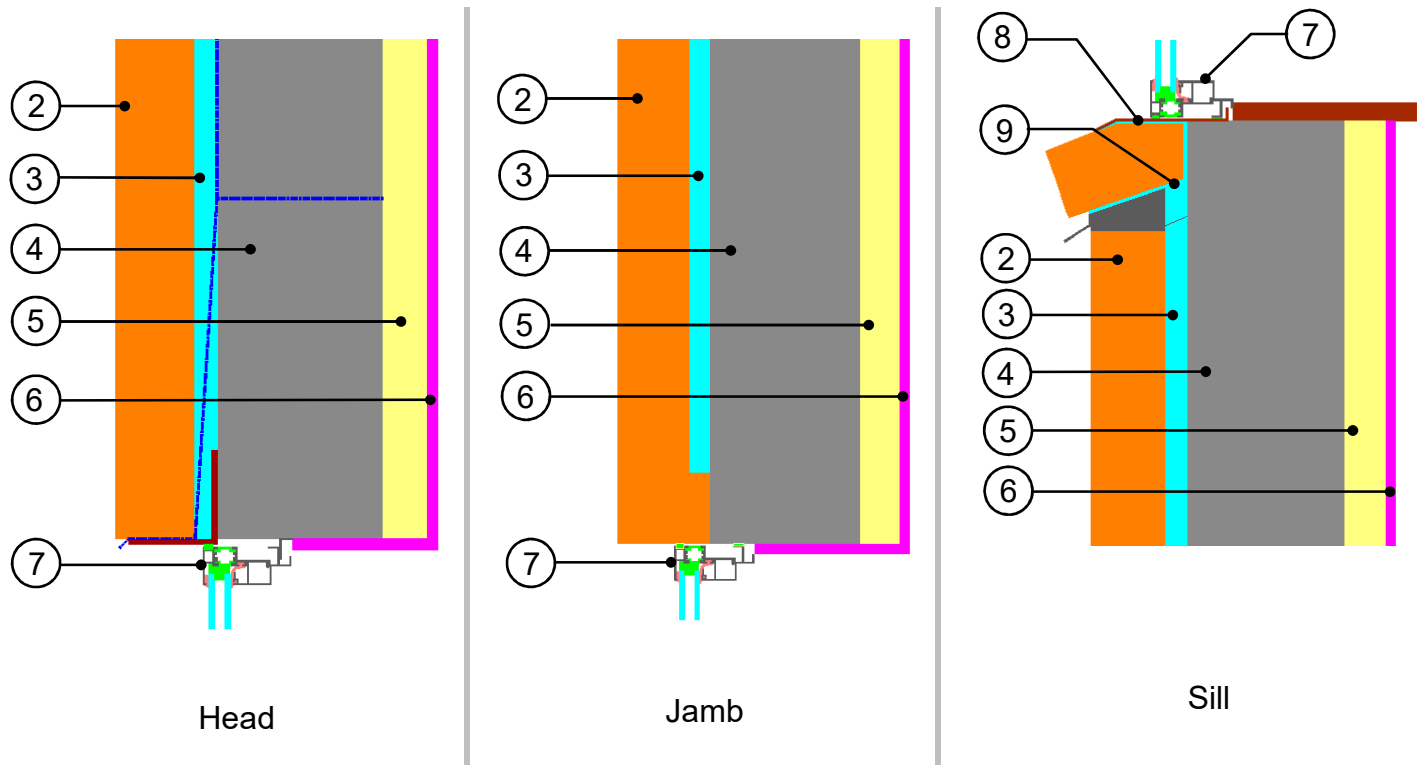


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.74 (0.13 RSI)	-	-
2	Brick	3 5/8" (92)	0.578 (1.0)	R-0.523 (0.092 RSI)	110 (1800)	-
3	Air Cavity	1" (25)	0.070 (0.122)	R-1.185 (0.209 RSI)	-	-
4	Concrete Block (CMU)	7 5/8" (194)	0.069 (1.2)	R-0.916 (0.161 RSI)	130 (2100)	-
5	Interior Insulation	2" (51)	0.0139 (0.024)	R12 (2.11 RSI)	-	-
6	Gypsum Board	1/2" (13)	0.092 (0.16)	R-0.5 (0.08 RSI)	50 (800)	-
7	5500 ISOWEB Window	-	-	-	-	-
8	Aluminum Sill Flashing	12 Gauge	92.45 (160)	-	-	-
9	Brick Sill	3 5/8" (92)	0.578 (1.0)	-	110 (1800)	-
10	Exterior Film ¹	-	-	R-0.23 (0.04 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.3.8 Interior Insulated Concrete Block or Concrete Wall Assembly with Brick Cladding – Window Intersection Aligned with Insulation

Detail referenced from work done by Passive House Academy


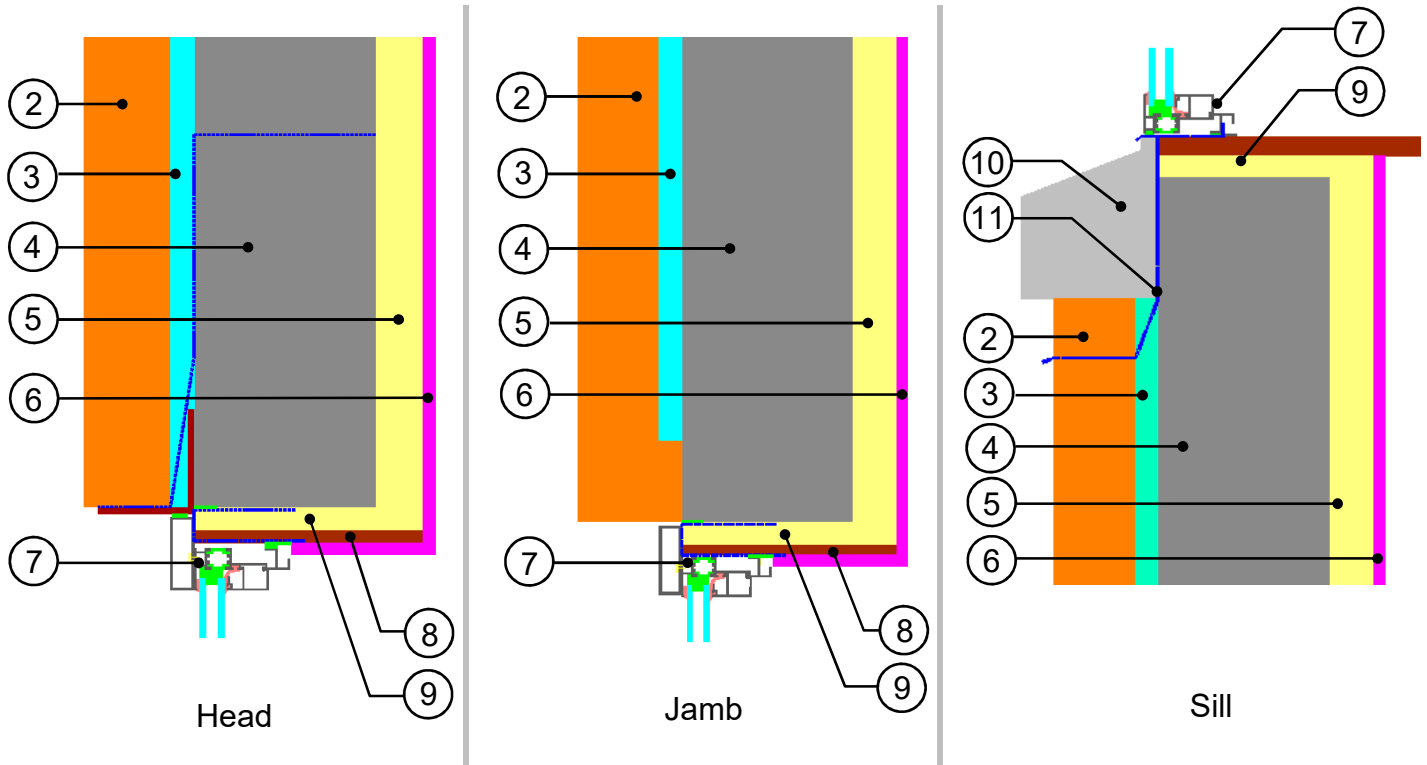


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.74 (0.13 RSI)	-	-
2	Brick	3 5/8" (92)	0.578 (1.0)	R-0.523 (0.092 RSI)	110 (1800)	-
3	Air Cavity	1" (25)	0.070 (0.122)	R-1.185 (0.209 RSI)	-	-
4	Concrete Block (CMU)	7 5/8" (194)	0.069 (1.2)	R-0.916 (0.161 RSI)	130 (2100)	-
5	Interior Insulation	2" (51)	0.0139 (0.024)	R12 (2.11 RSI)	-	-
6	Gypsum Board	1/2" (13)	0.092 (0.16)	R-0.5 (0.08 RSI)	50 (800)	-
7	5500 ISOWEB Window	-	-	-	-	-
8	Plywood Liner	3/4" (19)	0.058 (0.1)	-	-	-
9	Rigid Insulation	1" (25)	0.0139 (0.024)	-	-	-
10	Concrete Sill	-	1.4 (2.4)	-	110 (1800)	-
11	Aluminum Sill Flashing	12 Gauge	92.45 (160)	-	-	-
12	Exterior Film ¹	-	-	R-0.23 (0.04 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.3.9

Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection with Plywood and Insulation Liner

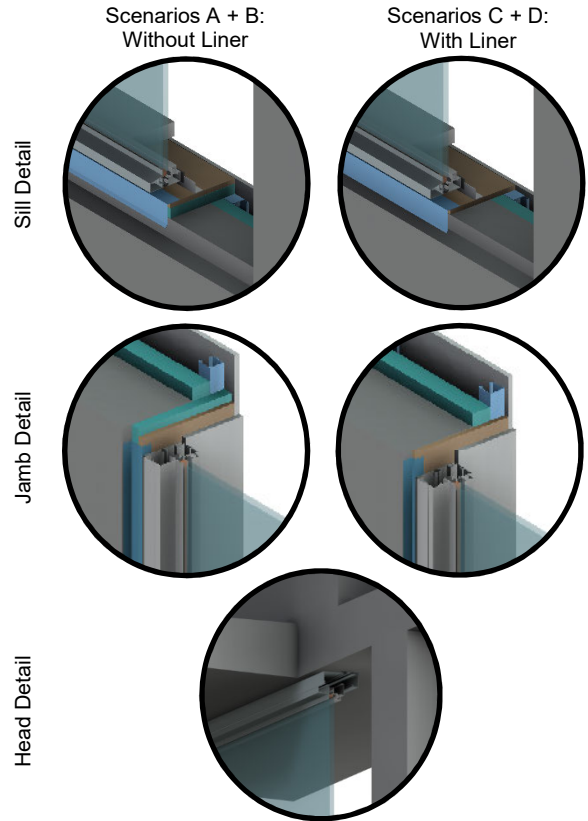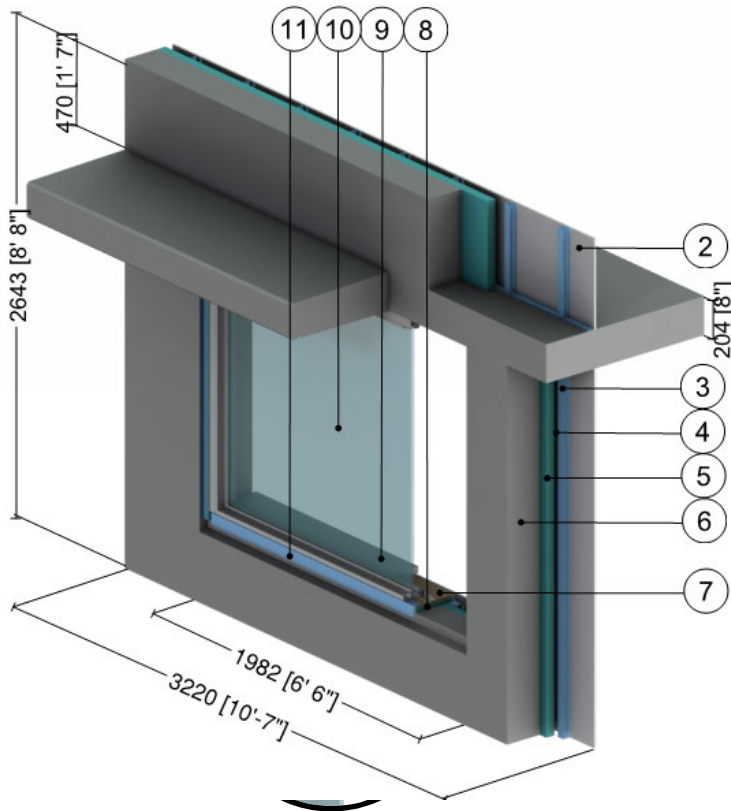



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Continuous Rigid Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/ Projected Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Plywood Liner	1/2" (13)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
8	Liner Insulation	Optional	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
9	Wood Sill	1 1/4" (30)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
10	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 6.3.10 Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection with Wall Insulation Wrapped into Opening

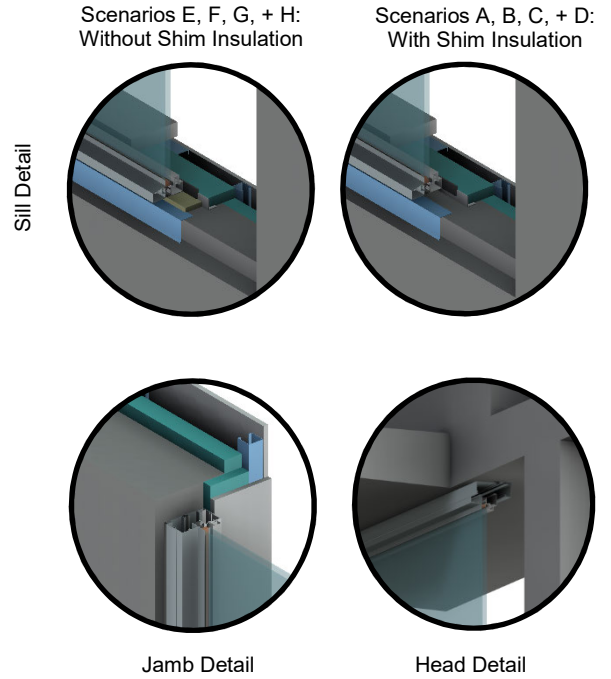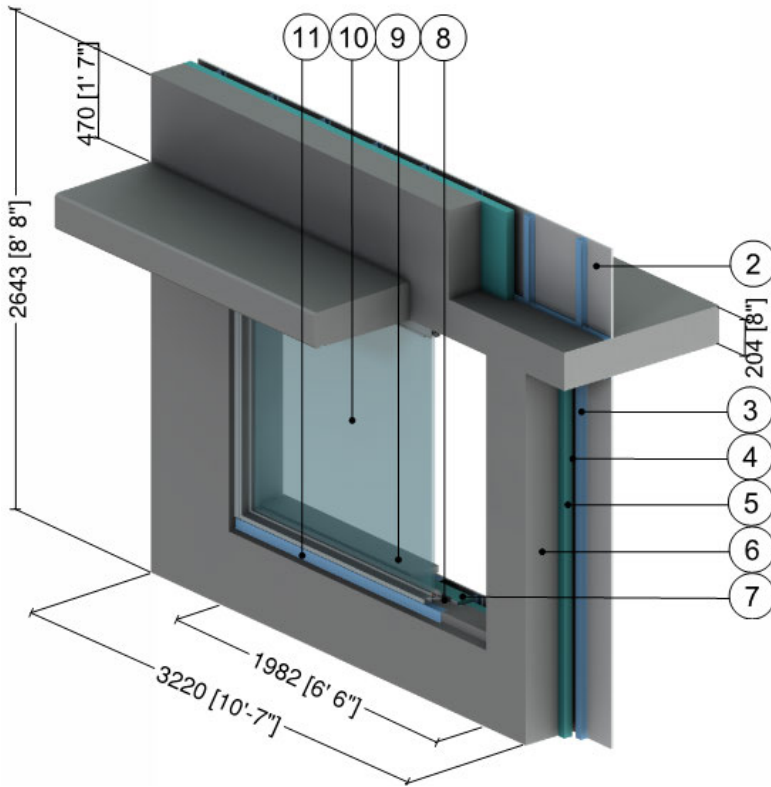

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Continuous Rigid Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/ Projected Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Opening Insulation	Varies	-	R-5 to R-10 (0.88 RSI to 1.76 RSI)	27.8 (445)	0.45 (1880)
8	Shim Insulation	Optional	0.24 (0.034)	-	1.8 (28)	0.29 (1220)
9	Wood Sill	1 1/4" (30)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
10	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 6.3.11

Interior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Window & Projected Slab Intersection – Plywood Liner and Glazing Aligned with Wall Insulation

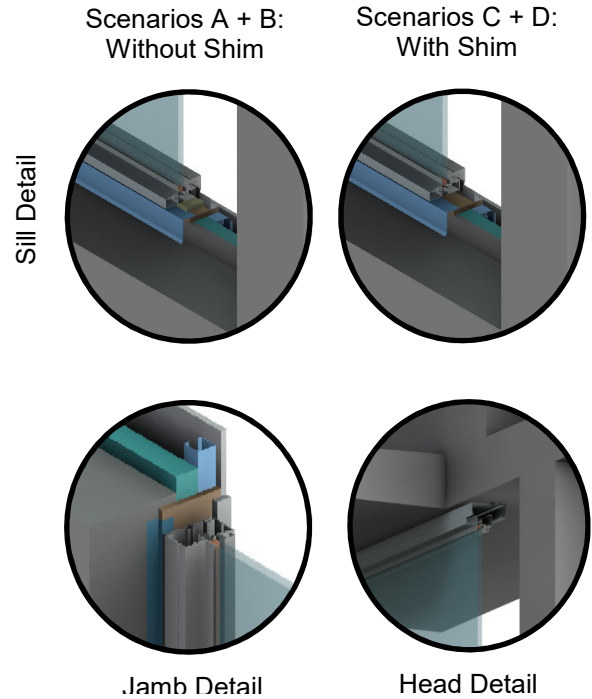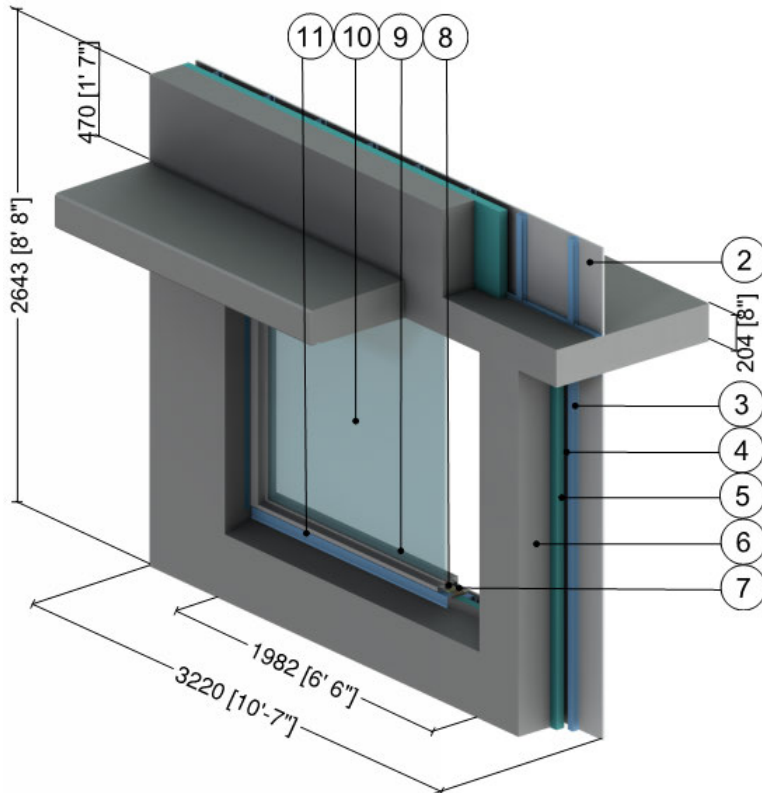


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (92)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Continuous Rigid Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall/ Projected Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Plywood Liner	1/2" (13)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
8	Shim Insulation	Optional	0.24 (0.034)	-	1.8 (28)	0.29 (1220)
9	Wood Sill	1 1/4" (30)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
10	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 6.3.12

Exterior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Stud (16" o.c.) and Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Window & Intermediate Floor Intersection with Window Thermal Break Positioned in Concrete Opening

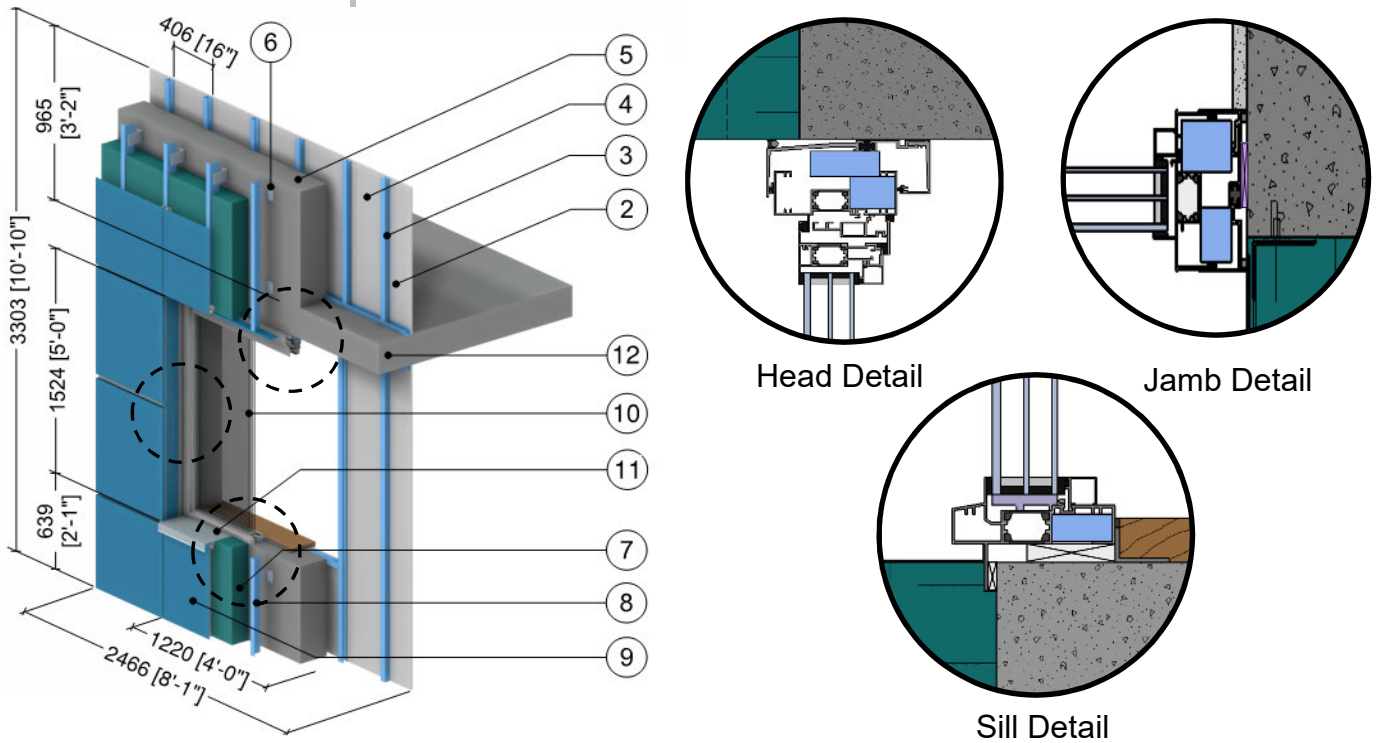

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum window: triple glazed & thermally broken ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Concrete Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 6.3.13

Exterior Insulated Concrete Mass Wall with 1 5/8" x 1 5/8" Steel Stud (16" o.c.) and Thermally Isolated Vertical Brackets and Rail System (24" o.c.) Supporting Metal Cladding – Triple Glazed Aluminum Curtain Wall & Intermediate Floor Intersection with Window Thermal Break Positioned in the Exterior Insulation

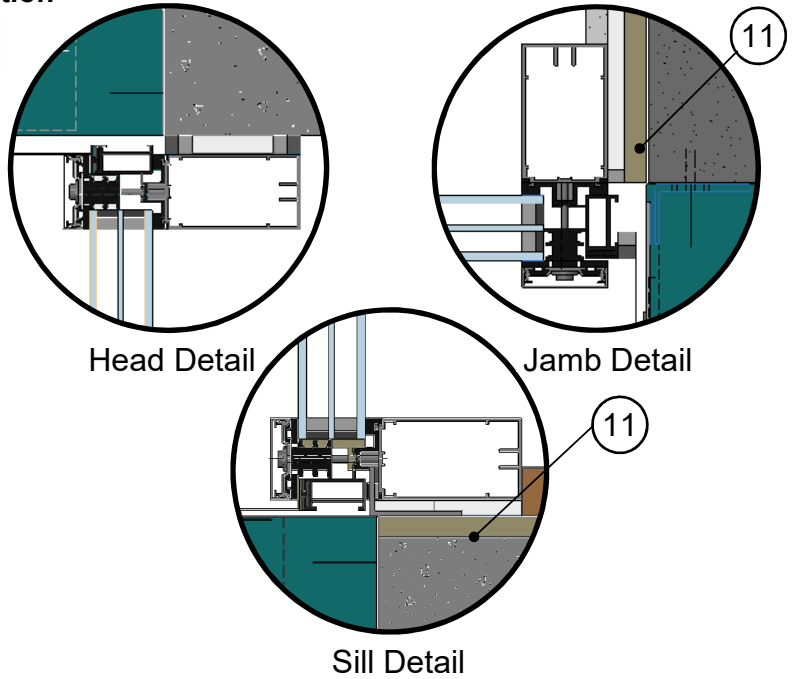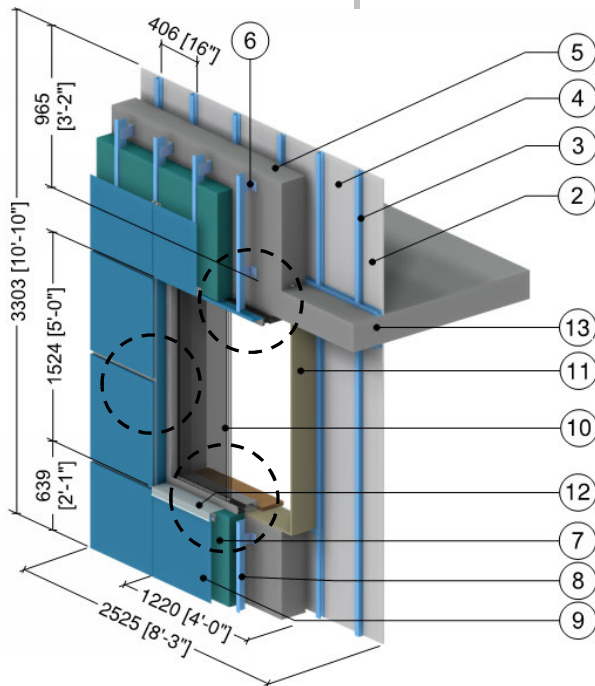



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Thermally Isolated Aluminum Bracket	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
7	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Aluminum L-girt	0.09" (2.2)	1109 (160)	-	171 (2739)	0.21 (900)
9	Generic Cladding with 1/2" (13mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Aluminum curtain wall (Passive House certified): triple glazed & thermally broken ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Wood Liner	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 6.4.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Conventional Curtain Wall Transition

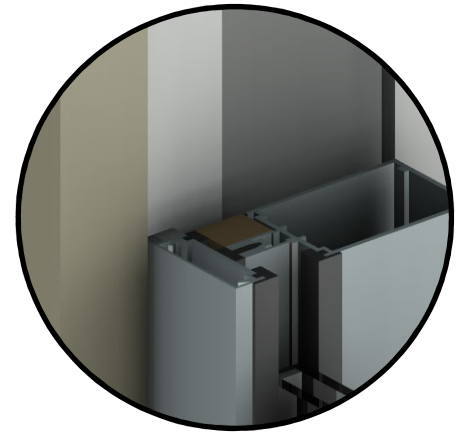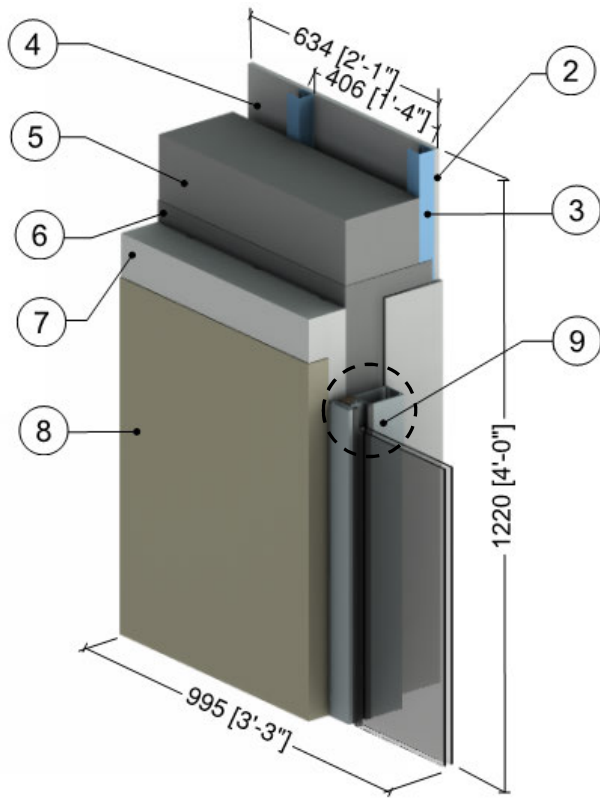


Curtain Wall Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.11 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (30)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hrft ² F (1.82 W/m ² K)					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.4.2 | Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Curtain Wall Transition


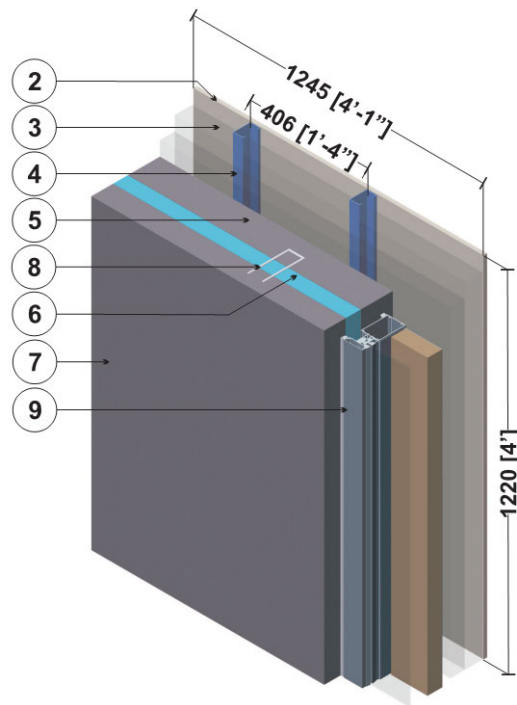


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel, Insulation	2" (50)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within curtain wall framing was found using ISO 10077-2.

Detail 6.4.3 Interior Insulated Concrete Mass Wall – Conventional Curtain Wall Transition

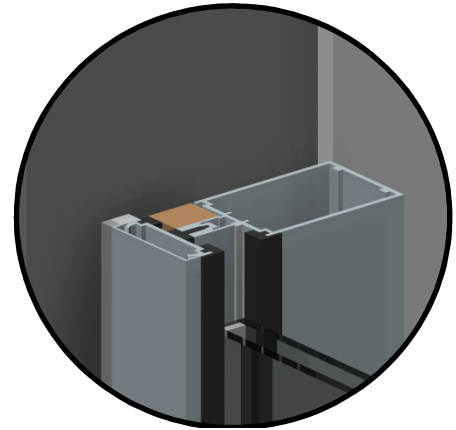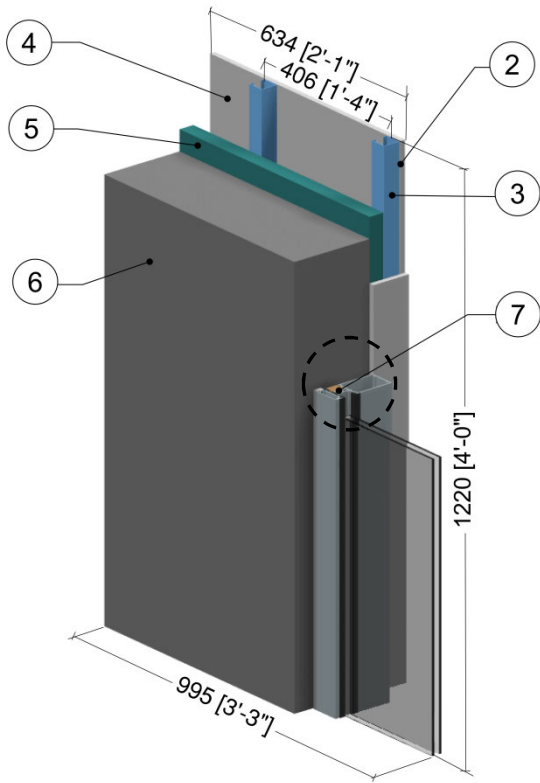



Curtain Wall Jamb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (30)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Interior Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hrft ² F (1.82 W/m ² K)					
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.4.4 Interior Insulated Concrete Mass Wall – Thermally Broken Curtain Wall Transition

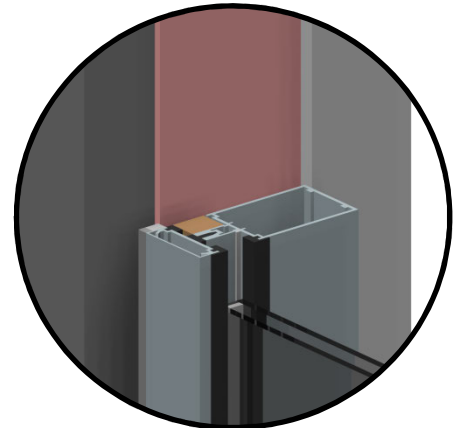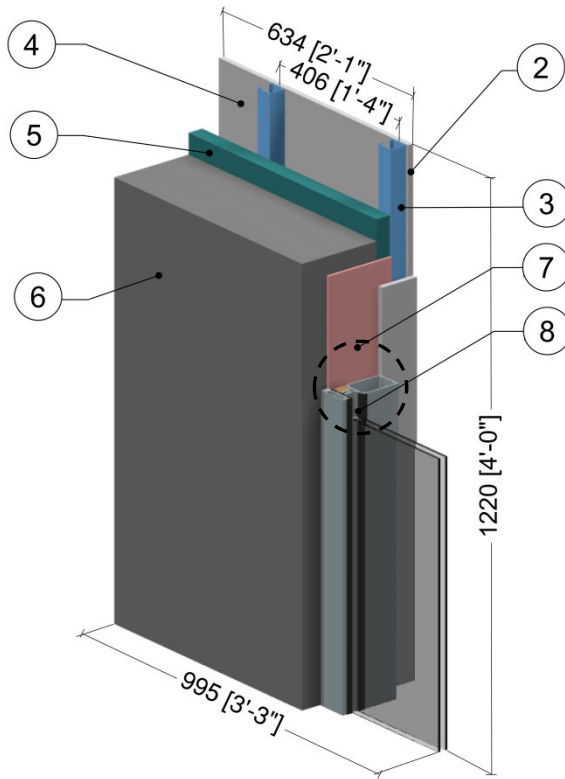

Curtain Wall Jamb Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.7 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (30)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Interior Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Aerogel Blanket	0.4" (10)	0.1 (0.015)	R-3.8 (0.67 RSI)	-	-
8	Conventional curtain wall system: double glazed with minimal thermal break ² , double glazed IGU U _{IGU} = 0.32 BTU/hrft ² F (1.82 W/m ² K)					
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 6.4.5

Precast Sandwich Panel Wall Assembly – Tigerloc Thermally Broken Curtain Wall Transition

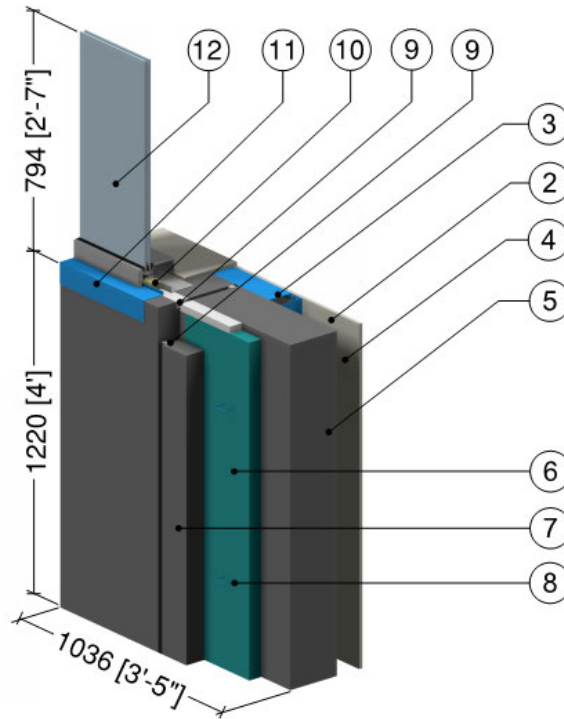


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (130)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Precast Sandwich Panel, Interior Concrete Panel	7 3/4" (197)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 RSI to 3.5 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete Panel	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Tigerloc, PVC Foam	1" (25)	0.42 (0.06)	-	-	-
10	Mineral Wool Sill Insulation	-	0.24 (0.034)	-	4 (64)	0.20 (850)
11	Sill Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Conventional curtain wall system with insulated back pan (Pressure plates with minimal thermal break) ²					
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2


Detail 6.5.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Concrete Parapet & Slab Intersection

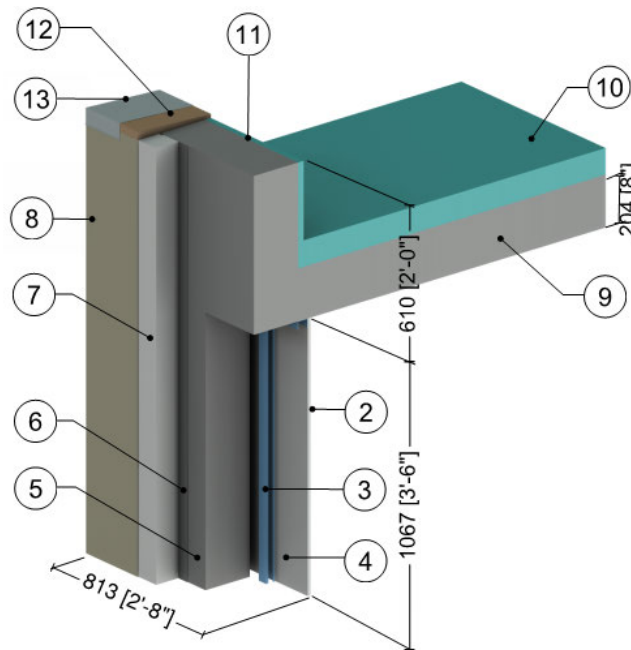

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	1" (25)	-	R-5 (0.88 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 6.5.2 Exterior Insulated Concrete Drained EIFS Wall Assembly – Insulated Concrete Parapet & Slab Intersection

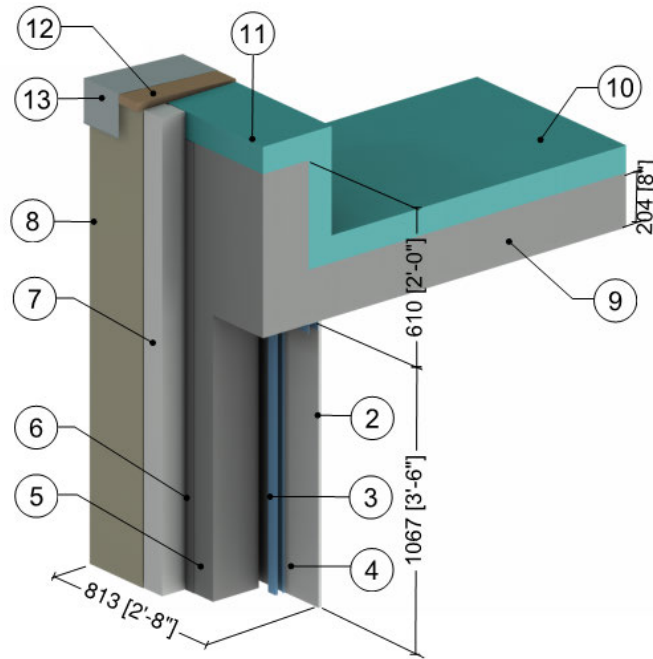

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistive Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Roof Insulation	4" (100)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
11	Parapet Insulation	Varies	-	R-10 to R-20 (1.76 RSI to 3.52 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
14	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


Detail 6.5.3 Interior Insulated Concrete Mass Wall with 1 5/8" Steel Stud (16" o.c.) Supporting Interior Finish – Concrete Parapet & Roof Intersection

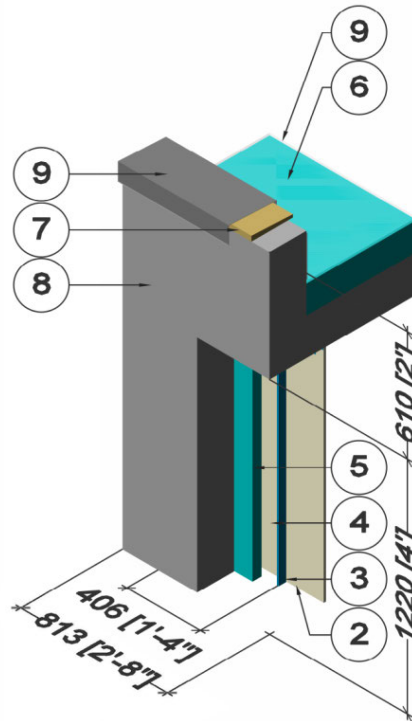

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" Steel Studs with Top Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (42)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Interior Insulation	2" (51)	0.18 (0.03)	R-11 (1.9 RSI)	1.8 (28)	0.29 (1220)
6	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
7	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
8	Concrete Slab & Parapet	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Metal cap flashing/ finish roof material is incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.5.4 | Precast Sandwich Panel Wall Assembly with 3 5/8" Steel Stud (16" o.c.) – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection


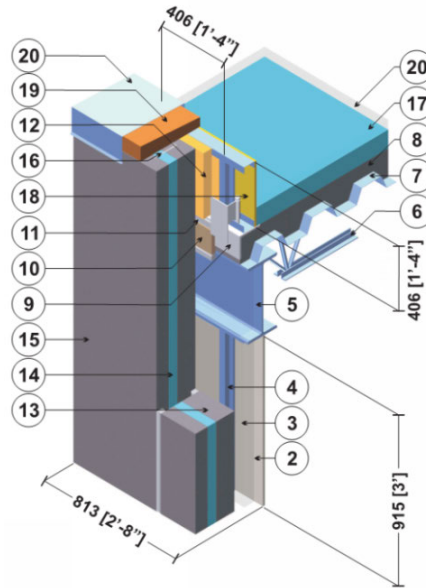


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
6	Open Web Steel Joist (550C)	-	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
8	Concrete Topping	6" (152)	6.3 (0.9)	-	120 (1920)	0.20 (850)
9	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
10	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
11	Silicone Sealant	-	2.4 (0.35)	-	-	-
12	Spray Foam Insulation	2" (51)	0.17 (0.025)	R-11.5 (2.0 RSI)	2.8 (39)	0.35 (1470)
13	Precast Sandwich Panel, Interior Concrete Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
15	Precast Sandwich Panel, Exterior Concrete Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
16	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
17	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
18	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
19	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
20	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
21	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 6.5.5 | Precast Sandwich Panel – Steel Roof Deck with Open Web Steel Joist & Parapet Intersection

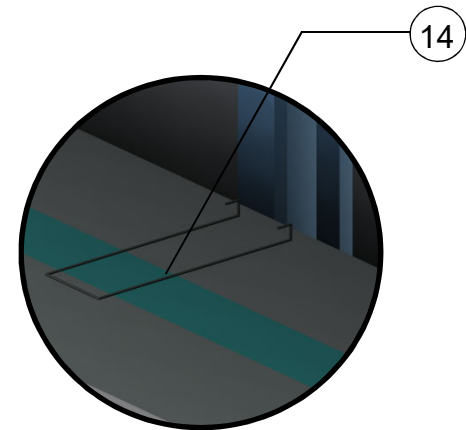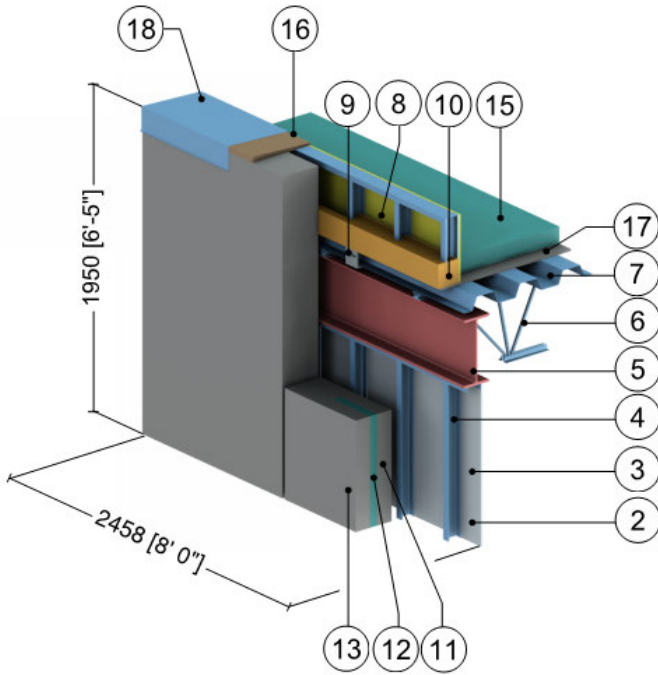


Connector Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr-ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
6	Open Web Steel Joist (550C)	-	347 (50)	-	489 (7830)	0.12 (500)
7	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
9	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
10	Polyurethane Foam Insulation	5 2/3" (144)	0.17 (0.024)	R-34 (6.0 RSI)	2.8 (30)	0.35 (1470)
11	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Precast Sandwich Panel, Steel Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
16	Wood Blocking	5/8" (16)	0.69 (0.10)	-	31 (500)	0.45 (1880)
17	Roof Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
18	Flashing & roof finish material are incorporated into exterior heat transfer coefficient					
19	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.5.6 Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Parapet & Roof Intersection


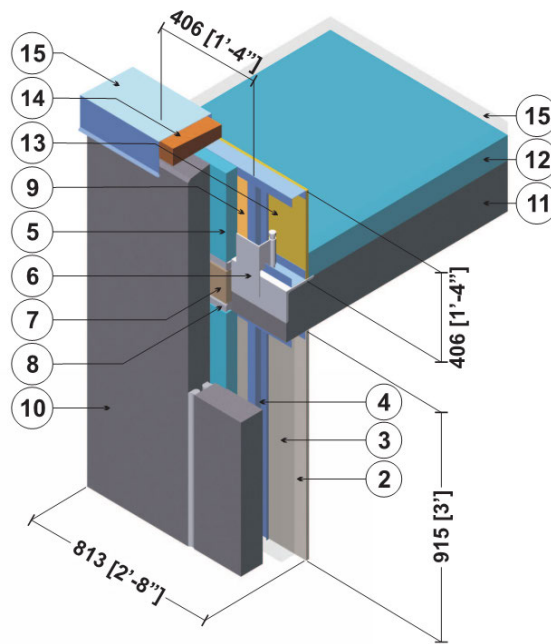


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Rigid Insulation	2" (51)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
6	Gravity and Slot Anchors at Roof	-	347 (50)	-	489 (7830)	0.12 (500)
7	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
8	Silicone Sealant	-	2.4 (0.35)	-	-	-
9	Spray Foam Insulation	1" (25)	0.17 (0.025)	R-5.8 (1.02 RSI)	2.8 (39)	0.35 (1470)
10	Precast Wall Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
13	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
14	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
15	Flashing & roof finish materials are incorporated into exterior heat transfer coefficient					
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.5.7

Precast Wall Assembly with 3 5/8" x 1 5/8" Steel Stud (16" o.c.) and Rigid Insulation Outboard of Studs – Parapet & Roof Intersection with Thermal Break under Parapet Stud Cavity and At Anchors

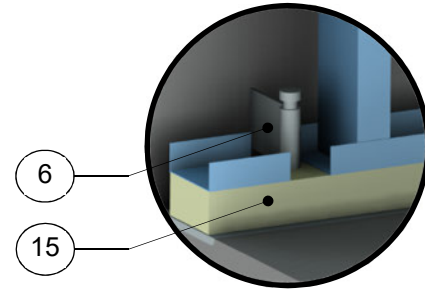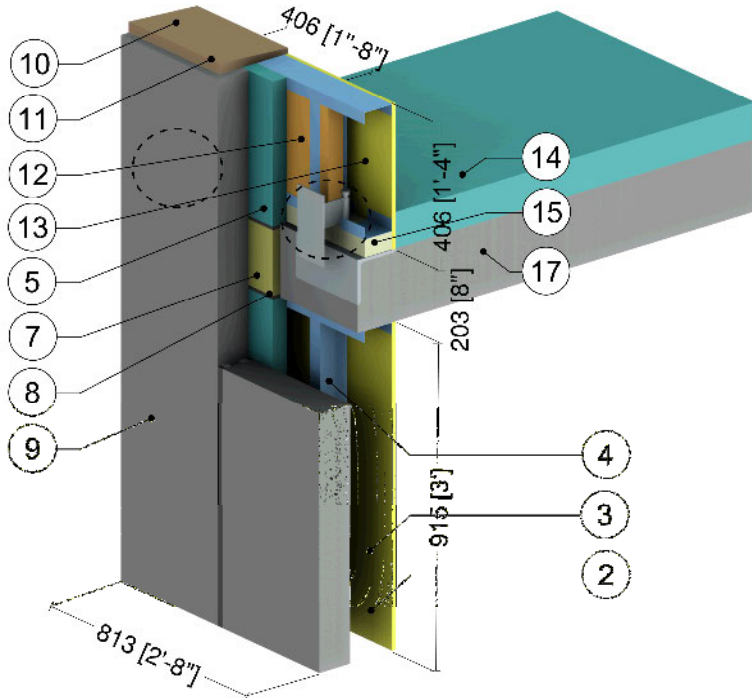

Gravity Anchor Detail


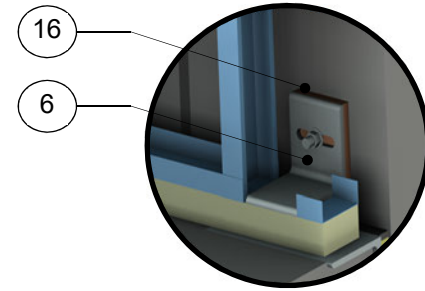


Slot Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Rigid Insulation	2" (51)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
6	Gravity and Slot Anchors at Roof	-	347 (50)	-	489 (7830)	0.12 (500)
7	Semi Rigid Insulation	1" (25)	0.28 (0.04)	R-3.6 (0.64 RSI)	4.5 (72)	0.17 (710)
8	Silicone Sealant	-	2.4 (0.35)	-	-	-
9	Precast Wall Panel	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Flashing & roof finish materials are incorporated into exterior heat transfer coefficient					
11	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
12	Spray Foam Insulation	1" (25)	0.17 (0.025)	R-5.8 (1.02 RSI)	2.8 (39)	0.35 (1470)
13	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
14	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
15	Armatherm 500	2" (50)	0.32 (0.05)	R-6.2 (1.09 RSI)	-	-
16	Armatherm FRR	3/8" (10)	1.4 (0.20)	-	85 (5.3)	-
17	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
18	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.5.8 Exterior Insulated Concrete Block Wall Assembly with Masonry Ties Supporting Brick Veneer – Parapet & Roof Intersection

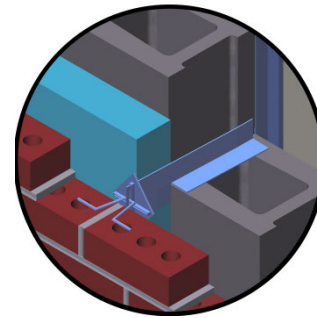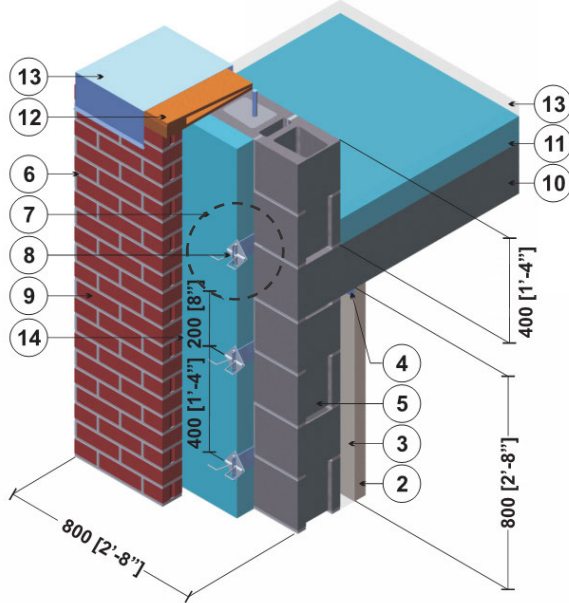



Brick Tie Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" Steel Studs with Metal Tracks	20 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Standard Concrete Block	7 5/8" (190)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	Cement Mortar	-	3.5 (0.5)	-	113 (1800)	0.12 (500)
7	Insulation	Varies	-	R-5 to R-25 (0.88 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
8	Masonry Ties @ 16" (406) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
10	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
11	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
12	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
13	Flashing & roof finish materials are incorporated into exterior heat transfer coefficient					
14	Air Gap	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.5.9


Precast Sandwich Panel – Steel Roof Deck with Open Web Steel Joist & Paroloc Thermally Broken Parapet Intersection

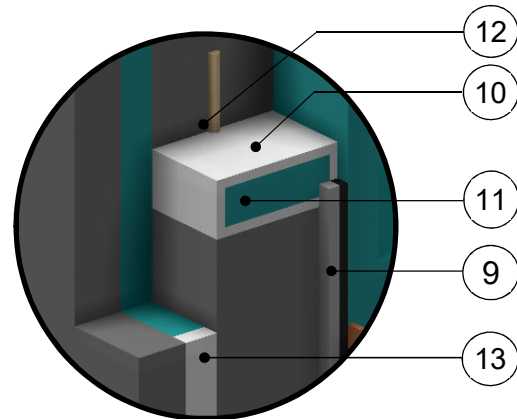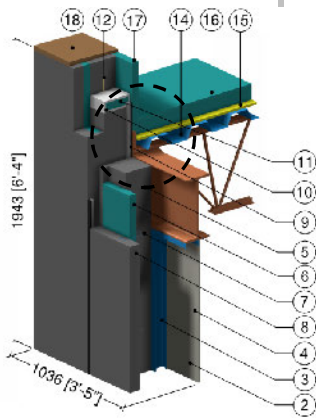

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	4 1/8" (130)	-	R-0.9 (RSI-0.16)	0.075 (1.2)	0.24 (1000)
5	Precast Sandwich Panel, Interior Concrete Panel	7 3/4" (197)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Precast Sandwich Panel Insulation	2" to 4" (51 to 102)	-	R-10 (1.8 RSI) to R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
7	Precast Sandwich Panel, Exterior Concrete Panel	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Silicone Sealant	-	1.7 (0.25)	-	-	-
10	Paraloc, PVC Foam	1/2" (13)	0.42 (0.06)	-	-	-
11	Paraloc, Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 RSI to 3.5 RSI)	1.8 (28)	0.29 (1220)
12	FRP rebar @ 10" (254) o.c.	#5 (16M)	2.4 (0.35)	-	-	-
13	Tigerloc, PVC Foam	1" (25)	0.42 (0.06)	-	-	-
14	Open Web Steel Joist, Beam, Angle, and Deck	-	347 (50)	-	489 (7830)	0.12 (500)
15	Exterior Sheathing	5/8" (16)	1.1 (0.16)	R-0.6 (0.1 RSI)	50 (800)	0.26 (1090)
16	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
17	Parapet Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 RSI to 3.5 RSI)	1.8 (28)	0.29 (1220)
18	Wood Blocking	5/8" (16)	0.63 (0.09)	-	27.8 (445)	0.45 (1880)
19	Flashing and roof finish material are incorporated into exterior heat transfer coefficient					
20	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.6.1 Exterior Insulated Concrete Drained EIFS Wall Assembly – Corner Intersection


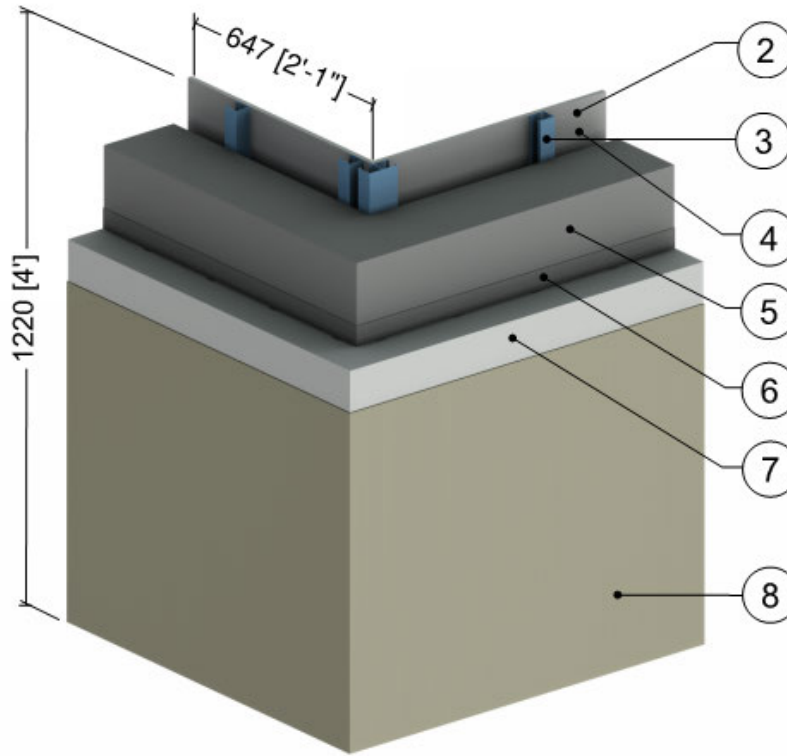


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	1 5/8" x 1 5/8" Steel Studs (16"o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Concrete Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Weather Resistant Barrier with Adhesive	-	-	-	-	-
7	Insulation Board	4" (100)	0.27 (0.039)	R-15 (2.64 RSI)	1 (16)	0.35 (1470)
8	Lamina	1/8" (4)	6 (0.9)	R-0.04 (0.01 RSI)	120 (1922)	0.20 (850)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.1

Interior Insulated Concrete Mass Wall with 3 5/8" x 1 5/8" Steel Studs (16" o.c.) Supporting Interior Finish – Intermediate Floor Intersection above Parking Garage

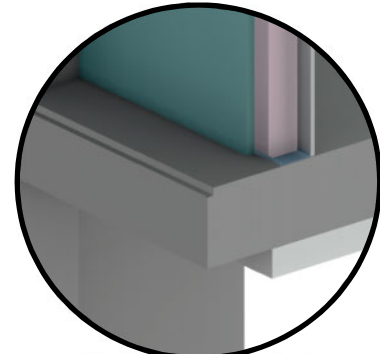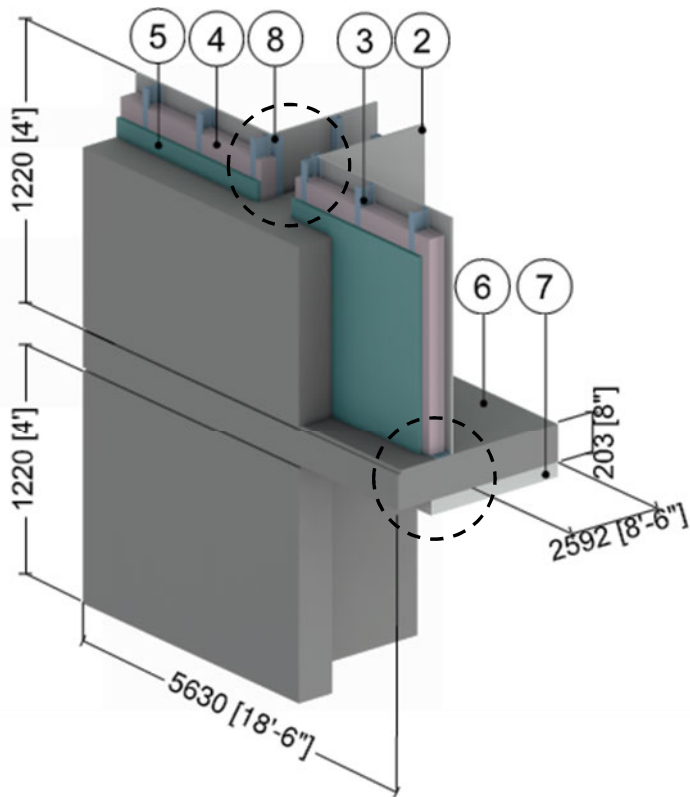

Slab Edge Detail

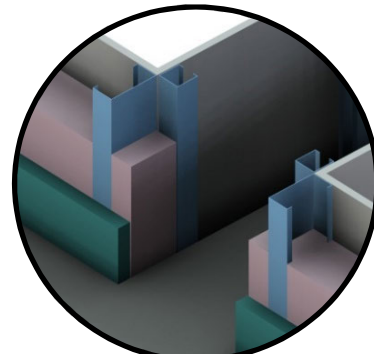


Partition Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs with Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Continuous Insulation	Varies	-	R-10 to R-15 (1.76 RS to 2.64 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Wall & Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Spray Applied Fiberglass Insulation	4" (102)	0.20 (0.029)	R-20 (3.5 RSI)	0.9 (14)	0.12 (500)
8	1 5/8" x 1 5/8" Steel Studs with Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation



Detail 6.7.2 | Insulated Concrete Floor Slab – Concrete Column Intersection

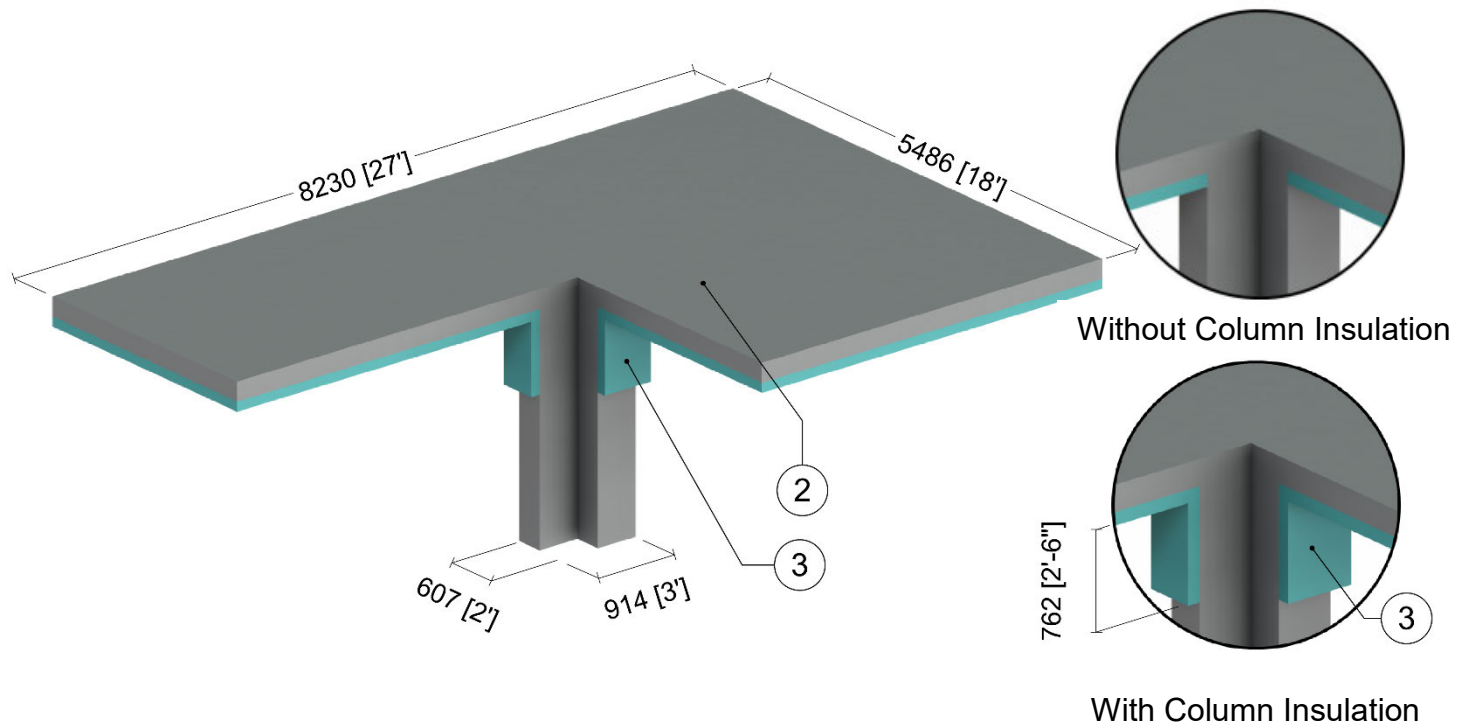


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.9 (0.16 RSI)	-	-
2	Concrete Floor	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Spray Applied Fiberglass Insulation	4" (101)	0.2 (0.029)	R-20 (3.5 RSI)	0.9 (14)	0.12 (500)
4	Exterior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.3 | Precast Sandwich Wall Assembly Slab and Foundation Intersection

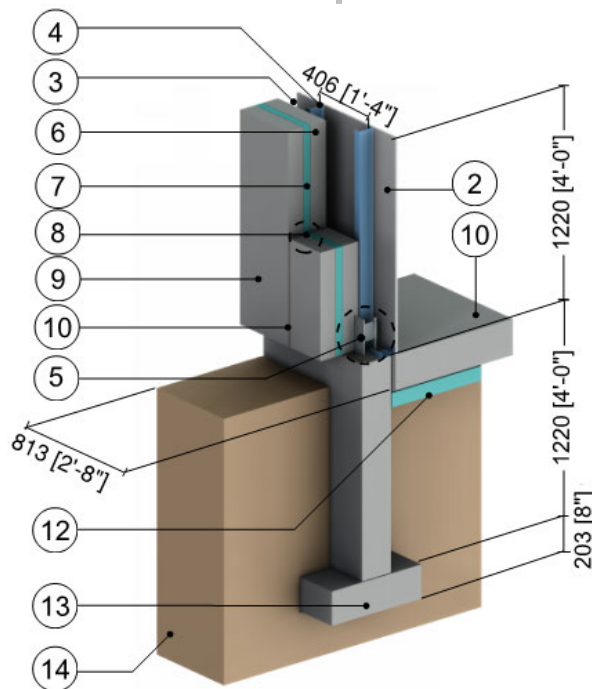

Connector Detail





Gravity and Slot Anchor Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5" (127)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
6	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Silicone Sealant	-	2.4 (3.5)	-	174 (2800)	0.17 (700)
11	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Foundation Insulation	3 1/2" (89)	0.24 (0.0343)	R-15 (2.6 RSI)	1.8 (28)	0.29 (1220)
13	Concrete Footing	12" (305)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Soil	-	15.6 (2.25)	-	-	-
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.4 | Precast Sandwich Panel with 3 5/8" Steel Stud (16" o.c.) – Concrete Slab and Foundation Wall

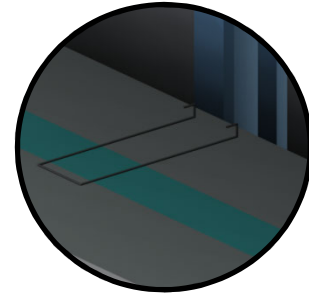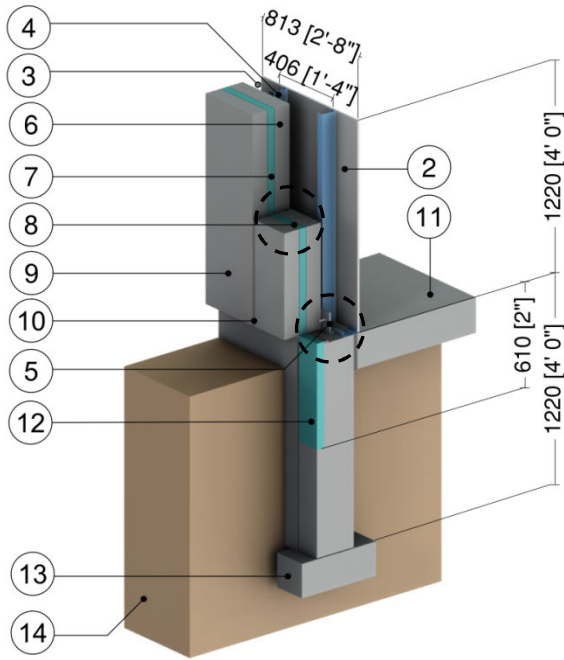

Connector Detail





Gravity and Slot Anchor Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 5/8" (143)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
6	Precast Sandwich Panel, Interior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
8	Precast Sandwich Panel, Structural Ties @ 24" o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Precast Sandwich Panel, Exterior Concrete	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Silicone Sealant	-	2.4 (3.5)	-	174 (2800)	0.17 (700)
11	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Foundation Insulation	2" (50)	0.2 (0.028)	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
13	Concrete Footing	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
14	Soil	-	15.6 (2.25)	-	-	-
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.5 Precast Sandwich Panel with 3 5/8" Steel Stud (16" o.c.) – Thermally Broken Concrete Slab and Foundation Intersection

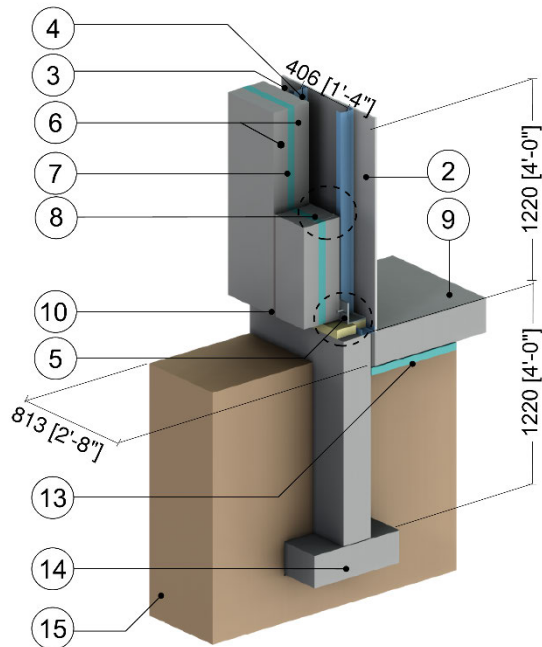

Connector Detail

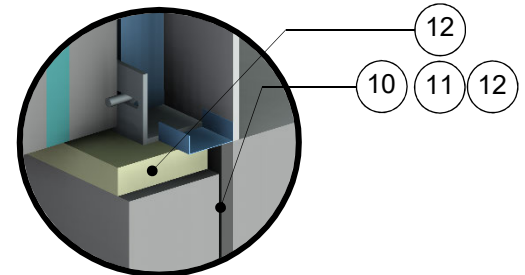



Gravity and Slot Anchor Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5" (127)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	3 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Gravity and Slot Anchors at Slab	-	347 (50)	-	489 (7830)	0.12 (500)
6	Precast Sandwich Panels	4" (102)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Precast Sandwich Panel, Insulation	2" (51)	-	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
8	Precast Sandwich Panel, Structural Ties @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Sealant	-	2.4 (3.5)	-	174 (2800)	0.17 (700)
11	Fibreboard	1" (25)	0.38 (0.055)	R-2.6 (0.47 RSI)	16 (254)	0.50 (2100)
12	Armatherm 500	2" (50)	0.32 (0.05)	R-6.2 (1.09 RSI)	-	-
13	Foundation Insulation	3 1/2" (89)	0.24 (0.0343)	R-15 (2.6 RSI)	1.8 (28)	0.29 (1220)
14	Concrete Footing	12" (305)	12.5 (1.8)	-	140 (2250)	0.20 (850)
15	Soil	-	15.6 (2.25)	-	-	-
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.6

Insulated Slab on Grade – Steel Column

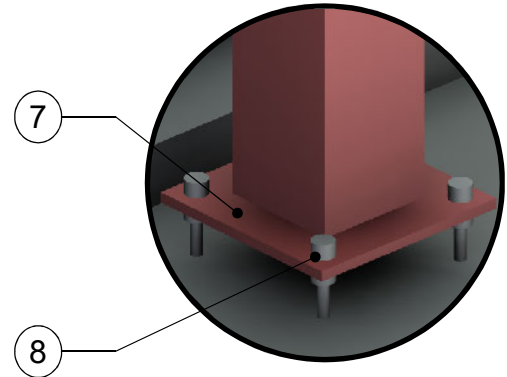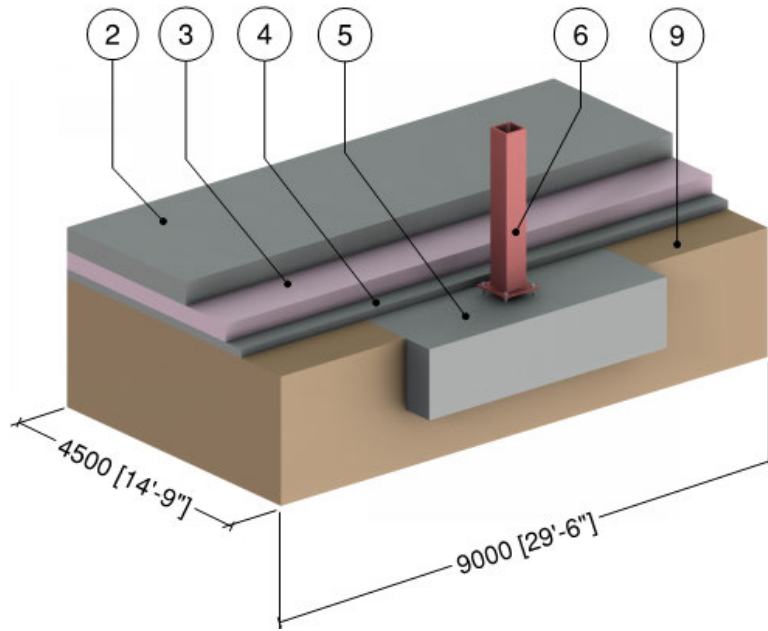



Column Connection

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Extruded Polystyrene Insulation (XPS)	6" (152)	0.20 (0.029)	R-30 (5.28 RSI)	1.8 (28)	0.29 (1220)
4	Concrete Sub Slab	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
5	Concrete Footing	24" (610)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	8" x 8" HSS Column	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
7	14" x 14" x 1/2" Base Plate	1/2" (13)	430 (62)	-	489 (7830)	0.12 (500)
8	Stainless Steel Bolts	3/4" (6) ∅	117 (17)	-	489 (7830)	0.12 (500)
9	Soil	-	10.4 (1.5)	-	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.7.7

Insulated Slab on Grade – Armatherm 500 Thermal Break under Column

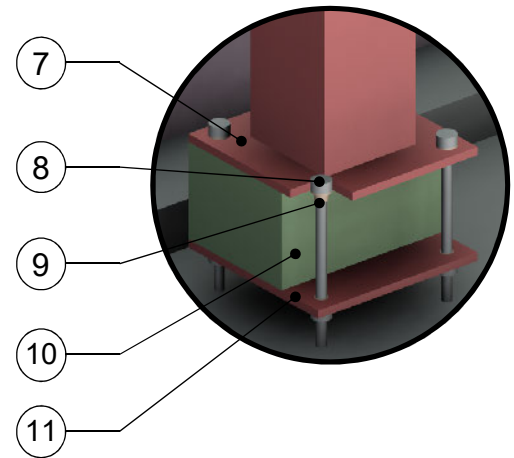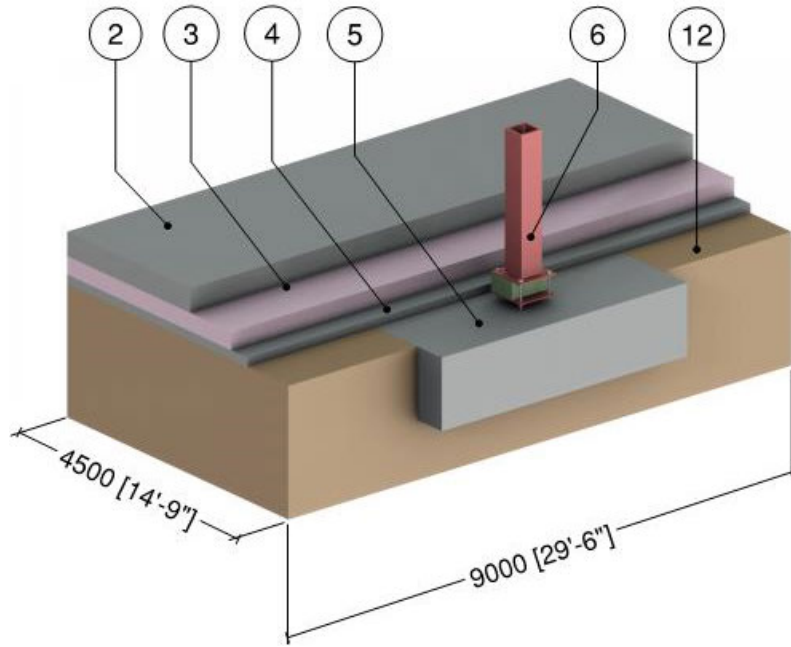


Armatherm 500 Column Thermal Break

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Concrete Slab on Grade	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Extruded Polystyrene Insulation (XPS)	6" (152)	0.20 (0.029)	R-30 (5.28 RSI)	1.8 (28)	0.29 (1220)
4	Concrete Sub Slab	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
5	Concrete Footing	24" (610)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	8" x 8" HSS Column	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
7	14" x 14" x 1/2" Base Plate	1/2" (13)	430 (62)	-	489 (7830)	0.12 (500)
8	Stainless Steel Bolts	3/4" (6) ϕ	117 (17)	-	489 (7830)	0.12 (500)
9	Armatherm FRR Washers and Bushing	-	1.4 (0.2)	-	85 (5.3)	-
10	Armatherm 500 Thermal Break	6" (152)	0.32 (0.05)	-	-	-
11	14" x 14" x 1/2" Base Plate	1/2" (13)	430 (62)	-	489 (7830)	0.12 (500)
12	Soil	-	10.4 (1.5)	-	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 6.8.1

Precast Sandwich Panel Wall Assembly – Emloc Thermally Broken Embedment Detail

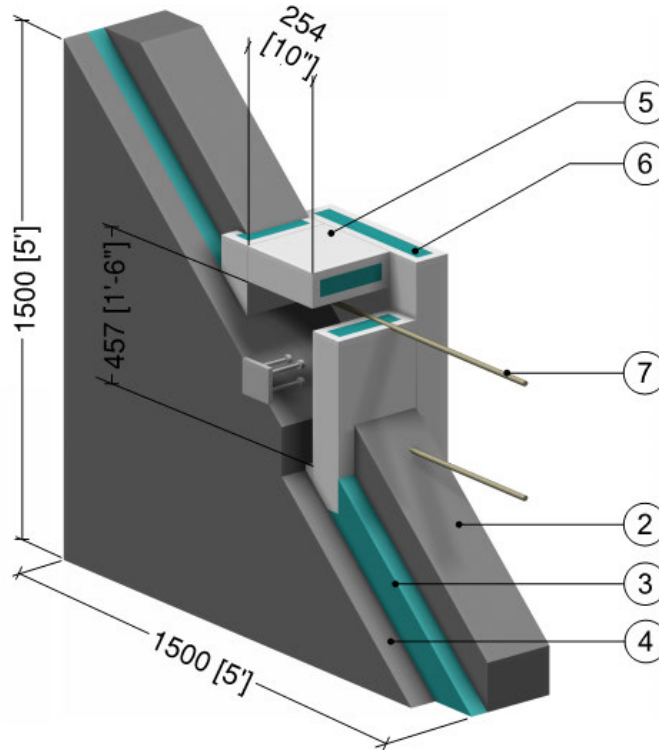

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Precast Sandwich Panel, Interior Concrete Panel	7 3/4" (197)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Precast Sandwich Panel Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 RSI to 3.5 RSI)	1.8 (28)	0.29 (1220)
4	Precast Sandwich Panel, Exterior Concrete Panel	3" (76)	12.5 (1.8)	-	140 (2250)	0.20 (850)
5	Emloc, PVC Foam	1" (25)	0.42 (0.06)	-	-	-
6	Emloc, Insulation	2" to 4" (51 to 102)	-	R-10 to R-20 (1.8 RSI to 3.5 RSI)	1.8 (28)	0.29 (1220)
7	FRP rebar	#5 (16M)	2.4 (0.35)	-	-	-
8	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

7.0 Wood Frame Construction

Detail 7.1.1	A.7.1
Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Clear Wall	
Detail 7.1.2	A.7.2
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Clear Wall	
Detail 7.1.3	A.7.3
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Rigid Insulation Supporting Fiber Cement Board – Clear Wall	
Detail 7.1.4	A.7.4
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Horizontal Metal Z-Girts (24" o.c.) Supporting Fiber Cement Board – Clear Wall	
Detail 7.1.5	A.7.5
Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 7.1.6	A.7.6
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 7.1.7	A.7.7
Exterior Insulated 2x6 Wood Stud (16"o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall	
Detail 7.2.1	A.7.8
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Rim Joist and Floor Intersection without Metal Flashing Bypassing Exterior Insulation	
Detail 7.2.2	A.7.9
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Rim Joist and Floor Intersection with Metal Flashing Bypassing Exterior Insulation	
Detail 7.2.3	A.7.10
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Cantilevered Wood Joist Balcony Intersection	
Detail 7.2.4	A.7.11
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Independently Supported Balcony Intersection	
Detail 7.2.5	A.7.12

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Cantilevered Floor Intersection

Detail 7.3.1 **A.7.13**

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vinyl Window Intersection

Detail 7.3.2 **A.7.14**

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Aluminum Window Intersection

Detail 7.3.3 **A.7.15**

Exterior and Interior Insulated 2x6 Wood Stud (8" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vinyl Window Intersection

Detail 7.3.4 **A.7.16**

Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed Flange Mounted Vinyl Window Intersection with Window Positioned in Wood Framing

Detail 7.3.5 **A.7.17**

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed Flange Mounted Vinyl Window Intersection with Window Positioned in Wood Framing

Detail 7.3.6 **A.7.18**

Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping (16" o.c.) and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed High Performance Vinyl Window Intersection (Insulated Frames)

Detail 7.3.7 **A.7.19**

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping (16" o.c.) and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed High Performance Vinyl Window Intersection (Insulated Frames)

Detail 7.4.1 **A.7.20**

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vented Low-slope Roof & Parapet Intersection

Detail 7.4.2 **A.7.21**


Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Sloped Wood Framed Roof & Wall Intersection with Insulation at Ceiling

Detail 7.4.3	A.7.22
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Sloped Wood Framed Roof & Wall Intersection with Insulation at Roof Sheathing	
Detail 7.4.4	A.7.23
Ventilated Wood Frame Low Slope Roof - Masonry Firewall Intersection	
Detail 7.5.1	A.7.24
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting and Continuous Insulation Fiber Cement Board – Corner Intersection	
Detail 7.6.1	A.7.25
Wood-frame Sliding Door – Concrete Floor Intersection for Unheated Spaces (Parking Garages)	
Detail 7.6.2	A.7.26
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Insulation and Wood Strapping Supporting Fiber Cement Board – Rim Joist and Interior Insulated At-Grade Foundation Wall Intersection	
Detail 7.6.3	A.7.27
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Insulation and Wood Strapping Supporting Fiber Cement Board – Rim Joist and Exterior Insulated At-Grade Foundation Wall Intersection	
Detail 7.6.4	A.7.28
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Exterior Insulated At-Grade Foundation Wall Intersection	
Detail 7.6.5	A.7.29
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Rim Joist and Floor Intersection	
Detail 7.6.6	A.7.30
Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Stand-off (Knife Plate) Shelf Angle & Brick Ties Supporting Brick Veneer – Rim Joist and Floor Intersection	
Detail 7.7.1	A.7.31
Exterior Insulated Wood Infill Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Concrete Wall and Intermediate Floor Intersection with Flashing Bypassing Exterior Insulation	
Detail 7.7.2	A.7.32
Exterior Insulated Cross Laminated Timber (CLT) Wall Assembly with Wood Strapping and Continuous Rigid Insulation Supporting Fiber Cement Board –	

Cross Laminated Timber Floor Intersection with Flashing Bypassing Exterior Insulation

Detail 7.1.1

Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Clear Wall

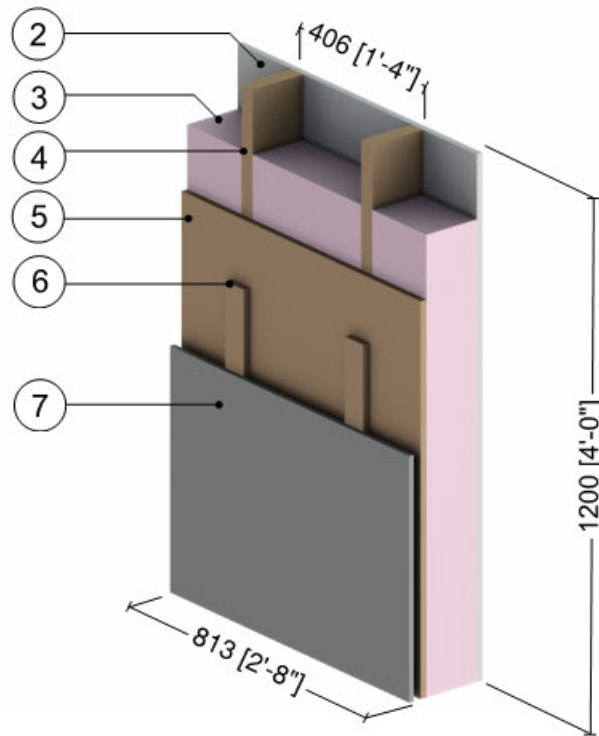


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
7	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
8	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.2

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Clear Wall

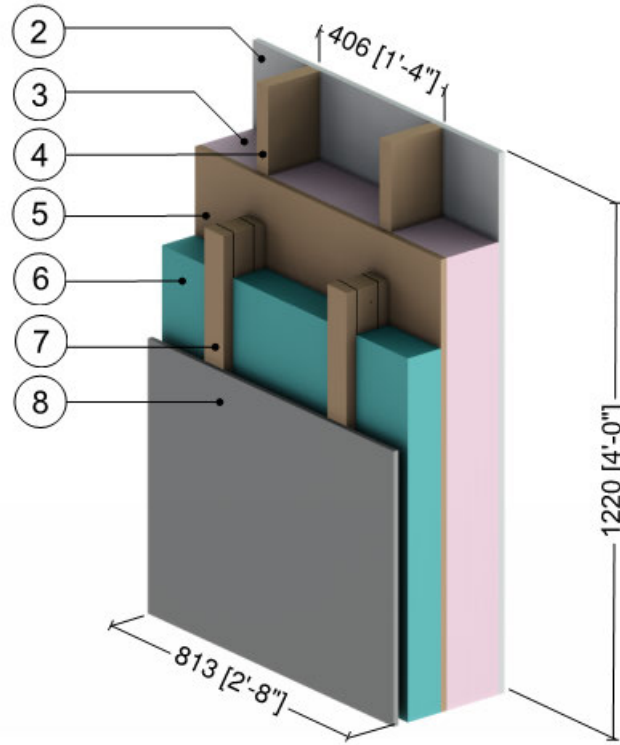


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	5/8" (16)	1.1 (0.16)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	Varies	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.3

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Rigid Insulation Supporting Fiber Cement Board – Clear Wall

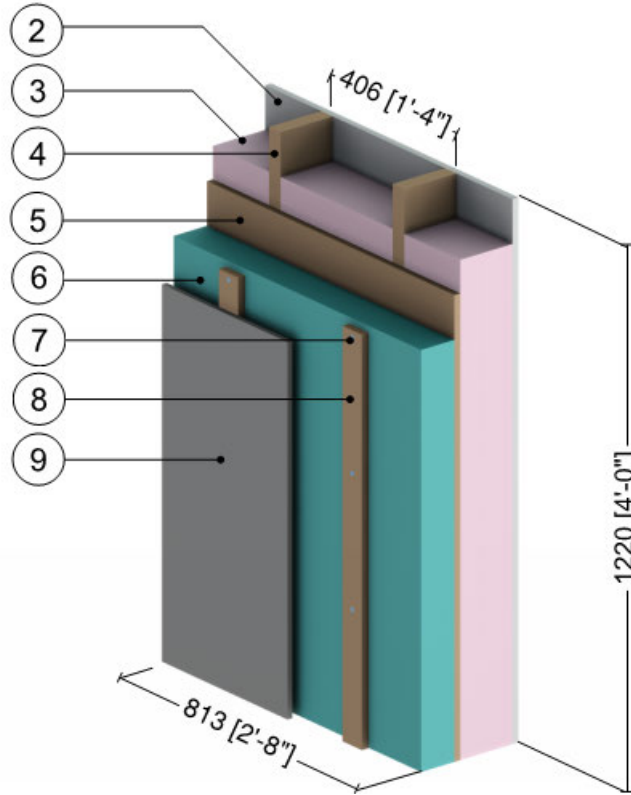


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Wood Strapping (1" x 3")	1 1/2" (38.1)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.4



Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Horizontal Metal Z-Girts (24" o.c.) Supporting Fiber Cement Board – Clear Wall

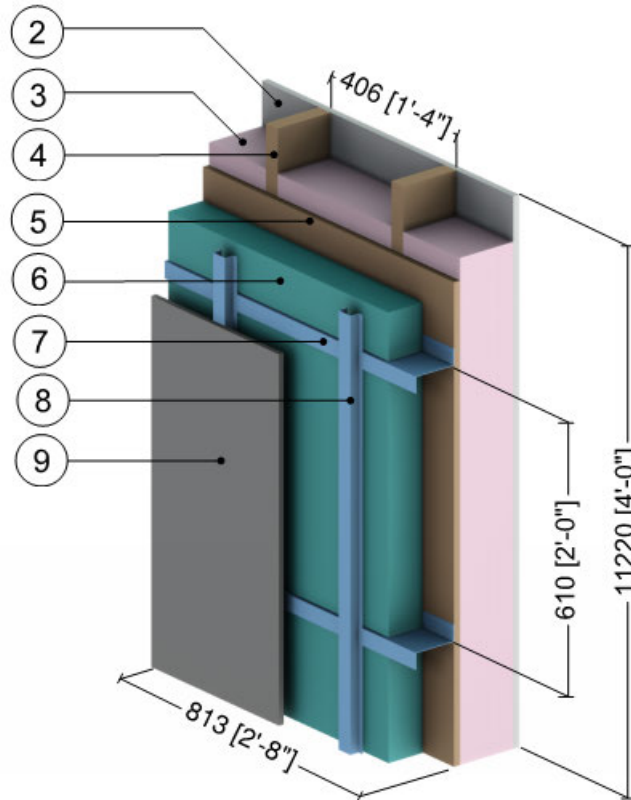

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film (right side) ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Horizontal Z-Girt with 1 1/2" Flange	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Steel Furring Hat Track (16" o.c.)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film (left side) ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.5 Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall

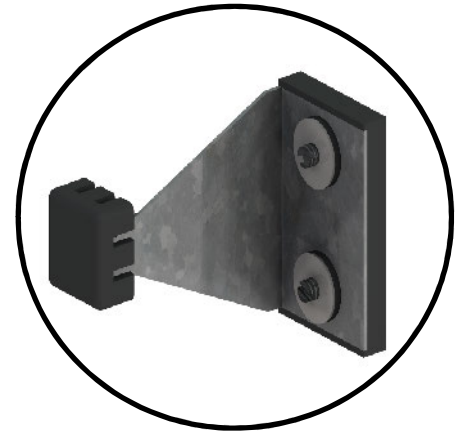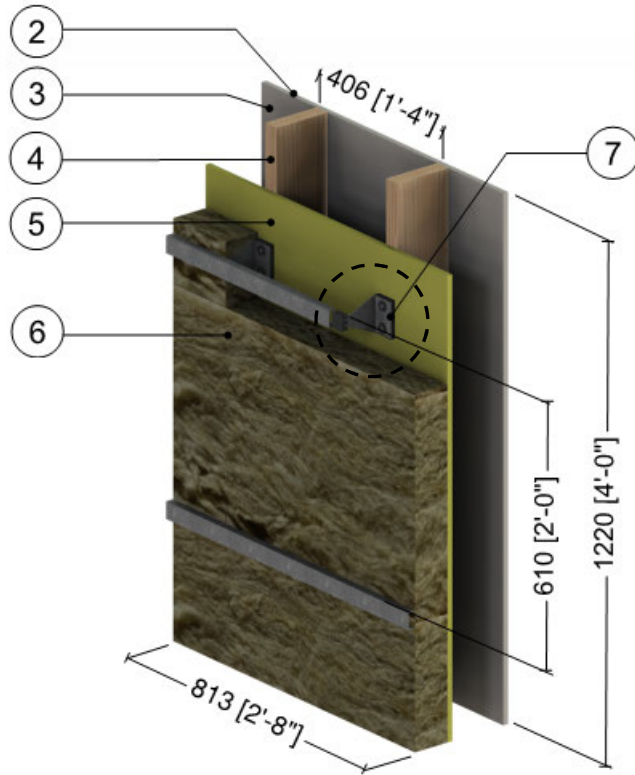



ThermaBracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.83 (0.12)	-	31 (500)	0.45 (1880)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.03)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	1.8 (28)	0.29 (1220)
7	ThermaBrackets (24" o.c. vertically)	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.6

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Knight MFI-System (24" o.c.) Supporting Cladding – Clear Wall

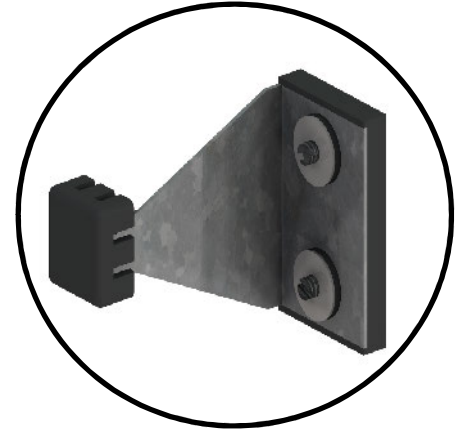
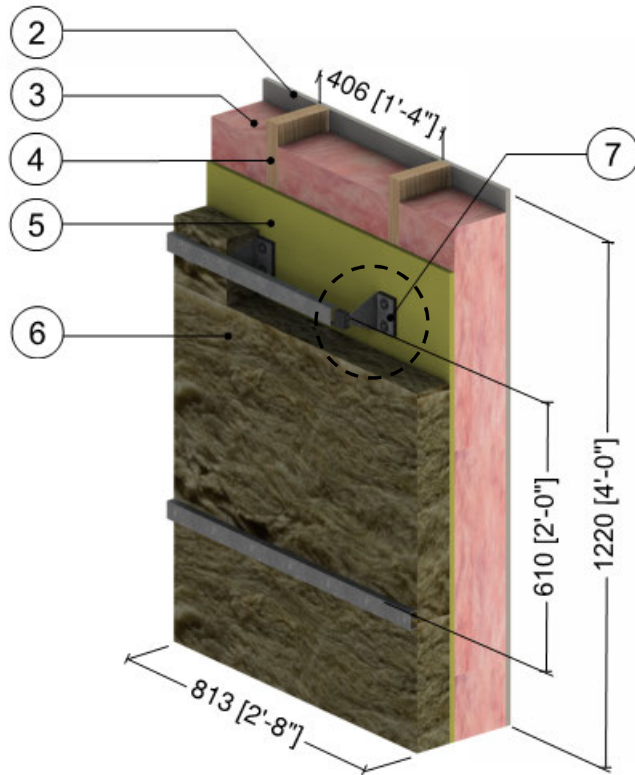


ThermaBracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.83 (0.12)	-	31 (500)	0.45 (1880)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	0.24 (0.03)	R-8.4 to R-25.2 (1.48 RSI to 4.44 RSI)	1.8 (28)	0.29 (1220)
7	ThermaBrackets (24" o.c. vertically)	18 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Metal Cladding with 1/2" vented airspace incorporated into exterior heat transfer coefficient					
9	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.1.7 Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Thermally Broken Aluminum Clip Rail System (24" o.c.) Supporting Cladding – Clear Wall

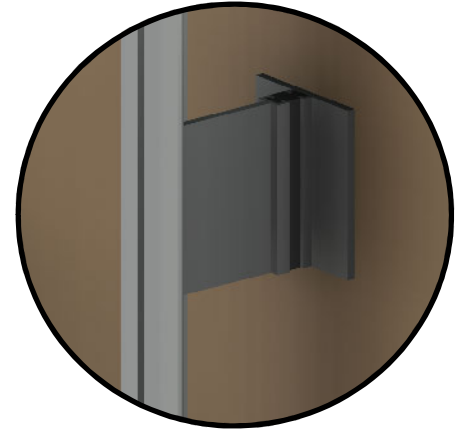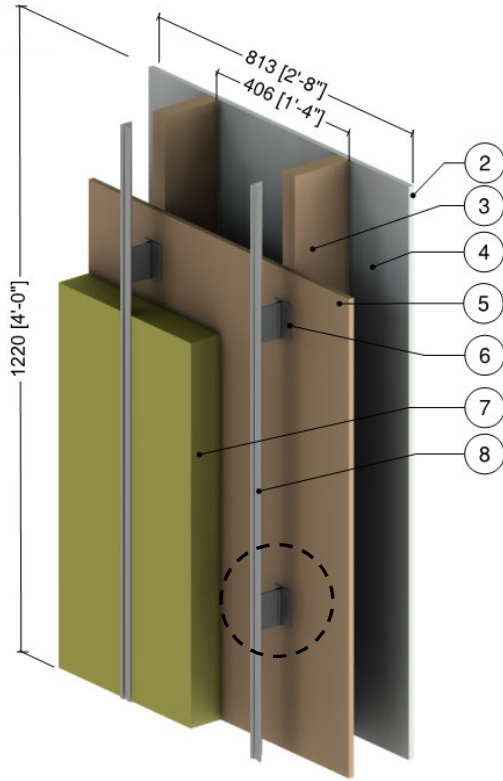


Clip Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.7 (0.10)	-	31 (500)	0.45 (1880)
4	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Wood Sheathing	1/2" (13)	0.7 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Longboard Aluminum Panel Clip	1/5" to 3/8" (5 to 10)	1109 (160)	-	-	-
7	Exterior Insulation	3" (76)	0.24 (0.03)	R-12.6 (2.22 RSI)	1.8 (28)	0.29 (1220)
8	Vertical Steel Girts	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Cladding with 1/2" (13mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.2.1

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Rim Joist and Floor Intersection without Metal Flashing Bypassing Exterior Insulation

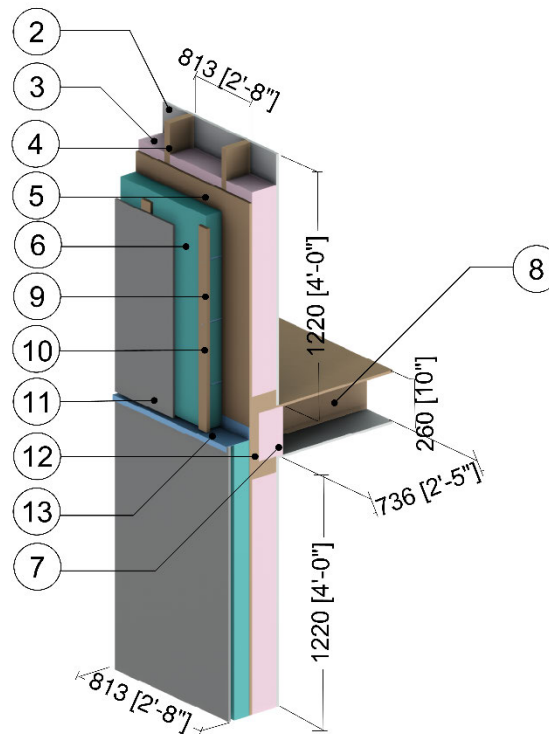


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Fiberglass Batt Insulation at Joist	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
8	2x10 Wood Joists (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	Wood Strapping (1" x 3")	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
10	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
11	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
12	2x10 Rim Board	1 1/2" (38)	0.69 (0.10)	-	31 (510)	0.45 (1880)
13	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
14	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.2.2

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Rim Joist and Floor Intersection with Metal Flashing Bypassing Exterior Insulation

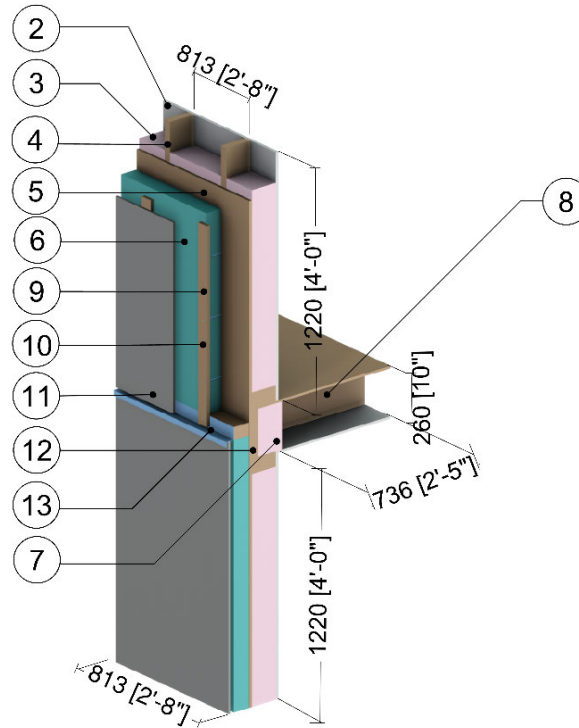


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Fiberglass Batt Insulation at Joist	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
8	2x10 Wood Joists (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
10	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
11	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
12	2x10 Rim Joist	1 1/2" (38)	0.69 (0.10)	-	31 (510)	0.45 (1880)
13	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
14	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.2.3

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board - Cantilevered Wood Joist Balcony Intersection

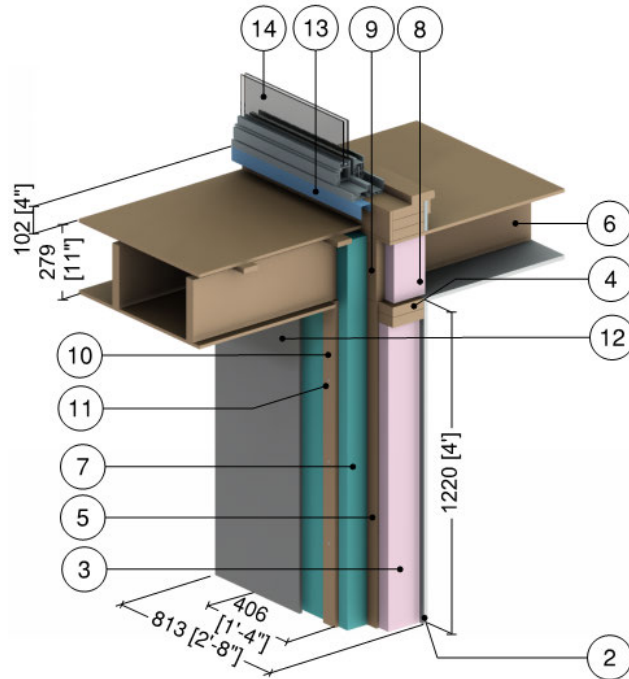


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" OC)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.26 (1090)
6	2x10 Wood Joist (16" OC)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
7	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
8	Fiberglass Batt Insulation at Joist	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
9	2x10 Rim Joist	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
10	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
11	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
12	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
13	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
14	Aluminum Sliding Door: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
15	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.2.4

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting Fiber Cement Board – Independently Supported Balcony Intersection

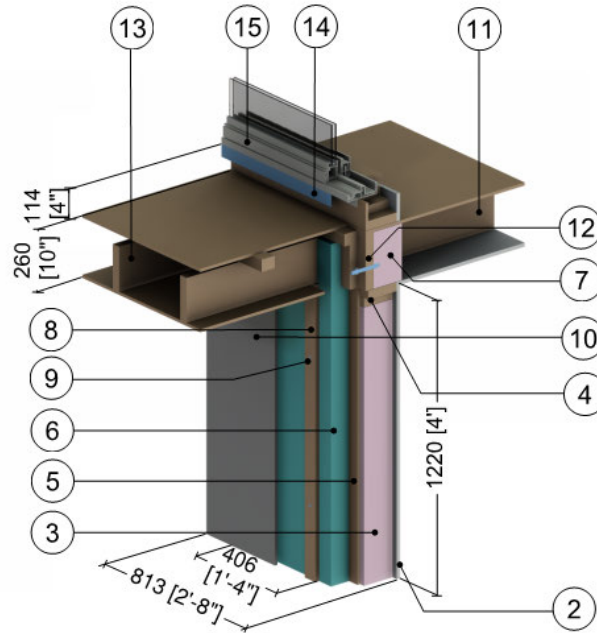



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)		31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Fiberglass Batt Insulation at Joist	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
8	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
11	2x10 Wood Joist (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	32 (510)	0.45 (1880)
12	2x10 Rim Joist	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
13	2x8 Wood Balcony Joists (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
14	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Aluminum Sliding Door: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
16	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077

Detail 7.2.5

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Cantilevered Floor Intersection

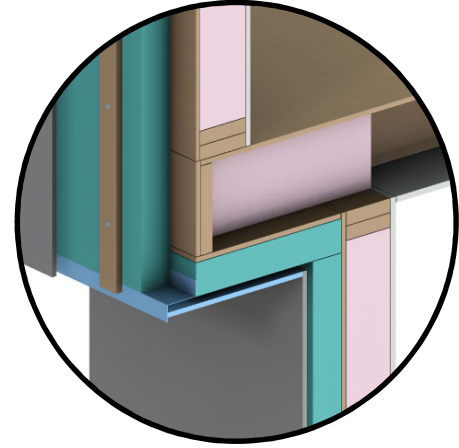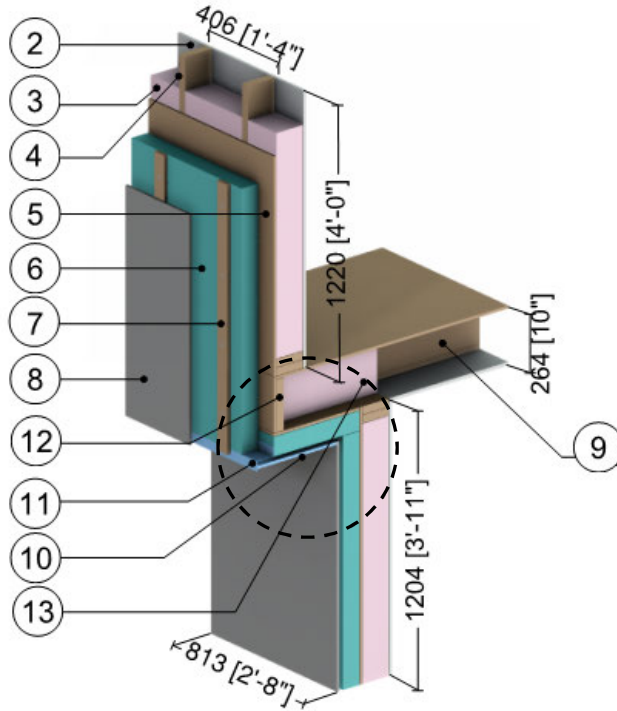



Soffit/Intersection Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	5/8" (16)	1.1 (0.16)	R-0.6 (0.20 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	5/8" (16)	0.69 (0.10)	R-0.6 (0.10 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	0.24 (0.0343)	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
9	2x10 Wood Joist (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
10	Vented Aluminum Soffit Panel is incorporated into the exterior heat transfer coefficient					
11	Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	2x10 Rim Joist	1 1/2"	0.69 (0.10)	-	31 (500)	0.45 (1880)
13	Fiberglass Batt Insulation in Floor	9 1/4" (235)	0.33 (0.048)	R-28 (4.9 RSI)	0.9 (14)	0.17 (710)
14	Exterior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.3.1

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vinyl Window Intersection

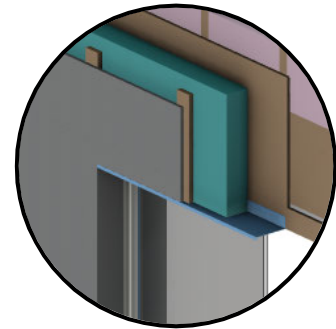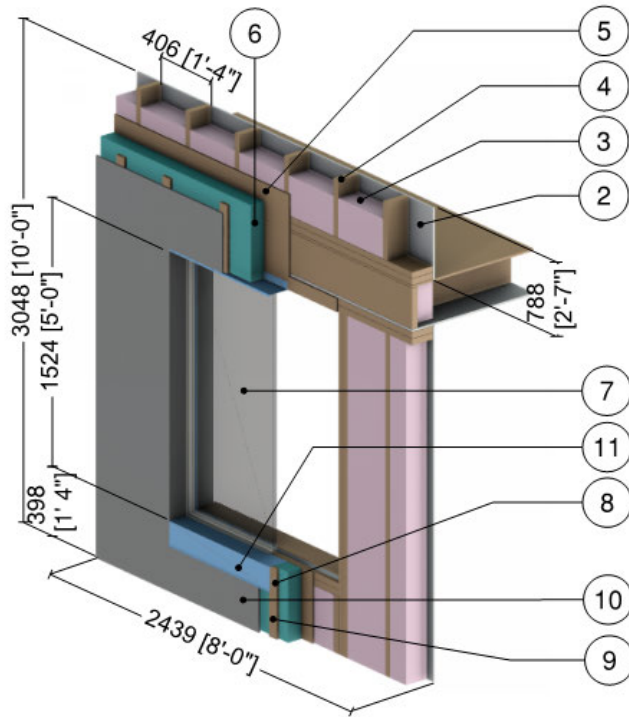

Head and Jamb Detail

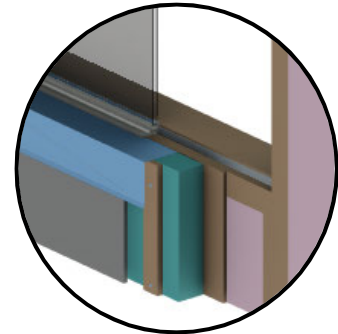

Sill Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (16)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	5' (1.5m) x 6' (1.8m) Vinyl window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
8	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	430 (50)	-	489 (7830)	0.12 (500)
10	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Aluminum Flashing	18 Gauge	1109 (160)	-	171(2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity for air spaces within window framing was found using ISO 10077-2

Detail 7.3.2

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Aluminum Window Intersection

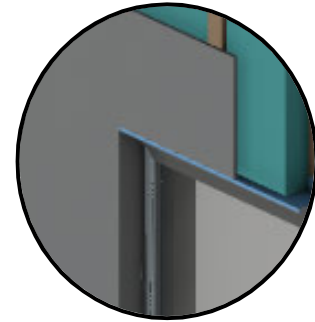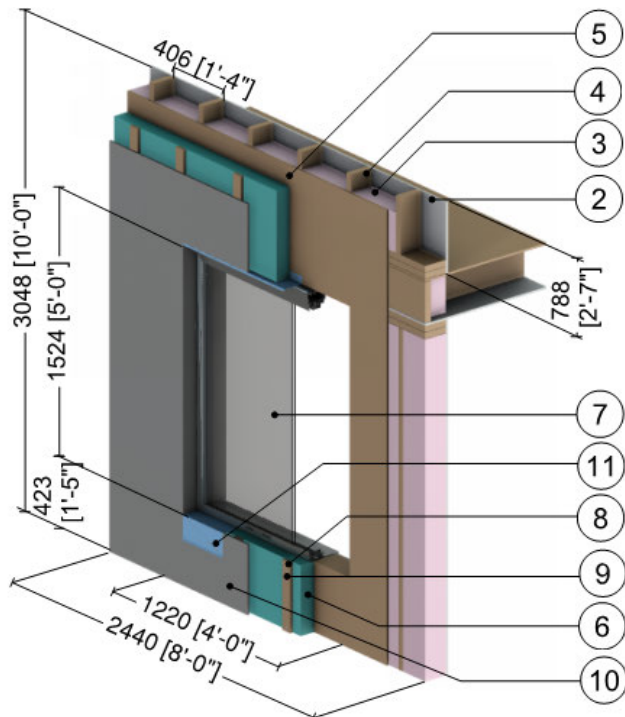

Head and Jamb Detail

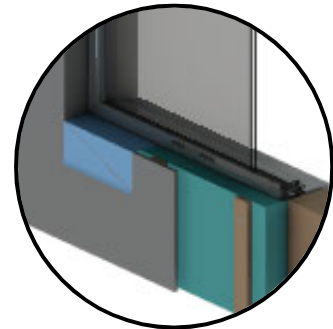

Sill Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	-	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	5' (1.5m) x 6' (1.8m) Aluminum window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr.ft ² ·°F (1.82 W/m ² K)					
8	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
10	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Aluminum Flashing	18 Gauge	1109 (160)	-	171(2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity for air spaces within window framing was found using ISO 10077-2

Detail 7.3.3

Exterior and Interior Insulated 2x6 Wood Stud (8" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vinyl Window Intersection

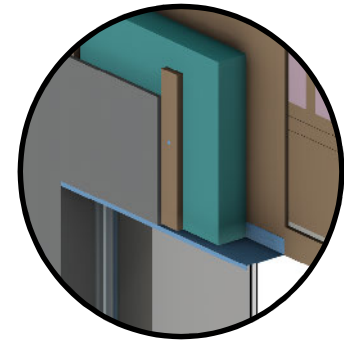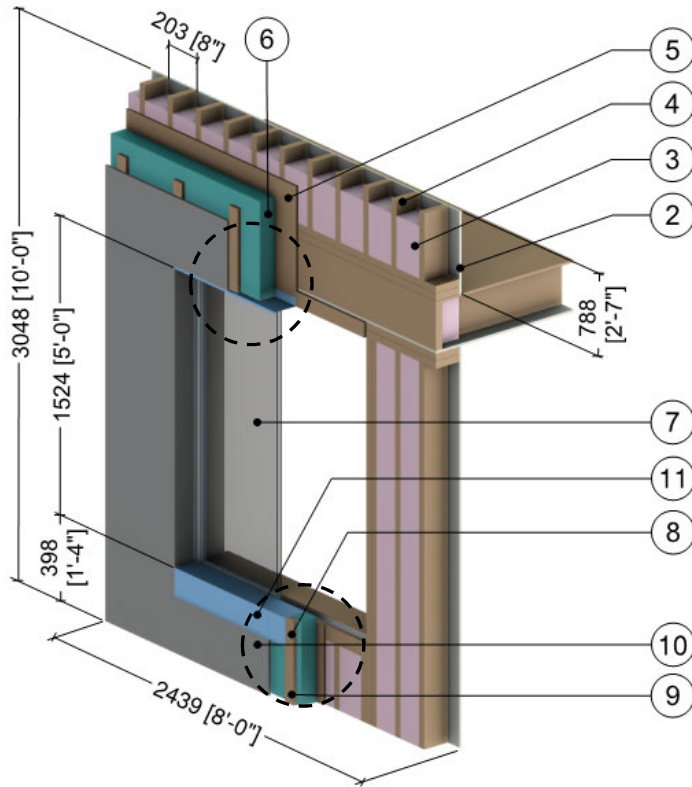

Head and Jamb Detail

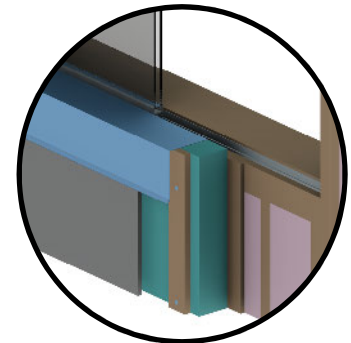

Sill Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.9 to R-1.1 (0.16 RSI to 0.2 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (8" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (16)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	5' (1.5m) x 6' (1.8m) Vinyl window: double glazed & thermally broken ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
8	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	#14 Steel Fasteners (16" o.c.)	0.35" (9) ∅	347 (50)	-	489 (7830)	0.12 (500)
10	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Aluminum Flashing	18 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.3.4

Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed Flange Mounted Vinyl Window Intersection with Window Positioned in Wood Framing

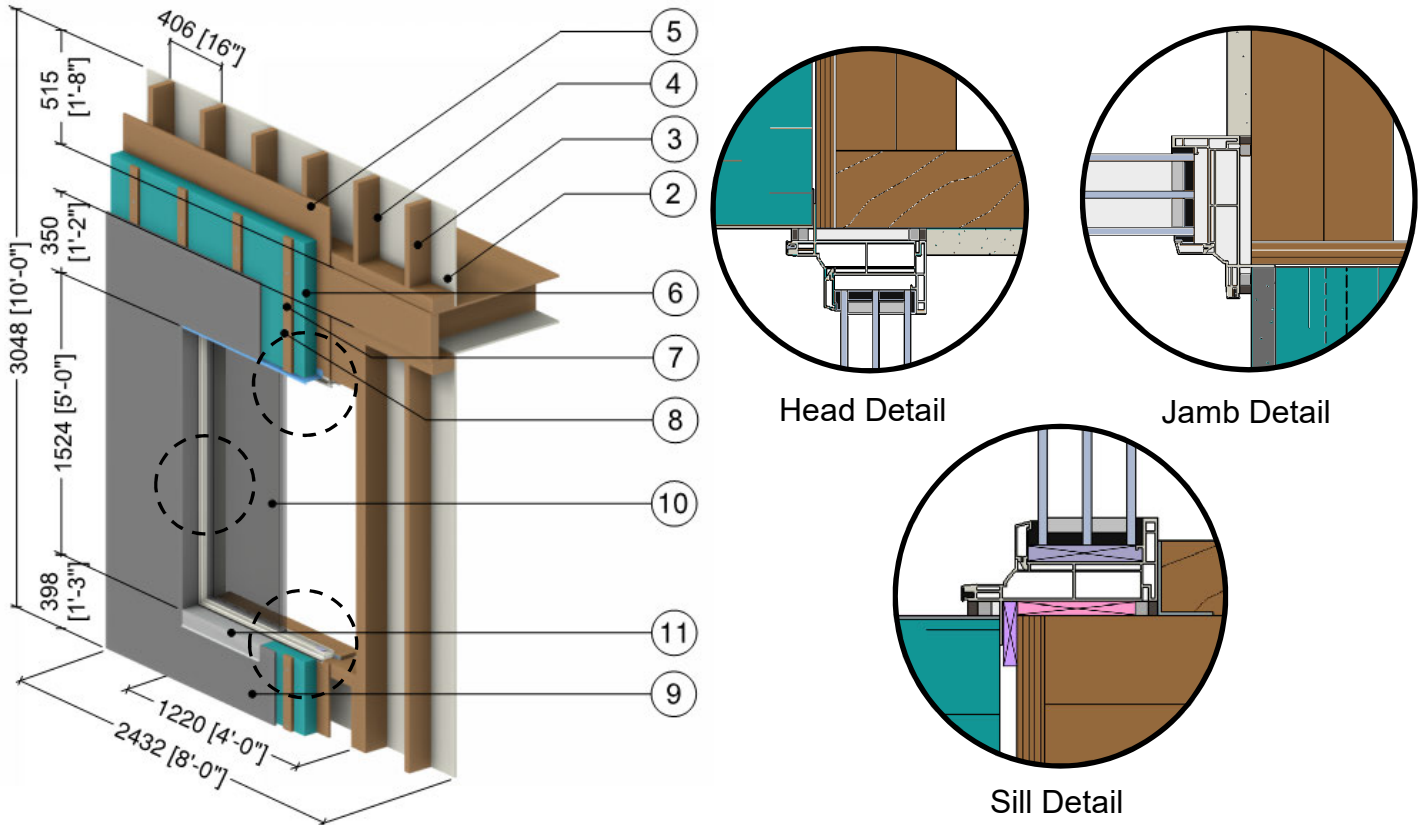


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Vinyl window: triple glazed ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² .°F (0.81 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.3.5

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed Flange Mounted Vinyl Window Intersection with Window Positioned in Wood Framing

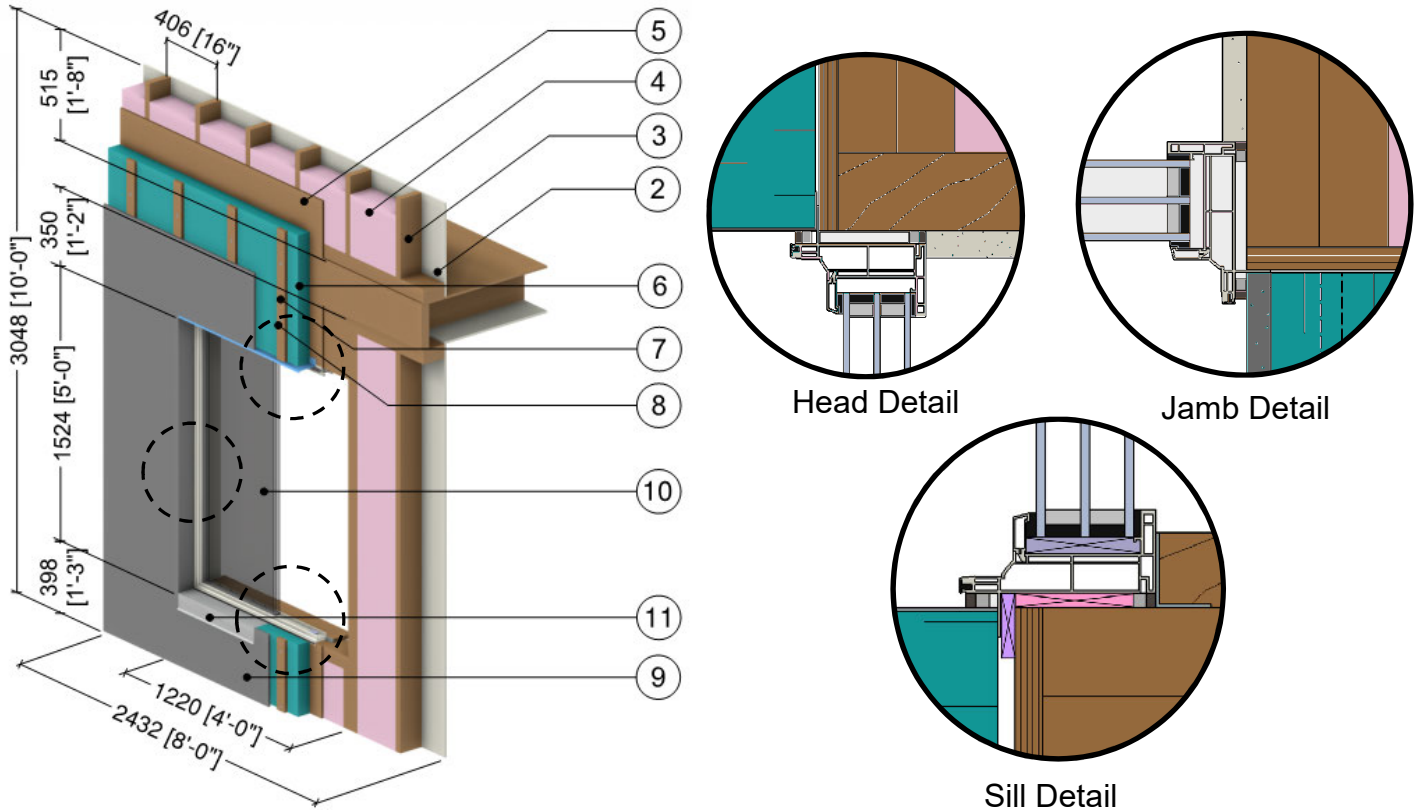


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Fiberglass Batt Insulation	5 1/2" (140)	-	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Vinyl window: triple glazed ² , IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.3.6

Exterior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping (16" o.c.) and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed High Performance Vinyl Window Intersection (Insulated Frames)

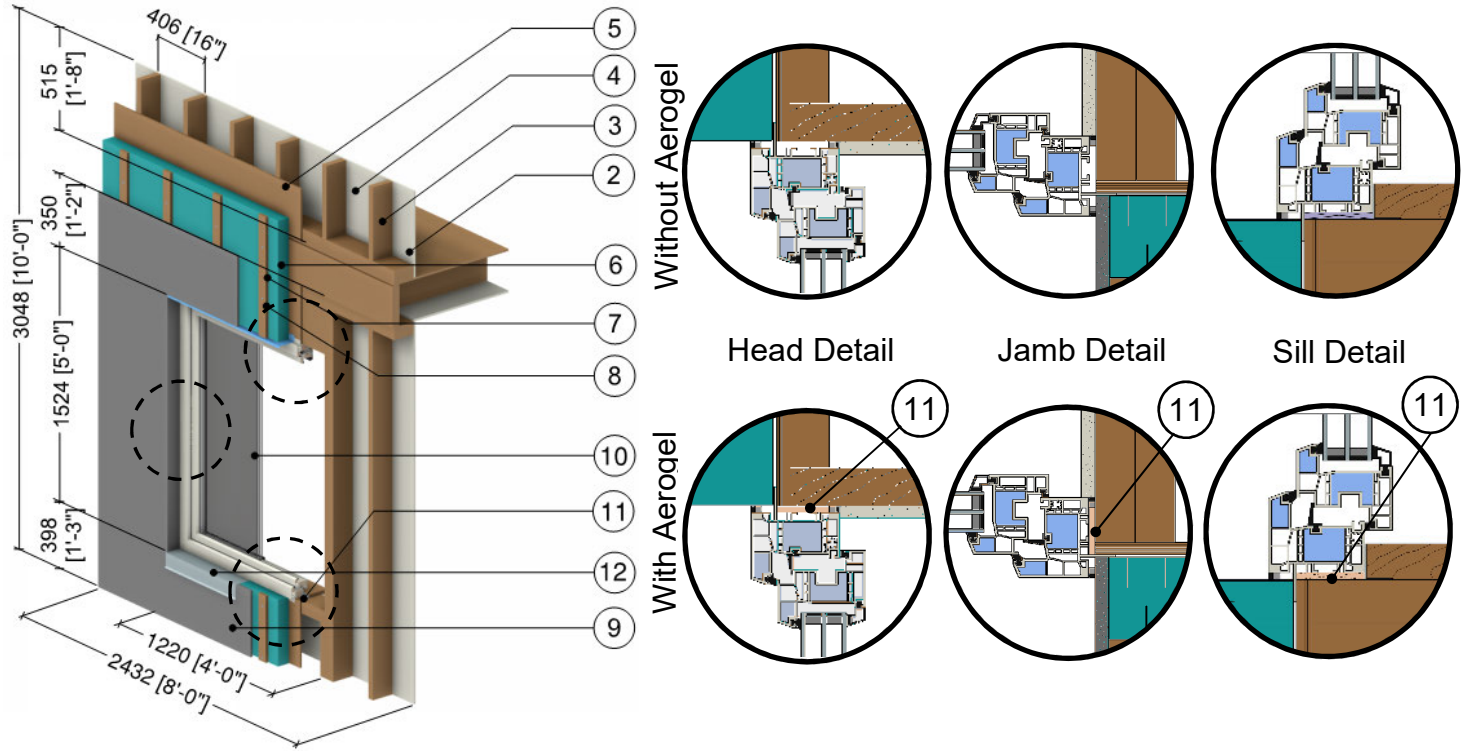


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Air in Stud Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Vinyl window (Passive House certified) ² : triple glazed, IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.3.7

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping (16" o.c.) and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Triple Glazed High Performance Vinyl Window Intersection (Insulated Frames)

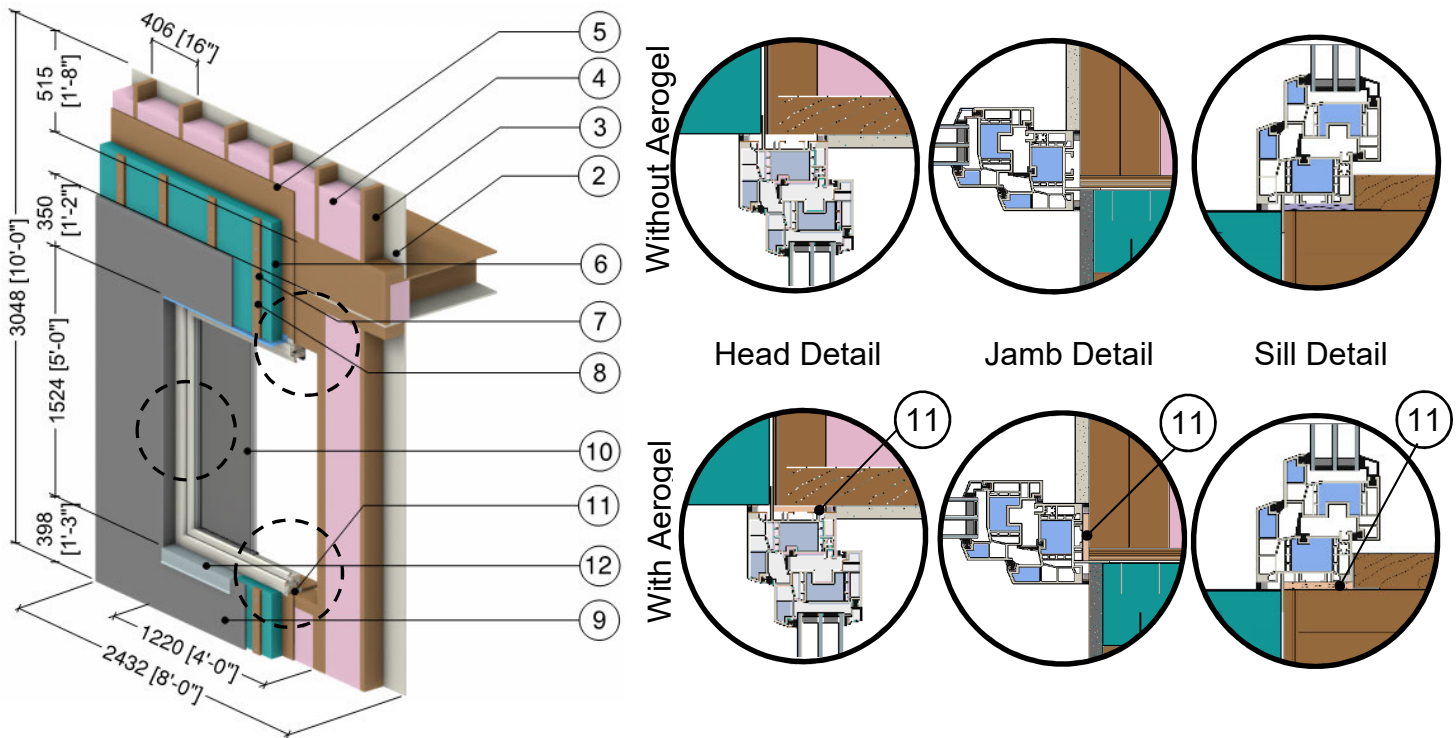


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Fiberglass Batt Insulation	5 1/2" (140)	-	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-10 to R-25 (1.76 RSI to 4.40 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) ∅	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented air space is incorporated into exterior heat transfer coefficient					
10	5' (1.5m) x 4' (1.2m) Vinyl window (Passive House certified) ² : triple glazed, IGU U _{IGU} = 0.14 BTU/hr.ft ² ·°F (0.81 W/m ² K)					
11	Aerogel Blanket	0.4" (10)	0.086 (0.015)	R-3.8 (0.67 RSI)	-	-
12	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.4.1

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Vented Low-slope Roof & Parapet Intersection

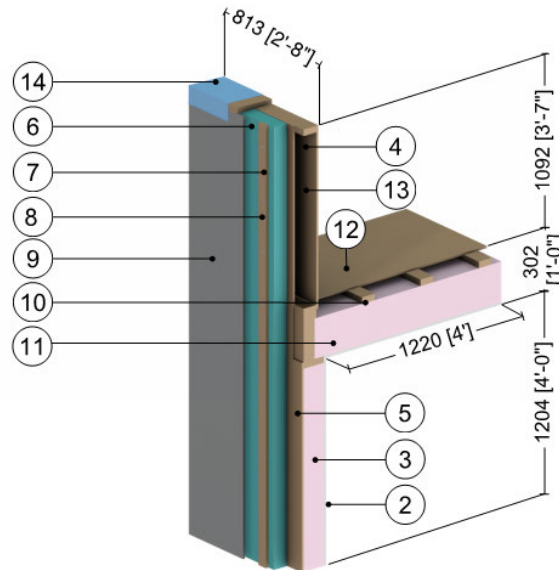


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	3 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-15 (0.00 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Roof Wood Framing	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
11	Fiberglass Roof Insulation	9 1/4" (235)	0.3 (0.04)	R-30 (5.28 RSI)	0.9 (14)	0.17 (710)
12	Roof Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
13	Air Cavity	3 1/2" (89)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
14	Steel Cap Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
Flashing & roof material are incorporated into exterior heat transfer coefficient						
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.4.2

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Sloped Wood Framed Roof & Wall Intersection with Insulation at Ceiling

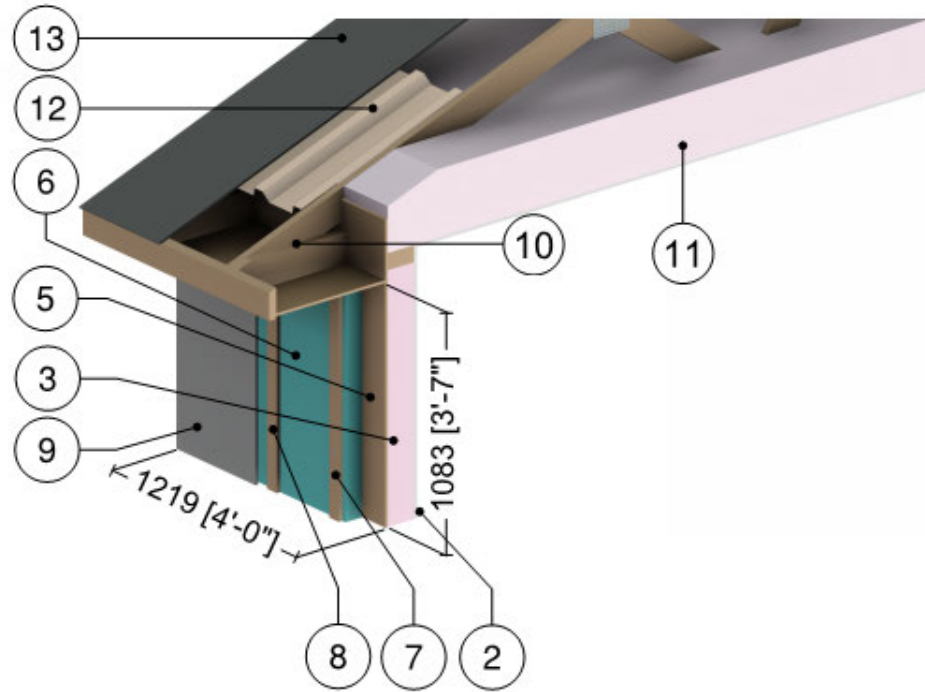


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.12 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-15 (0.00 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Roof Truss (24" o.c.)	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
11	Attic Insulation	9" (228)	0.29 (0.042)	R-30 (5.3 RSI)	0.9 (14)	0.17 (710)
12	Roof Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
13	Asphalt Shingles	-	-	R-0.45 (0.08 RSI)	57 (920)	0.3 (1260)
14	Exterior Film (left side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.4.3


Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping and Continuous Insulation Supporting Rainscreen Fiber Cement Board – Sloped Wood Framed Roof & Wall Intersection with Insulation at Roof Sheathing

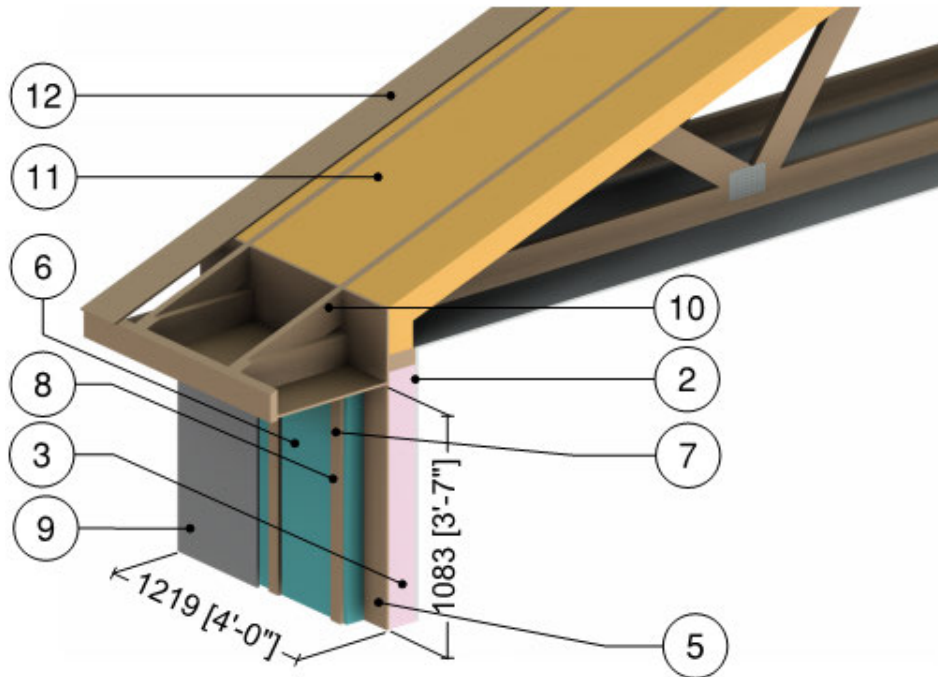

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.12 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	R-7.9 (1.4 RSI)	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-15 (0.00 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Roof Truss (24" o.c.)	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
11	Polyurethane Foam Insulation	5" (127)	0.17 (0.024)	R-30 (5.3 RSI)	1.8 (28)	0.29 (1220)
12	Roof Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
13	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.4.4 | Ventilated Wood Frame Low Slope Roof - Masonry Firewall Intersection

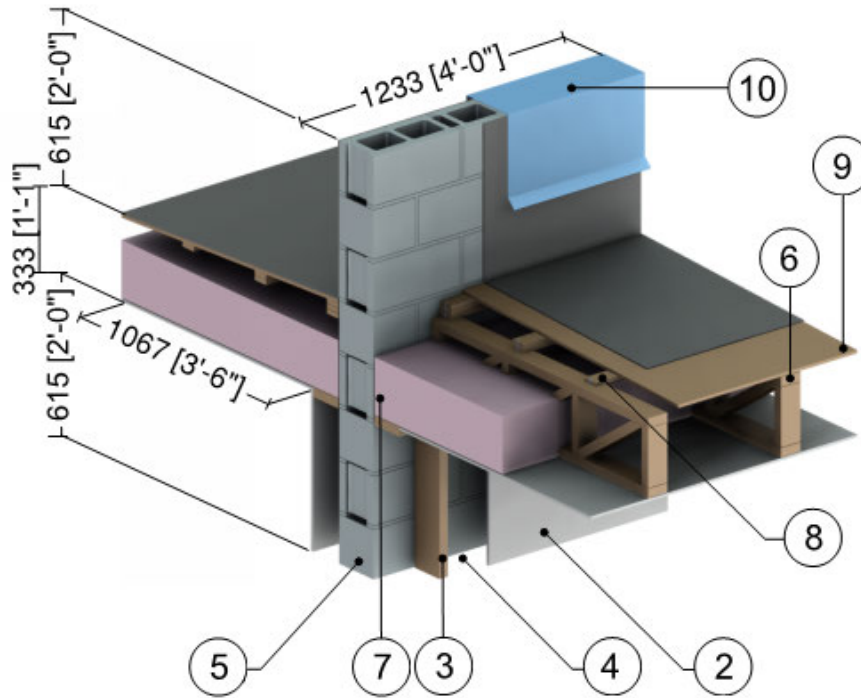


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Studs (16" o.c.) and Top Plate	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Air Cavity	5 1/2" (140)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
5	Standard Concrete Block	8" (203)	3.5 (0.5)	-	119 (1900)	0.19 (800)
6	2x4 Parallel Wood Truss	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
7	Roof Insulation	8 3/4" (222)	0.29 (0.04)	R-30 (5.3 RSI)	0.9 (14)	0.17 (710)
8	Wood Purlins (16" o.c.)	-	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	Roof Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.6 (0.10 RSI)	50 (800)	0.26 (1090)
10	Steel Cap Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 7.5.1


Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Wood Strapping Supporting and Continuous Insulation Fiber Cement Board – Corner Intersection

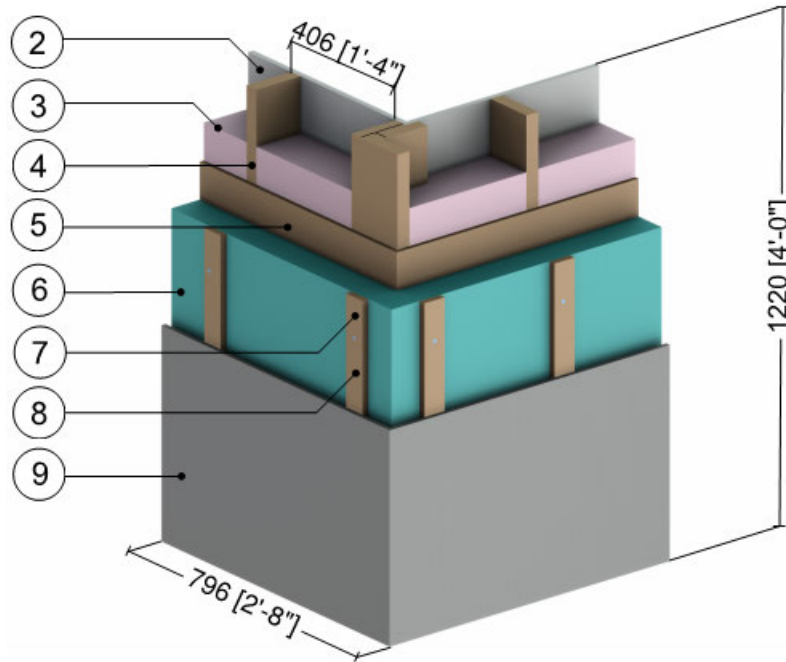

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (16)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (16)	0.69 (0.10)	R-0.6 (0.10 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-15 (0.00 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	-	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.6.1 Wood-frame Sliding Door – Concrete Floor Intersection for Unheated Spaces (Parking Garages)

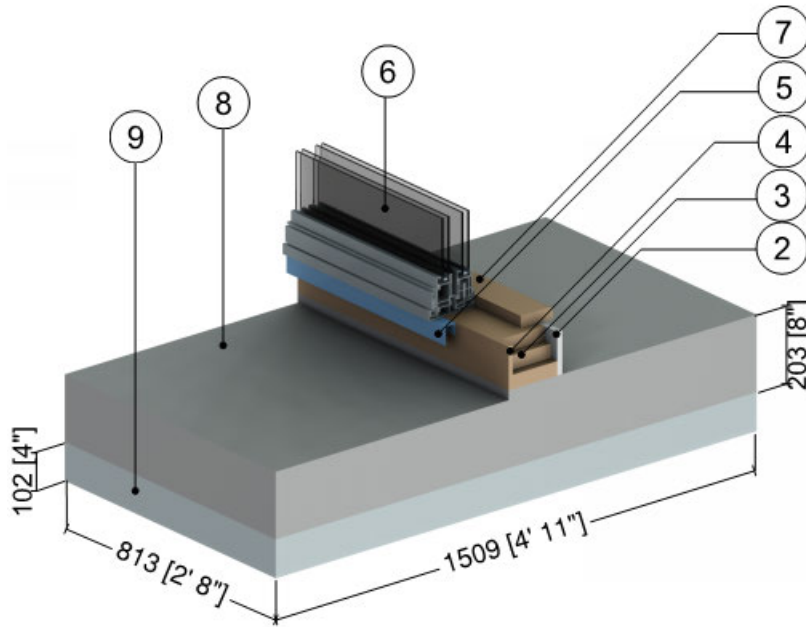


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 (0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	2x6 Wood Plates	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
4	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.26 (1090)
5	Steel Flashing	28 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Aluminum Sliding Door: double glazed and thermally broken ² , double glazed IGU UIGU = 0.32 BTU/hr.ft ² .°F (1.82 W/m ² K)					
7	Wood Sill	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	141 (2250)	0.20 (850)
9	Spray Applied Fiberglass insulation	4" (102)	0.20 (0.029)	R-20 (3.5 RSI)	0.9 (14)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity for air spaces within window framing was found using ISO 10077-2

Detail 7.6.2

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Insulation and Wood Strapping Supporting Fiber Cement Board – Rim Joist and Interior Insulated At-Grade Foundation Wall Intersection

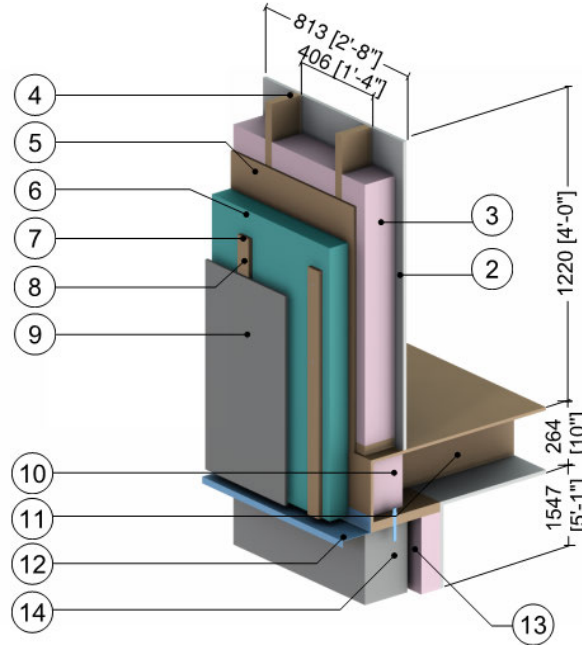


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Fiberglass Batt Insulation at Joist	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
11	2x10 Wood Joist (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
12	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	2x4 Wood Stud (16" o.c.)	3 1/2" (89)	0.69 (0.10)	-	31 (500)	0.45 (1880)
14	Concrete Foundation Wall	8" (203)	12.5 (1.8)	R-0.6 (0.11 RSI)	140 (2250)	0.20 (850)
15	Exterior Film ^{1,2}	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² Except at foundation wall adjacent soil

Detail 7.6.3

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Continuous Insulation and Wood Strapping Supporting Fiber Cement Board – Rim Joist and Exterior Insulated At-Grade Foundation Wall Intersection

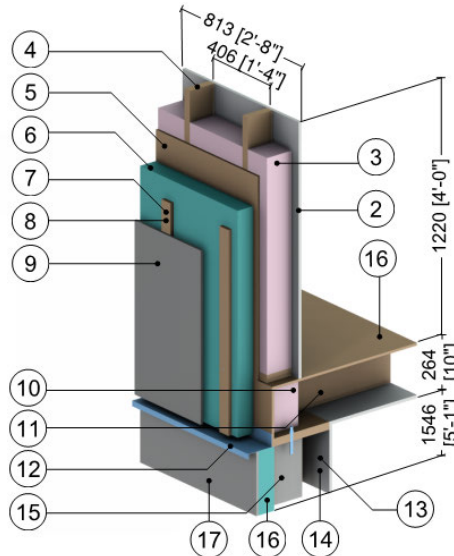


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.5 (0.08 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
8	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
9	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
10	Fiberglass Batt Insulation at Joists	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
11	2x10 Wood Joists (16" o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
12	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
13	2x4 Wood Stud (16" OC)	3 1/2" (89)	0.69 (0.10)	-	31 (500)	0.45 (1880)
14	Air Cavity	3 1/2" (89)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
15	Concrete Foundation Wall	8" (203)	12.5 (1.8)	R-0.6 (0.11 RSI)	140 (2250)	0.20 (850)
16	Rigid Exterior Insulation	2 1/2" (64)	-	R-12.5 (2.2 RSI)	1.8 (28)	0.29 (1220)
17	Protective Coating or Flashing	-	-	-	-	-
18	Exterior Film ^{1,2}	-	-	R-0.7 (0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² Except at foundation wall adjacent soil

Detail 7.6.4

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Exterior Insulated At-Grade Foundation Wall Intersection

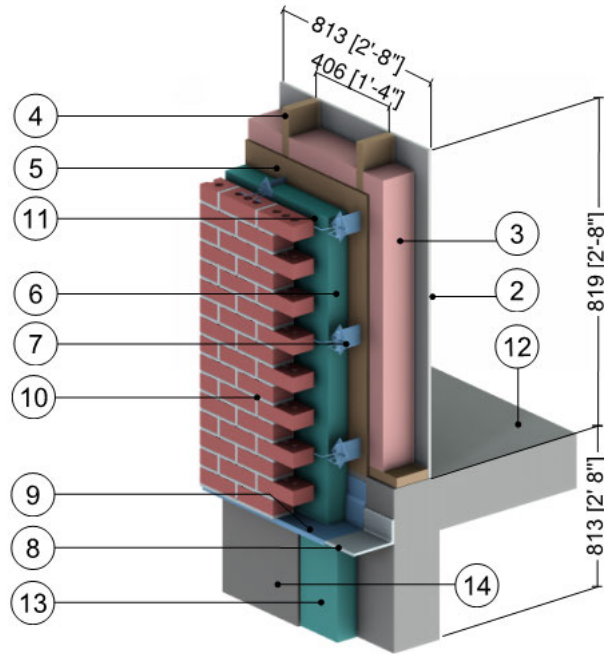



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.7 to R-0.9 (0.12 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.04)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.) with Bottom Plate	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (16)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Masonry Ties @ 16" (406) o.c.	14 Gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Steel Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
9	Steel Flashing	20 Gauge	347 (50)	-	489 (7830)	0.12 (500)
10	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	120 (1920)	0.19 (720)
11	Air Cavity	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
12	Concrete Slab & Foundation Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Rigid Exterior Insulation	2 1/2" (64)	0.2 (0.03)	R-12.5 (2.2 RSI)	1.8 (28)	0.29 (1220)
14	Protective Coating or Flashing	-	-	-	-	-
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² Except at foundation wall adjacent soil

Detail 7.6.5

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Shelf Angle & Brick Ties Supporting Brick Veneer – Rim Joist and Floor Intersection

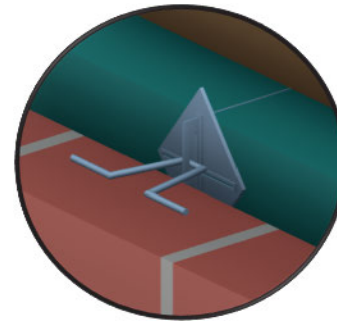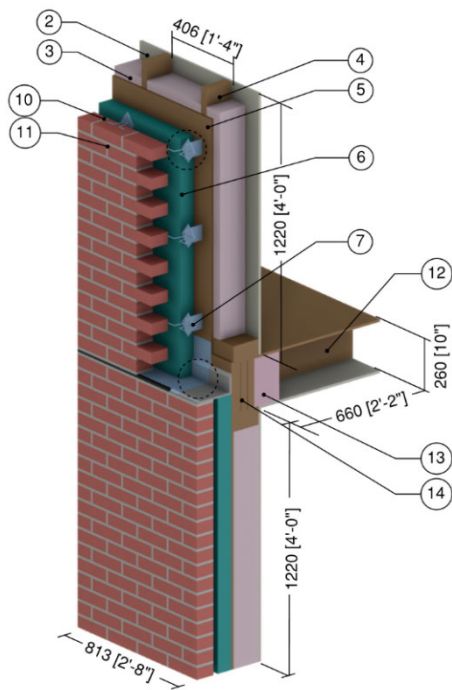

Brick Tie Detail

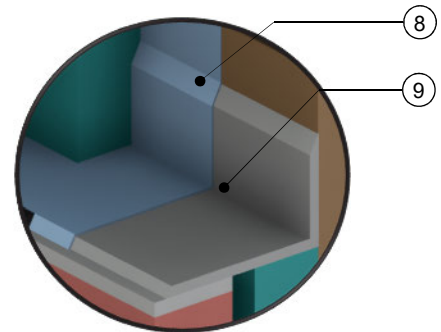

Shelf Angle Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation in Stud Cavity	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.13 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-10 (0.00 RSI to 1.76 RSI)	1.8 (28)	0.29 (1220)
7	Brick Ties	14 gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Flashing	20 gauge	347 (50)	-	489 (7830)	0.12 (500)
9	Steel Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Air Cavity ²	1" (25)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
11	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	140 (2250)	0.20 (850)
12	2x10 Wood Joists (16"o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
13	Fiberglass Batt Insulation at Joists	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
14	2x10 Rim Joist	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
15	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2




Detail 7.6.6

Exterior and Interior Insulated 2x6 Wood Stud (16" o.c.) Wall Assembly with Stand-off (Knife Plate) Shelf Angle & Brick Ties Supporting Brick Veneer – Rim Joist and Floor Intersection

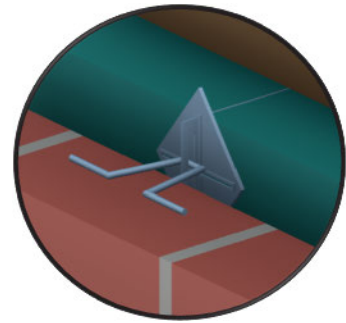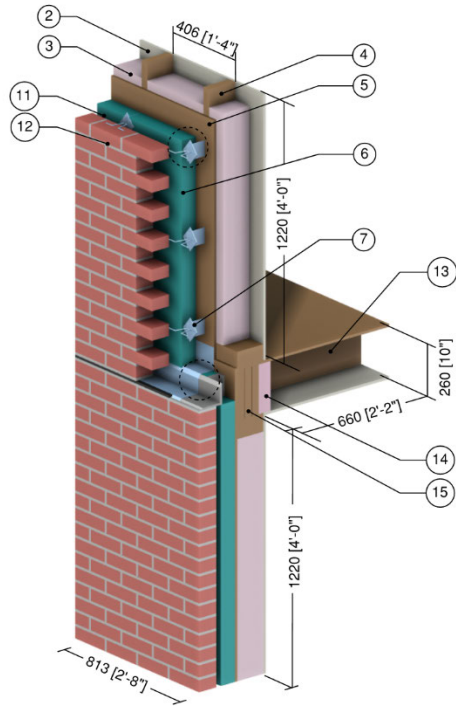

Brick Tie Detail

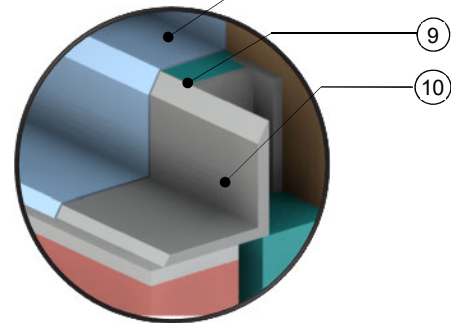

Shelf Angle Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation in Stud Cavity	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Plywood Sheathing	1/2" (13)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-0 to R-10 (0.00 RSI to 1.76 RSI)	1.8 (28)	0.29 (1220)
7	Brick Ties	14 gauge	347 (50)	-	489 (7830)	0.12 (500)
8	Exterior Insulation Behind Shelf Angle	Varies	-	R-0 to R-10 (0.00 RSI to 1.76 RSI)	1.8 (28)	0.29 (1220)
9	Flashing	20 gauge	347 (50)	-	489 (7830)	0.12 (500)
10	Spteel Shelf Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
11	Air Cavity ²	1" (25)	-	R-0.9 (0.16RSI)	0.075 (1.2)	0.24 (1000)
12	Brick Veneer	3 5/8" (92)	5.4 (0.78)	-	140 (2250)	0.20 (850)
13	2x10 Wood Joists (16"o.c.)	9 1/4" (235)	0.69 (0.10)	-	31 (500)	0.45 (1880)
14	Fiberglass Batt Insulation at Joists	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
15	2x10 Rim Joist	1 1/2" (38)	0.69 (0.10)	-	31 (500)	0.45 (1880)
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 7.7.1

Exterior Insulated Wood Infill Wall Assembly with Wood Strapping and Continuous Insulation Supporting Fiber Cement Board – Concrete Wall and Intermediate Floor Intersection with Flashing Bypassing Exterior Insulation

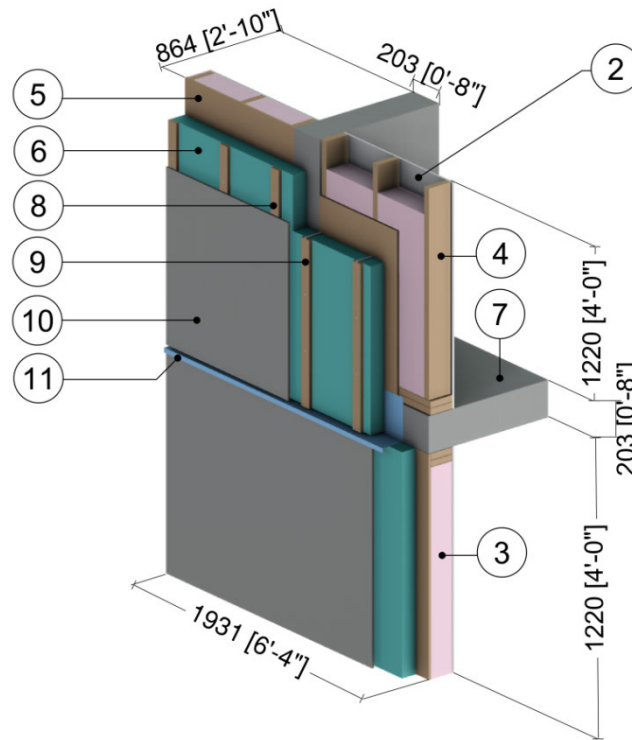


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	5 1/2" (140)	0.29 (0.042)	R-19 (3.3 RSI)	0.9 (14)	0.17 (710)
4	2x6 Wood Stud (16" o.c.)	5 1/2" (140)	0.69 (0.10)	-	31 (500)	0.45 (1880)
5	Exterior Wood Sheathing	1/2" (13)	0.69 (0.10)	R-0.7 (0.12 RSI)	31 (500)	0.45 (1880)
6	Exterior Insulation	Varies	-	R-5 to R-15 (0.88 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Concrete Wall & Floor Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347(50)	-	489 (7830)	0.12 (500)
10	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
11	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 7.7.2

Exterior Insulated Cross Laminated Timber (CLT) Wall Assembly with Wood Strapping and Continuous Rigid Insulation Supporting Fiber Cement Board – Cross Laminated Timber Floor Intersection with Flashing Bypassing Exterior Insulation

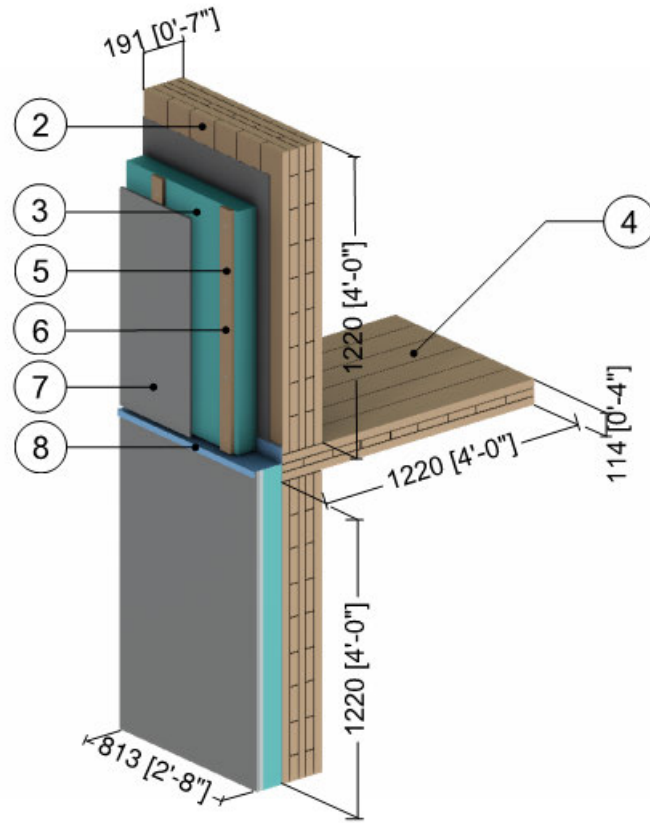

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Cross Laminated Timber Wall	7 1/2" (191)	0.83 (0.12)	R-9 (1.59 RSI)	31 (500)	0.45 (1880)
3	Exterior Insulation	Varies	-	R-15 to R-25 (2.64 RSI to 4.4 RSI)	1.8 (28)	0.29 (1220)
4	Cross Laminated Timber Floor	4 1/2" (114)	0.83 (0.12)	R-5.4 (0.95 RSI)	31 (500)	0.45 (1880)
5	1x3 Wood Strapping	3/4" (19)	0.69 (0.10)	-	31 (500)	0.45 (1880)
6	#14 Steel Fasteners (16" o.c.)	0.35" (9) Ø	347 (50)	-	489 (7830)	0.12 (500)
7	Fiber Cement Board Cladding with 3/4" (19mm) vented airspace incorporated into exterior heat transfer coefficient					
8	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Galvanized Steel L-clips	3/8" (9.5)	430 (62)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

8.0 Doors and Balconies

Detail 8.1.1	A.8.1
Interior Insulated Concrete Curb at Sliding Door Sill and Window Head – Intermediate Floor Intersection	
Detail 8.1.2	A.8.2
Exterior Insulated Concrete Curb at Sliding Door Sill and Window Head – Intermediate Floor Intersection	
Detail 8.1.3	A.8.3
Interior Insulated Concrete Curb – Window-Wall and Intermediate Floor Intersection	
Detail 8.1.4	A.8.4
Exterior Insulated Concrete Curb at Sliding Door Sill and Head- Intermediate Floor Intersection	
Detail 8.1.5	A.8.5
Exterior Insulated Concrete Curb – Window-Wall and Recessed Intermediate Floor Intersection	
Detail 8.1.6	A.8.6
Window Wall System with Spandrel Panels and Sliding Door - Concrete Balcony and Curb Intersection	
Detail 8.1.7	A.8.7
Window-wall with Sliding Door and Insulated Spandrel Section – Concrete Intermediate Floor Intersection without Concrete Curb for Alternative Balcony Slab Connections	
Detail 8.1.8	A.8.8
Window Wall System with Spandrel Panels and Sliding Door - Thermally Broken Concrete Balcony and Curb Intersection	
Detail 8.1.9	A.8.9
Window Wall System with Spandrel Panels - Concrete Balcony and Bypass Intersection	
Detail 8.1.10	A.8.10
Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly - Door Sill with Exterior Slab Insulation	
Detail 8.1.11	A.8.11
Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly - Door Sill with Exterior Slab Insulation	

Detail 8.1.1

Interior Insulated Concrete Curb at Sliding Door Sill and Window Head – Intermediate Floor Intersection

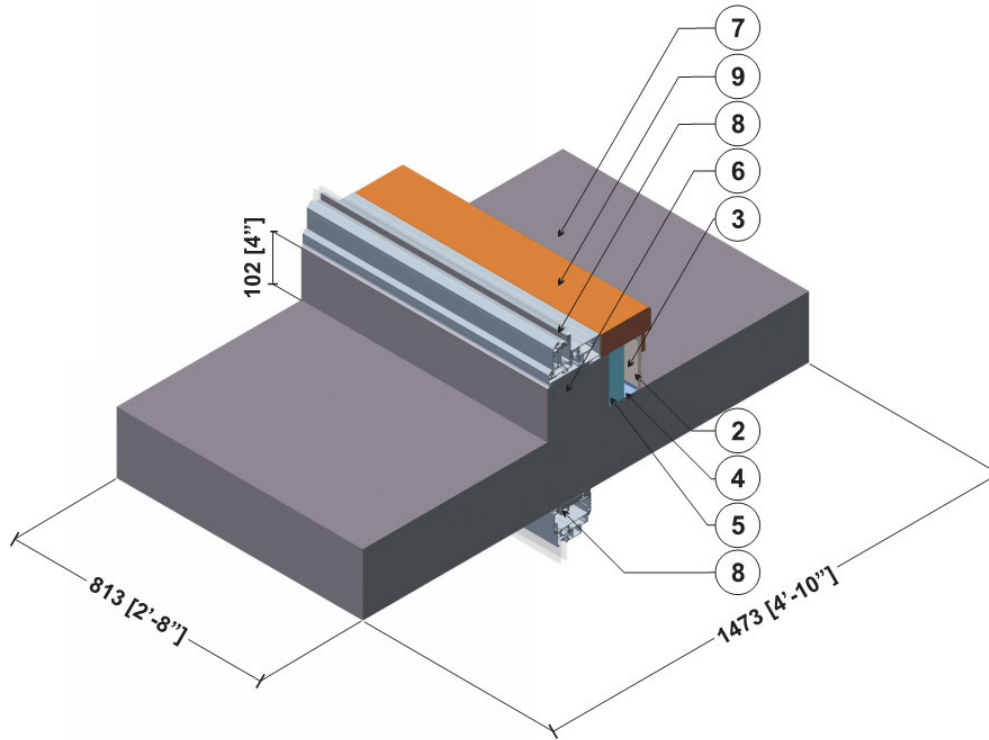


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air in Stud Cavity	2 5/8" (67)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	2 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Interior Insulation	2" (50)	-	R-10 (1.8 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Thermally Broken Aluminum Window & Sliding Door ²					
9	Wood Sill	2" (50)	0.63 (0.09)	-	1.8 (28)	0.29 (1220)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door and window framing was found using ISO 10077-2.

Detail 8.1.2

Exterior Insulated Concrete Curb at Sliding Door Sill and Window Head – Intermediate Floor Intersection

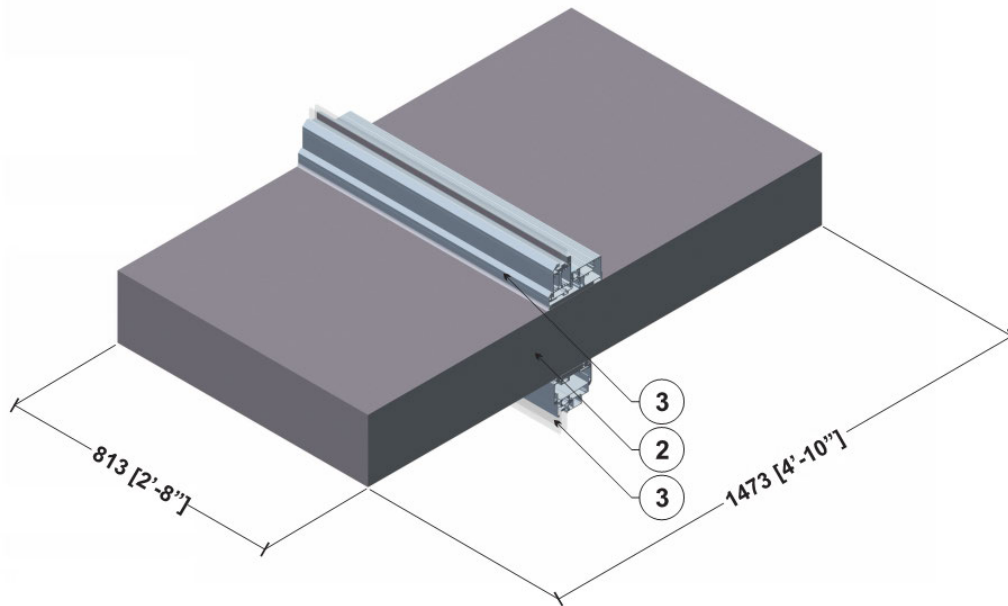



ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Thermally Broken Aluminum Window & Sliding Door ²					
4	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door and window framing was found using ISO 10077-2.

Detail 8.1.3

Interior Insulated Concrete Curb – Window-Wall and Intermediate Floor Intersection

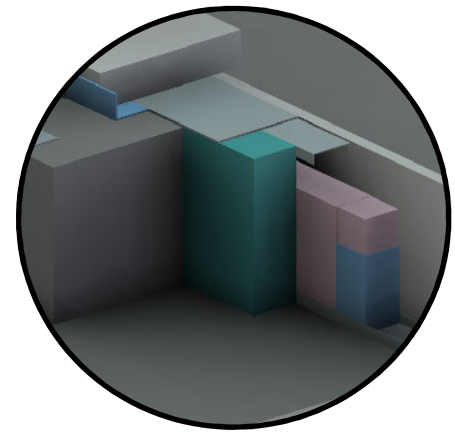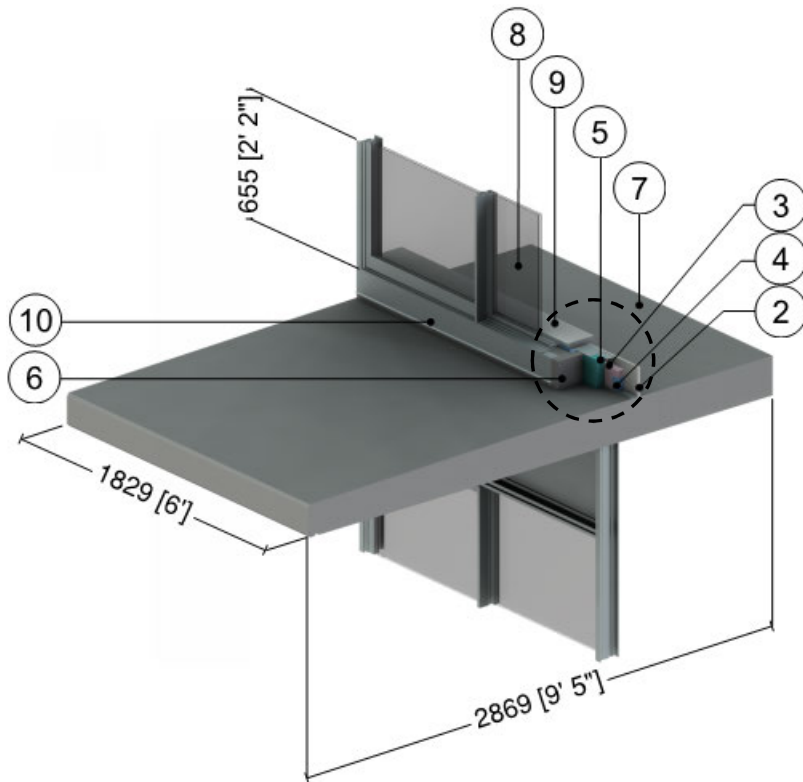



Curb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	1 5/8" (41)	0.29 (0.042)	R-5.5 (0.98 RSI)	0.9 (14)	0.17 (710)
4	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Continuous Rigid Insulation	2" (51)	0.24 (0.034)	R-10 (1.76 RSI)	1.8 (28)	0.29 (1220)
6	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
8	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
9	Wood Sill	2" (50)	0.69 (0.10)	-	31 (500)	0.45 (1880)
10	Steel Flashing	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door framing was found using ISO 10077-2

Detail 8.1.4 Exterior Insulated Concrete Curb at Sliding Door Sill and Head-Intermediate Floor Intersection

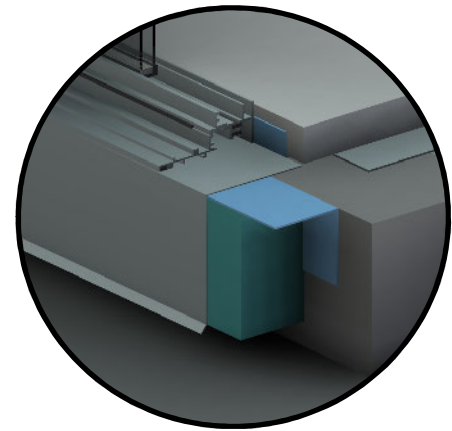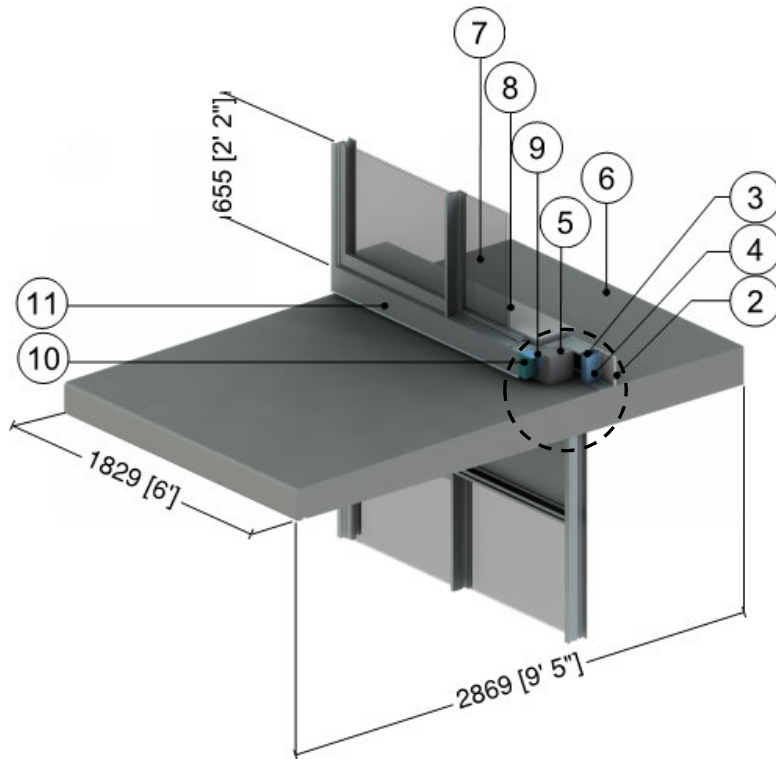

Curb Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air In Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
8	Wood Sill	2" (50)	0.69 (0.1)	-	31 (500)	0.45 (1880)
9	Support Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
11	Steel Flashing	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door framing was found using ISO 10077-2

Detail 8.1.5

Exterior Insulated Concrete Curb – Window-Wall and Recessed Intermediate Floor Intersection

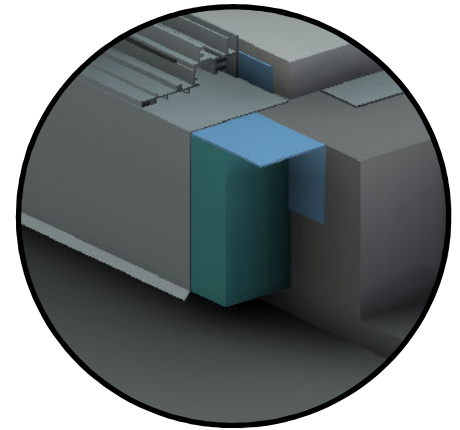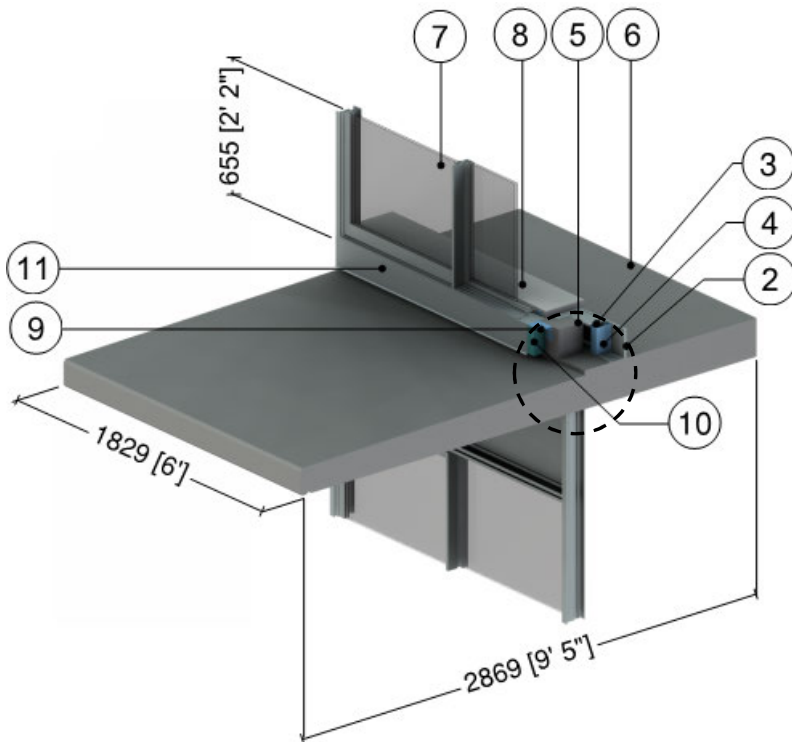


Curb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.9 (0.11 RSI to 0.16 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Air In Stud Cavity	3 5/8" (92)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
4	1 5/8" x 1 5/8" Steel Studs with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
6	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
8	Wood Sill	2" (50)	0.69 (0.10)	-	31 (500)	0.45 (1880)
9	Support Angle	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
11	Steel Flashing	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door framing was found using ISO 10077-2

Detail 8.1.6 Window Wall System with Spandrel Panels and Sliding Door - Concrete Balcony and Curb Intersection

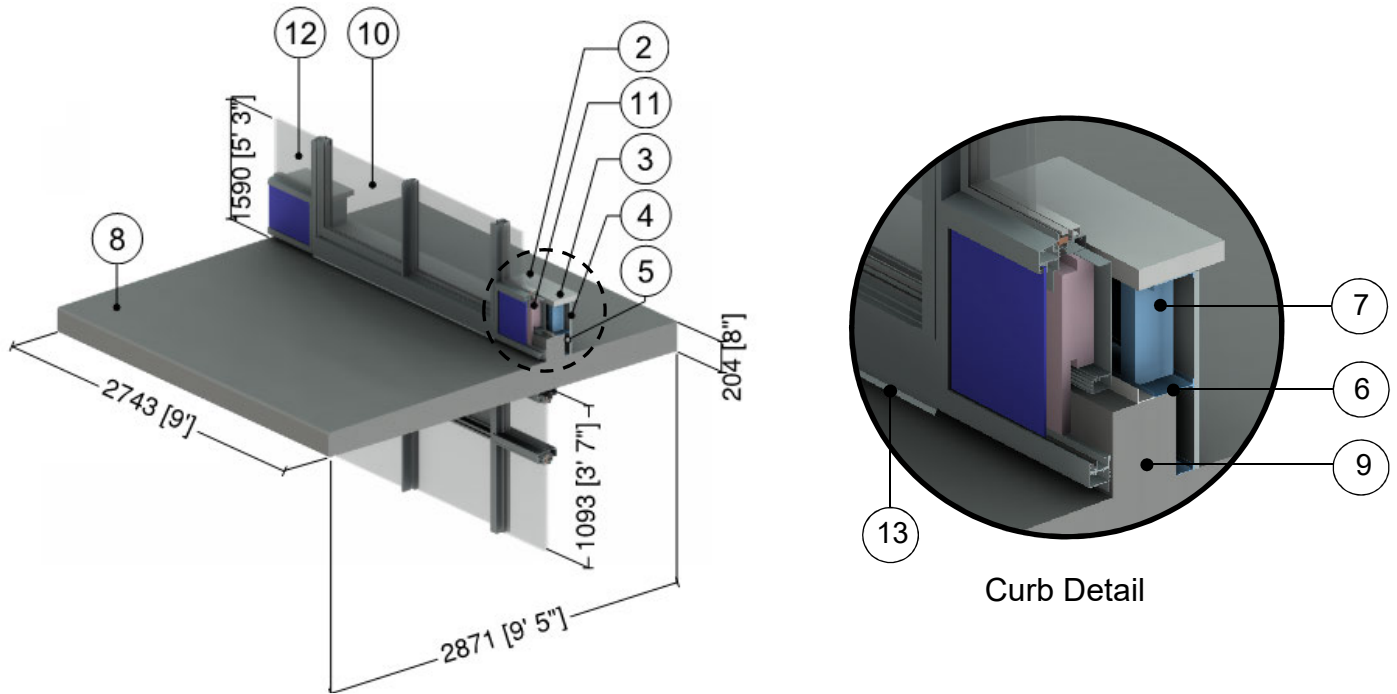



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	2" (50)	0.69 (0.1)	-	31 (500)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	1 5/8" (41)	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
11	Back Pan Insulation	Varies	0.24 (0.034)	R-6.3 to R-12.6 (1.11 RSI to 2.22 RSI)	4 (64)	0.20 (850)
12	Aluminum Window Wall Vision System ² : thermally broken frame, double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
13	Aluminum Flashing	16 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation


² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 8.1.7


Window-wall with Sliding Door and Insulated Spandrel Section – Concrete Intermediate Floor Intersection without Concrete Curb for Alternative Balcony Slab Connections

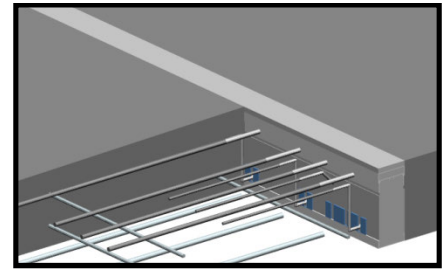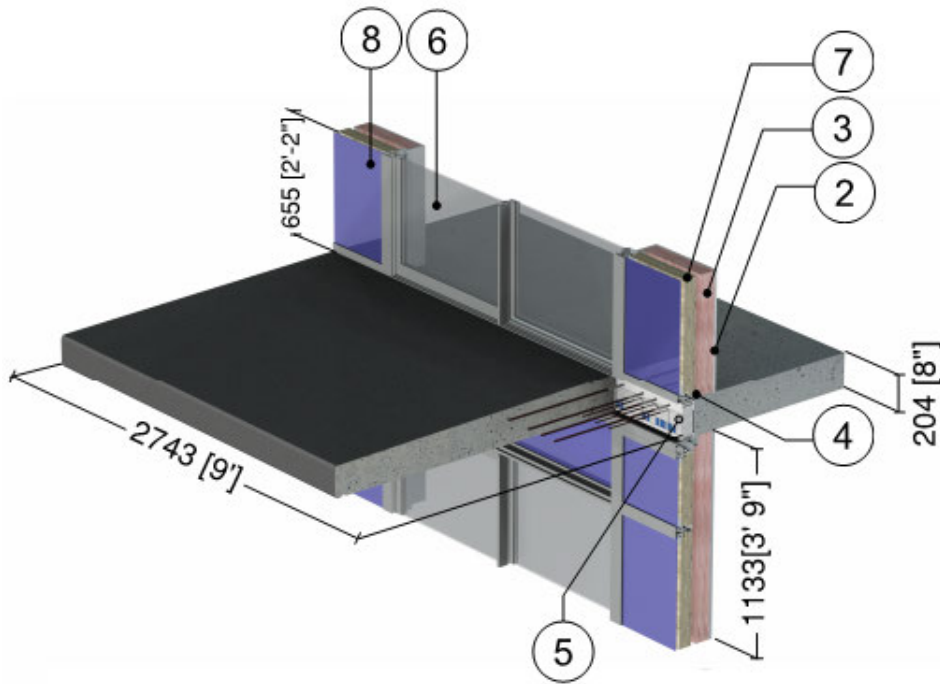

A – Thermally Broken Slab with 3” (80 mm) thick Isokorb CM20

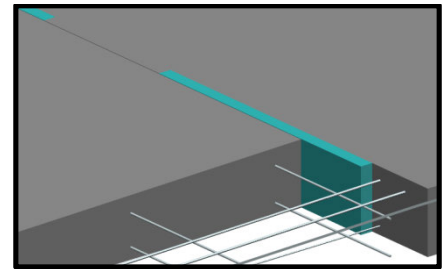

B – Thermally Broken Slab with 1.5” (40 mm) Intermittent Slab Insulation

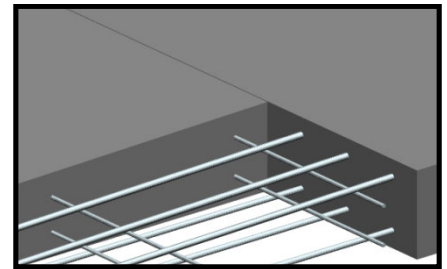


C – Continuous Slab

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12.4 (2.2 RSI)	0.9 (14)	0.17 (710)
4	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	8" (203 mm) Concrete Slab with various slab balcony connections shown in A, B, or C above					
6	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
7	Back Pan Insulation	3" (75)	0.24 (0.034)	R-12.6 (2.2 RSI)	1.8 (28)	0.29 (1220)
8	Aluminum Window Wall Vision System: thermally broken frame, double glazed IGU, U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K) ²					
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 8.1.8 | Window Wall System with Spandrel Panels and Sliding Door - Thermally Broken Concrete Balcony and Curb Intersection

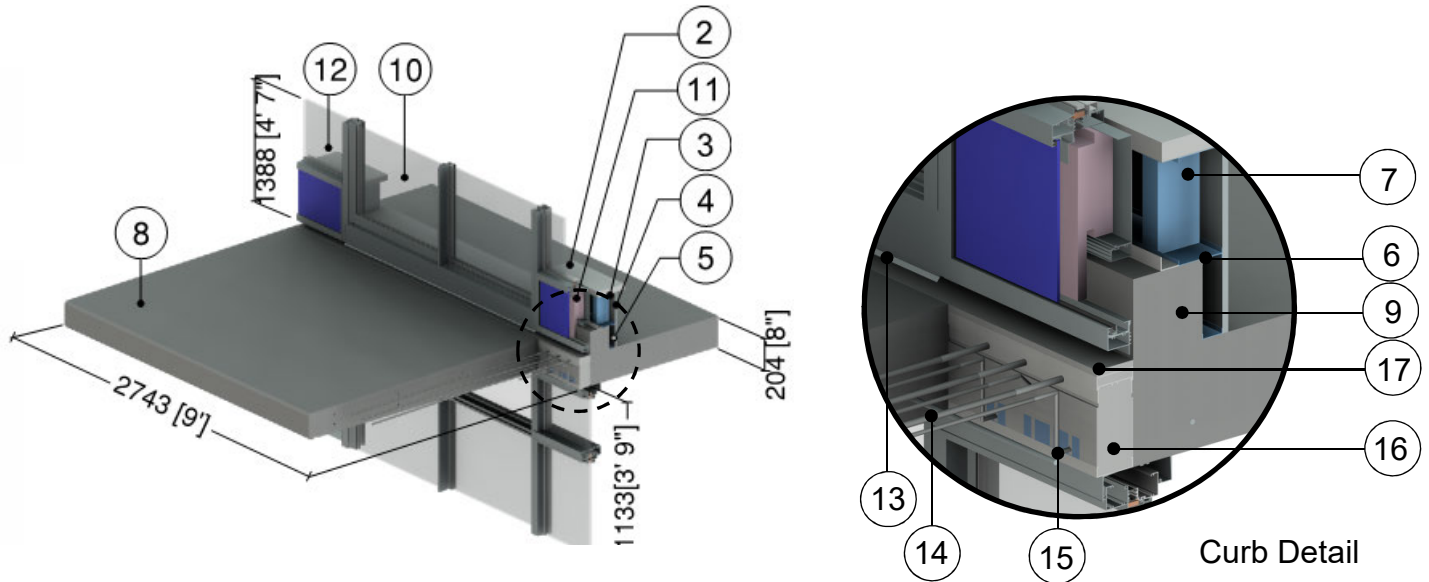


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	2" (50)	0.69 (0.10)	-	31 (500)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	Varies	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
11	Back Pan Insulation	Varies	0.24 (0.034)	R-6.3 to R-12.6 (1.11 RSI to 2.22 RSI)	4 (64)	0.20 (850)
12	Aluminum Window Wall Vision System ² : thermally broken frame, double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
14	Stainless Steel Rebar	-	118 (17)	-	500 (8000)	0.12 (500)
15	HDPE Plastic Sleeve	-	3.5 (0.5)	-	59 (950)	0.48 (2000)
16	Polystyrene Hard Foam Insulation	3" (76)	0.24 (0.035)	R-12 (2.1 RSI)	66 (1060)	0.35 (1500)
17	Cement Board	1" (25)	1.7 (0.25)	-	72 (1150)	0.20 (850)
18	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 8.1.9 | Window Wall System with Spandrel Panels - Concrete Balcony and Bypass Intersection


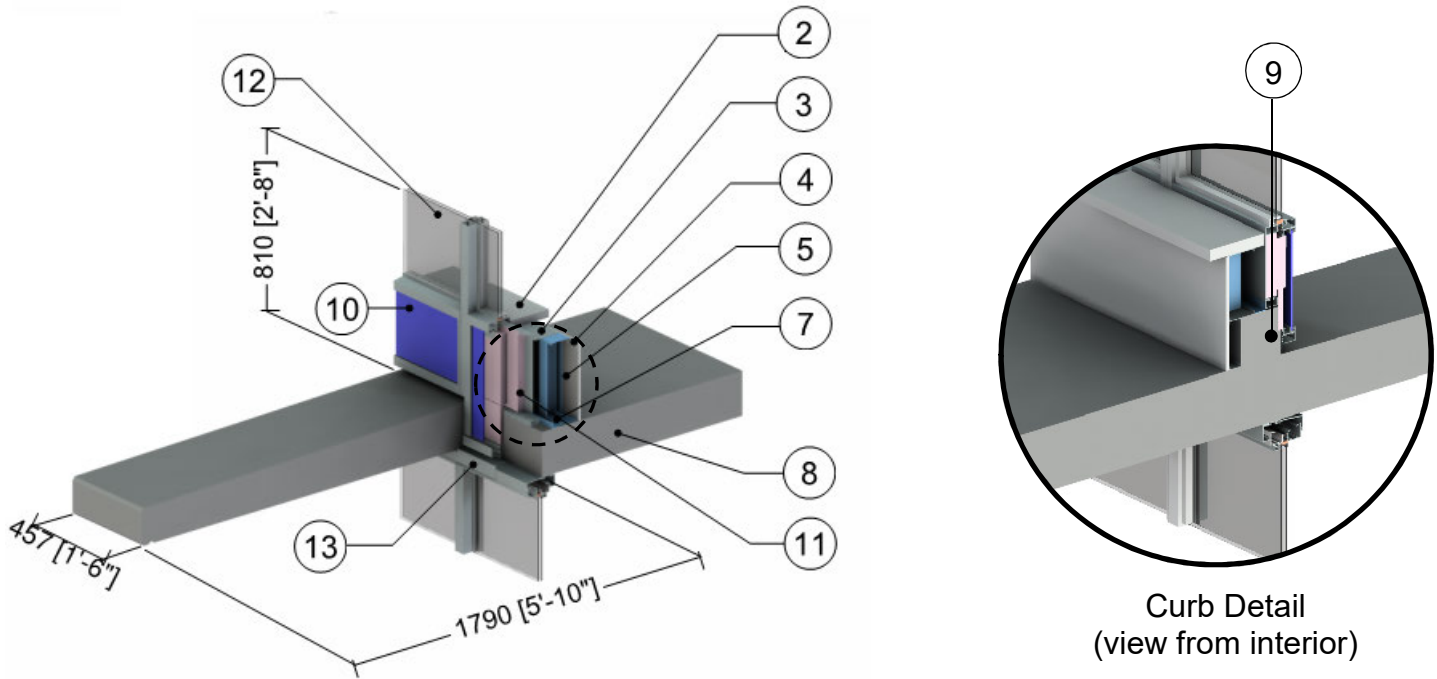


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Wood Sill	2" (50)	0.69 (0.10)	-	31 (500)	0.45 (1880)
3	Steel Sheet Connected to Studs	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Air in Stud Cavity	Varies	-	R-0.9 (0.16 RSI)	0.075 (1.2)	0.24 (1000)
6	1 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top and Bottom Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
9	Concrete Curb	6" (152)	12.5 (1.8)	-	140 (2250)	0.20 (850)
10	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
11	Back Pan Insulation	Varies	0.24 (0.034)	R-6.4 to R-12.8 (1.13 RSI to 2.25 RSI)	4 (64)	0.20 (850)
12	Aluminum Window Wall Vision System ² : thermally broken frame, double glazed IGU U _{IGU} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K)					
13	Aluminum Flashing	14 Gauge	1109 (160)	-	171 (2739)	0.21 (900)
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 8.1.10 Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly - Door Sill with Exterior Slab Insulation

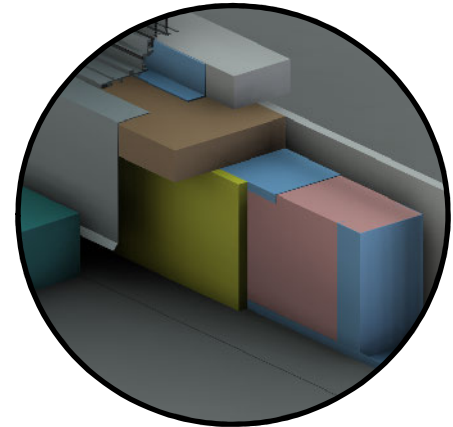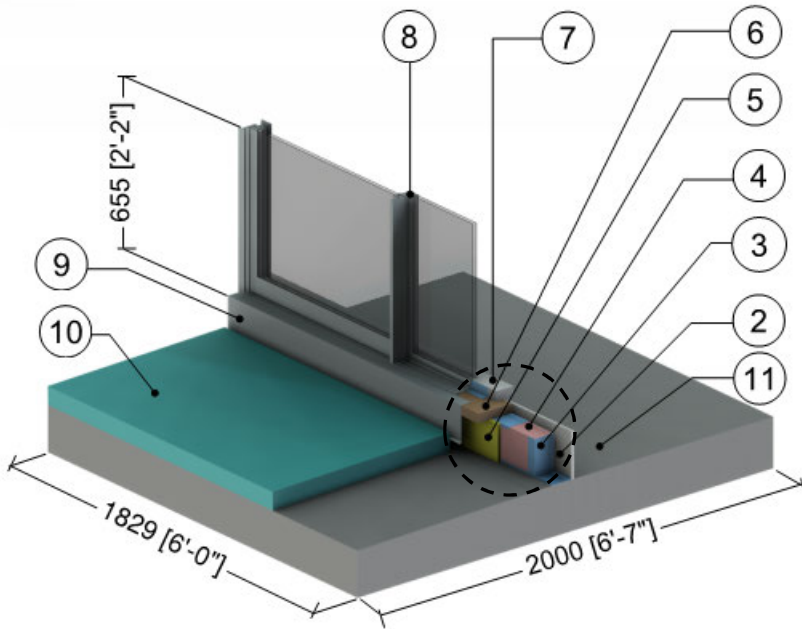



Curb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top Tracks	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
6	Wood Blocking	1 5/8" (161)	0.69 (0.1)	-	31 (500)	0.45 (1880)
7	Wood Sill	3 1/4" (82)	0.69 (0.1)	-	31 (500)	0.45 (1880)
8	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
9	Aluminum Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
10	Deck Insulation	3" (75)	0.20 (0.029)	R-15 (2.6 RSI)	1.8 (28)	0.29 (1220)
11	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
12	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door framing was found using ISO 10077-2

Detail 8.1.11 Exterior and Interior Insulated 3 5/8" x 1 5/8" Steel Stud (16" o.c.) Wall Assembly - Door Sill with Exterior Slab Insulation

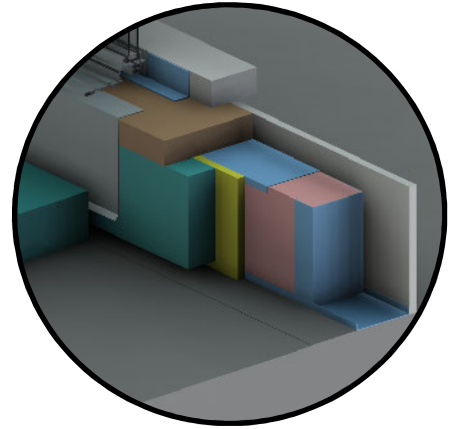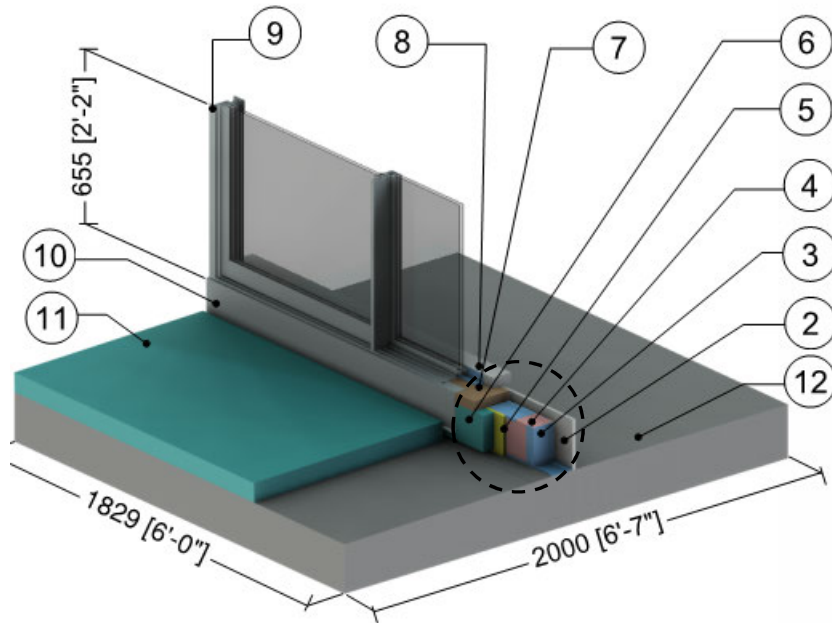

Curb Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 to R-0.7 (0.11 RSI to 0.12 RSI)	-	-
2	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
3	3 5/8" x 1 5/8" Steel Studs (16" o.c.) with Top Track	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Fiberglass Batt Insulation	3 5/8" (92)	0.29 (0.042)	R-12 (2.1 RSI)	0.9 (14)	0.17 (710)
5	Exterior Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.09 RSI)	50 (800)	0.26 (1090)
6	Exterior Insulation	Varies	-	R-10 to R-15 (1.76 RSI to 2.64 RSI)	1.8 (28)	0.29 (1220)
7	Wood Blocking	1 5/8" (161)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
8	Wood Sill	3 1/4" (82)	0.69 (0.1)	-	27.8 (445)	0.45 (1880)
9	Thermally Broken Aluminum Sliding Door ² , double glazed IGU U _{IGU} = 0.32 BTU/hr-ft ² -°F (1.82 W/m ² K)					
10	Steel Flashing	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Deck Insulation	3" (75)	0.20 (0.029)	R-15 (2.6 RSI)	1.8 (28)	0.29 (1220)
12	Concrete Slab	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
13	Exterior Film ¹	-	-	R-0.2 to R-0.7 (0.03 RSI to 0.12 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within sliding door framing was found using ISO 10077-2


9.0 Roofs

Detail 9.1.1	A.9.1
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (12" o.c.) Supporting Standing Seam Metal Roof – Clear Roof	
Detail 9.1.2	A.9.2
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof – Clear Roof	
Detail 9.1.3	A.9.3
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (36" o.c.) Supporting Standing Seam Metal Roof – Clear Roof	
Detail 9.1.4	A.9.4
Insulated Sheet Steel Roof Supported by Thermal Chairs – Baseline System – Clear Roof	
Detail 9.1.5	A.9.5
Insulated Sheet Steel Roof Supported by Thermal Chairs – Additional Scenarios – Clear Roof	
Detail 9.1.6	A.9.6
Insulated Sheet Steel Roof Supported by Thermal Chairs – Additional Insulation Type Scenarios – Clear Roof	
Detail 9.1.7	A.9.7
Insulated Standing Seam Roof Supported by Thermal Chairs – Clear Wall	
Detail 9.1.8	A.9.8
Standing Seam Roof with Draped Insulation – Clear Wall	
Detail 9.1.9	A.9.9
Exterior Insulated Low Sloped Roof – Clear Roof Assembly	
Detail 9.2.1	A.9.10
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Metal Roof – Ridge Intersection	
Detail 9.2.2	A.9.11
Insulated Concrete Slab – Concrete Curb or Wall Intersection	
Detail 9.2.3	A.9.12
Insulated Projected Membrane Roof – Floating Concrete Wall Intersection	
Detail 9.2.4	A.9.13
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Continuous Through Wall Structural Metal Deck	
Detail 9.2.5	A.9.14

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Thermally Broken Structural Metal Deck	
Detail 9.2.6	A.9.15
Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Fully Insulated Soffit	
Detail 9.3.1	A.9.16
Exterior Insulated Conventional Flat Roof – Roof Anchor	
Detail 9.3.2	A.9.17
Exterior Insulated Conventional Flat Roof – Armatherm Thermal Break under Roof Anchor	

Detail 9.1.1

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (12" o.c.) Supporting Standing Seam Metal Roof – Clear Roof

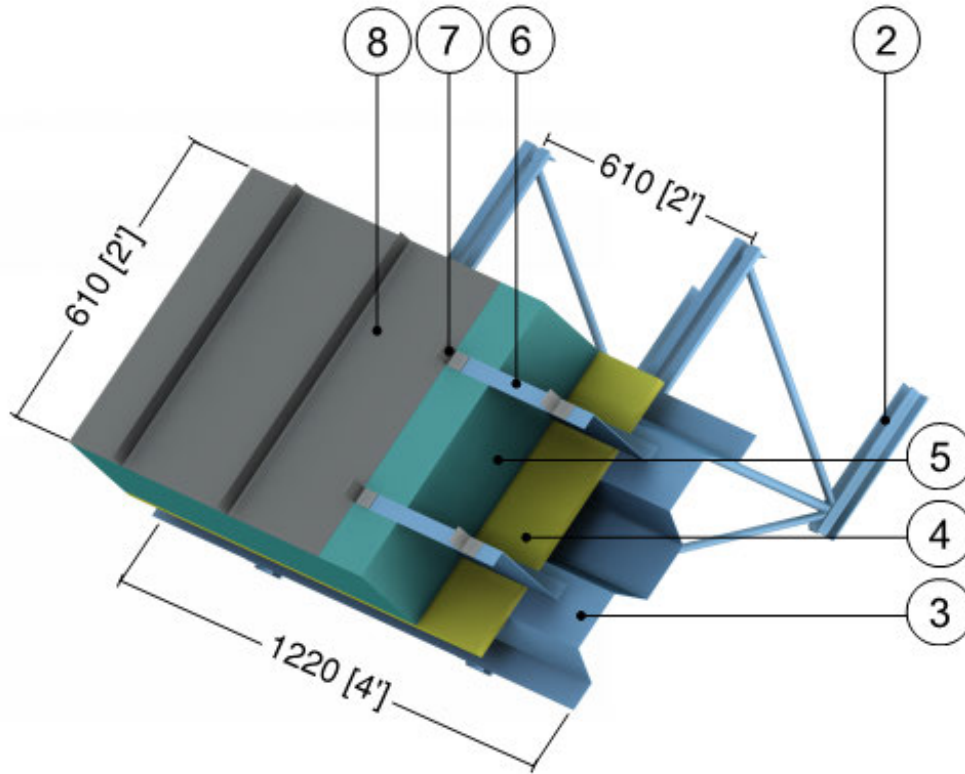


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Open Web Steel Joist (550C) @ 24" (610) o.c.	-	347 (50)	-	489 (7830)	0.12 (500)
3	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
4	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Rigid Roof Insulation	Varies	-	R-20 to R-40 (3.52 RSI to 7.04 RSI)	1.8 (28)	0.29 (1220)
6	Sub-Girt with 1 1/2" Flange @ 12" (305) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Roof Clip (1 1/2" x 1 1/2")	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Roof	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.1.2

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof – Clear Roof

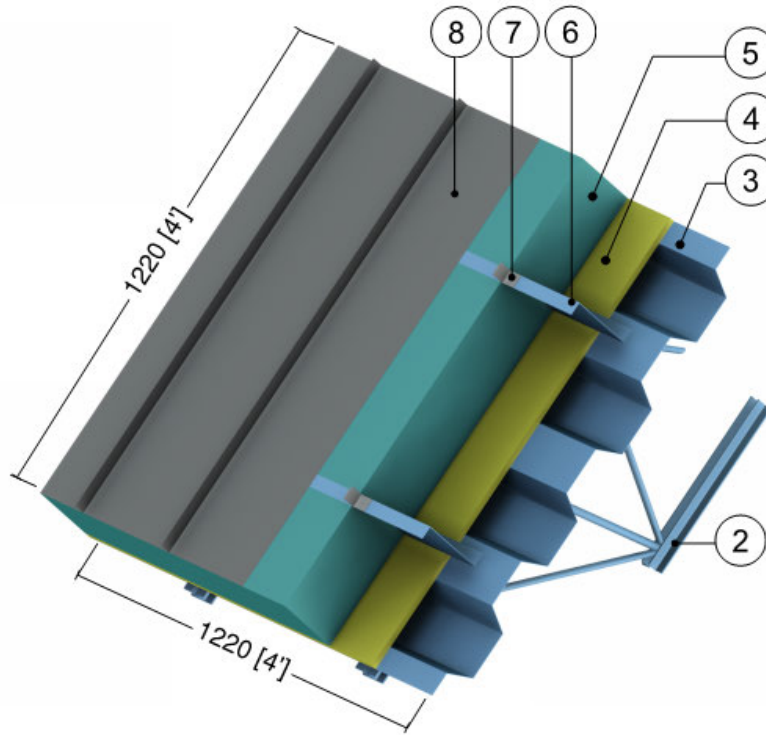


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Open Web Steel Joist (550C) @ 24" (610) o.c.	-	347 (50)	-	489 (7830)	0.12 (500)
3	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
4	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Rigid Roof Insulation	Varies	-	R-20 to R-40 (3.52 RSI to 7.04 RSI)	1.8 (28)	0.29 (1220)
6	Sub-Girt with 1 1/2" Flange @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Roof Clip (1 1/2" x 1 1/2")	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Roof	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.1.3

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (36" o.c.) Supporting Standing Seam Metal Roof – Clear Roof


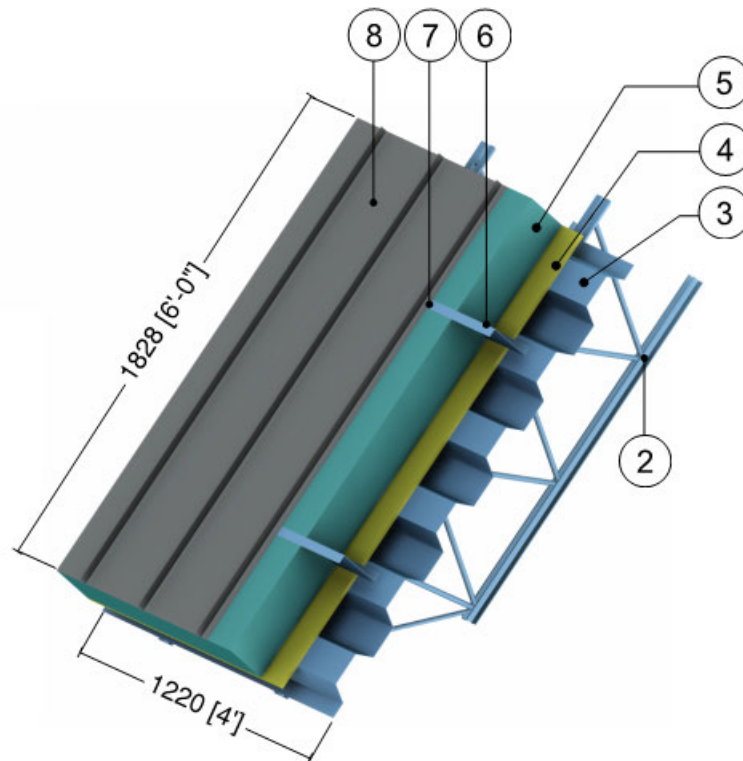


ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Open Web Steel Joist (550C)@ 24" (610) o.c.	-	347 (50)	-	489 (7830)	0.12 (500)
3	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
4	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Rigid Roof Insulation	Varies	-	R-20 to R-40 (3.52 RSI to 7.04 RSI)	1.8 (28)	0.29 (1220)
6	Sub-Girt with 1 1/2" Flange @ 36" (914) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Roof Clips (1 1/2" x 1 1/2")	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Roof	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.1.4

Insulated Sheet Steel Roof Supported by Thermal Chairs – Baseline System – Clear Roof

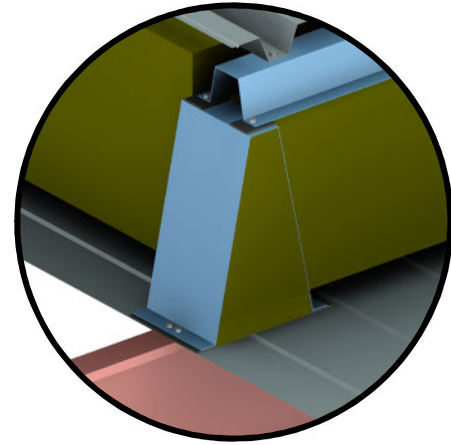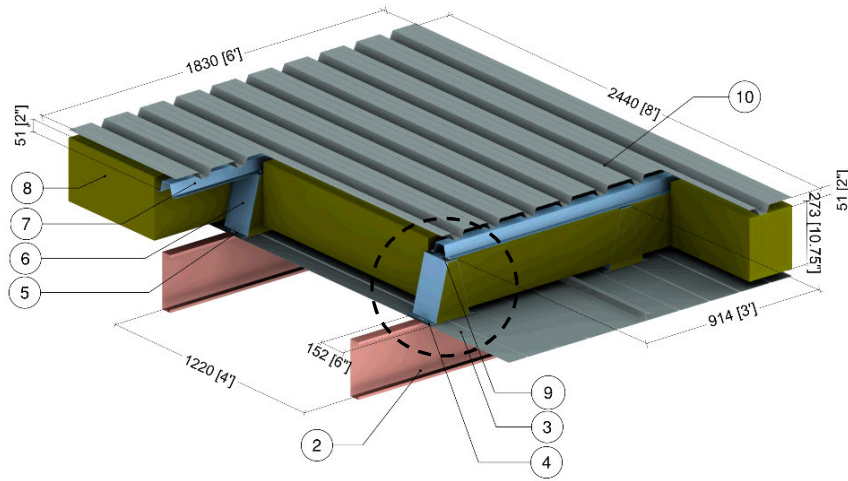

Bracket Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-1.1 (0.20 RSI)	-	-
2	10 x 2 Galvanized Steel Purlin @ 48" o.c.	1/10" (2.6)	430 (62)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.18)	0.097 (0.014)	-	-	-
5	#12 Steel Fasteners	0.22" (5.50) Ø	430 (62)	-	489 (7830)	0.12 (500)
6	10-in Galvanized Steel Hat Section (Thermal Chair)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	2-in Galvanized Steel Hat Section (Outer Rail)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Mineral Wool Insulation	10 3/4" (273)	0.240 (0.034)	R-45 (7.93 RSI)	1.8 (28)	0.29 (1090)
9	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
10	Galvanized Steel Cladding	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 9.1.5

Insulated Sheet Steel Roof Supported by Thermal Chairs – Additional Scenarios – Clear Roof

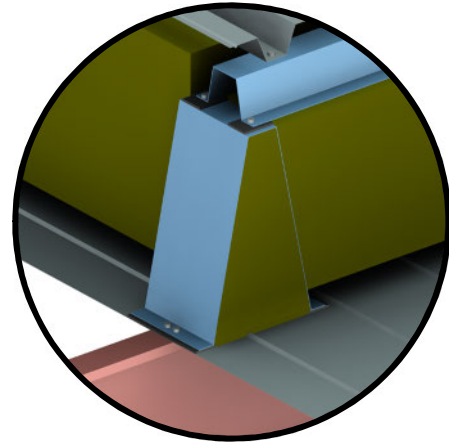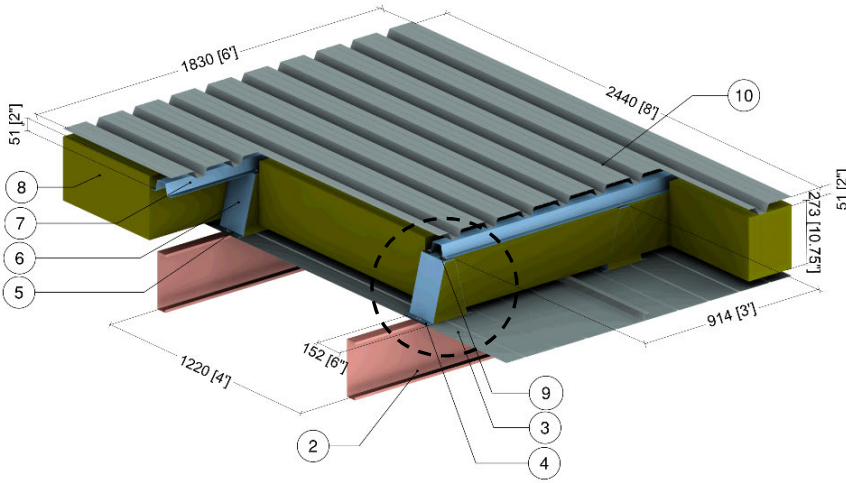

Bracket Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-1.1 (0.20 RSI)	-	-
2	10 x 2 Galvanized Steel Purlin @ 48" o.c.	1/10" (2.6)	430 (62)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.18)	0.097 (0.014)	-	-	-
5	#12 Steel Fasteners	0.22" (5.50) ∅	430 (62)	-	489 (7830)	0.12 (500)
6	10-in Galvanized Steel Hat Section (Thermal Chair)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	2-in Galvanized Steel Hat Section (Outer Rail)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Mineral Wool Insulation	10 3/4" (273)	0.240 (0.034)	R-45 (7.93 RSI)	1.8 (28)	0.29 (1090)
9	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
10	Galvanized Steel Cladding	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 9.1.6

Insulated Sheet Steel Roof Supported by Thermal Chairs – Additional Insulation Type Scenarios – Clear Roof

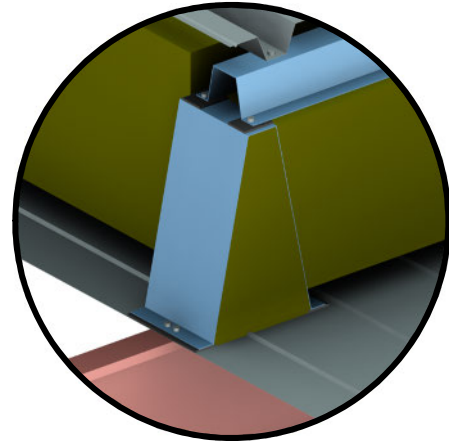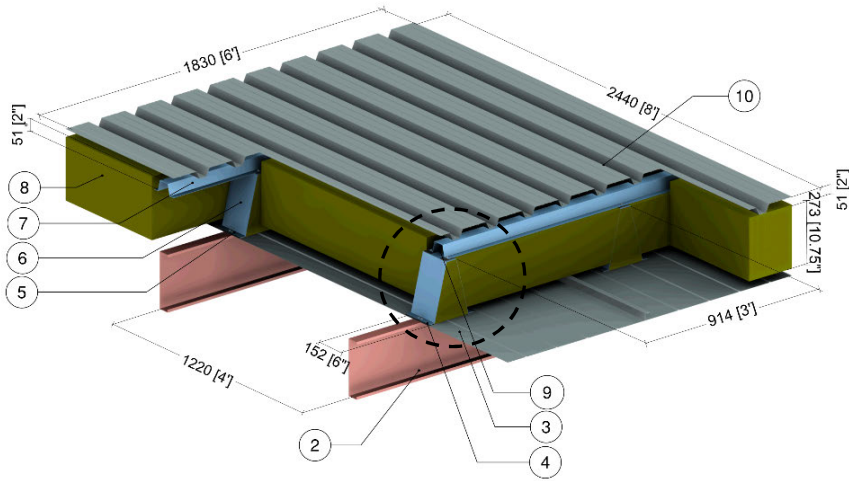

Bracket Detail


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-1.1 (0.20 RSI)	-	-
2	10 x 2 Galvanized Steel Purlin @ 48" o.c.	1/10" (2.6)	430 (62)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.18)	0.097 (0.014)	-	-	-
5	#12 Steel Fasteners	0.22" (5.50) ∅	430 (62)	-	489 (7830)	0.12 (500)
6	10-in Galvanized Steel Hat Section (Thermal Chair)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	2-in Galvanized Steel Hat Section (Outer Rail)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Mineral Wool Insulation	10 3/4" (273)	0.240 (0.034)	R-45 (7.93 RSI)	1.8 (28)	0.29 (1090)
9	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
10	Galvanized Steel Cladding	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 9.1.7

Insulated Standing Seam Roof Supported by Thermal Chairs – Clear Wall

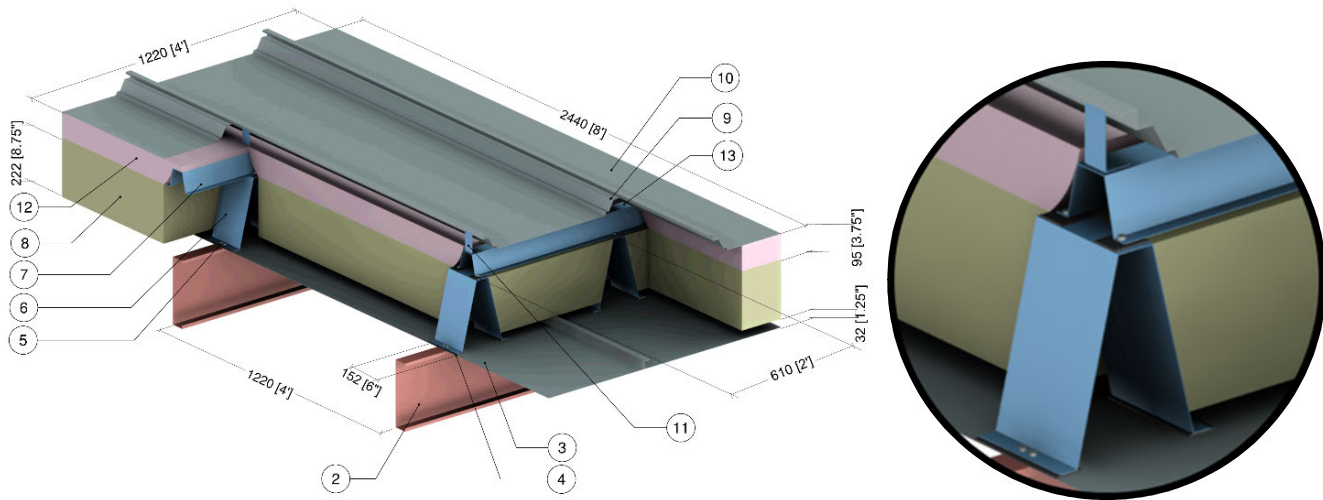

Bracket Detail



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-1.1 (0.20 RSI)	-	-
2	10 x 2 Galvanized Steel Purlin @ 48" o.c.	1/10" (2.6)	430 (62)	-	489 (7830)	0.12 (500)
3	Galvanized Steel Liner	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
4	Thermal Tape	1/8" (3.18)	0.097 (0.014)	-	-	-
5	#12 Steel Fasteners	0.22" (5.50) ∅	430 (62)	-	489 (7830)	0.12 (500)
6	10-in Galvanized Steel Hat Section (Thermal Chair)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	2-in Galvanized Steel Hat Section (Outer Rail)	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Mineral Wool Insulation	10 3/4" (273)	0.240 (0.034)	R-45 (7.93 RSI)	1.8 (28)	0.29 (1090)
9	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
10	Galvanized Steel Cladding	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Steel Clips	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Fiberglass Batt Insulation	6" (152)	0.30 (0.043)	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
13	Thermal Block	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	9.4 (150)	0.23 (1000)
14	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 9.1.8

Standing Seam Roof with Draped Insulation – Clear Wall

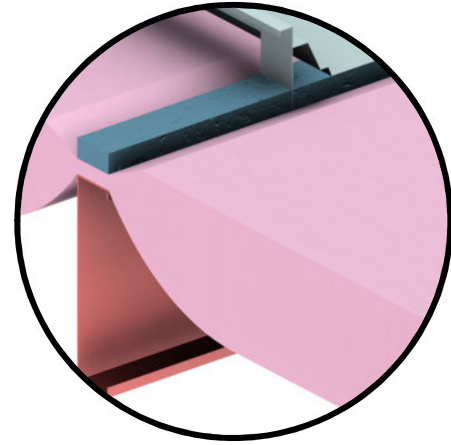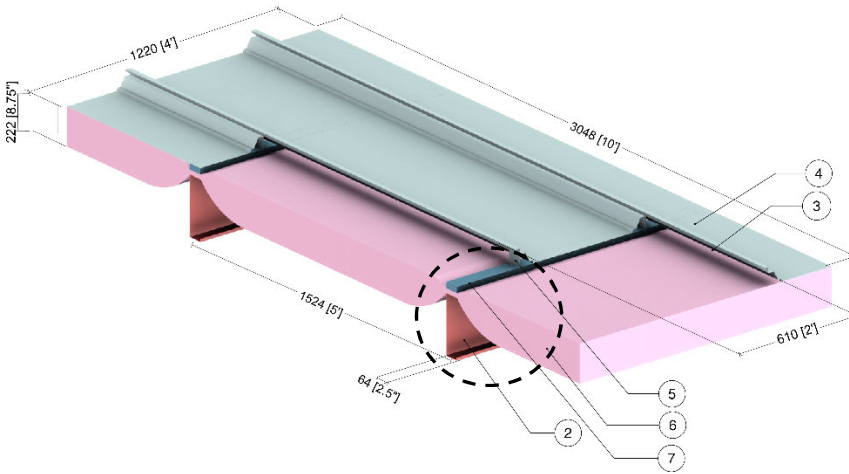


Bracket Detail

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films (left side) ¹	-	-	R-1.1 (0.20 RSI)	-	-
2	10 x 2 Galvanized Steel Purlin @ 48" o.c.	1/10" (2.6)	430 (62)	-	489 (7830)	0.12 (500)
3	Air Gap ²	-	Varies	-	0.075 (1.2)	0.24 (1000)
4	Galvanized Steel Cladding	22 Gauge	430 (62)	-	489 (7830)	0.12 (500)
5	Steel Clips	18 Gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Fiberglass Batt Insulation	6" (152)	0.30 (0.043)	R-19 (3.35 RSI)	0.9 (14)	0.17 (710)
7	Thermal Block	1" (25)	0.20 (0.029)	R-5 (0.88 RSI)	9.4 (150)	0.23 (1000)
8	Exterior Film (right side) ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces was found using ISO 100077-2

Detail 9.1.9 Exterior Insulated Low Sloped Roof – Clear Roof Assembly

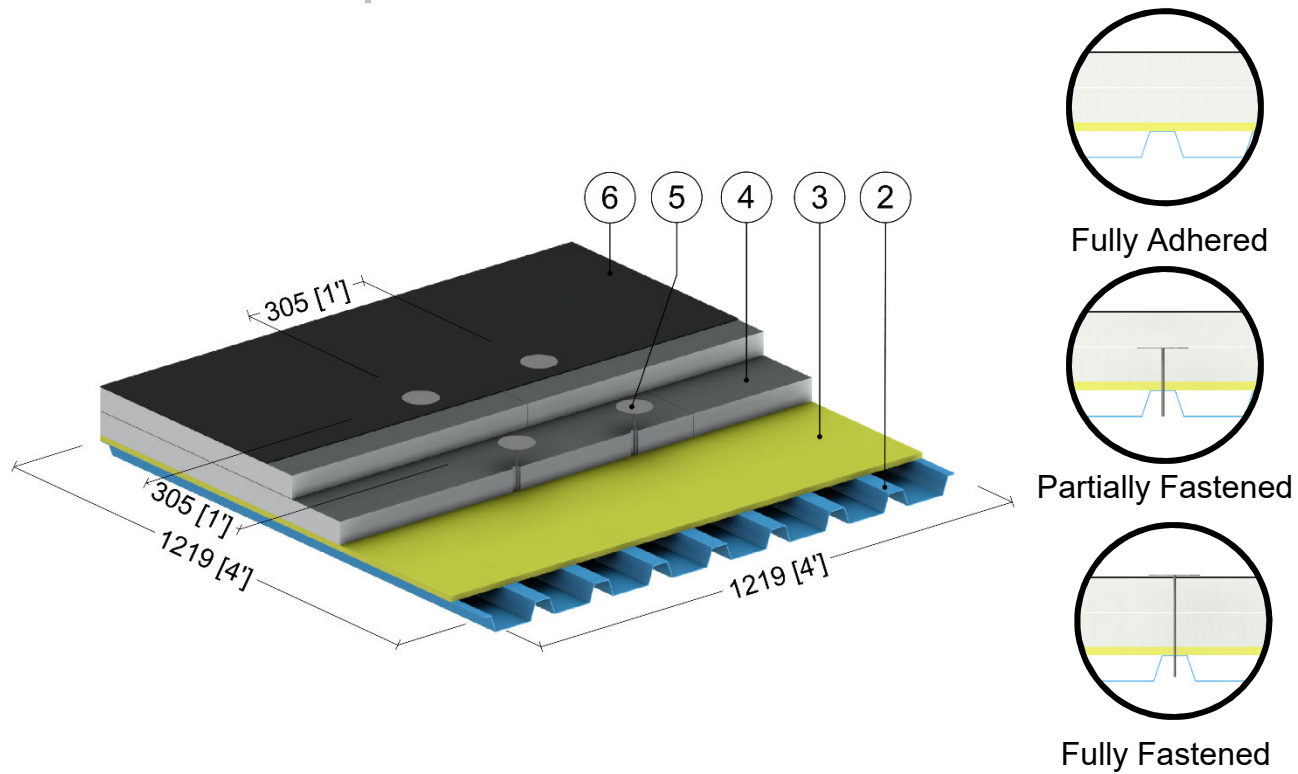


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	2 Layer Polyisocyanurate Insulation	4" (101)	0.2 (0.025)	R-20 (3.52 RSI)	1.8 (28)	0.29 (1220)
5	#10 Steel Fasteners	3/16" (4.8) Ø	347 (50)	-	489 (7830)	0.12 (500)
6	Asphalt Cover Board and Roof Membrane	1/2" (12)	3 (0.43)	R-0.2 (0.03 RSI)	100 (1600)	100 (1500)
7	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.2.1


Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Metal Roof – Ridge Intersection

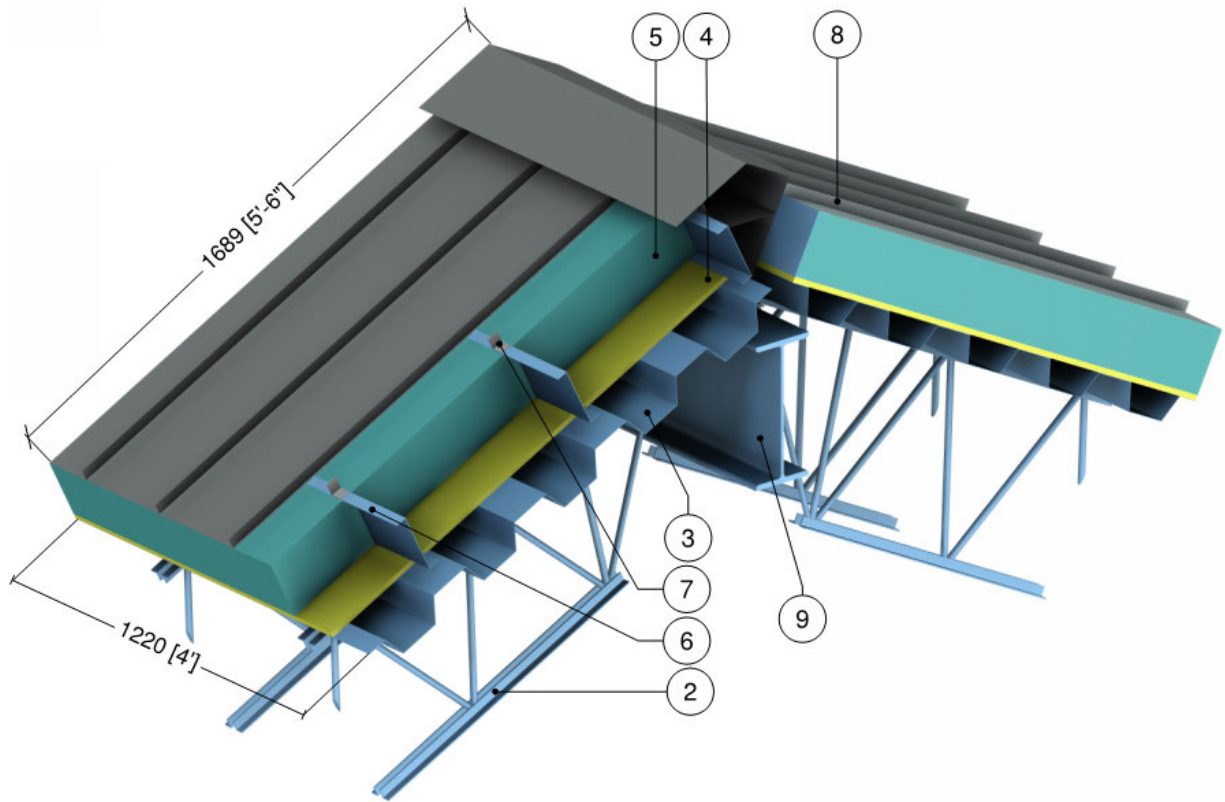

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² -hr-°F (W/m K)	Nominal Resistance hr-ft ² -°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb-°F (J/kg K)
1	Interior Film ¹	-	-	R-1.1 (0.2 RSI)	-	-
2	Open Web Steel Joist (550C) @ 24" (610) o.c.	-	347 (50)	-	489 (7830)	0.12 (500)
3	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
4	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
5	Rigid Roof Insulation	Varies	-	R-20 to R-30 (3.52 RSI to 5.28 RSI)	1.8 (28)	0.29 (1220)
6	Sub-Girt with 1 1/2" Flange @ 24" (610) o.c.	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Roof Clips (1 1/2" x 1 1/2")	16 Gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Metal Roof with Ridge Flashing	24 Gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.2.2 | Insulated Concrete Slab – Concrete Curb or Wall Intersection

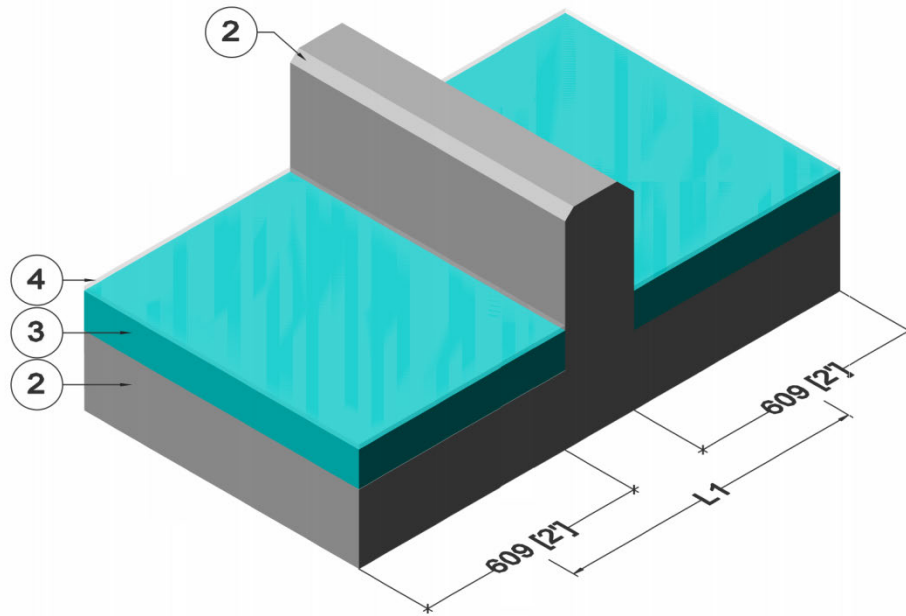


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Concrete Slab, Curb or Wall	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Roof Insulation	4" (102)	-	R-20 (3.5 RSI)	1.8 (28)	0.29 (1220)
4	Finish roof material is incorporated into exterior heat transfer coefficient					
5	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.2.3

Insulated Projected Membrane Roof – Floating Concrete Wall Intersection


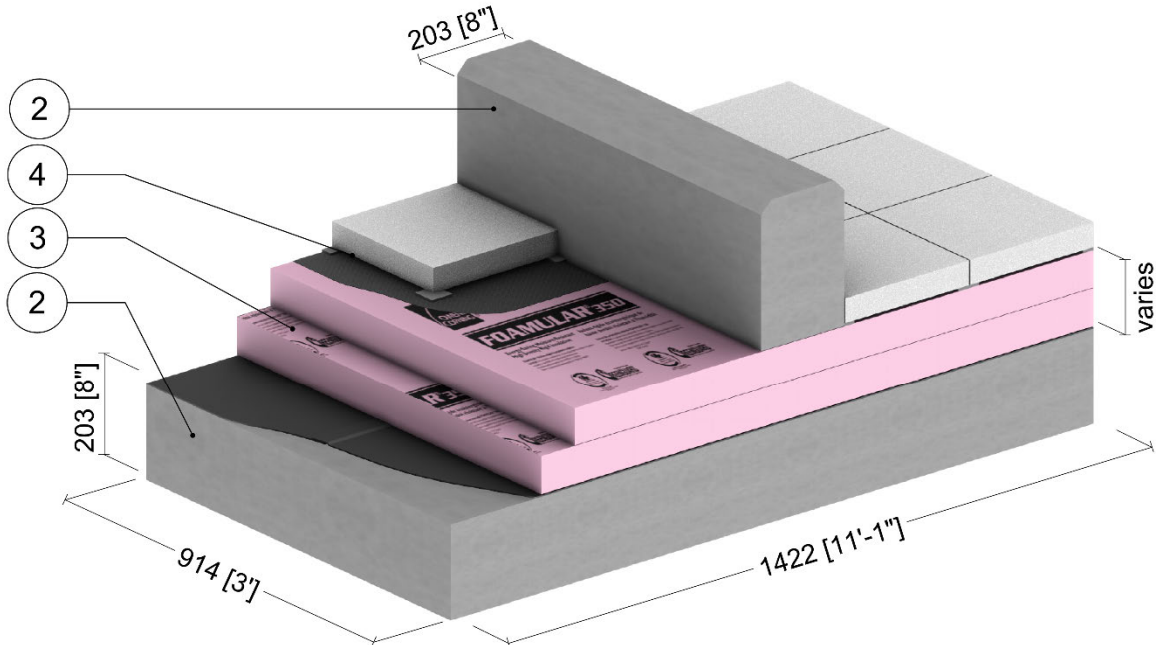


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Concrete	8" (203)	12.5 (1.8)	-	140 (2250)	0.20 (850)
3	Fomular 350 Extruded Polystyrene Rigid Insulation Type 4	Varies	-	R-20 to R-40 (3.52 RSI to 7.04 RSI)	varies	-
4	Finish roof material is incorporated into exterior heat transfer coefficient					
5	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.2.4

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Continuous Through Wall Structural Metal Deck

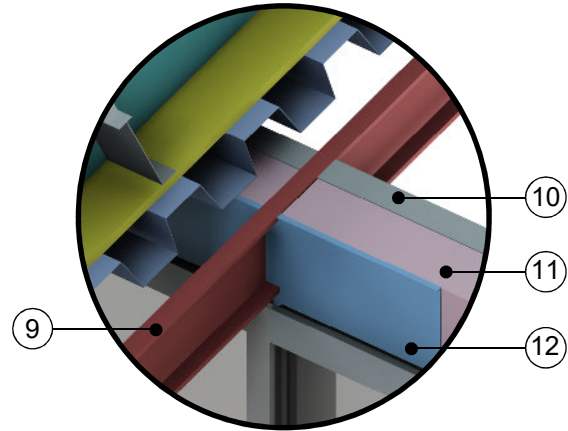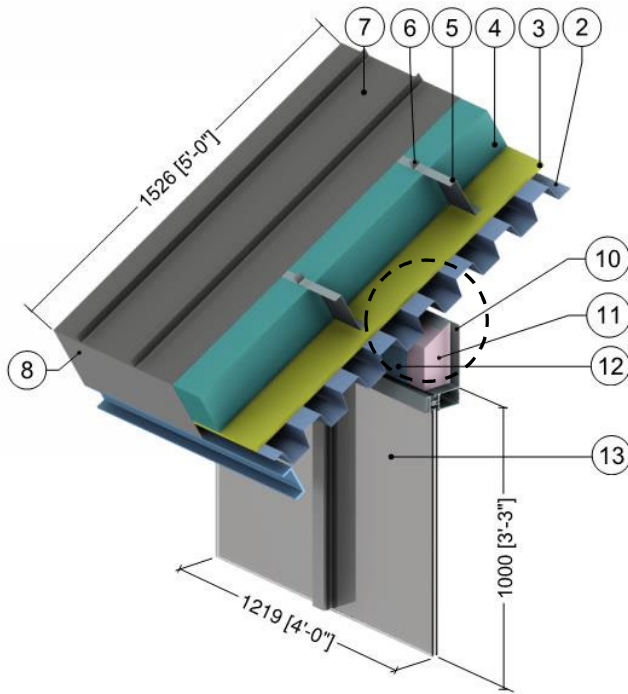

Through Beam and Metal Deck at Curtain Wall



ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Rigid Roof Insulation	7" (183)	0.2 (0.03)	R-35 (6.16 RSI)	1.8 (28)	0.29 (1220)
5	Sub-Girt with 1 1/2" Flange @ 24" (610) o.c.	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Roof Clips (1 1/2" x 1 1/2")	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Metal Roof	24 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Roof Closure Panel	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Interior Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Fiberglass Insulation	4 1/2" (118)	0.24 (0.034)	R-19 (3.35 RSI)	4 (64)	0.20 (850)
12	Exterior Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Aluminum Curtain Wall Vision System: thermally broken frame, double glazed IGU U _{COG} = 0.32 BTU/hr ft ² ·°F (1.82 W/m ² K) ²					
14	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2

Detail 9.2.5

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Thermally Broken Structural Metal Deck

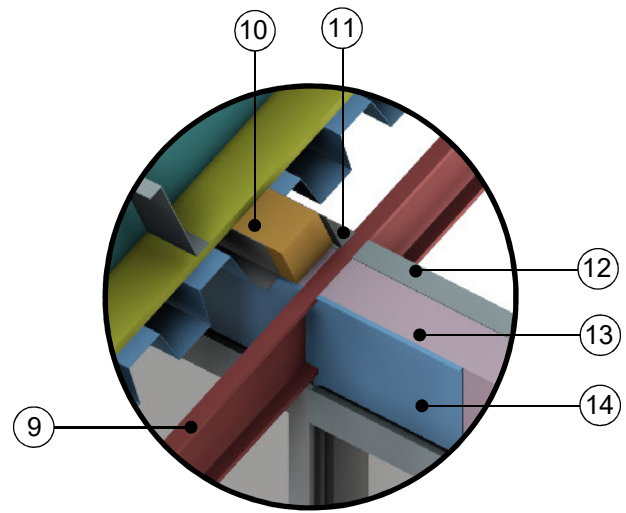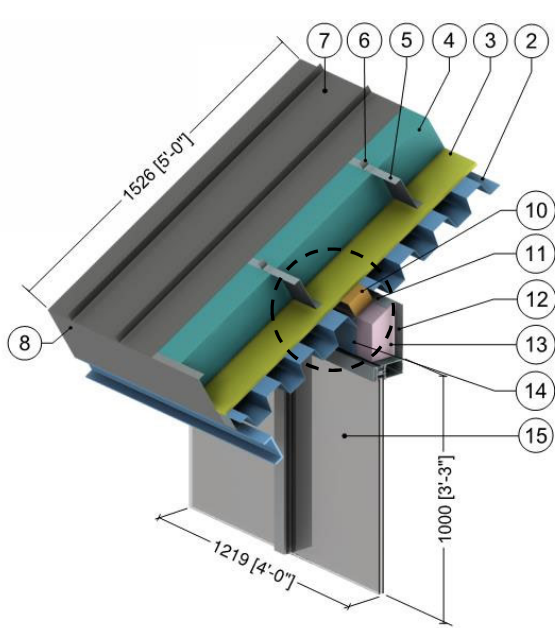

Through Beam and Thermally Broken Metal Deck

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Rigid Roof Insulation	7" (183)	0.2 (0.03)	R-35 (6.16 RSI)	1.8 (28)	0.29 (1220)
5	Sub-Girt with 1 1/2" Flange @ 24" (610) o.c.	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Roof Clips (1 1/2" x 1 1/2")	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Metal Roof	24 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Roof Closure Panel	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Steel Beam (W410)	-	347 (50)	-	489 (7830)	0.12 (500)
10	Continuous Spray Foam Insulation	4" (100)	0.17 (0.024)	R-24 (4.23 RSI)	2.8 (39)	0.35 (1470)
11	Stiffening Brackets	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
12	Interior Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Fiberglass Insulation	4 1/2" (118)	0.24 (0.034)	R-19 (3.35 RSI)	4 (64)	0.20 (850)
14	Exterior Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Aluminum Curtain Wall Vision System: thermally broken frame, double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K) ²					
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 9.2.6

Exterior Insulated Sloped Metal Roof with Metal Sub-Girts (24" o.c.) Supporting Standing Seam Metal Roof and Curtain Wall – Roof to Wall Intersection with Through Wall Structural Beam and Fully Insulated Soffit

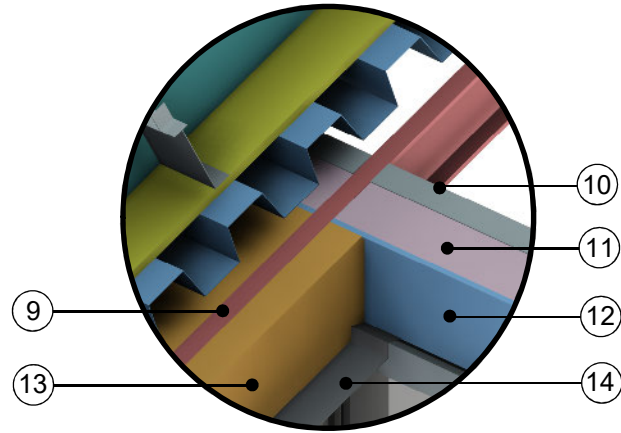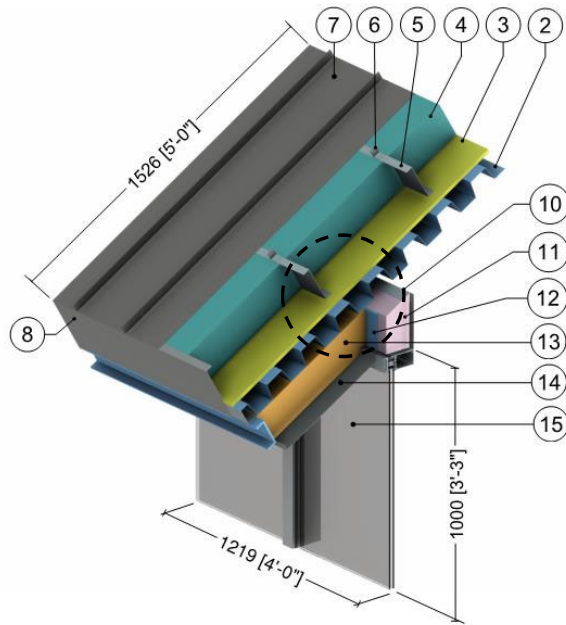

Through Beam and Metal Deck at Soffit

ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Films ¹	-	-	R-0.6 to R-1.1 (0.12 RSI to 0.20 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Roof Sheathing	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Rigid Roof Insulation	7" (183)	0.2 (0.03)	R-35 (6.16 RSI)	1.8 (28)	0.29 (1220)
5	Sub-Girt with 1 1/2" Flange @ 24" (610) o.c.	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
6	Roof Clips (1 1/2" x 1 1/2")	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
7	Metal Roof	24 gauge	430 (62)	-	489 (7830)	0.12 (500)
8	Roof Closure Panel	16 gauge	430 (62)	-	489 (7830)	0.12 (500)
9	Steel Beam	-	347 (50)	-	489 (7830)	0.12 (500)
10	Curtain Wall Bracket and Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
11	Curtain Wall Fill Insulation	4 1/2" (118)	0.24 (0.034)	R-19 (3.35 RSI)	4 (64)	0.20 (850)
12	Curtain Wall Closure Panel	12 gauge	430 (62)	-	489 (7830)	0.12 (500)
13	Rigid Soffit Insulation	6" (150)	0.17 (0.024)	R-36 (6.34 RSI)	2.8 (39)	0.35 (1470)
14	Metal Soffit Panel	24 gauge	430 (62)	-	489 (7830)	0.12 (500)
15	Aluminum Curtain Wall Vision System: thermally broken frame, double glazed IGU U _{COG} = 0.32 BTU/hr·ft ² ·°F (1.82 W/m ² K) ²					
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-



¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

² The thermal conductivity of air spaces within framing was found using ISO 100077-2



Detail 9.3.1

Exterior Insulated Conventional Flat Roof – Roof Anchor

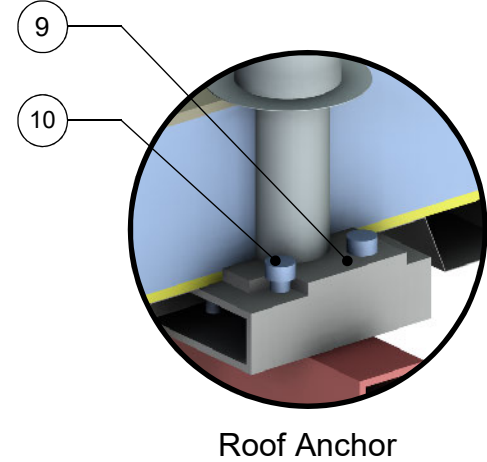
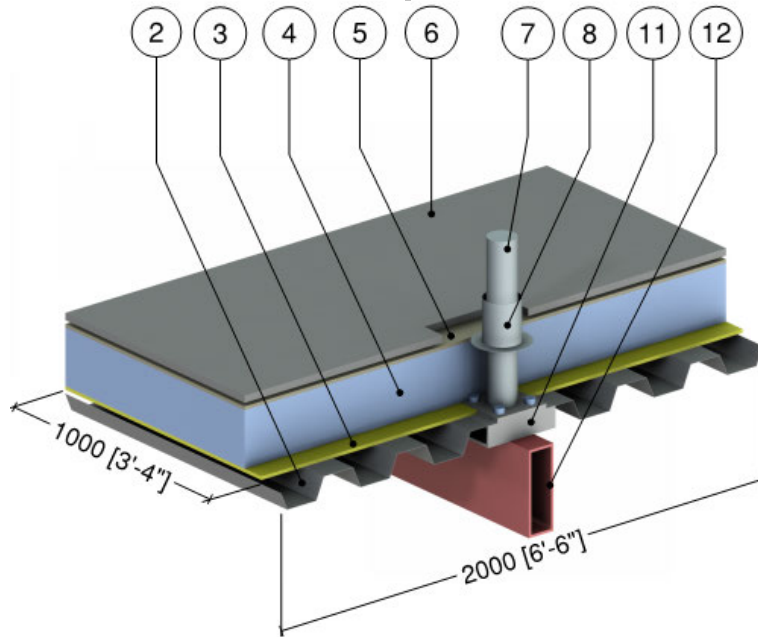


ID	Component	Thickness Inches (mm)	Conductivity Btu-in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Extruded Polystyrene Insulation (XPS)	8" (203)	0.20 (0.029)	R-40 (7.04 RSI)	1.8 (28)	0.29 (1220)
5	Asphalt Cover Board and Roof Membrane	1/2" (13)	3 (0.43)	R-0.2 (0.03 RSI)	100 (1600)	100 (1500)
6	Concrete Pavers	1" (25)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Roof Anchor	1/4" (6)	430 (62)	-	489 (7830)	0.12 (500)
8	Roof Anchor Flashing	18 Gauge	1100 (160)	-	171 (2739)	0.21 (900)
9	8" x 8" x 5/8" Base Plate	5/8" (16)	430 (62)	-	489 (7830)	0.12 (500)
10	Stainless Steel Bolts	3/4" (6) ∅	117 (17)	-	489 (7830)	0.12 (500)
11	3" x 8" x 11" HSS	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
12	Structural Steel	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
13	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-


¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation

Detail 9.3.2

Exterior Insulated Conventional Flat Roof – Armatherm Thermal Break under Roof Anchor

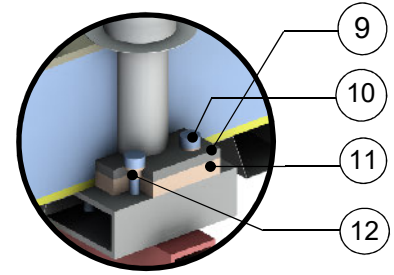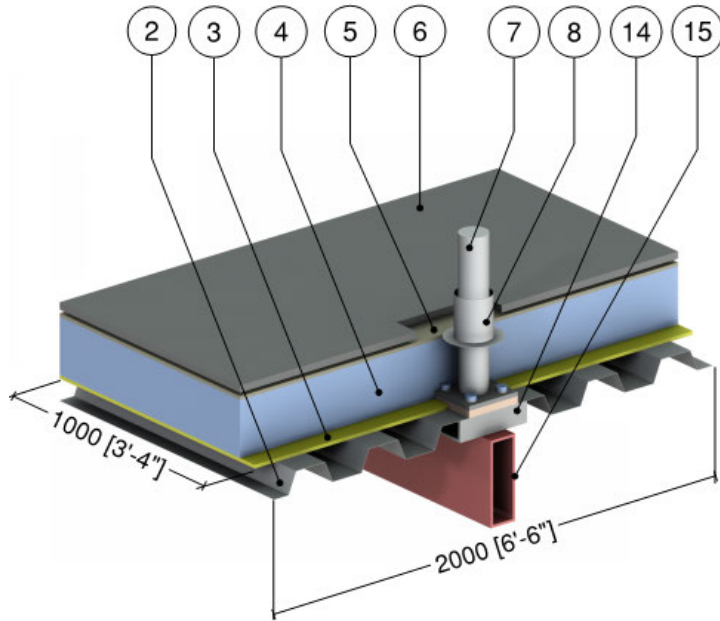

Armatherm FRR Roof Anchor Thermal Break

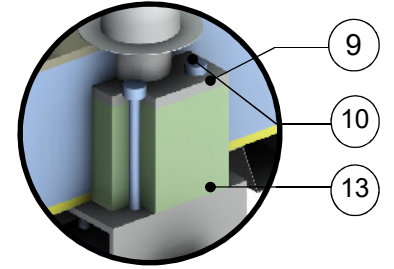

Armatherm 500 Roof Anchor Thermal Break

ID	Component	Thickness Inches (mm)	Conductivity Btu·in / ft ² ·hr·°F (W/m K)	Nominal Resistance hr·ft ² ·°F/Btu (m ² K/W)	Density lb/ft ³ (kg/m ³)	Specific Heat Btu/lb·°F (J/kg K)
1	Interior Film ¹	-	-	R-0.6 (0.11 RSI)	-	-
2	Steel Deck	1/16" (1.6)	347 (50)	-	489 (7830)	0.12 (500)
3	Gypsum Board	1/2" (13)	1.1 (0.16)	R-0.5 (0.08 RSI)	50 (800)	0.26 (1090)
4	Extruded Polystyrene Insulation (XPS)	8" (203)	0.20 (0.029)	R-40 (7.04 RSI)	1.8 (28)	0.29 (1220)
5	Asphalt Cover Board and Roof Membrane	1/2" (13)	3 (0.43)	R-0.2 (0.03 RSI)	100 (1600)	100 (1500)
6	Concrete Pavers	1" (25)	12.5 (1.8)	-	140 (2250)	0.20 (850)
7	Roof Anchor	1/4" (6)	430 (62)	-	489 (7830)	0.12 (500)
8	Roof Anchor Flashing	18 Gauge	1100 (160)	-	171 (2739)	0.21 (900)
9	8" x 8" x 5/8" Base Plate	5/8" (16)	430 (62)	-	489 (7830)	0.12 (500)
10	Stainless Steel Bolts	3/4" (6) ∅	117 (17)	-	489 (7830)	0.12 (500)
11	Armatherm FRR Thermal Break	1/2" (13)	1.4 (0.2)	-	85 (5.3)	-
12	Armatherm FRR Washers and Bushing	-	1.4 (0.2)	-	85 (5.3)	-
13	Armatherm 500 Thermal Break	6" (152)	0.32 (0.05)	-	-	-
14	3" x 8" x 11" HSS	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
15	Structural Steel	3/8" (10)	347 (50)	-	489 (7830)	0.12 (500)
16	Exterior Film ¹	-	-	R-0.2 (0.03 RSI)	-	-

¹ Value selected from table 1, p. 26.1 of 2009 ASHRAE Handbook – Fundamentals depending on surface orientation