

SAMPLE SIMPLIFIED SLD FOR CERTIFIED MOMENTARY CTT

INSTRUCTIONS TO PROPONENT:

1. DO NOT INCLUDE THIS BOX IN YOUR SLD.
2. THIS MOMENTARY CTT SLD IS JUST FOR REFERENCE ONLY. PROPONENT'S FACILITY MAY HAVE DIFFERENT ARRANGEMENT AND MUST REFLECT THEIR ACTUAL ARRANGEMENT IN THEIR SLD.
3. PROPONENT MUST PROVIDE ALL THE NAME TAGS AS LABELED IN RED TEXT IN THIS EXAMPLE SLD
4. ALL DEVICE ID# AND NAME MUST BE UNIQUE. THE DEVICE ID# CAN BE 2 TO 4 DIGITS LONG.

RATINGS OF EQUIPMENT

GENERATOR(S)


[G ID# – G ID#] : [include voltage, power frequency ratings with manufacture name and model]

AUTOMATIC TRANSFER SWITCH (CLOSED TRANSITION TYPE)

[ATS ID# – ATS ID#] : [ATS Brand, model and include CSA certification information]

TRANSFORMERS

[T ID#] : [include voltage, power rating with % impedance information]

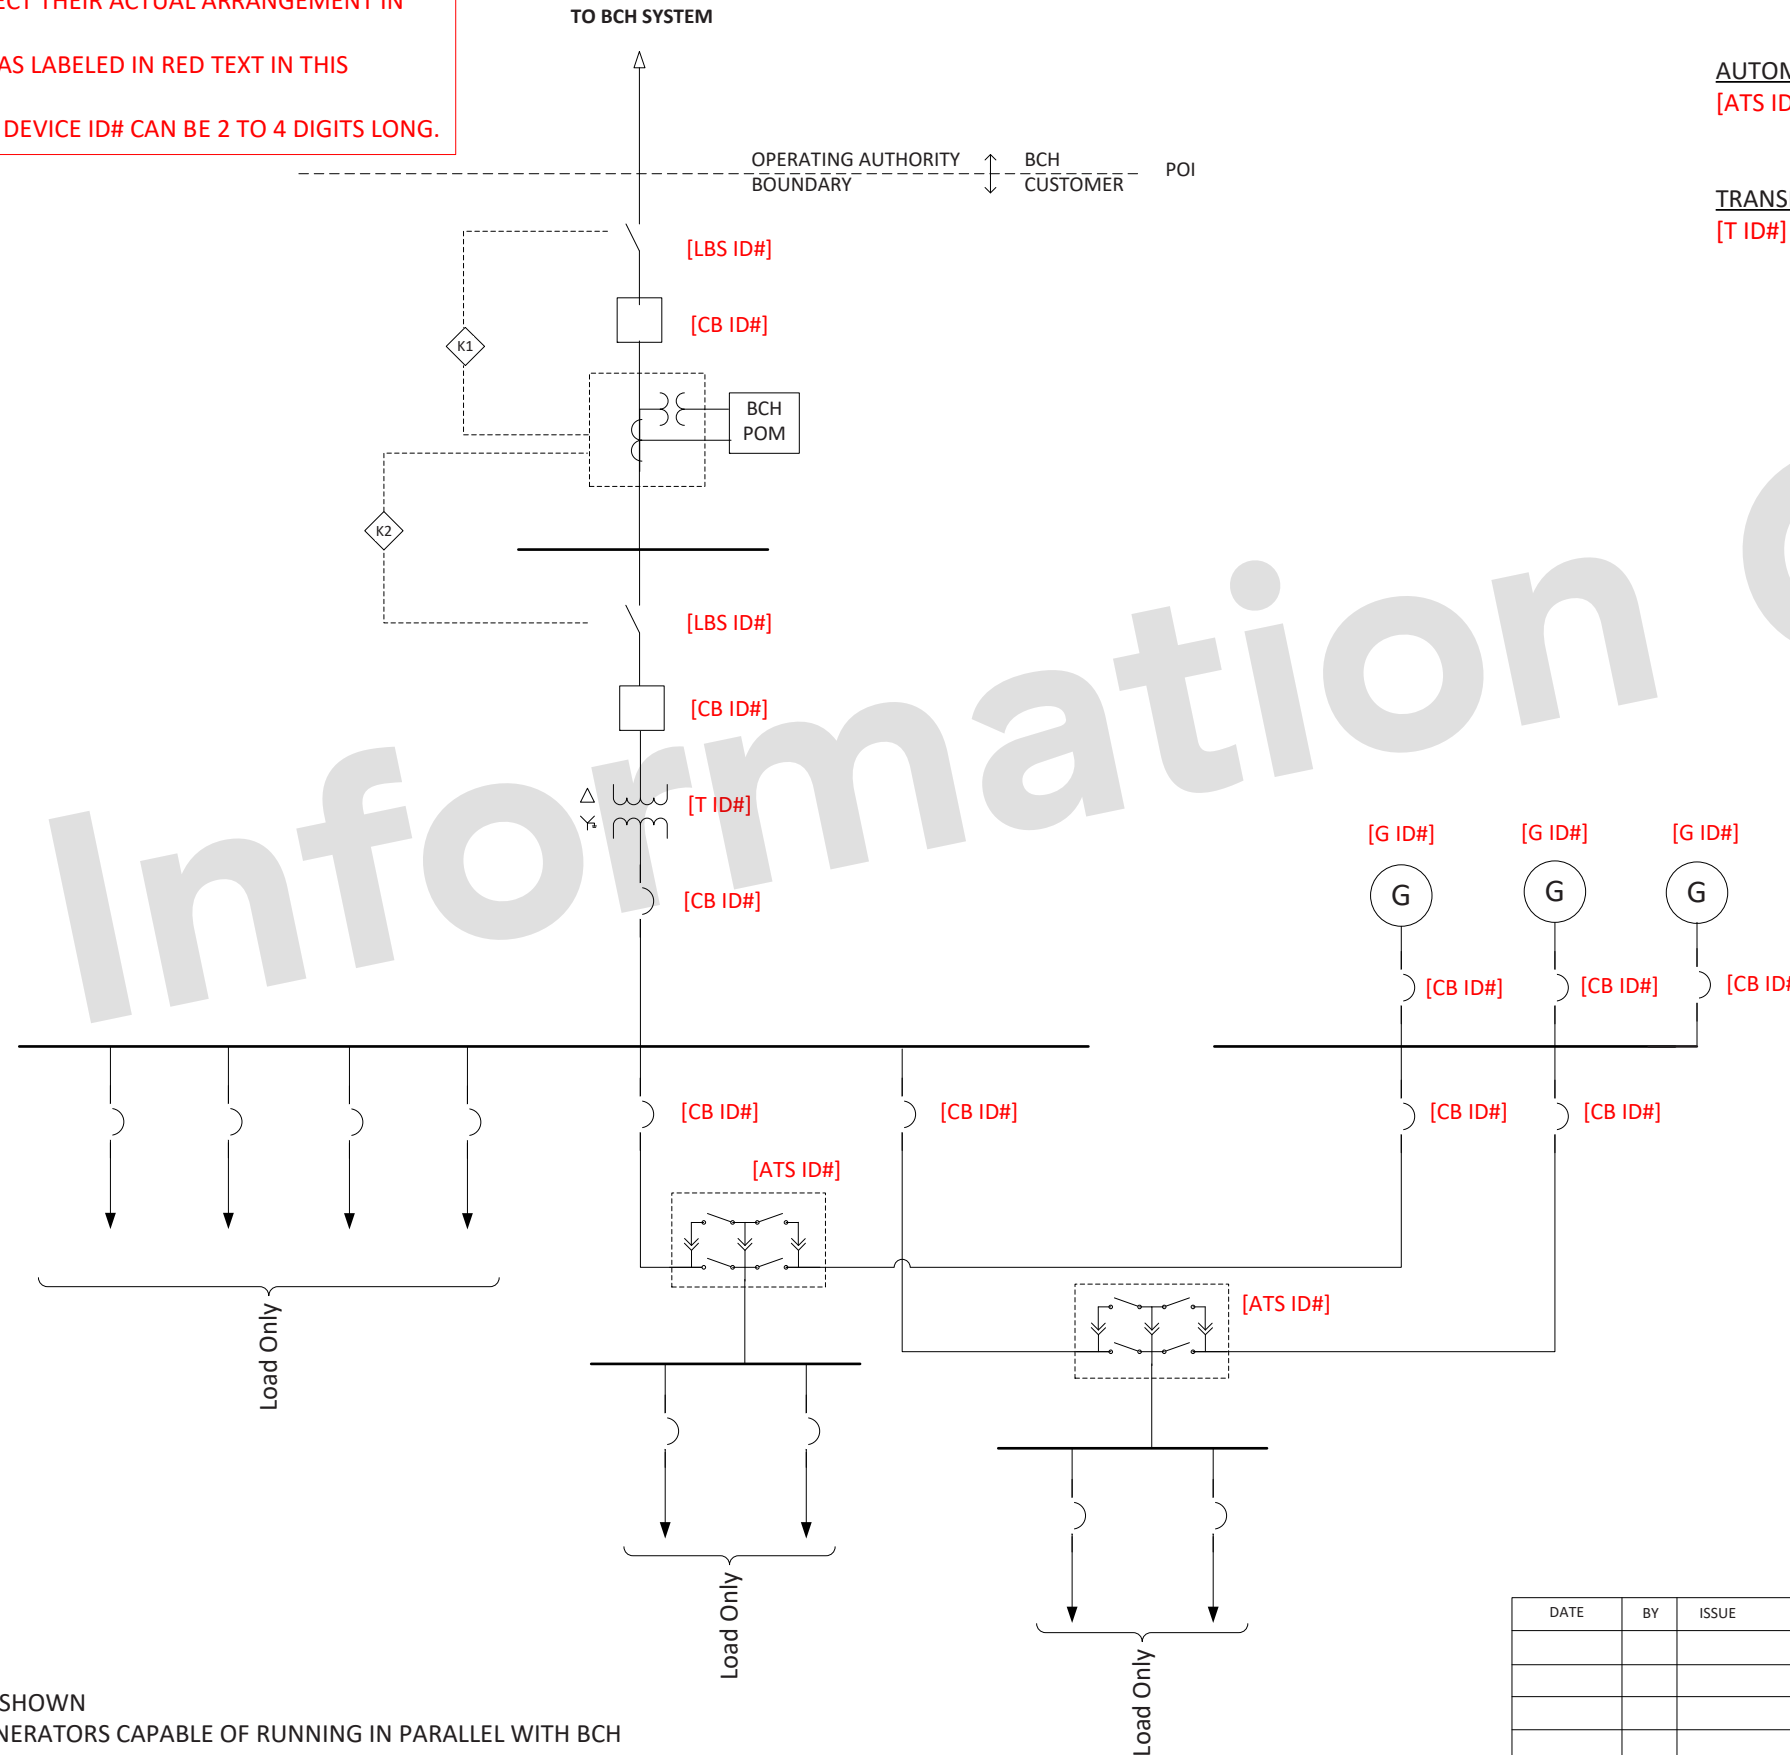

LEGEND

- PG - POWER GENERATOR
- POI - POINT OF INTERCONNECTION
- POM - POINT OF METERING
- LBS - LOAD BREAK SWITCH
- ID# - IDENTIFICATION NUMBER
- CB - CIRCUIT BREAKER
- ATS - AUTOMATIC TRANSFER SWITCH

- MV CIRCUIT BREAKER
- LV CIRCUIT BREAKER
- KEY INTERLOCK

- NOTE:**
1. ONLY ELEMENTS RELEVANT TO BC HYDRO PIR ARE SHOWN
 2. LOAD ONLY MEANS THERE ARE NO CUSTOMER GENERATORS CAPABLE OF RUNNING IN PARALLEL WITH BCH

DATE	BY	ISSUE	BC HYDRO	
			[FULL NAME OF CTT SITE]	
			[Facility Code]	
			LOCATION: [CTT SITE ADDRESS]	
			DWG #: SK-SLD-[Facility Code]	SHEET 1 OF 1
		ISSUED TO BCH WITH CTT APPLICATION	TYPE: CUSTOMER ONE-LINE DAIGRAM (SKETCH)	