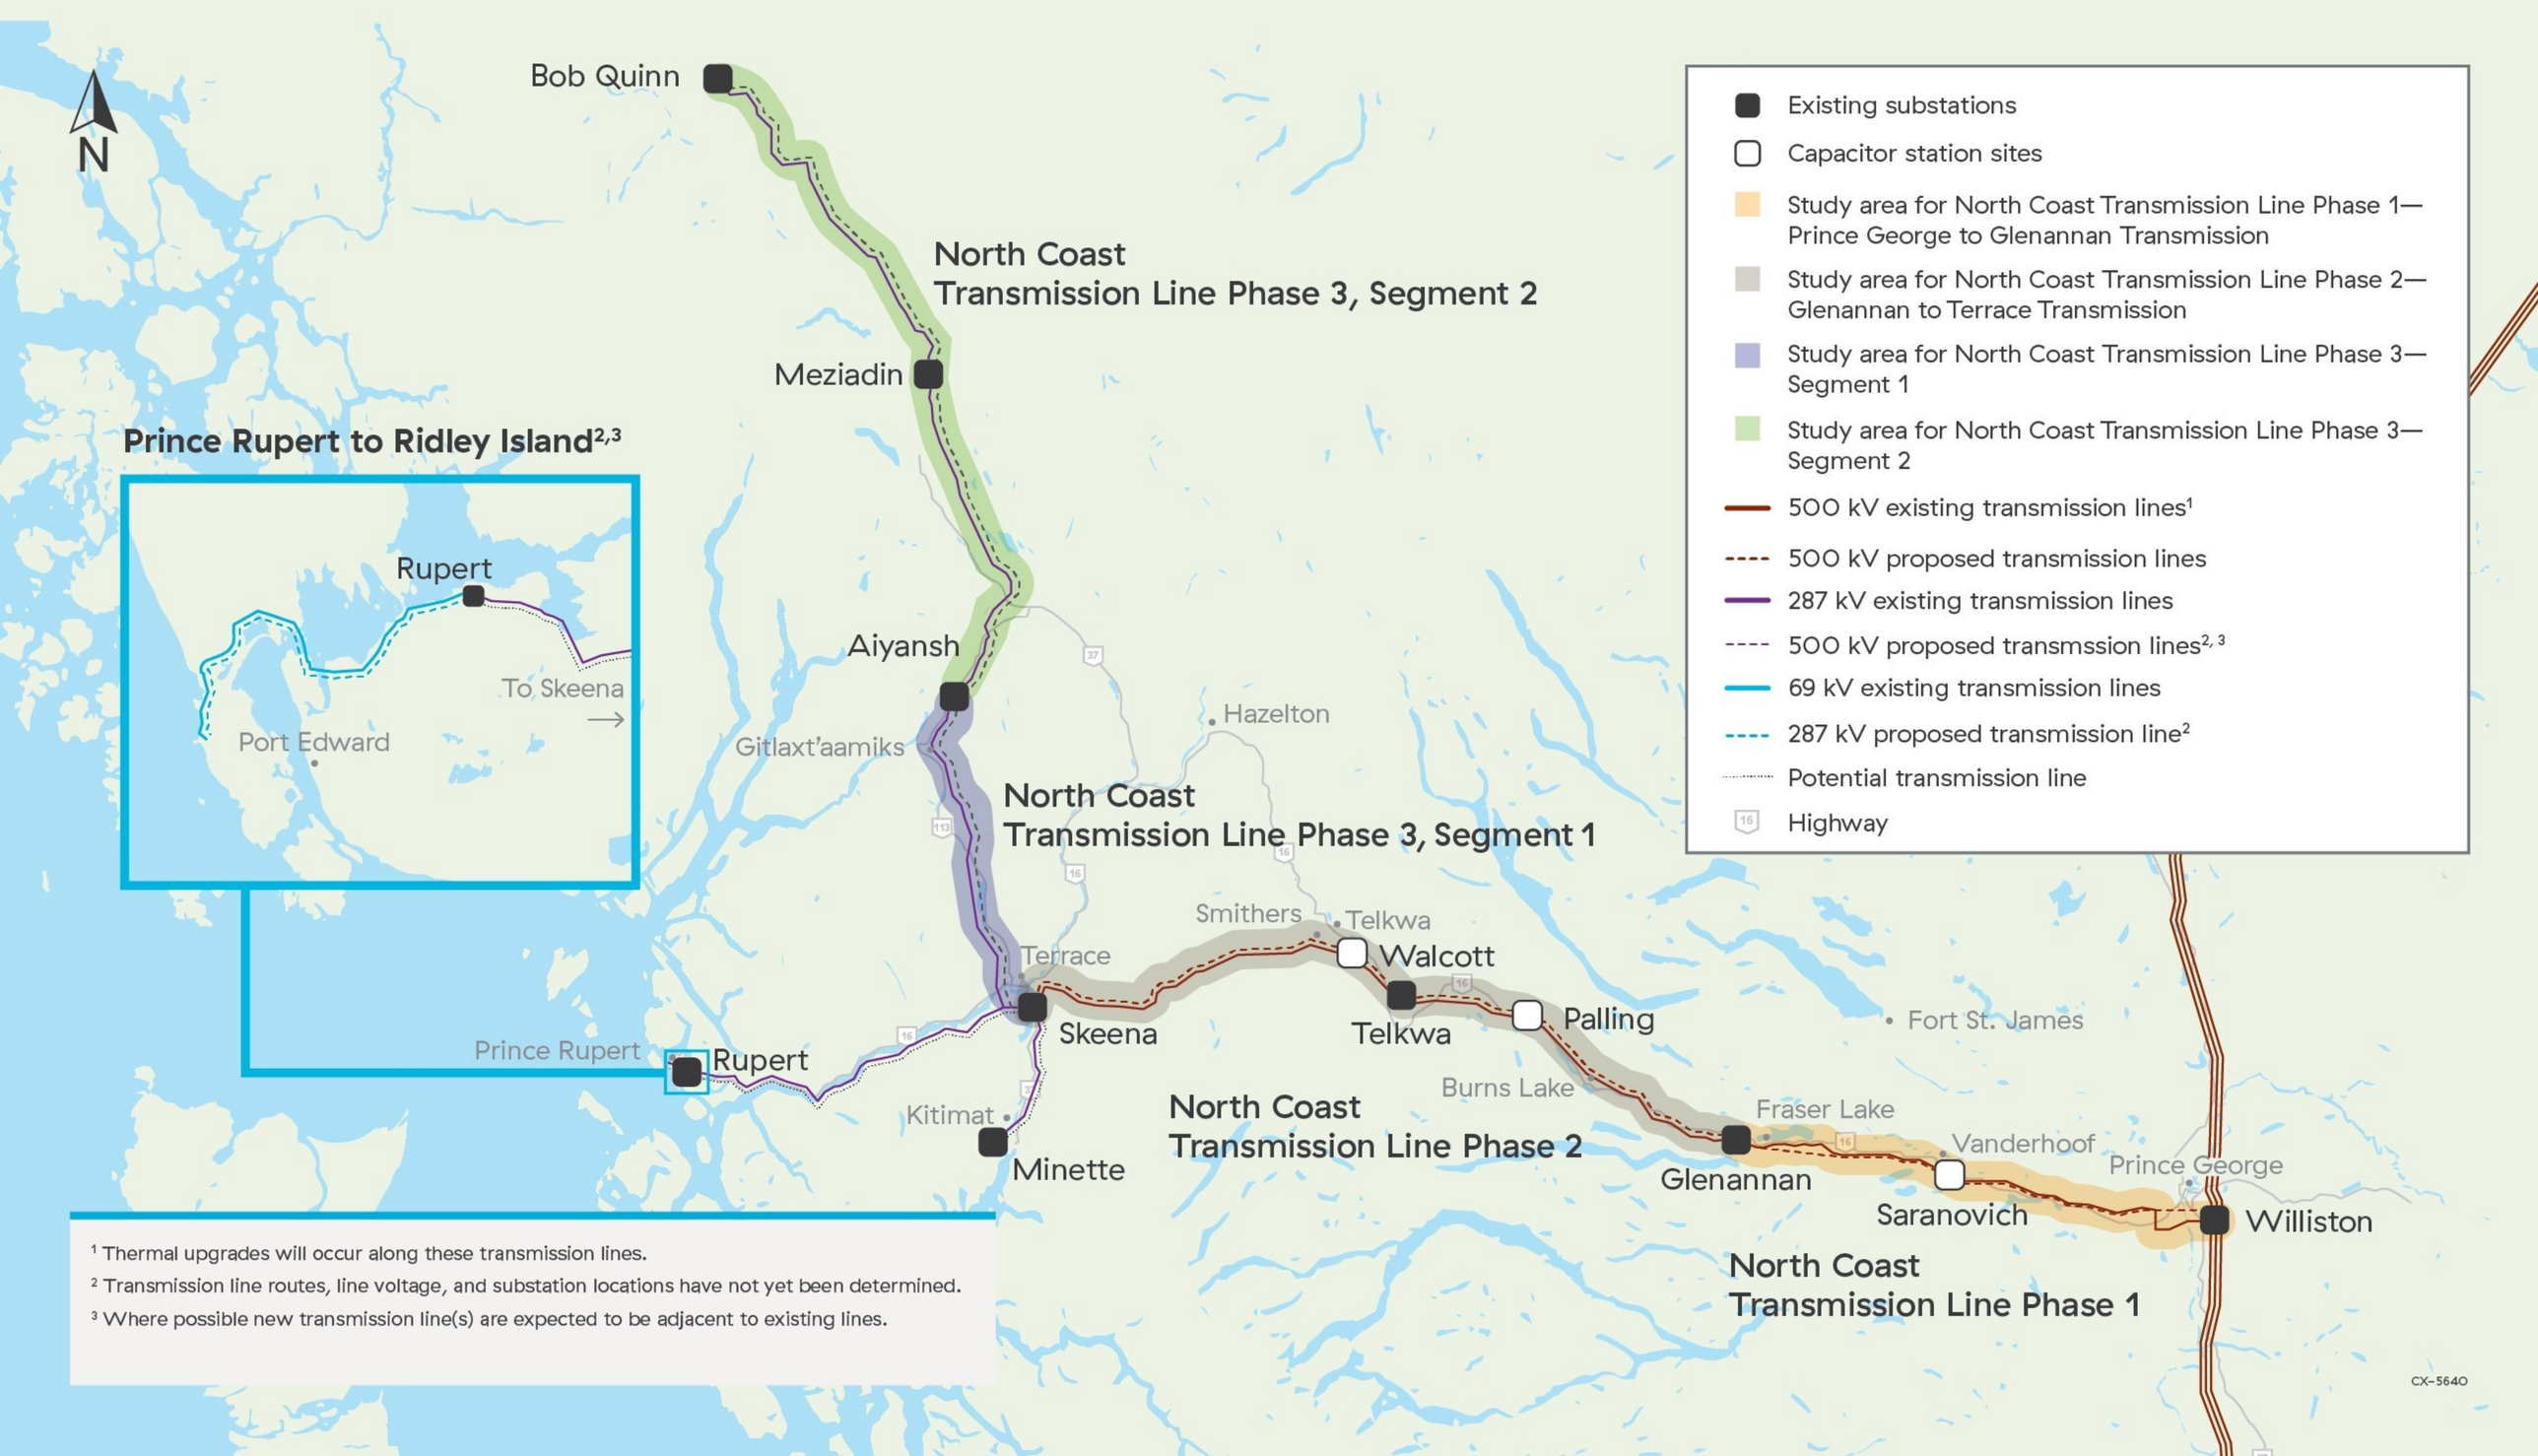

[1] Thermal upgrades will occur along these transmission lines.

[2] Transmission line routes, line voltage, and substation locations have not yet been determined.

[3] Where possible new transmission line(s) are expected to be adjacent to existing lines.