


SAMPLE

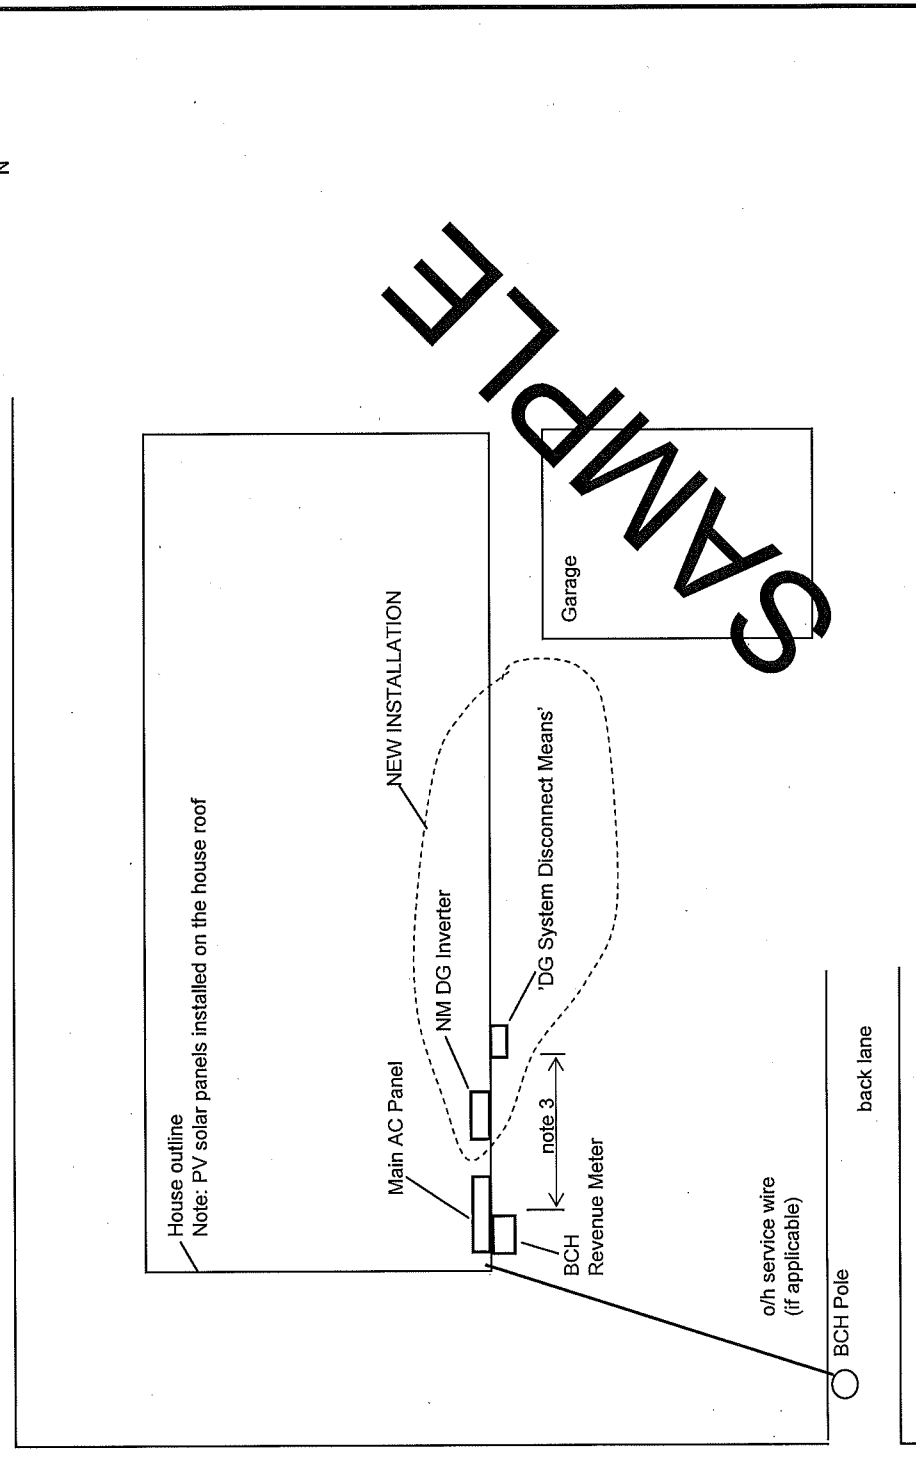

- Notes**
1. This drawing is provided for illustration only. It is meant to be used as a guide for NM applicant to show what is required to be shown and level of details.
 2. The drawing is not required to be to scale, may be hand drawn, but it is to be legible and unambiguously convey the information. It is to be consistent with the associated NM application and NM DG 1-line diagram.
 3. DG System Disconnect Means" switch is to be located near BCH meter:
 - no more than 3 m (10 ft) horizontal distance away from the meter, or
 - with some additional requirement and special permission from BCH, to be in line of sight from the BCH meter

NET METERING DISTRIBUTED GENERATOR	
CUSTOMER SITE PLAN	
Date:	22-Jul-09
By:	JG
Issue:	Issued to BCH with NM DG application for review
Location:	1234 Abcd Street, XYZ Town, BC, V1A 1A1
Dwg #:	1234-1
Date:	yyyy-mm-dd
Prepared by:	Joe Green
SHEET 1 OF 1	

BCH Rev date: 4-Sep-2009