
2012 Integrated Resource Plan



Appendix

6G-4

**Cluster Analysis Summary
Potential Nodes**



Legend

- Legally Protected Area
 - Glacier
 - BC Hydro Transmission Line
 - Fortis BC Transmission Line
 - Proposed NTL
 - BC Hydro Substation
 - Fortis BC Transmission Station
 - Proposed BC Hydro Substation
 - 0.06 MW/KM² Contour For Capacity Density
- Capacity Density**
MW/km²
- | |
|-------------|
| 0 - 0.02 |
| 0.02 - 0.04 |
| 0.04 - 0.06 |
| 0.06 - 0.08 |
| 0.08 - 0.1 |
| 0.1 - 0.15 |
| 0.15 - 0.3 |
| 0.3 - 0.45 |
| 0.45 - 0.6 |
| 0.6 - 7.9 |

Source: BC Hydro IRP, KWL, 2010.




Project No.
478-098

Date
May 2011

**Potential Nodes
Density Boundaries**

Figure 11

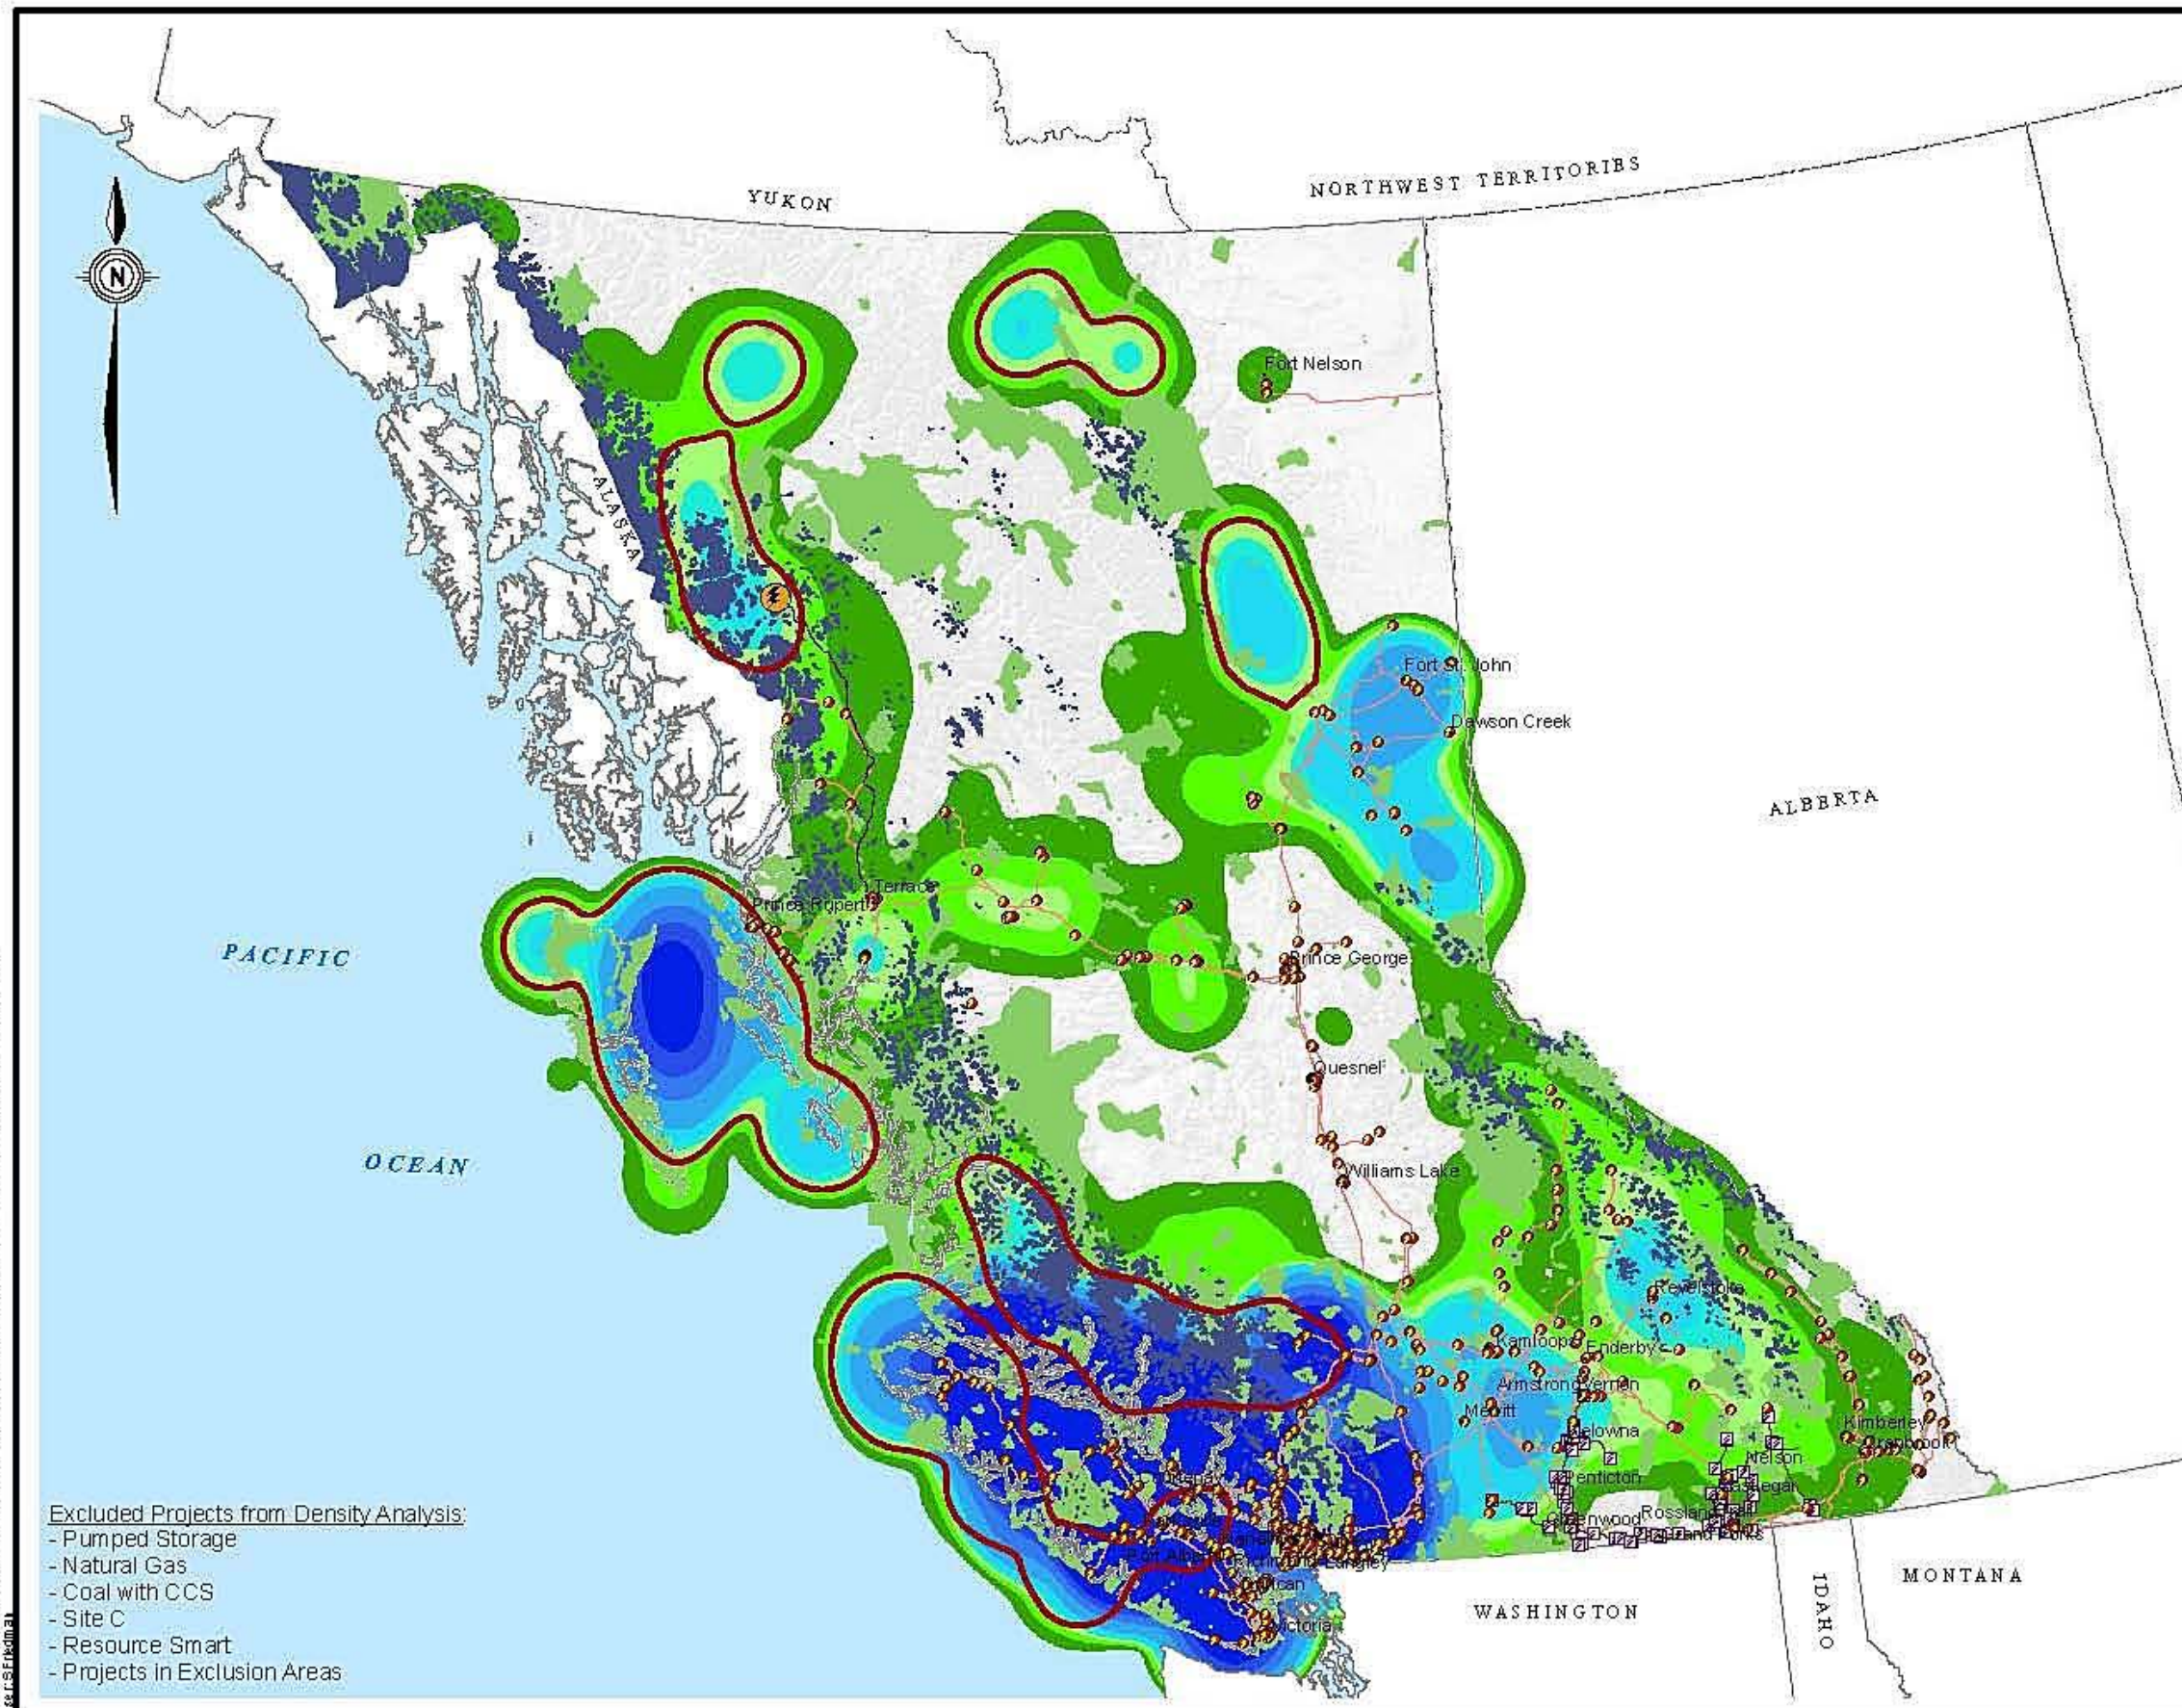

Path: \\lb\ncs\0000-0998\0400-050478-098\478-098\3D-C-15\WCD-Rp-W\780587\figr\11.mxd Date Saved: 05/05/2011 2:03:30 PM
 User: psr@bc.ca

Excluded Projects from Density Analysis:

- Pumped Storage
- Natural Gas
- Coal with CCS
- Site C
- Resource Smart
- Projects in Exclusion Areas

